

PRECAST SLAB AND FLOOR REINFORCING

MARK	SIZE	W = 1.319 m		W = 1.624 m		W = 1.929 m		W = 2.234 m		W = 2.538 m	
		NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
a1	#13	13	2.004 m	13	2.613 m	13	3.223 m	13	3.833 m	13	4.442 m
* a2	#13	4	1.829 m	4	2.438 m	4	3.048 m	4	3.658 m	4	4.267 m
a3	#13	23	1.244 m	23	1.549 m	23	1.854 m	23	2.159 m	23	2.463 m
b1	#13	1	2.968 m	1	2.968 m	1	2.968 m	1	2.968 m	1	2.968 m
* b2	#13	23	3.378 m	29	3.378 m	35	3.378 m	41	3.378 m	47	3.378 m
x1	#13	16	1.164 m	16	1.270 m	16	1.369 m	16	1.469 m	16	1.574 m




WALL REINFORCING

MARK	SIZE	W = 1.319 m		W = 1.624 m		W = 1.929 m		W = 2.234 m		W = 2.538 m	
		NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
w1	#13	①	3.378 m	①	3.378 m	①	3.378 m	①	3.378 m	①	3.378 m
w2	#13	①	1.244 m	①	1.549 m	①	1.854 m	①	2.159 m	①	2.463 m
w3	#13	52	②	56	②	60	②	64	②	68	②




* Field Bend or Cut Reinforcing as Required for Clearance.
 ① 4 (Hl - 300 mm); (Hl - 300 mm) Rounded down to nearest 150 mm.
 ② Hl - 75 mm

STANDARD CURB INLET PRECAST TOPS



W	PRE-CAST TOP SIZE	PIPE SIZE	CU. M CONC.
1.319 m	1.119 m x 3.444 m x 190 mm	525 mm & SMALLER	0.63±
1.624 m	1.424 m x 3.444 m x 190 mm	600 mm & 750 mm	0.83±
1.929 m	1.729 m x 3.444 m x 190 mm	900 mm & 1,050 m	1.03±
2.234 m	2.034 m x 3.444 m x 190 mm	1,200 m & 1,350 m	1.23±
2.538 m	2.338 m x 3.444 m x 190 mm	1,500 m & 1,650 m	1.43±

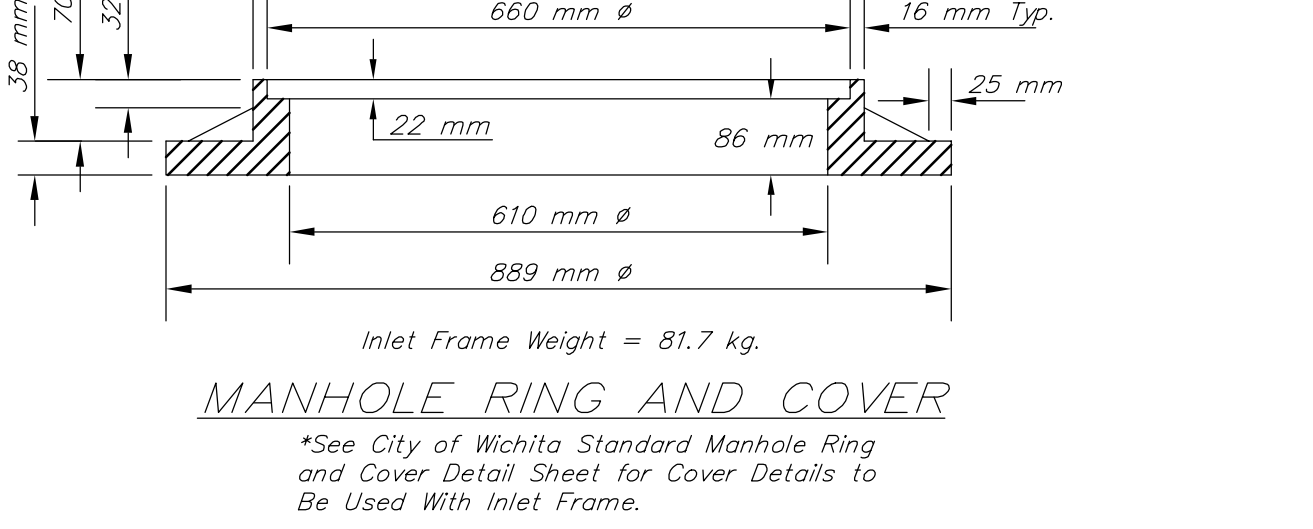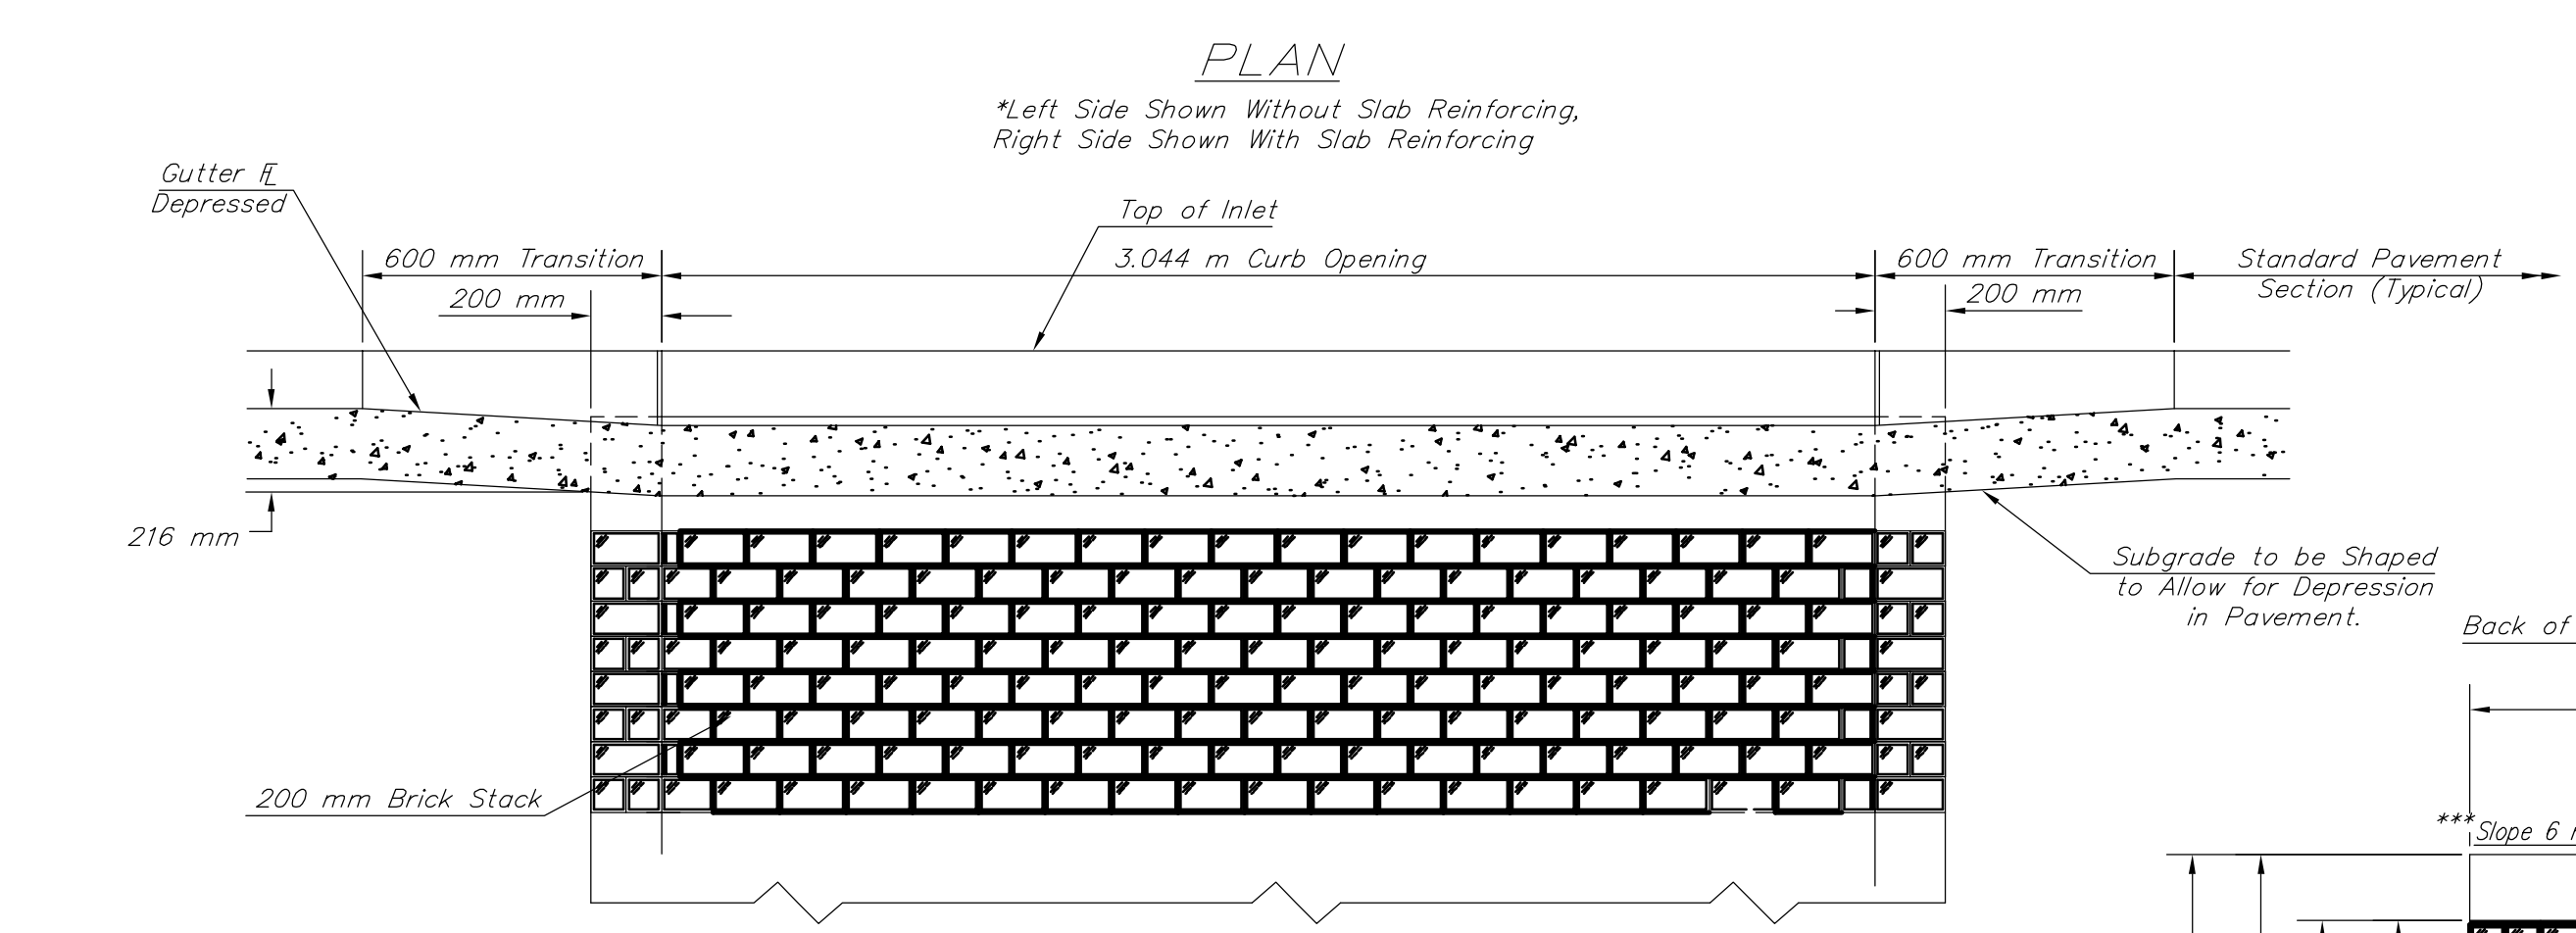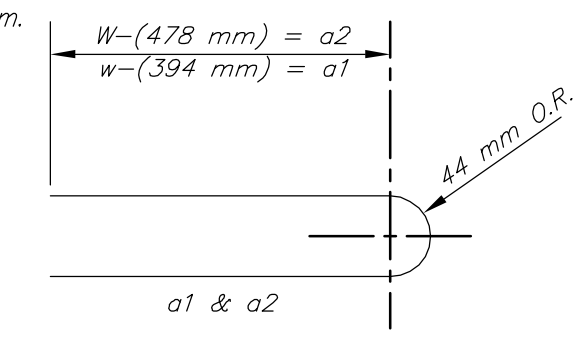

GENERAL NOTES:
 Concrete shall be C.O.W. standard paving mix. All exposed edges shall be finished with an edging tool. Reinforcing bars shall be field bent or cut to clear pipes and inlet rings. All bars are #13 bars @ 150 mm spacing and shall have a minimum clearance of 38 mm unless otherwise noted. Floors of inlet shall be shaped with 8 sack sand mix concrete to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipe(s). The contractor will be required to construct 200 mm brick masonry walls between the inlet base and top on this inlet when H=2.14 m or less and W=1.93 m or less. When W is greater than 1.93 m and H is less than 2.14 m, the outside inlet walls below the brick stack shall be reinforced concrete construction.
 Concrete taps to be installed on thin mortar cushion to insure full support along brick walls. Concrete taps may be cast in place or precast.
 The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

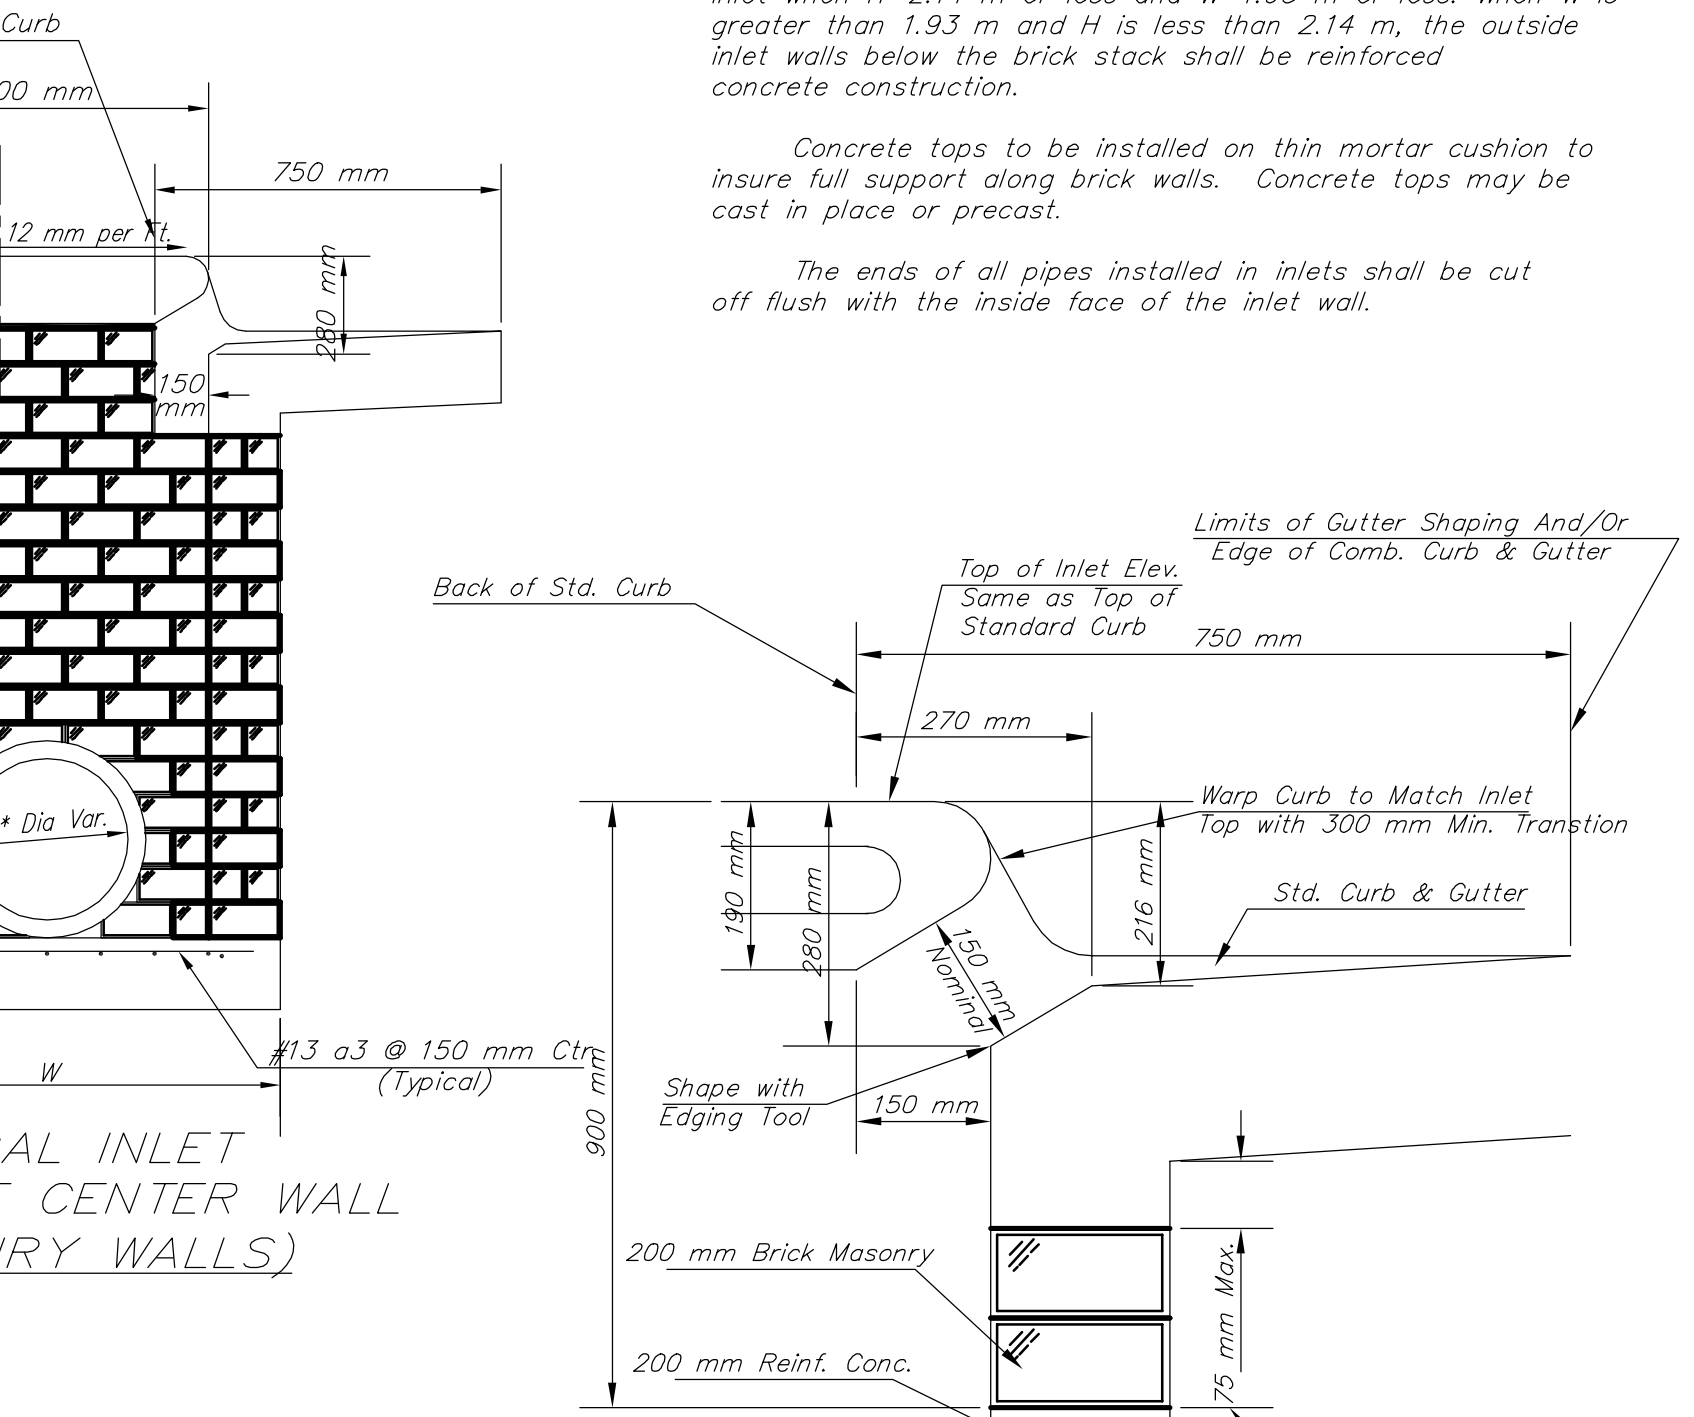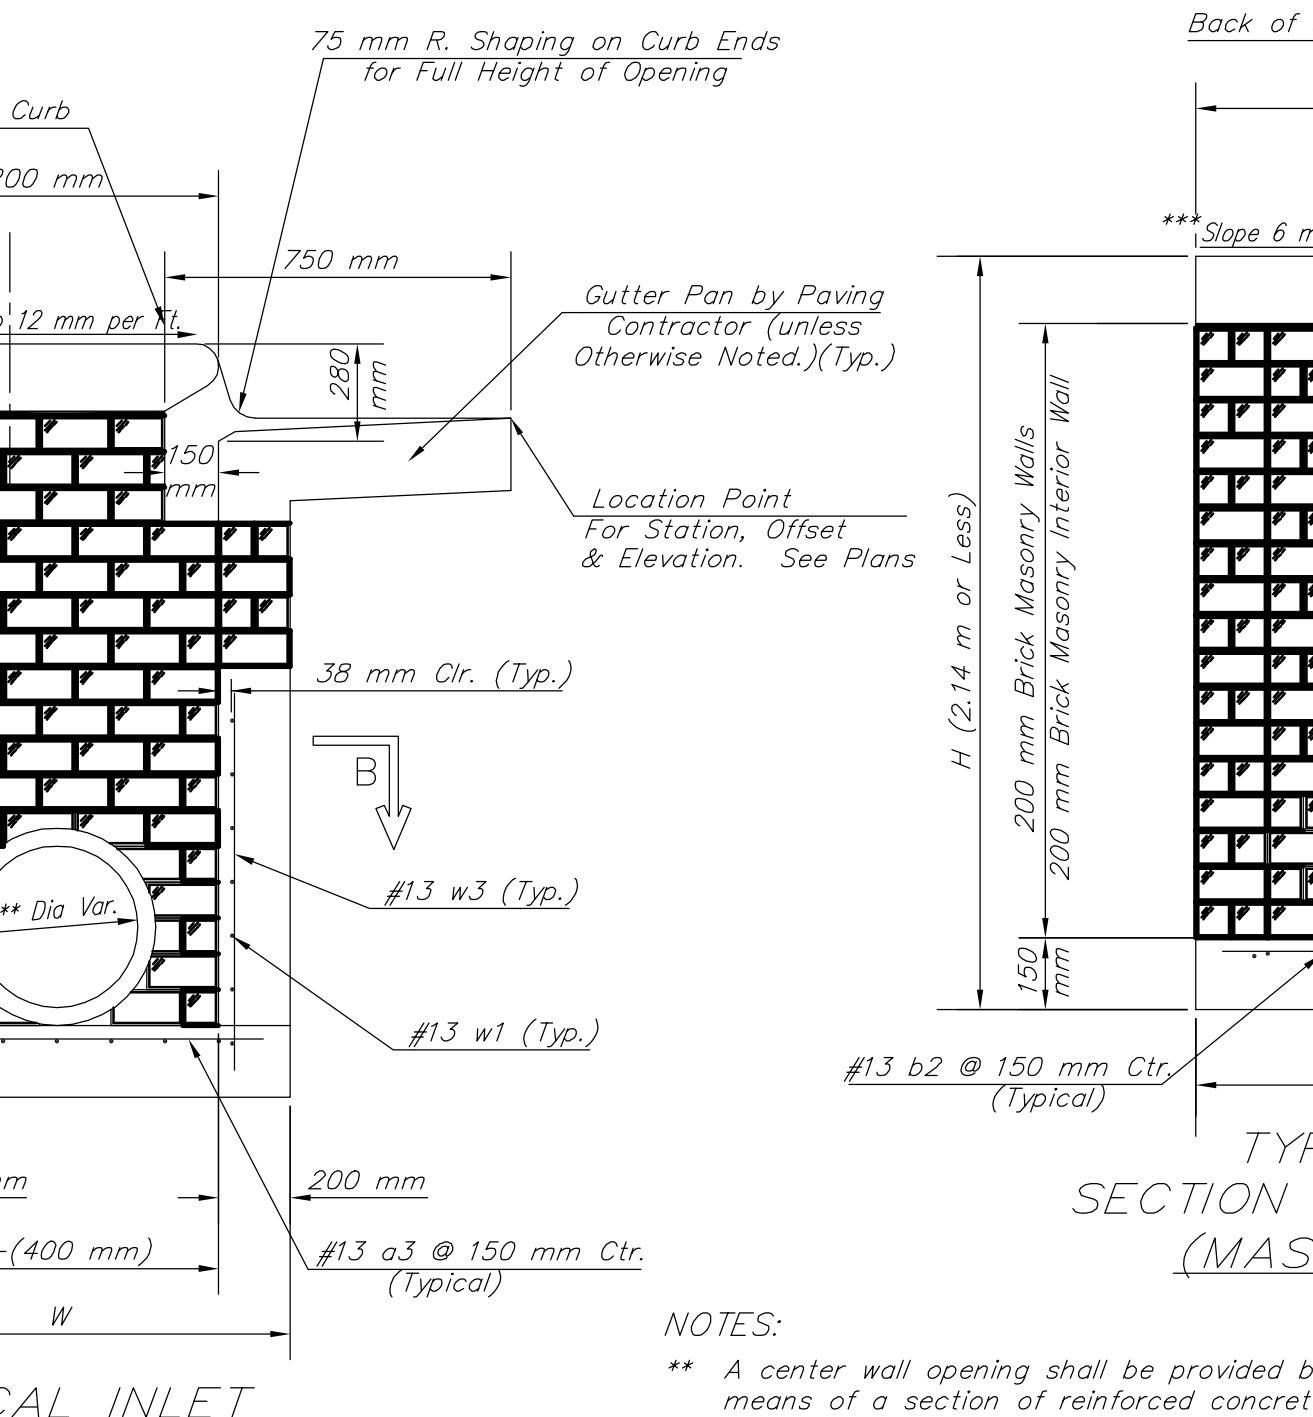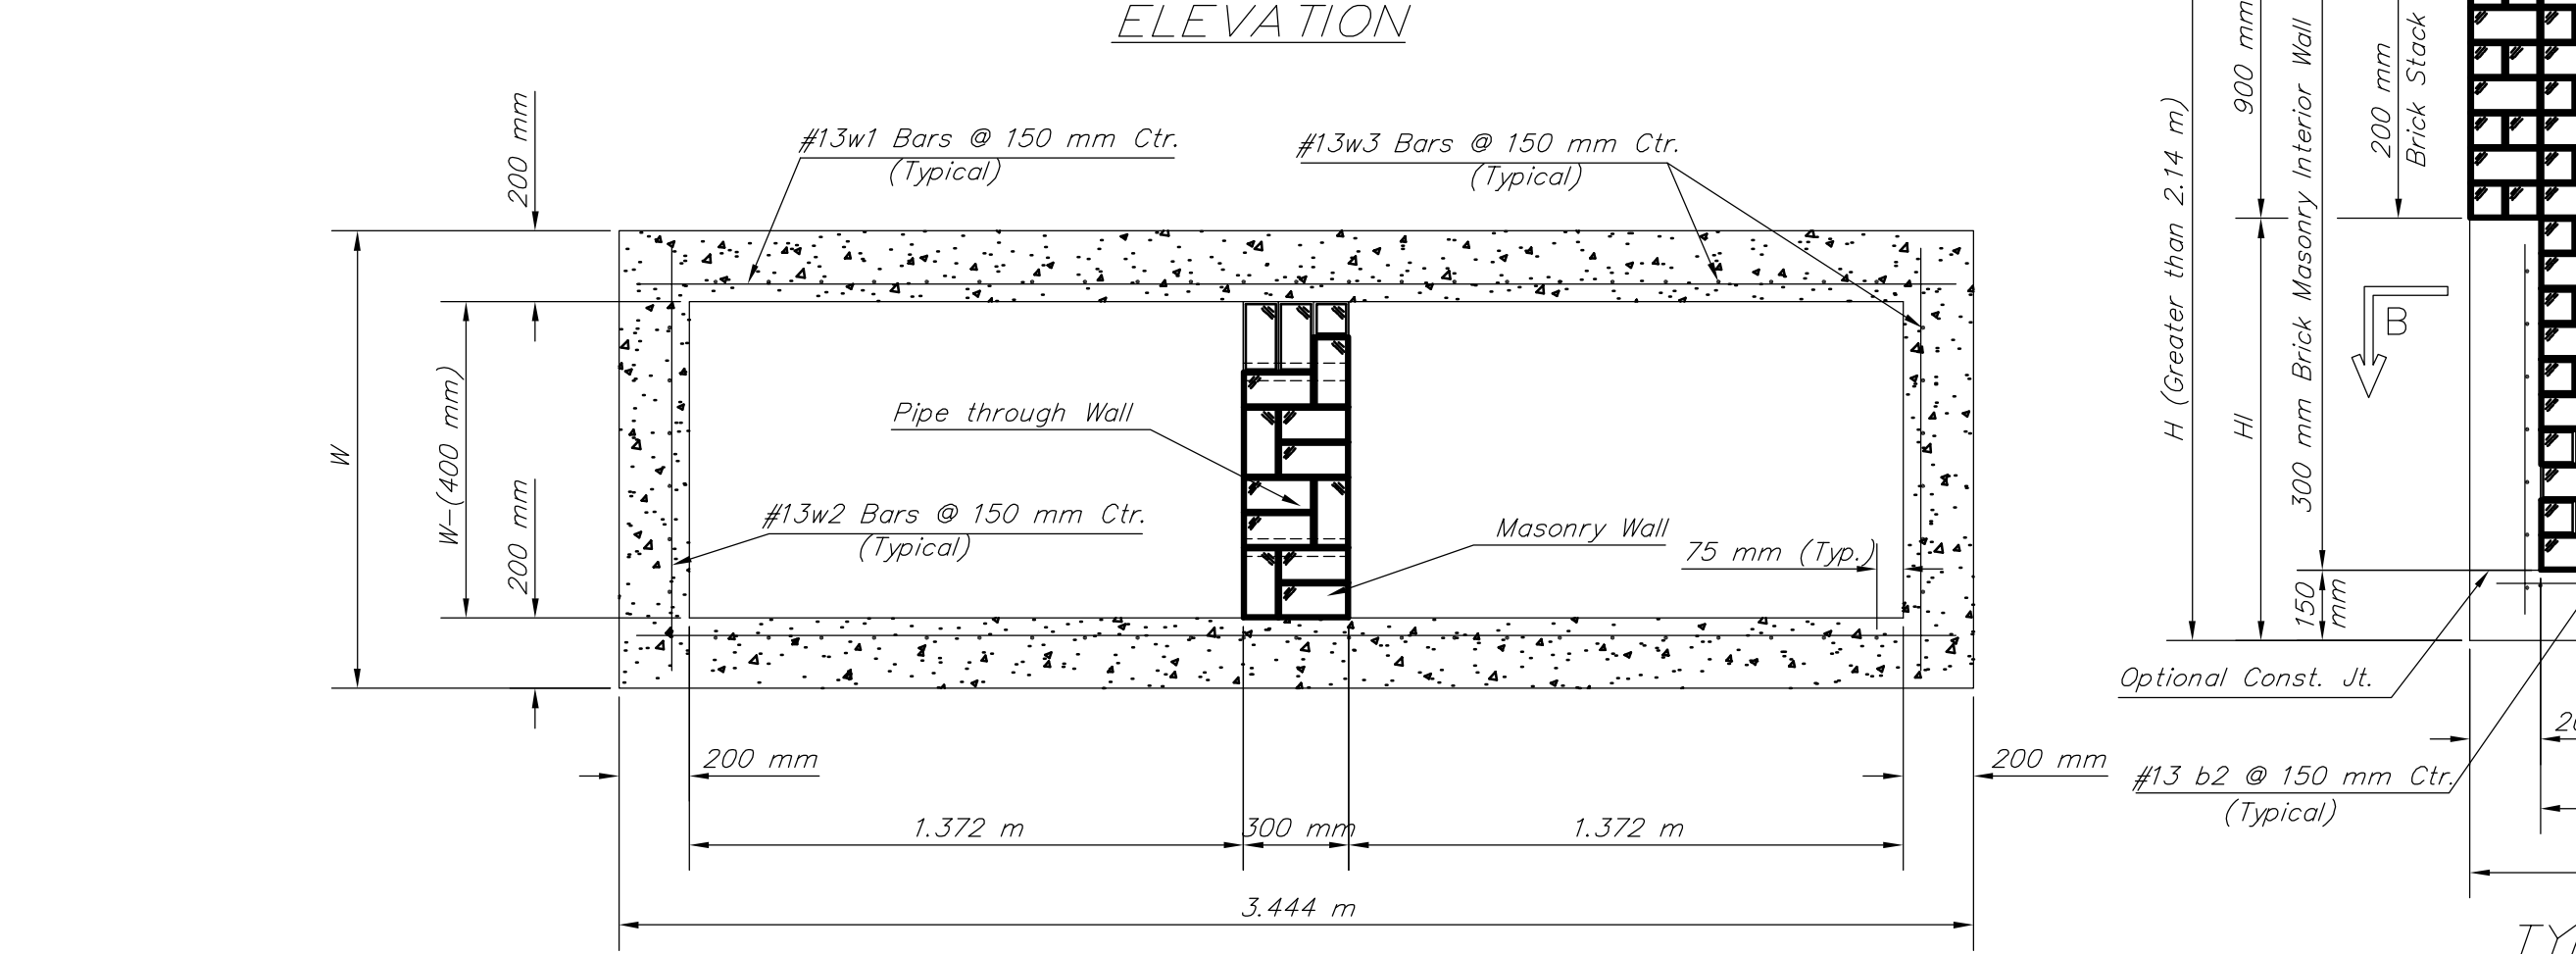

NOTES:
 ** A center wall opening shall be provided by means of a section of reinforced concrete pipe. See Case I and Case II below.
 *** Slope of inlet tops to match sidewalk of parking slopes within limits indicated

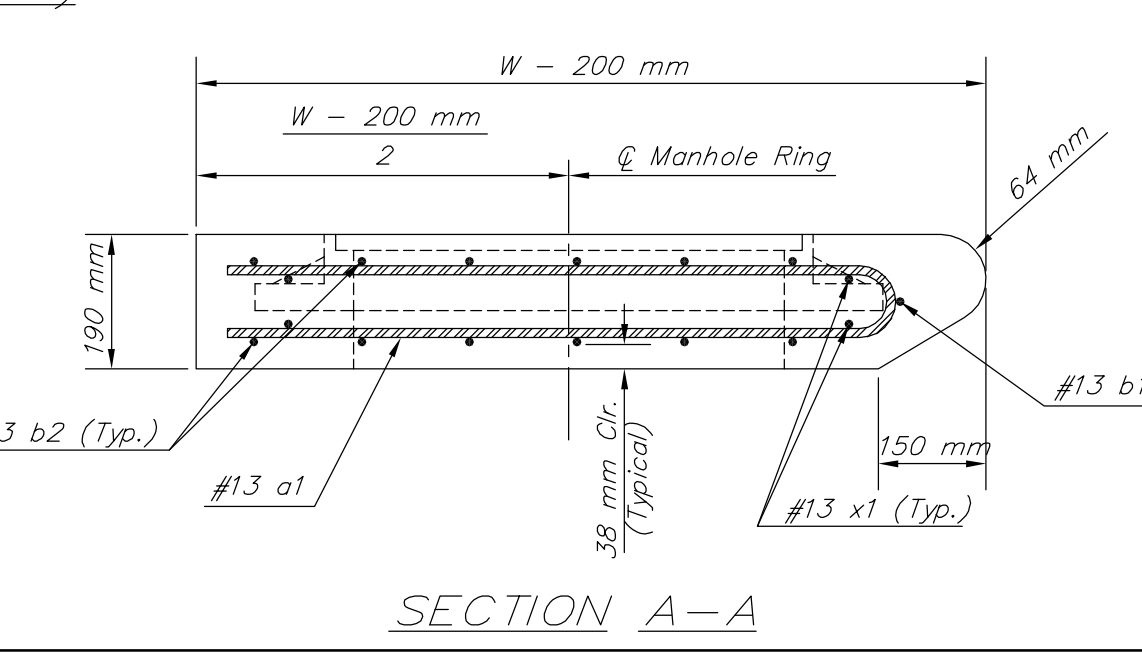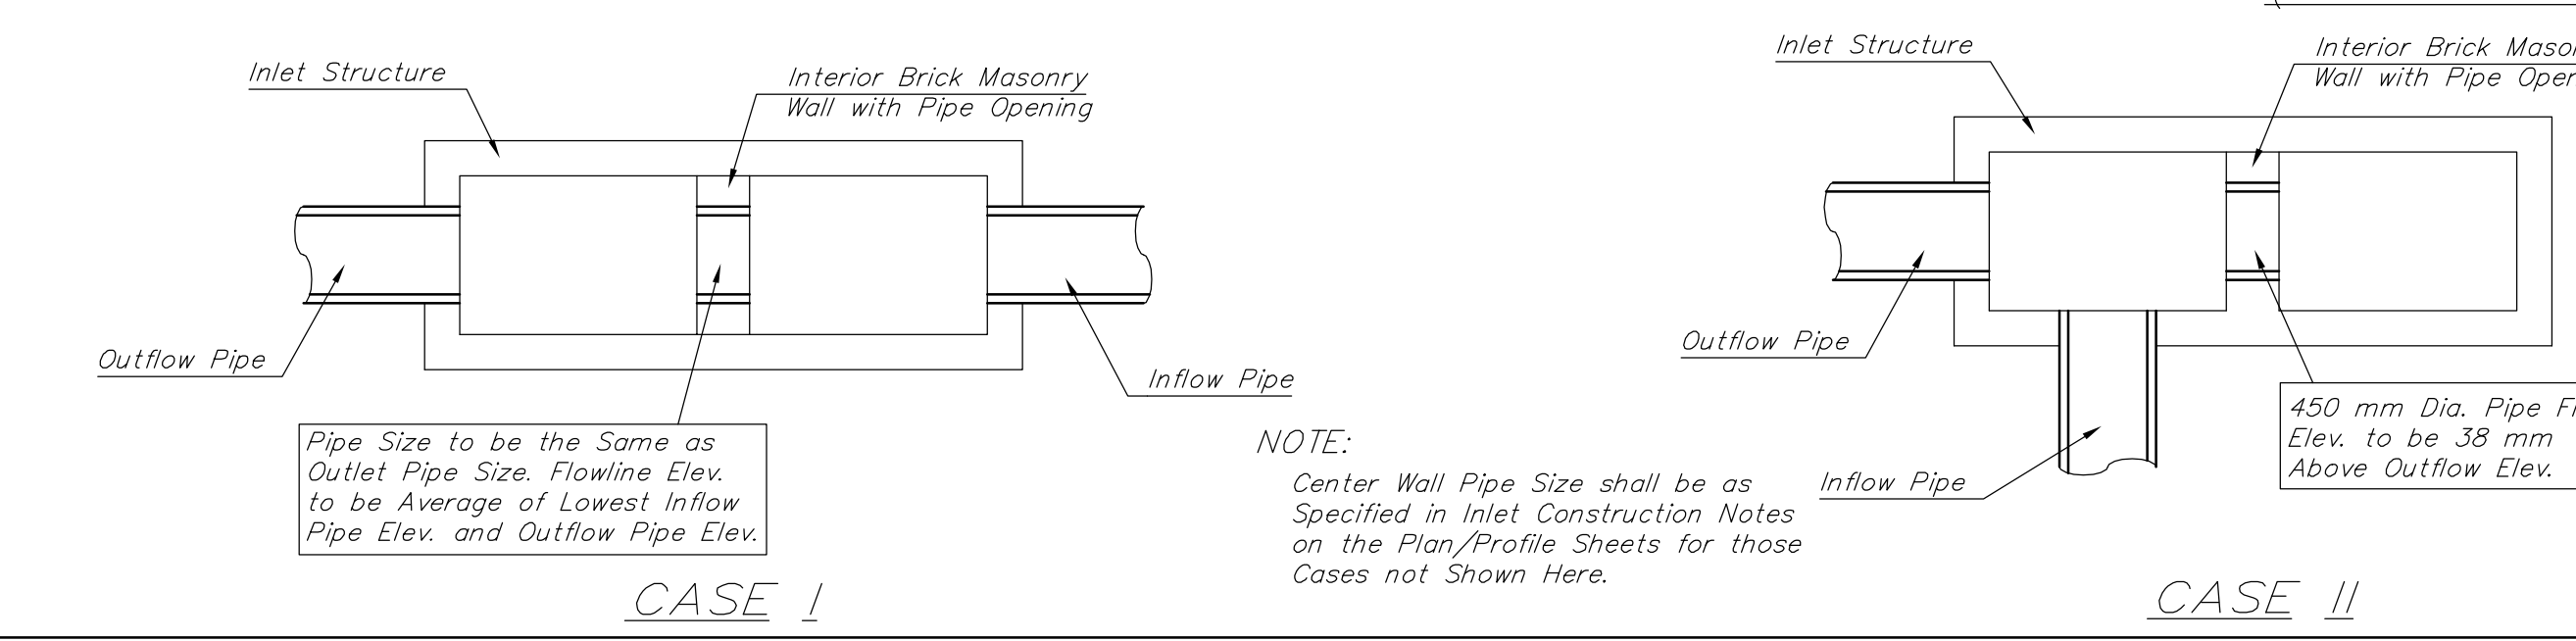

NOTE:
 All dimensions shown without a SI suffix are in millimeters.

THE CITY OF WICHITA

STANDARD TYPE 1 CURB INLET
 OPENING = 150 mm x 3 m

M. E. LINDEBAK P.E. - CITY ENGINEER

PROJECT NUMBER 54-87 K-8258-05 INDEX CODE 7

CITY ENGINEER'S OFFICE
 458 NORTH MAIN STREET
 WICHITA, KANSAS 67202
 (316) 268-4501
 (316) 268-1114 FAX

DATE 2003 SHEET 15 OF 51