


STA. 39+50.68 LINE 1
 BL STA. 44+88.63, 17.0' LT.
 1 - 12" X 8" MJ TEE (N)
 1 - 8" ANCHORED GATE VALVE ASS'Y
 5.0 L.F. 8" DI CL. PIPE (N)
 VALVE BOX ELEV. = 1348.06
 CONNECT TO EXISTING 8" WATER MAIN.
 2 - 8" MJ CAPS (E,W)

2 - 8" MJ CAPS
 MAX. 3' N. OF 20" MAIN.



SCALE 1" = 20'
 IRON = •

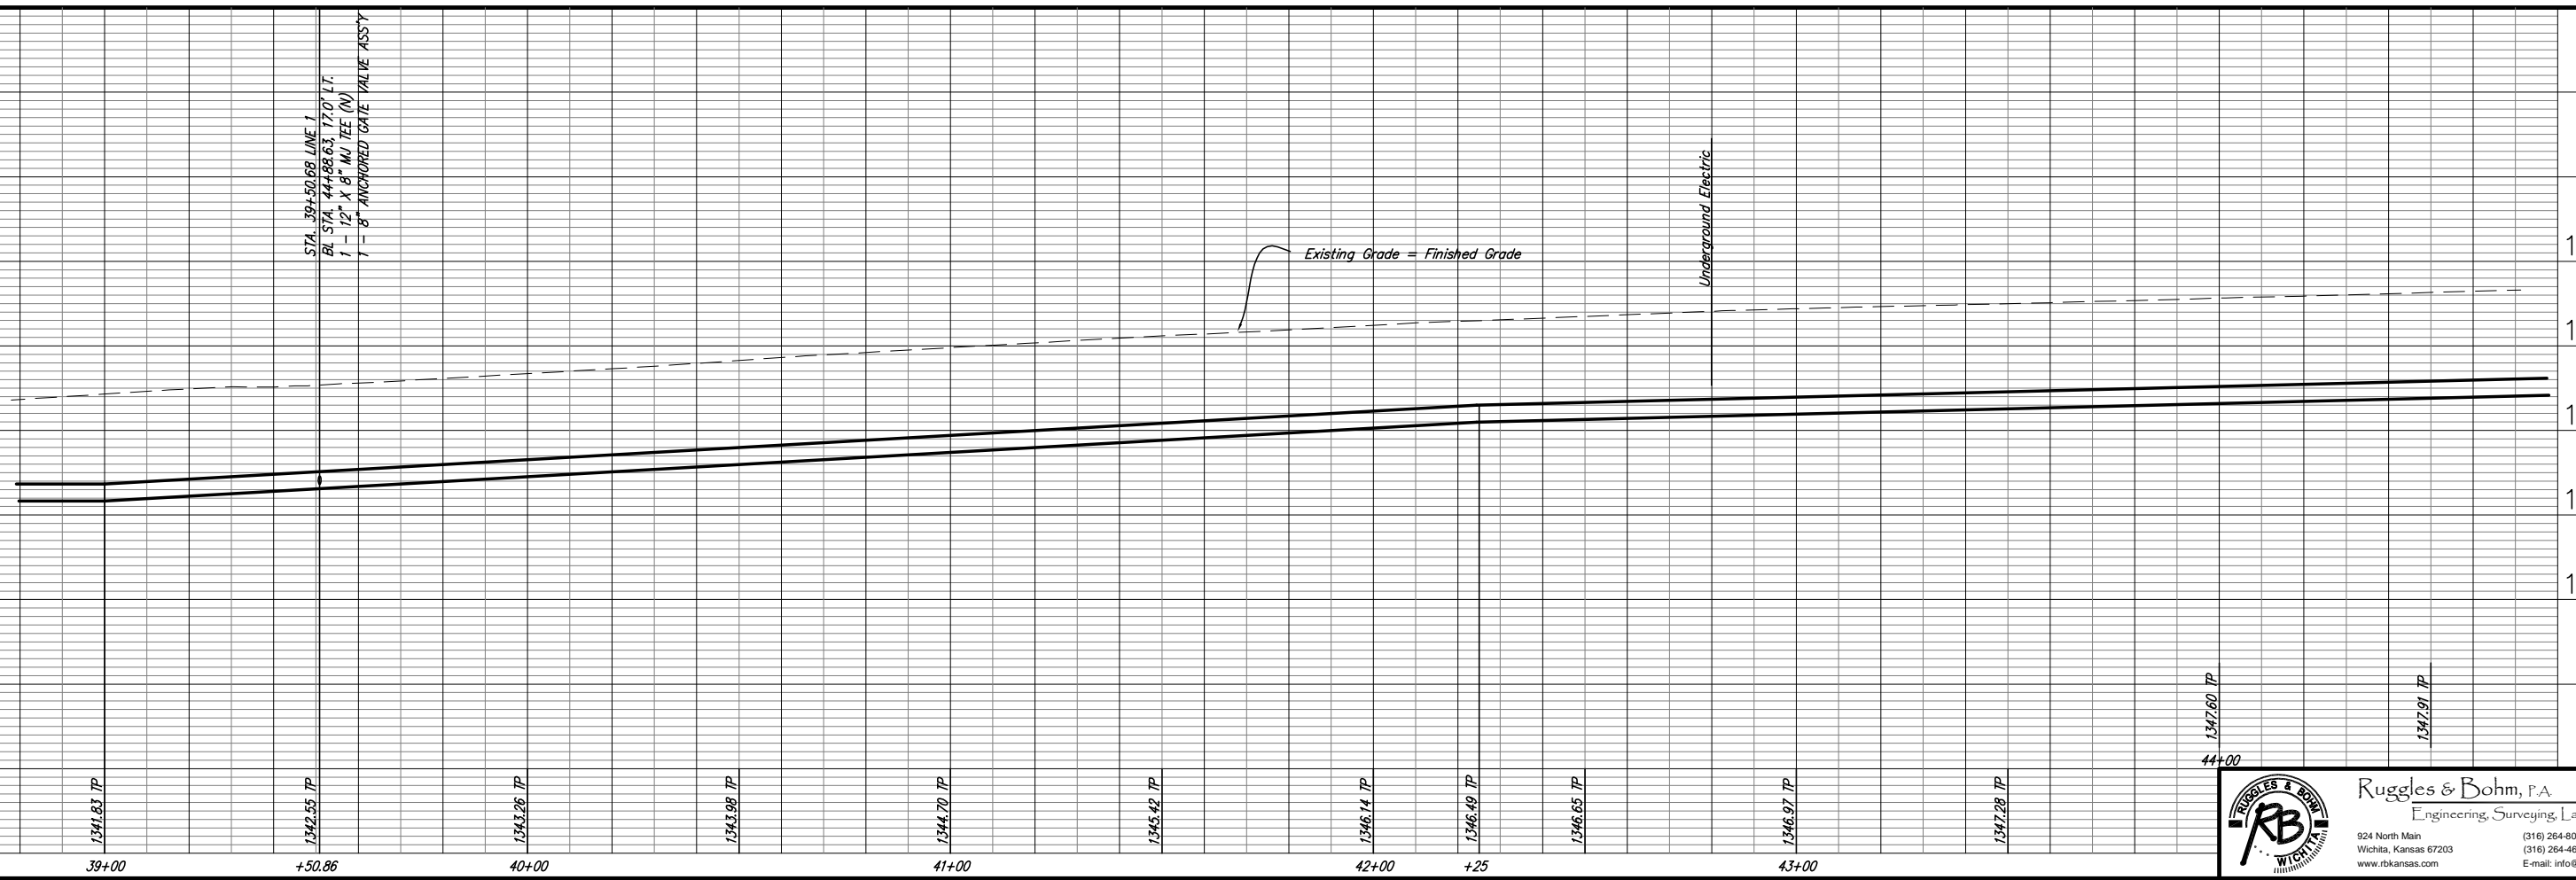

STA. 39+50.68 LINE 1
 BL STA. 44+88.63, 17.0' LT.
 1 - 12" X 8" MJ TEE (N)
 1 - 8" ANCHORED GATE VALVE ASS'Y

PROJECT NUMBER	448-89893	DESIGN	KWL	DRAWN	RA	REVIEWED	
DRAWING FILE	water {sheet 10}	UTILITY		DATE	July 11, 2006		
12" Water Main Replacement		WICHITA, KANSAS					
1355							
1350							
1345							
1340							
1335							
RB JOB	2136W	Ruggles & Bohm, P.A.					
SHEET	W10	Engineering, Surveying, Land Planning					
OF	W15	924 North Main (316) 264-8008					
		Wichita, Kansas 67203 (316) 264-4621 fax					
		www.rbkansas.com E-mail: info@rbkansas.com					

