


SCALE 1" = 20'

 IRON = ●

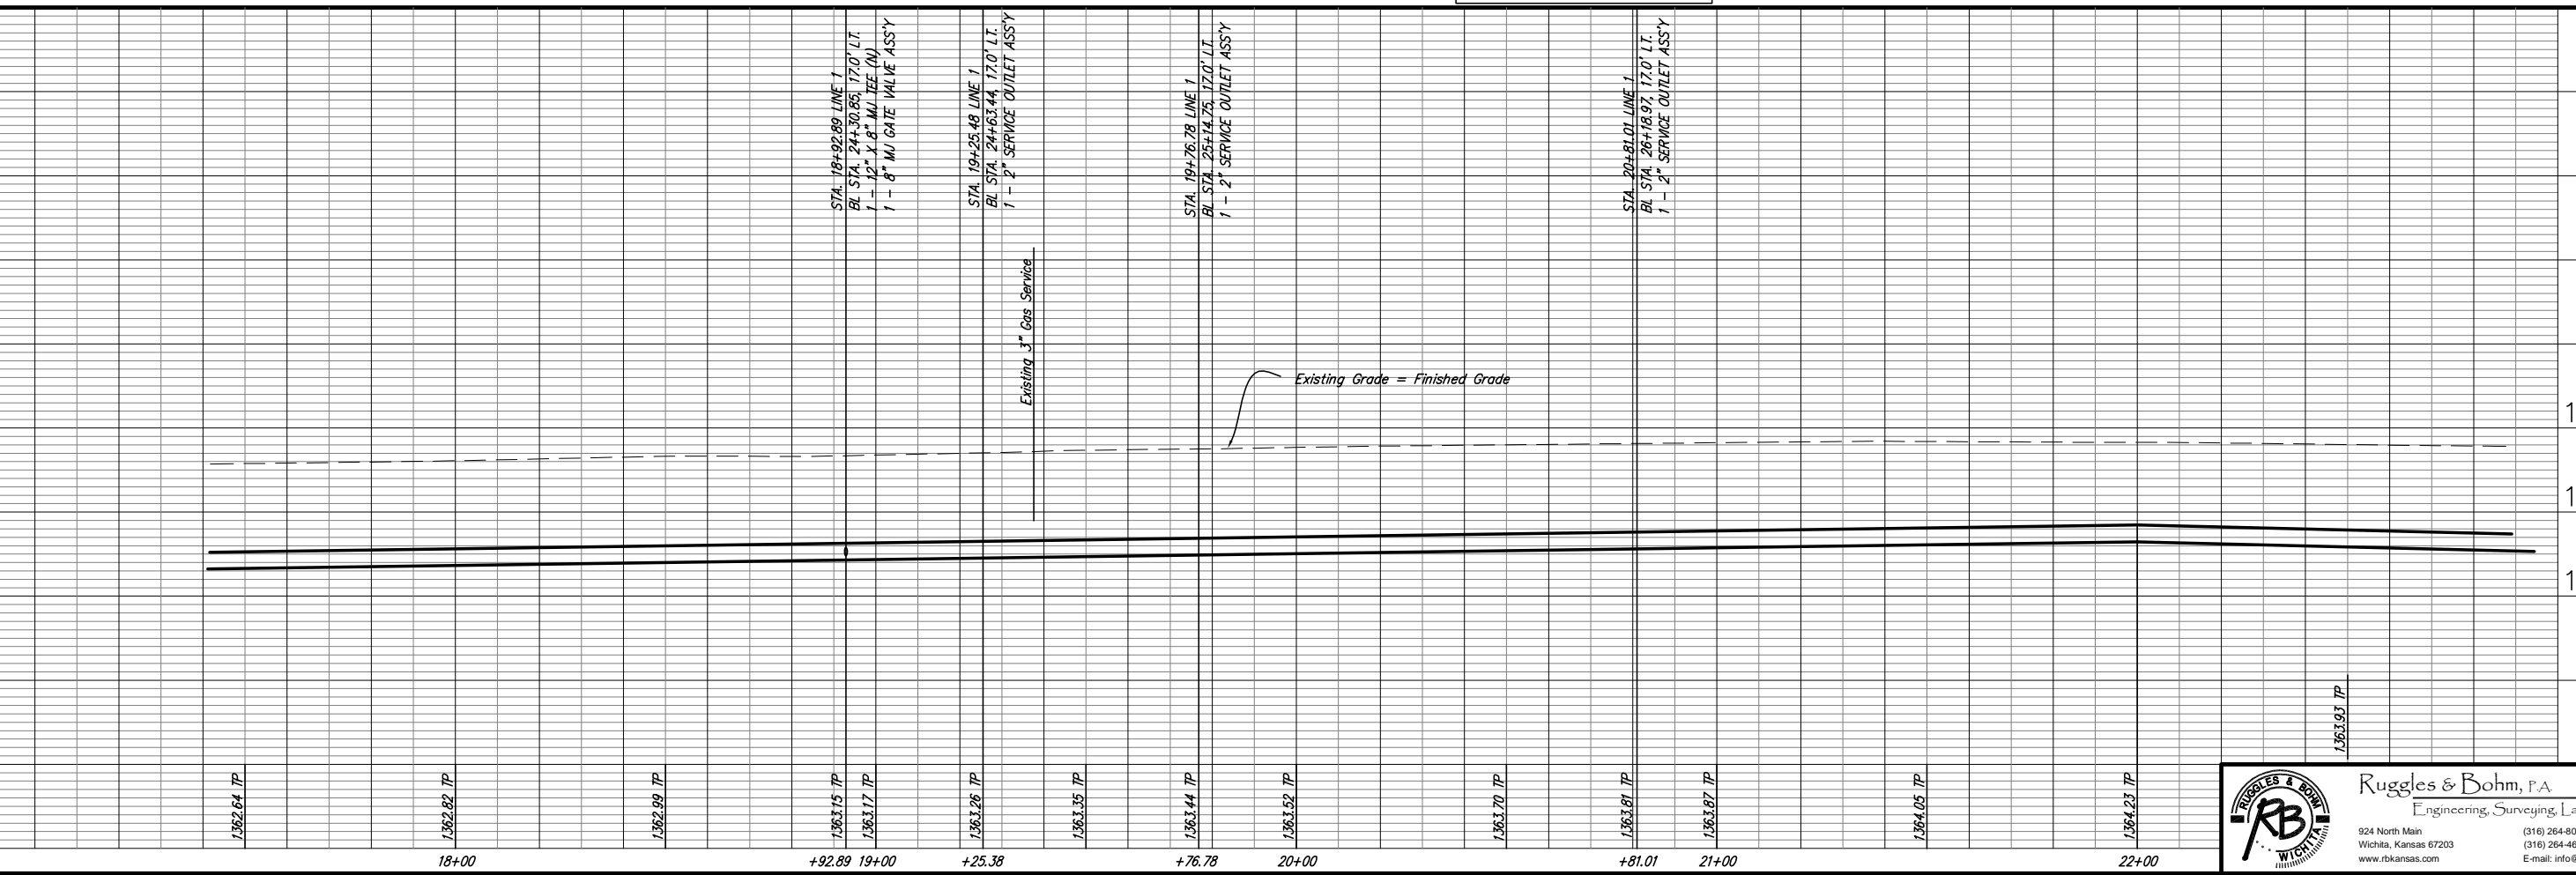

1362.64 TP	1362.92 TP	1362.99 TP	1363.15 TP	1363.17 TP	1363.26 TP	1363.35 TP	1363.44 TP	1363.52 TP	1363.70 TP	1363.81 TP	1363.87 TP	1364.05 TP	1364.23 TP
18+00	19+00	19+00	19+00	19+00	20+00	20+00	20+00	20+00	21+00	21+00	21+00	22+00	22+00

- STA. 18+92.89 LINE 1
 BL STA. 24+30.85, 17.0' LT.
 1 - 12" X 8" MJ TEE (N)
 1 - 8" MJ GATE VALVE ASS'Y (N)
 1 - 2" SERVICE OUTLET ASS'Y
- STA. 19+25.48 LINE 1
 BL STA. 24+63.44, 17.0' LT.
 1 - 2" SERVICE OUTLET ASS'Y
 5.0 L.F. 2" DI CL PIPE (S)
 1 - 2" 90° BEND (E)
 5.0 L.F. 2" DI CL PIPE (E)
 1 - 2" 90° BEND (S)
 VALVE BOX ELEV. = 1368.68
 CONNECT TO EXISTING 2" WATER SERV.
 1 - 2" CAP (N)
- STA. 19+76.78 LINE 1
 BL STA. 25+14.75, 17.0' LT.
 1 - 2" SERVICE OUTLET ASS'Y
 5.0 L.F. 2" PIPE (S)
 1 - 2" 90° BEND (E)
 5.0 L.F. 2" PIPE (E)
 1 - 2" 90° BEND (S)
 VALVE BOX ELEV. = 1369.22
 CONNECT TO EXISTING 2" WATER SERV.
 1 - 2" CAP (N)
- STA. 20+81.01 LINE 1
 BL STA. 26+18.97, 17.0' LT.
 1 - 2" SERVICE OUTLET ASS'Y
 5.0 L.F. 2" DI CL PIPE (S)
 1 - 2" 90° BEND (E)
 5.0 L.F. 2" DI CL PIPE (E)
 1 - 2" 90° BEND (S)
 VALVE BOX ELEV. = 1369.27
 CONNECT TO EXISTING 2" WATER SERV.
 1 - 2" CAP (N)

PROJECT NUMBER: 448-89893
 DRAWING FILE: water (sheet 6)
 DESIGN: KWL
 DRAWN: RA
 CHECKED: RA
 DATE: July 11, 2006
 REVIEW:

12" Water Main Replacement
 WICHITA, KANSAS

RB JOB 2136W
 SHEET W6 OF W15