

NOTES:


ALL WORK ASSOCIATED WITH THE POND CONSTRUCTION SHALL BE SUBSIDIARY TO THE BID ITEM "EXCAVATION"

THE POND BOTTOM AND SIDES ARE TO BE SCARIFIED A MINIMUM OF 8 INCHES, MOISTURE CONDITIONED AND RECOMPACTED TO A MINIMUM OF 95 PERCENT OF STANDARD PROCTOR DENSITY (ASTM D-698) FROM MINUS 3 TO PLUS 3 PERCENT OF OPTIMUM MOISTURE CONTENT. ADDITIONALLY, ALL GYPSUM/CALICHE SEAMS, SANDY CLAY AND CLAY SHALE ENCOUNTERED SHOULD BE OVER-EXCAVATED A MINIMUM OF 1 FOOT AND REPLACED WITH CLAY. MINIMUM PI OF THE SOIL USED FOR THE POND LINER IS 30.

CAD TIN FILES WILL BE PROVIDED TO CONTRACTOR PRIOR TO CONSTRUCTION FOR USE IN SITE GRADING.

ALL FILL IN STREET RIGHT OF WAY SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY.

CONSTRUCTION LIMITS FOR WORK DEPICTED ON THE SHEET ARE THE PROPERTY LINES.

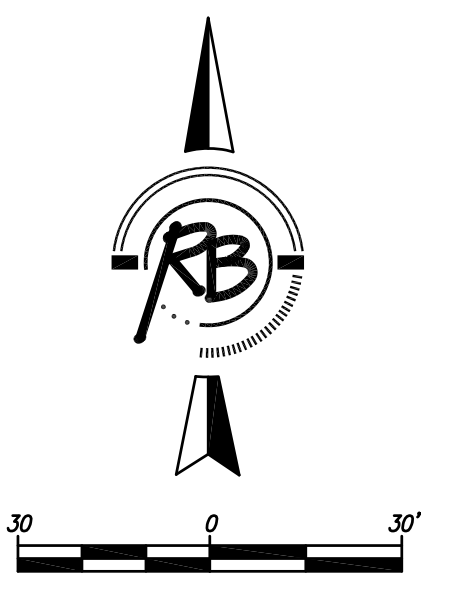

REEDS COVE MEDICAL CAMPUS SITE GRADING PLAN WICHITA, KANSAS		DESIGN: KWL DRAWN: RA REVIEW: SS UTILITY: 2 DATE: 17
Ruggles & Bohm, P.A. Engineering, Surveying, Land Planning 924 North Main Wichita, Kansas 67203 www.rbkansas.com		(316) 264-8008 (316) 264-4621 fax E-mail: info@rbkansas.com
DRAWING FILE: Engineering Base [Site Grading]	PROJECT NUMBER:	DATE: