




5' X 10' BUS SHELTER PAD DIMENSIONS

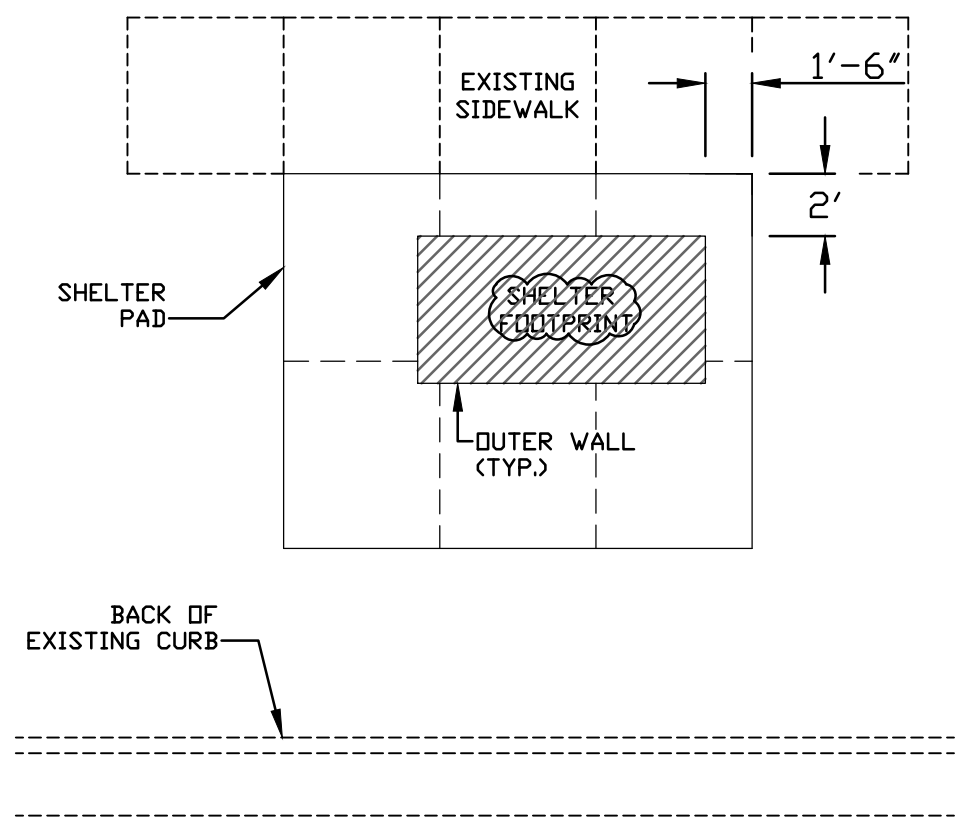


5' X 10' SHELTER LAYOUT

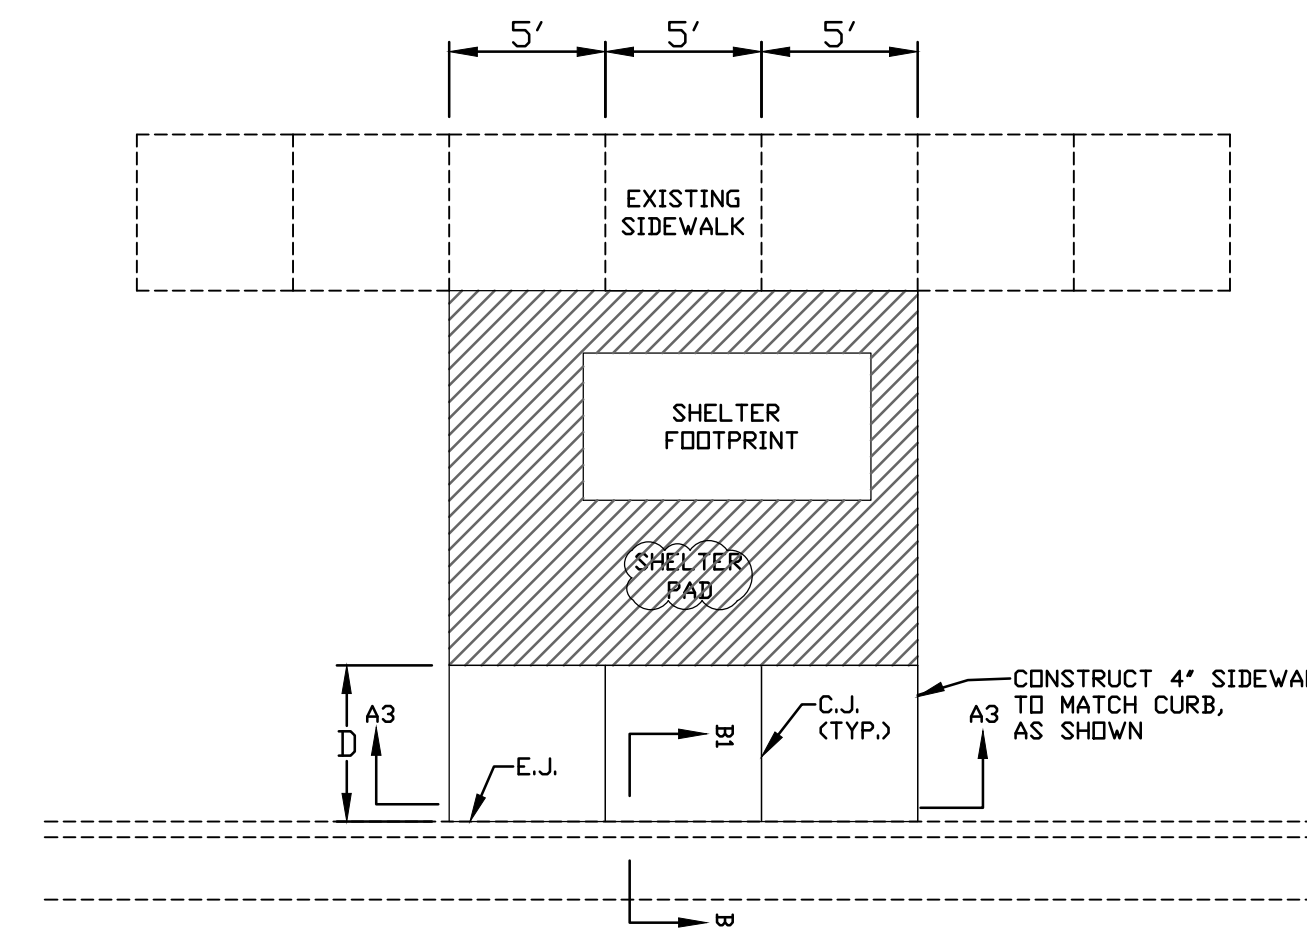


SIDEWALK CONSTRUCTION, D ≤ 5'

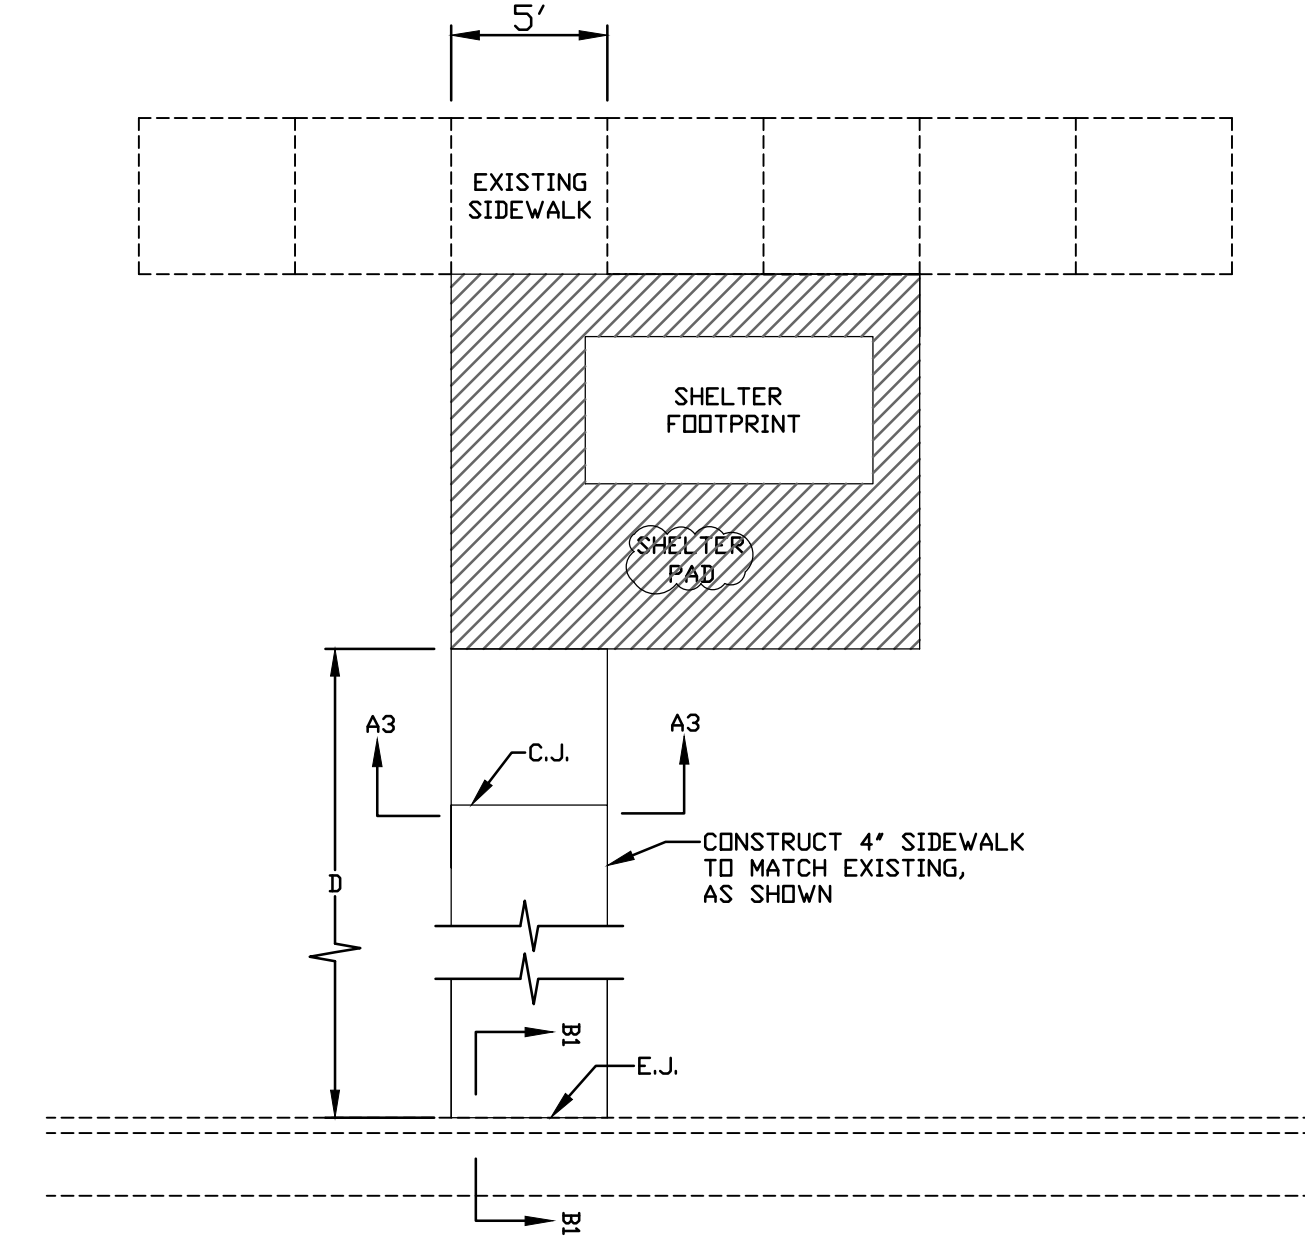


SIDEWALK CONSTRUCTION, D > 5'

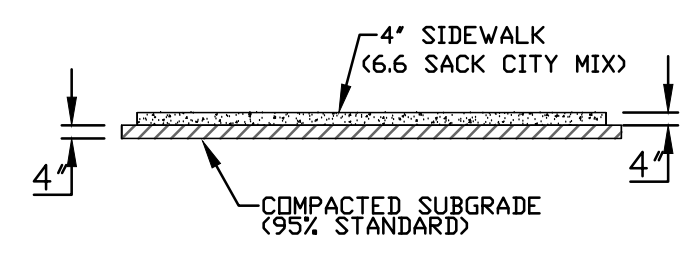

SECTION A3 - A3

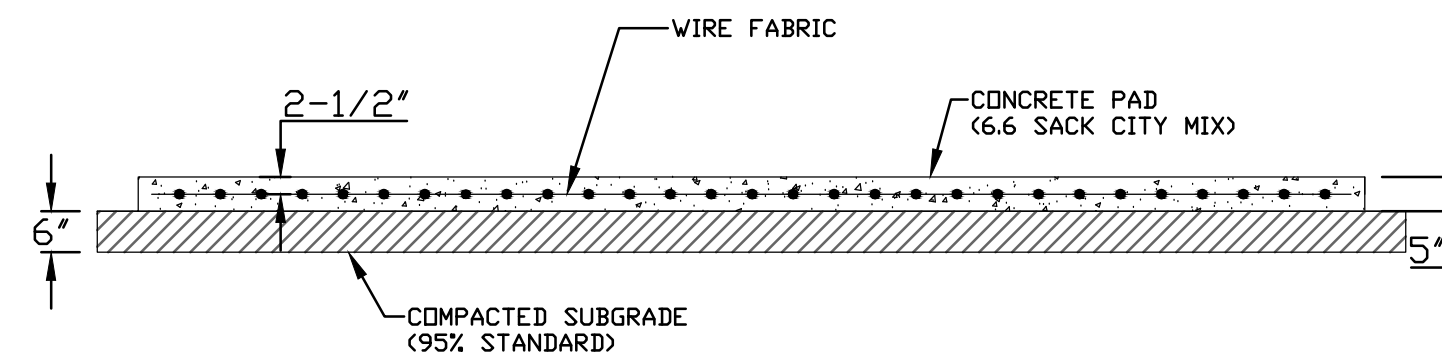


SECTION A1 - A1

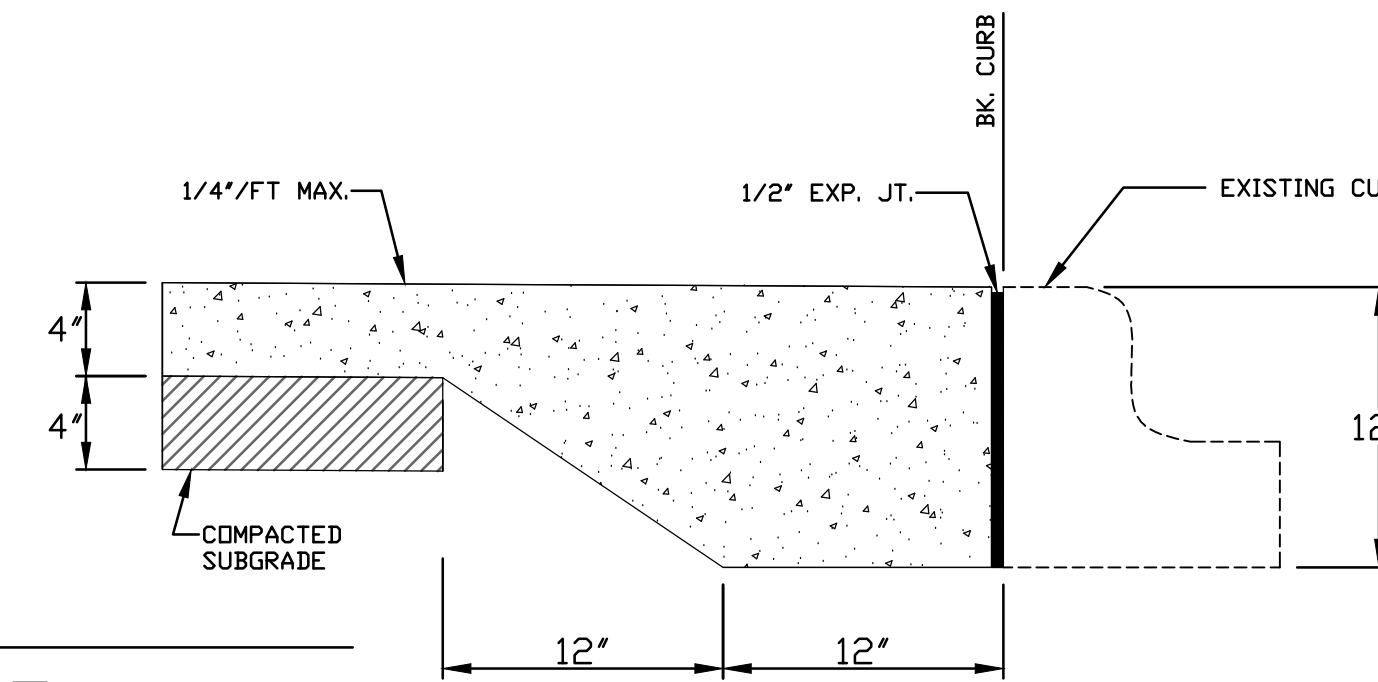


SECTION B1 - B1


5' X 10' BUS SHELTER

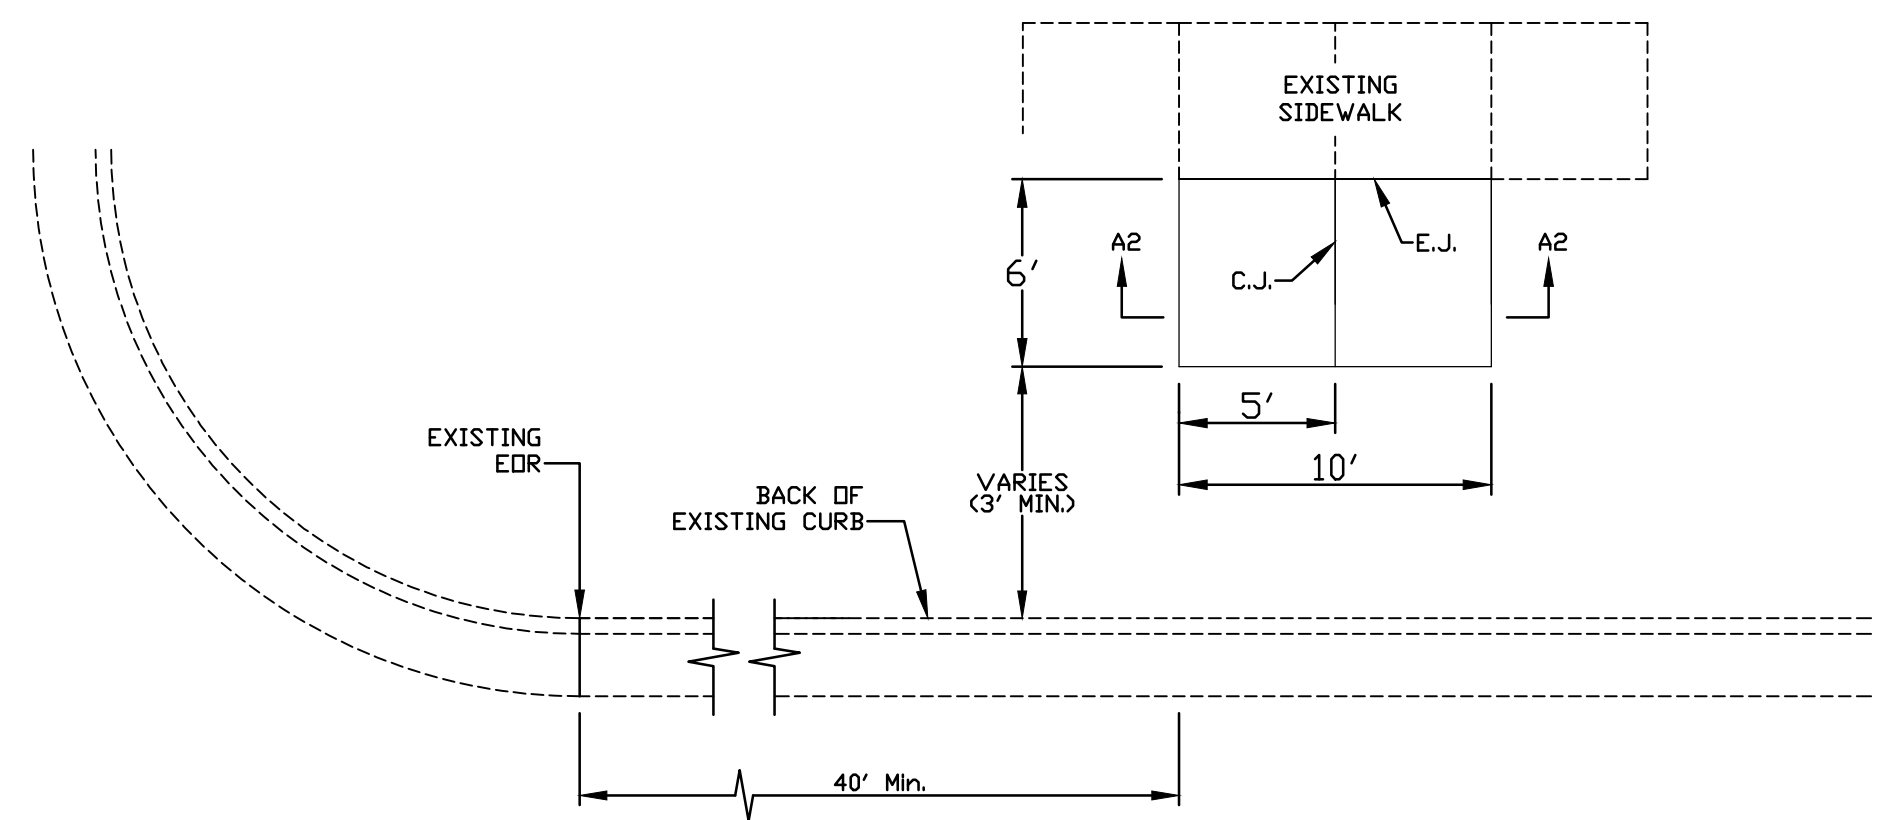


BENCH PAD DIMENSIONS

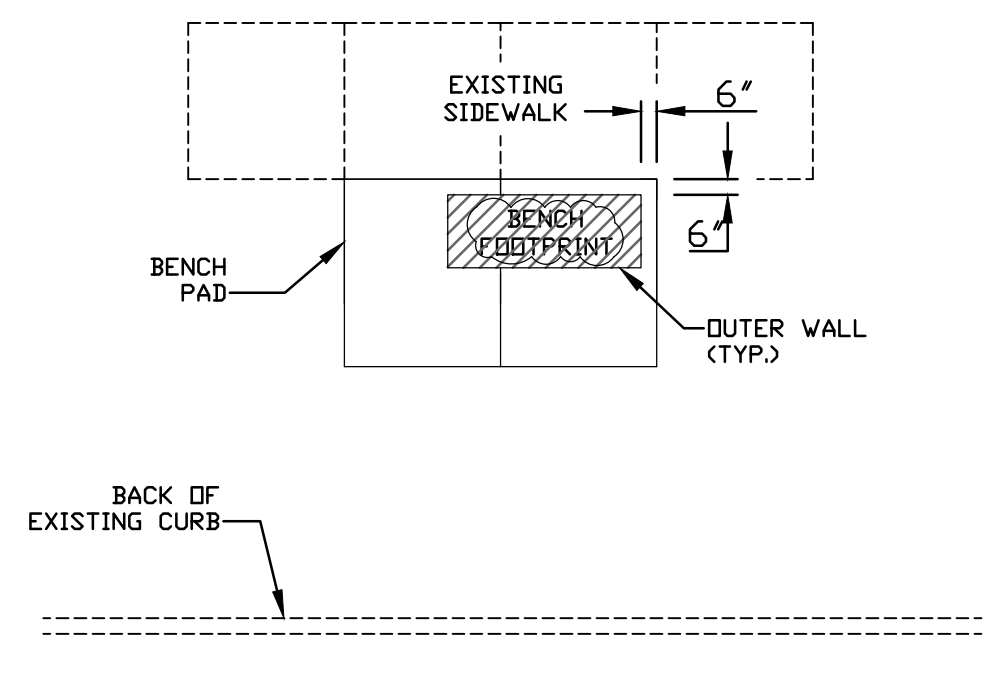


BENCH LAYOUT

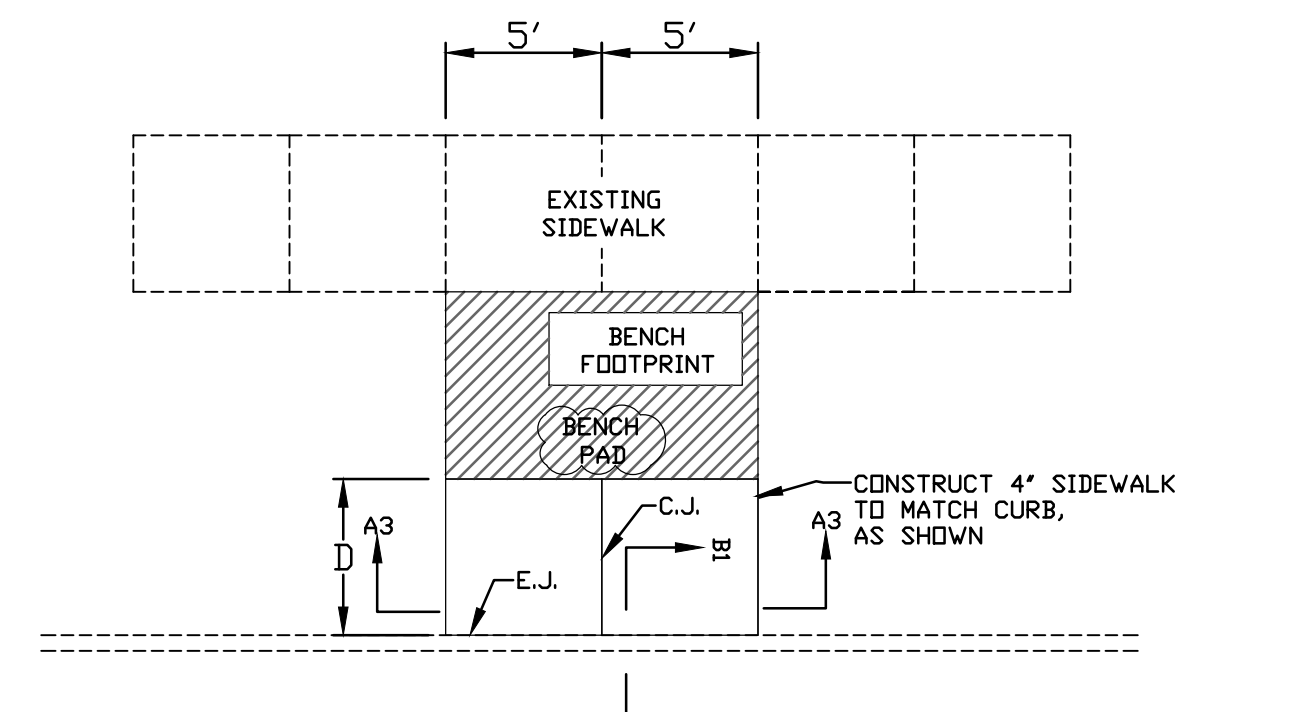


SIDEWALK CONSTRUCTION, D ≤ 5'

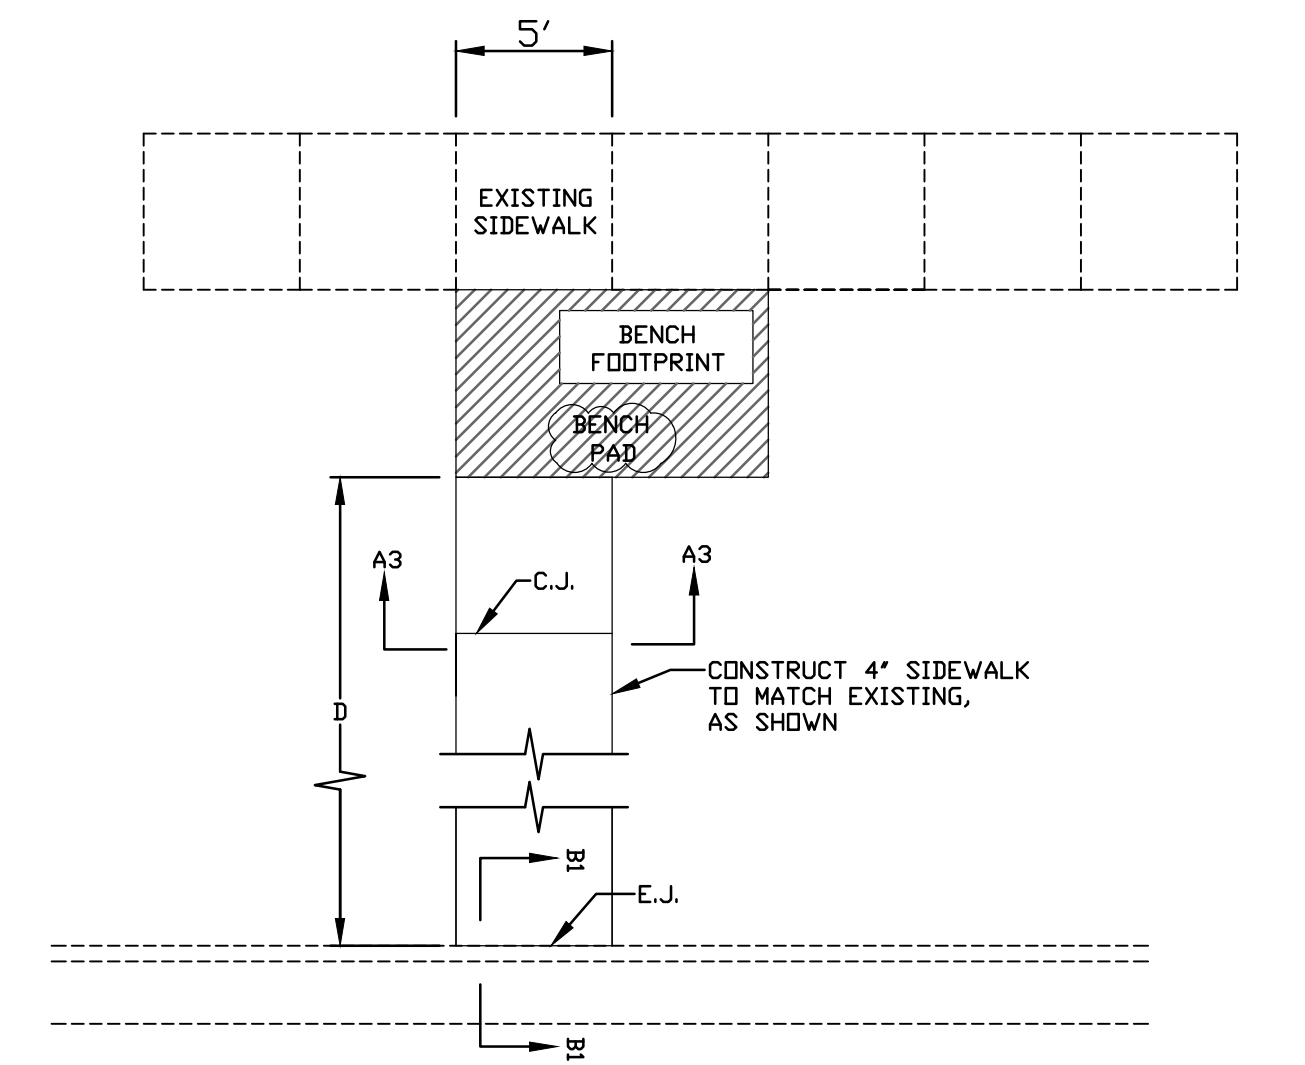


SIDEWALK CONSTRUCTION, D > 5'

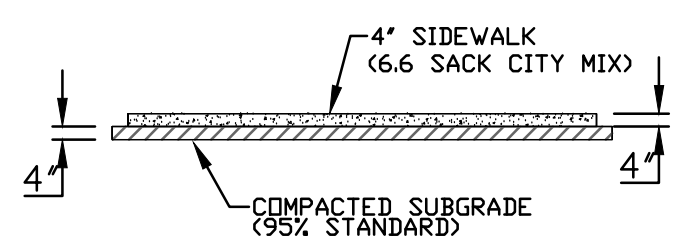

SECTION A3 - A3

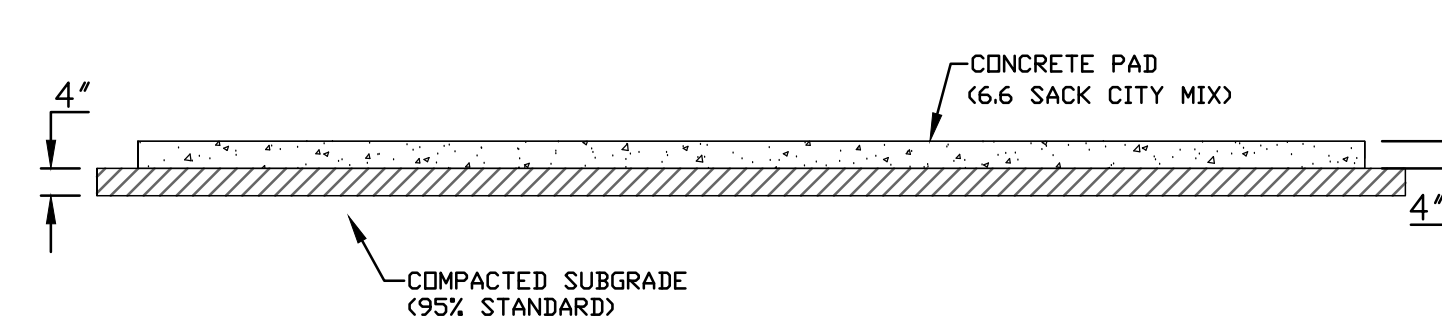

SECTION A2 - A2

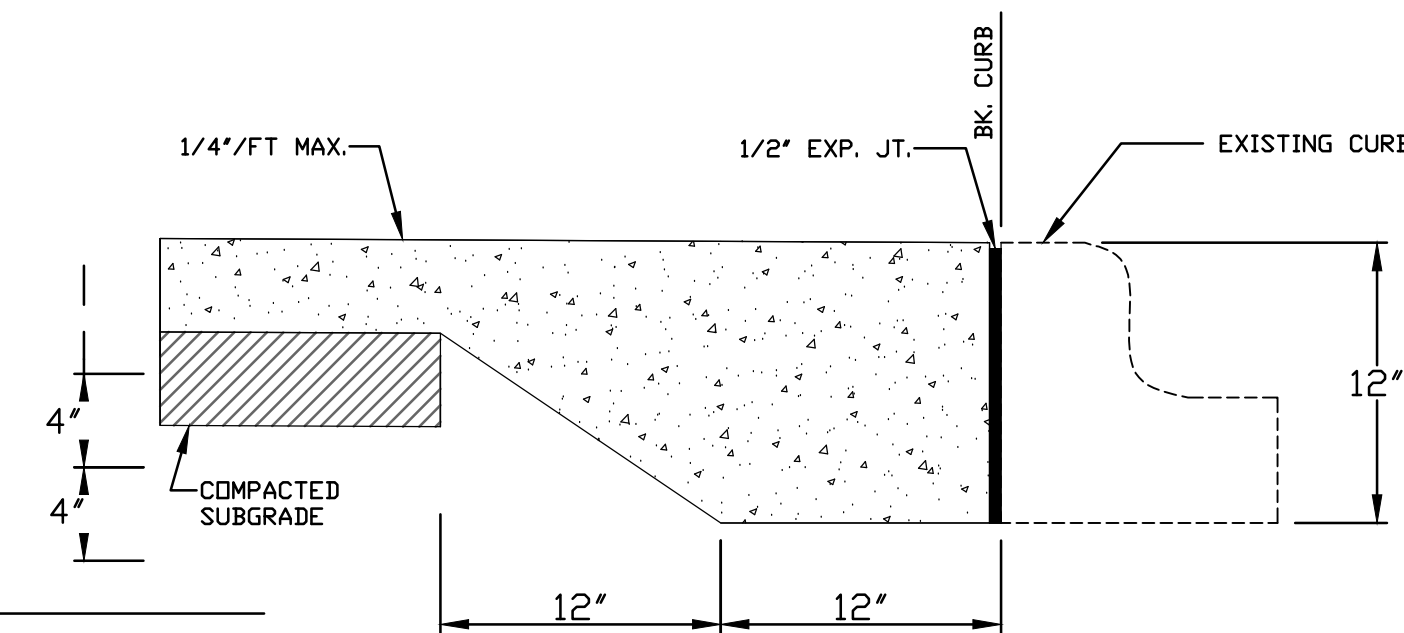

SECTION B1 - B1

FREESTANDING BENCH

GENERAL NOTES

1. IN THE ABSENCE OF EXISTING SIDEWALK, THE MINIMUM 5' SETBACK DISTANCE SHALL BE MAINTAINED.
2. EXCEPT AS OTHERWISE NOTED, SIDEWALK SLOPE MUST NOT EXCEED 5%, IN THE DIRECTION OF TRAVEL, OR 2% PERPENDICULAR TO THE DIRECTION OF TRAVEL.
3. ALL SIDEWALK WITHIN 5' OF BACK-OF-CURB MUST BE CONSTRUCTED AS A LANDING AREA, WITH SLOPES NOT IN EXCESS OF 2% IN ANY DIRECTION.

