

LIGHTING FIXTURE SCHEDULE

(P.E.C.)

FIXT. LTR.	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	MANUFACTURER CATALOG NUMBER	DESCRIPTION	LAMP TYPE	LENS\LOUVER\FINISH	W	L	D
					SEE NOTES	NO.	VOLTS			
1 2	P	ANTIQUE STREET LAMPS, INC.			POST TOP	150W HPS				
						1	240			

1 MANUFACTURERS LISTED IN THIS SCHEDULE WILL BE THE ONLY APPROVED MANUFACTURERS TO BID THE LIGHTING FIXTURES FOR THIS PROJECT. CONTRACTORS AND SUPPLIERS USING PRICING FROM MANUFACTURERS NOT LISTED ON SCHEDULE DO SO AT THEIR OWN RISK.

2 CATALOG NUMBER: WLT30 PC/BKS150/240-11 WITH POLE #D11/15-C1/BK


GENERAL NOTES

- ALL ELECTRICAL WORK SHALL COMPLY WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE (NEC) & THE AMERICANS WITH DISABILITIES ACT (ADA).
- REFER TO RELATED ARCHITECTURAL, AND STRUCTURAL DRAWINGS FOR RELATED INFORMATION.
- REFER TO THE SPECIFICATIONS FOR DATA NOT ON THE DRAWINGS.
- CONDUIT RUN W/CONDUCTORS AS INDICATED & GROUND WIRE SIZED PER N.E.C. 250-122 (1999). CONDUIT SIZE AS REQUIRED.
- WHEN INCREASED CONDUCTOR SIZES ARE SHOWN ON THE PLANS, THE LARGER CONDUCTOR SIZE SHALL BE USED THROUGHOUT THE LENGTH OF THE CIRCUIT, INCLUDING NEUTRAL AND GROUND.

SYMBOL LIST


SYMBOL	DESCRIPTION	MOUNTING
OA	LIGHT FIXTURE & FIXTURE LETTER	POLE
UGP	SEE GENERAL NOTE 4 AND NOTE 5	
UGP	UNDERGROUND PRIMARY	

PANEL A									
240/120 VOLTS, 1 PHASE, 3 WIRE									
100 AMP MAIN BKR									
10000 AIC LABELED									
CIR. NO.	LOAD V. A.	LOAD TYPE	DESCRIPTION	AMP SIZE	AMP SIZE	LOAD DESCRIPTION	LOAD TYPE	LOAD V. A.	CIR. NO.
1	740	EXIST.	PATH LIGHTS	1	20	EXIST. SITE POLE	EXIST.	400	2
3	740	EXIST.	PATH LIGHTS	1	20	EXIST. SITE POLE	EXIST.	400	4
5	856	EXIST.	PATH LIGHTS	1	20	N. BRIDGE POLES	EXIST.	2400	6
7	400	REC. & LTG. CON		1	20	S. BRIDGE POLES	EXIST.	2400	8
9		SPARE		1	20	S. BRIDGE POLES	EXIST.	2400	10
11		SPARE		1	20	S. BRIDGE POLES	EXIST.	2400	12
13		SPARE		1	20	S. BRIDGE POLES	EXIST.	2400	14
15		SPARE		1	20	S. BRIDGE POLES	EXIST.	2400	16
17		SPARE		1	20	S. BRIDGE POLES	EXIST.	2400	18
19		SPACE				SPACE			20
21		SPACE				SPACE			22
23		SPACE				SPACE			24
25		SPACE				SPACE			26
27		SPACE				SPACE			28
29		SPACE				SPACE			30

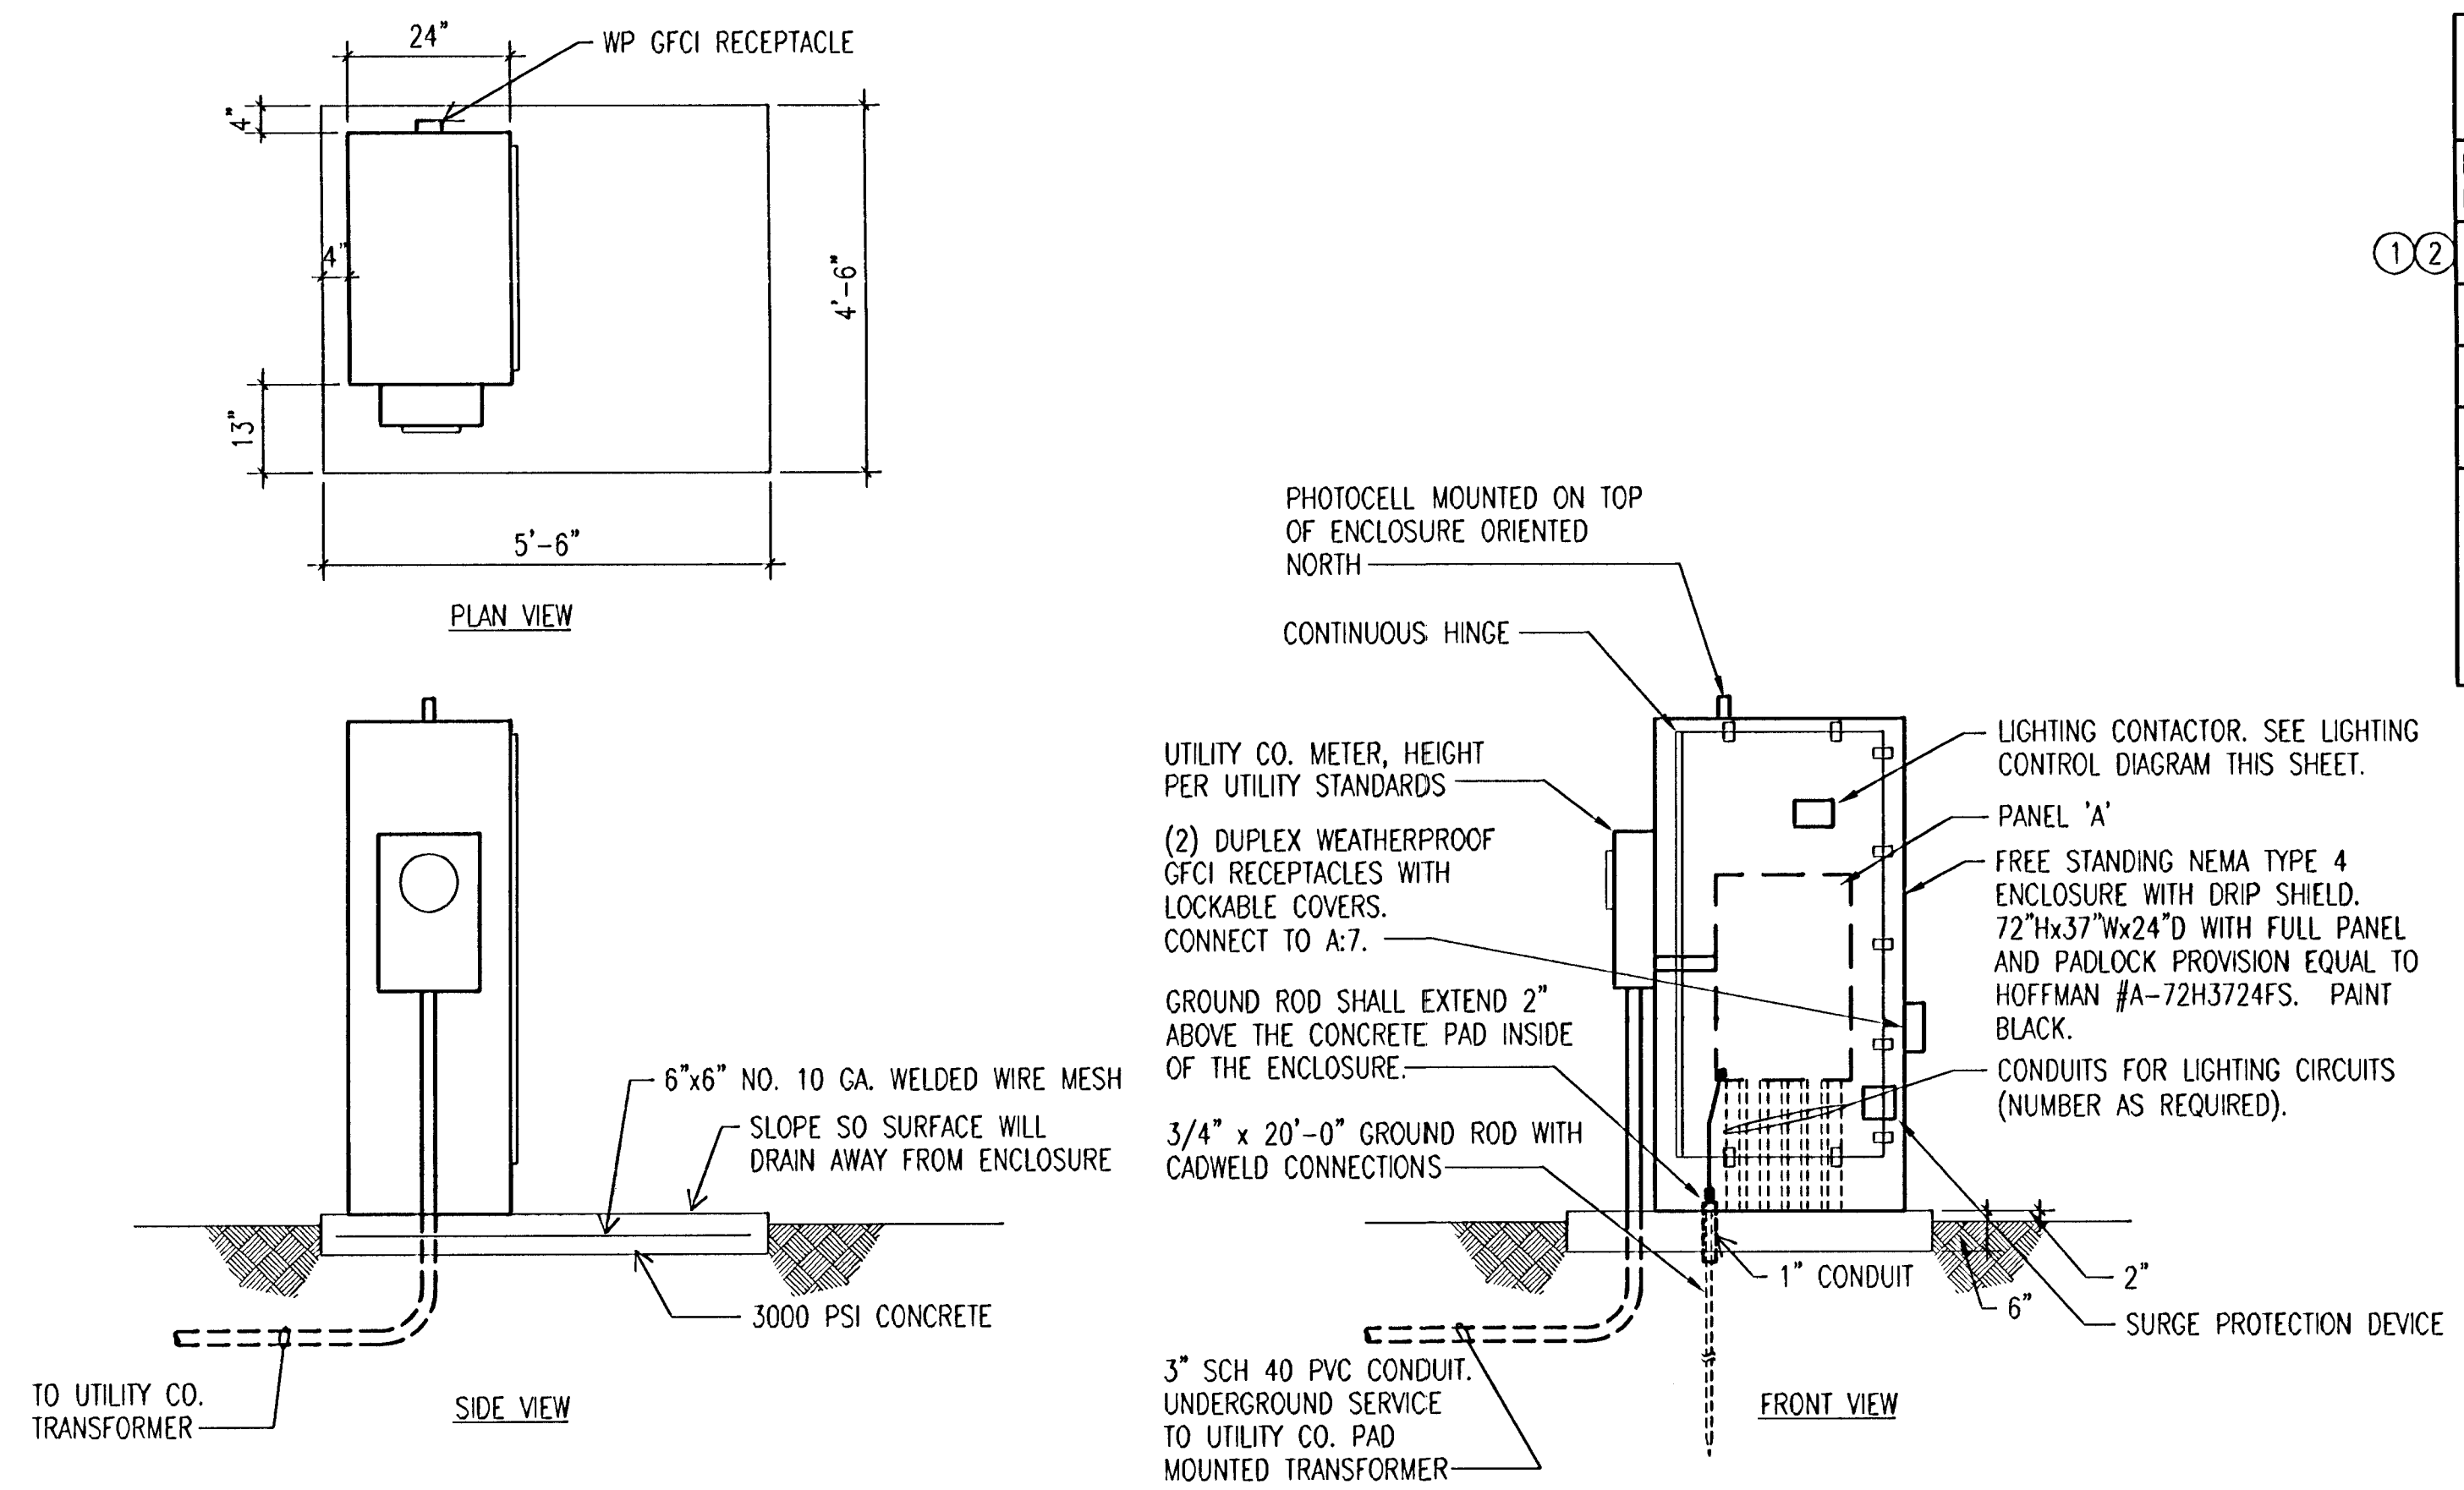


SERVICE ENCLOSURE DETAIL

NO SCALE

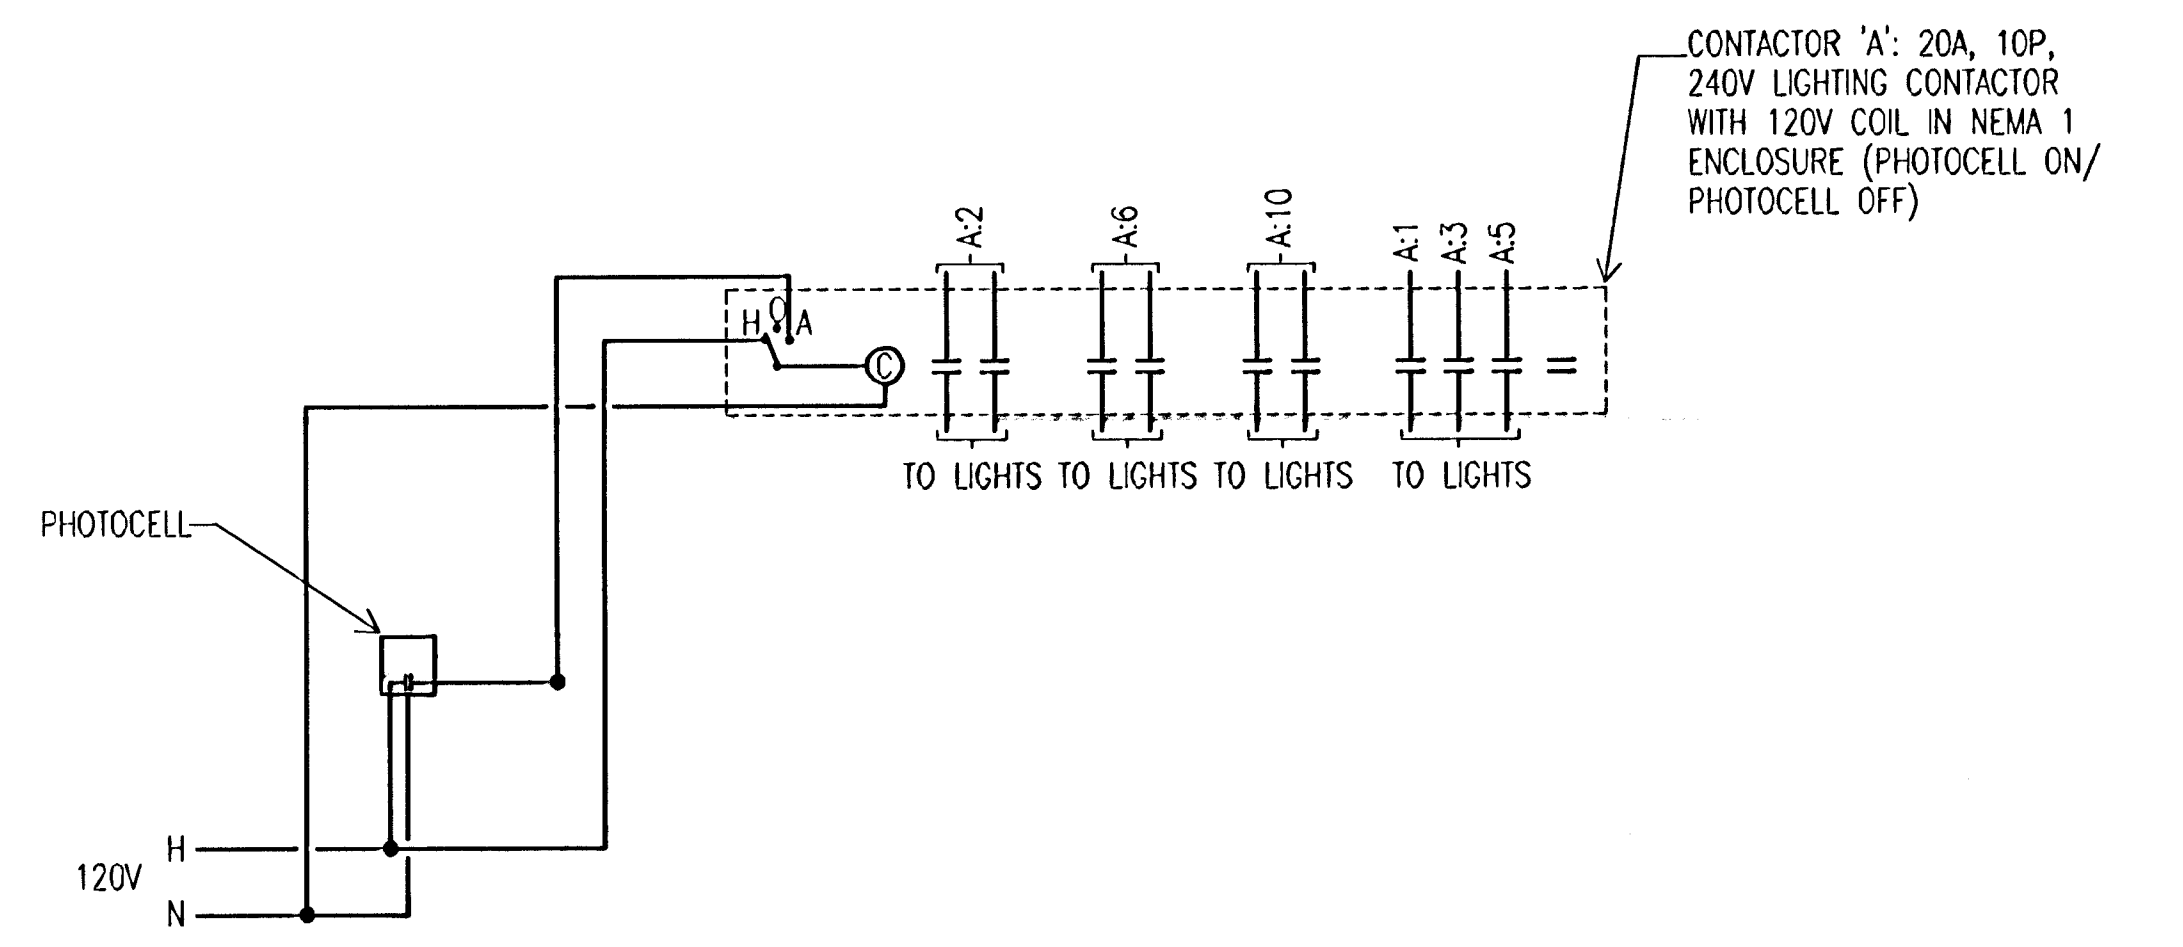

LIGHTING CONTROL DIAGRAM

NO SCALE

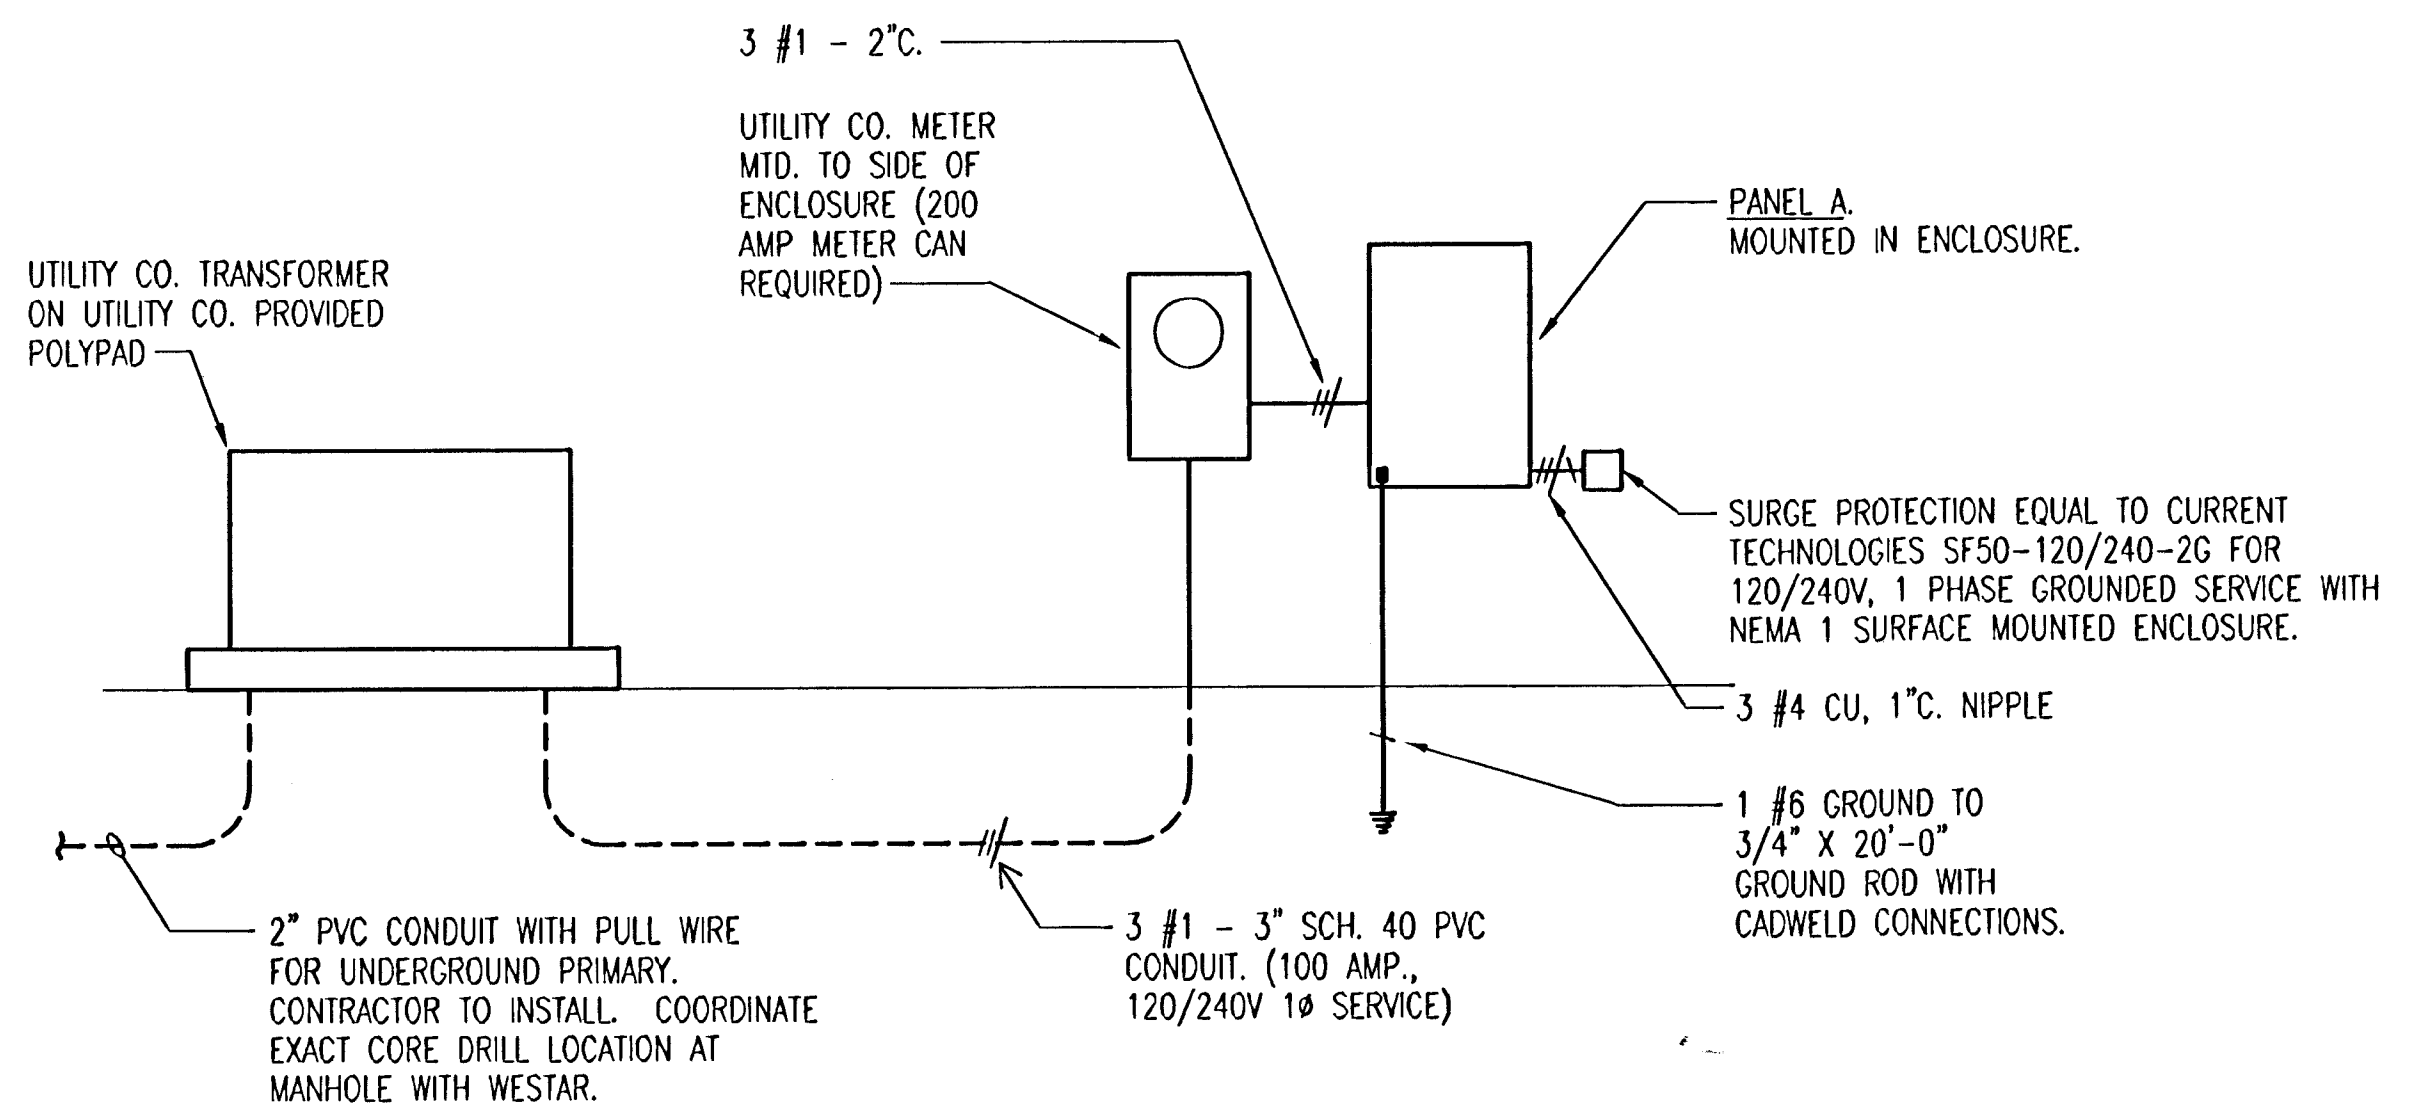

RISER DIAGRAM

NO SCALE

SEE SERVICE ENCLOSURE DETAIL ABOVE FOR MOUNTING INFORMATION



City of Wichita, Kansas
James L. Armour, P.E. - Acting City Engineer
MURDOCK BRIDGE
OVER LITTLE ARKANSAS RIVER
ELECTRICAL SCHEDULES
CITY OF WICHITA PROJECT NO. 472-83895
Professional Engineering Consultants, P.A.
303 S. TOPEKA • WICHITA, KANSAS 67202
316-262-2691 • FAX 316-262-3003
Designed by DCG Drawn by MDB Checked by Date JULY 2003 Job No. 96940-2