


DATE	BY
REFERENCES NOTED	
REFERENCES CHECKED	

FHWA REG NO.	STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
7	KANSAS	87-N-0200-01	2001	4	78

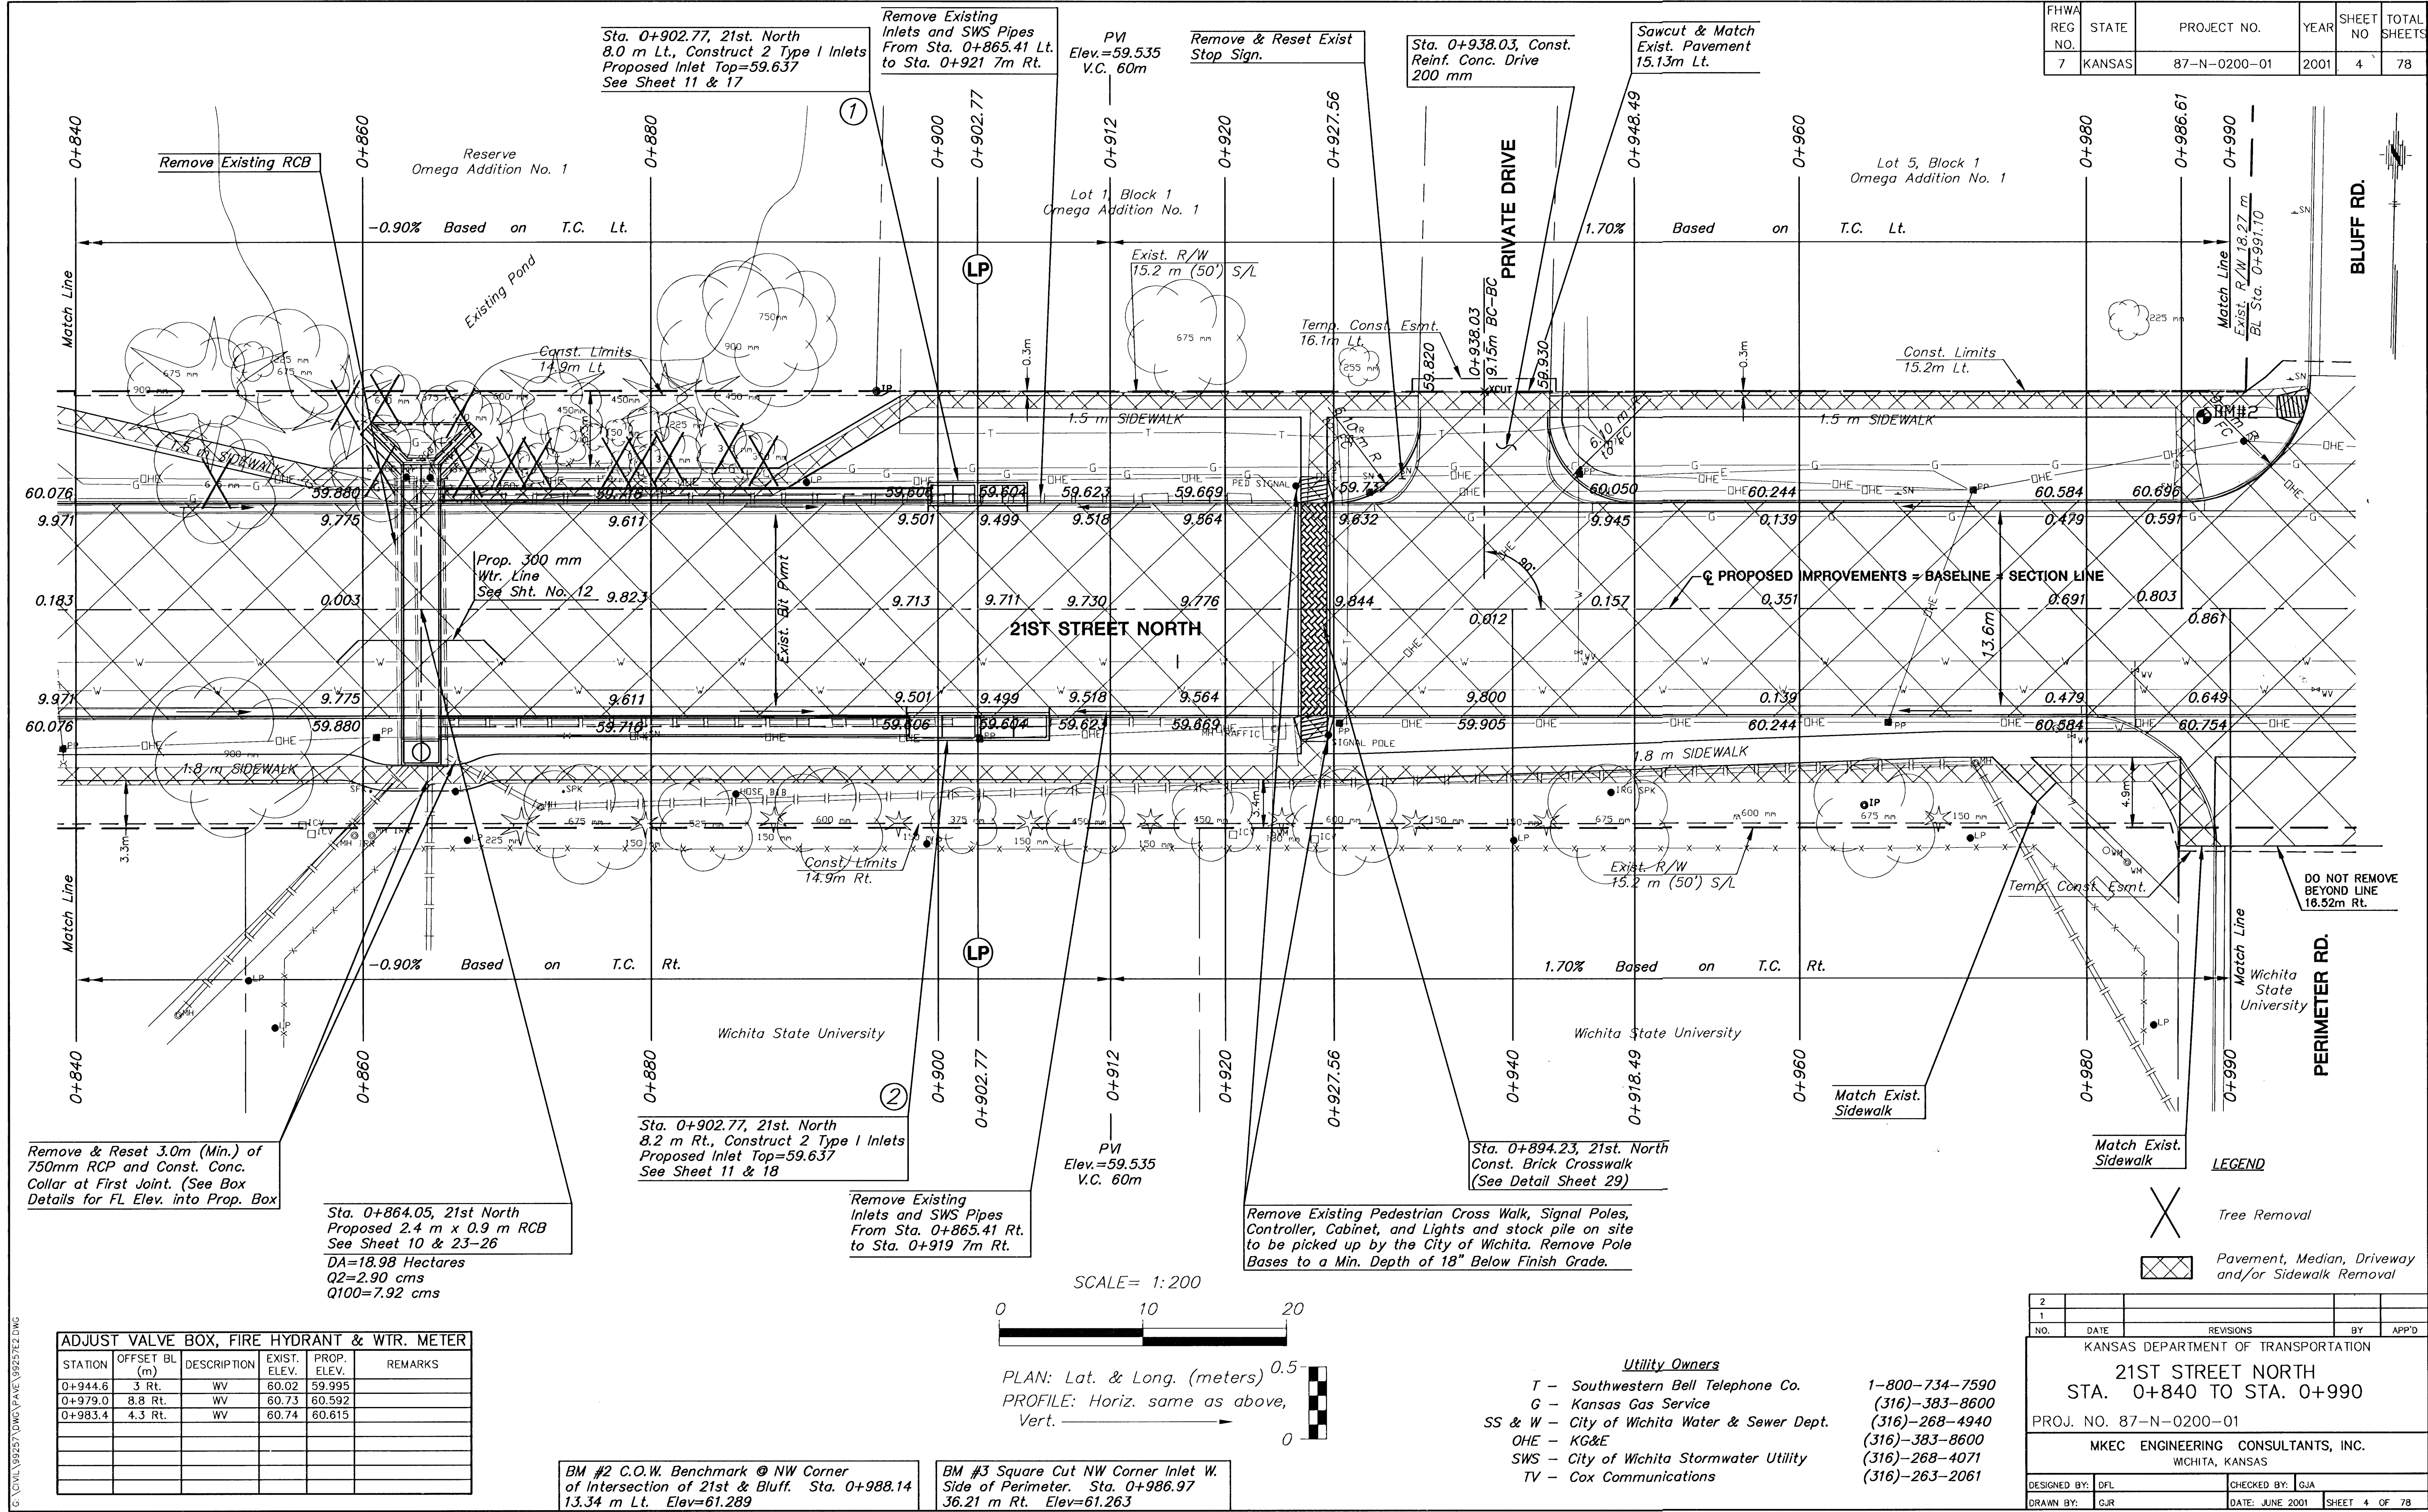

ADJUST VALVE BOX, FIRE HYDRANT & WTR. METER					
STATION	OFFSET BL (m)	DESCRIPTION	EXIST. ELEV.	PROP. ELEV.	REMARKS
0+944.6	3 Rt.	WV	60.02	59.995	
0+979.0	8.8 Rt.	WV	60.73	60.592	
0+983.4	4.3 Rt.	WV	60.74	60.615	

BM #2 C.O.W. Benchmark @ NW Corner of Intersection of 21st & Bluff. Sta. 0+988.14 13.34 m Lt. Elev=61.289

BM #3 Square Cut NW Corner Inlet W. Side of Perimeter. Sta. 0+986.97 36.21 m Rt. Elev=61.263

Utility Owners
 T - Southwestern Bell Telephone Co. 1-800-734-7590
 G - Kansas Gas Service (316)-383-8600
 SS & W - City of Wichita Water & Sewer Dept. (316)-268-4940
 OHE - KG&E (316)-383-8600
 SWS - City of Wichita Stormwater Utility (316)-268-4071
 TV - Cox Communications (316)-263-2061

KANSAS DEPARTMENT OF TRANSPORTATION				
21ST STREET NORTH STA. 0+840 TO STA. 0+990				
PROJ. NO. 87-N-0200-01				
MKEC ENGINEERING CONSULTANTS, INC. WICHITA, KANSAS				
DESIGNED BY: DFL	CHECKED BY: GJA			
DRAWN BY: GJR	DATE: JUNE 2001	SHEET 4	OF 78	