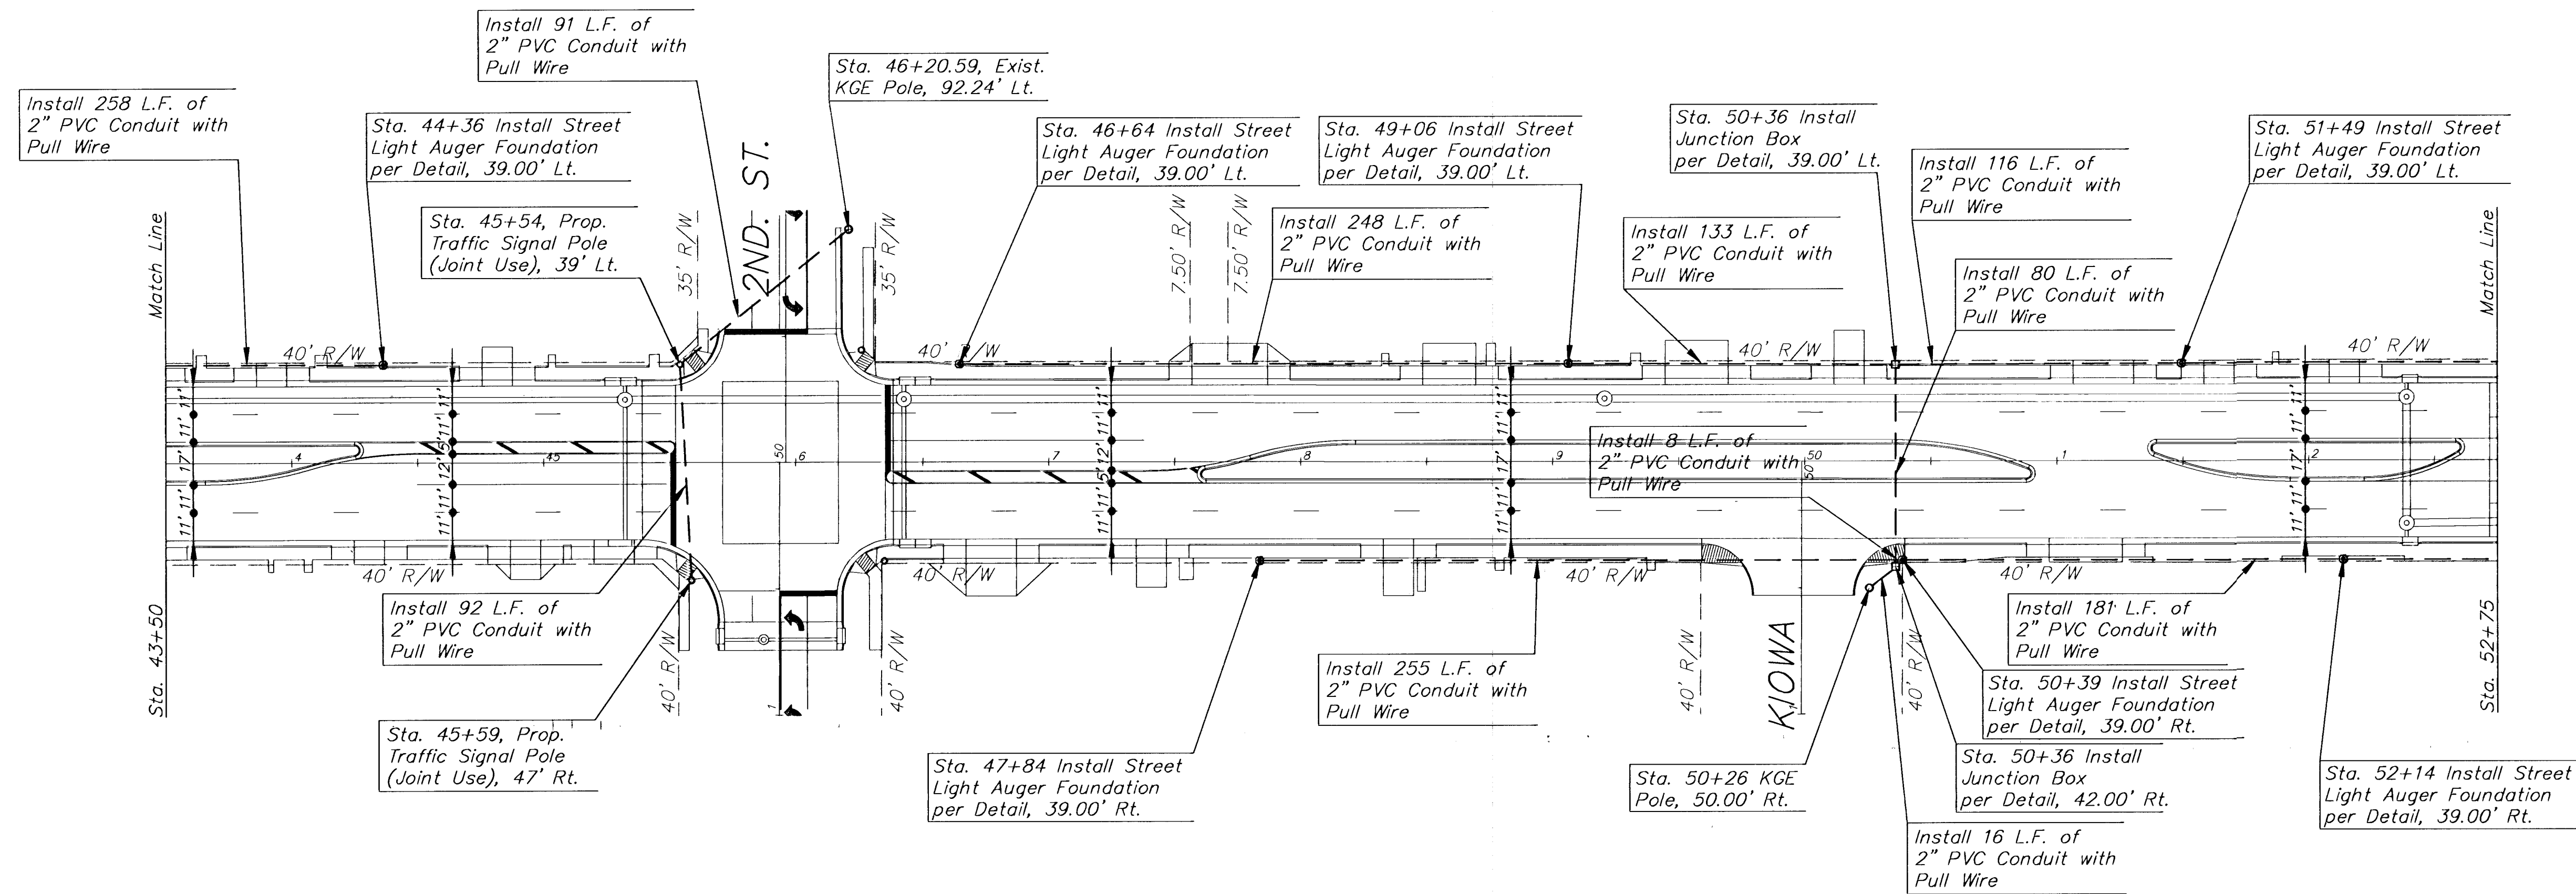


- Notes:
1. Install 2" PVC Conduit with pull wire. Conduit shall be buried 36" below finish grade.
 2. Terminate conduit at KGE poles with 24" sweep elbow and vertical stub extended above grade. Coordinate with KGE.
 3. At Douglas intersection, terminate conduit at KGE manholes. Coordinate with KGE.
 4. Junction boxes shall be installed per standard detail on traffic signalization sheets. Cover lettering shall be "KGE". Cost Subsidiary to 2" PVC Conduit.
 5. Install Auger Foundation for light poles per detail and manufacturer's instructions. Terminate conduit inside foundation at top of base plate.
 6. Pole locations may be moved up to 10' from plan location to avoid conflict with other improvements, as approved by the Engineer. Relocation of more than 10' will require KGE concurrence.

SENECA ST. STA. 43+50 TO STA. 54+50

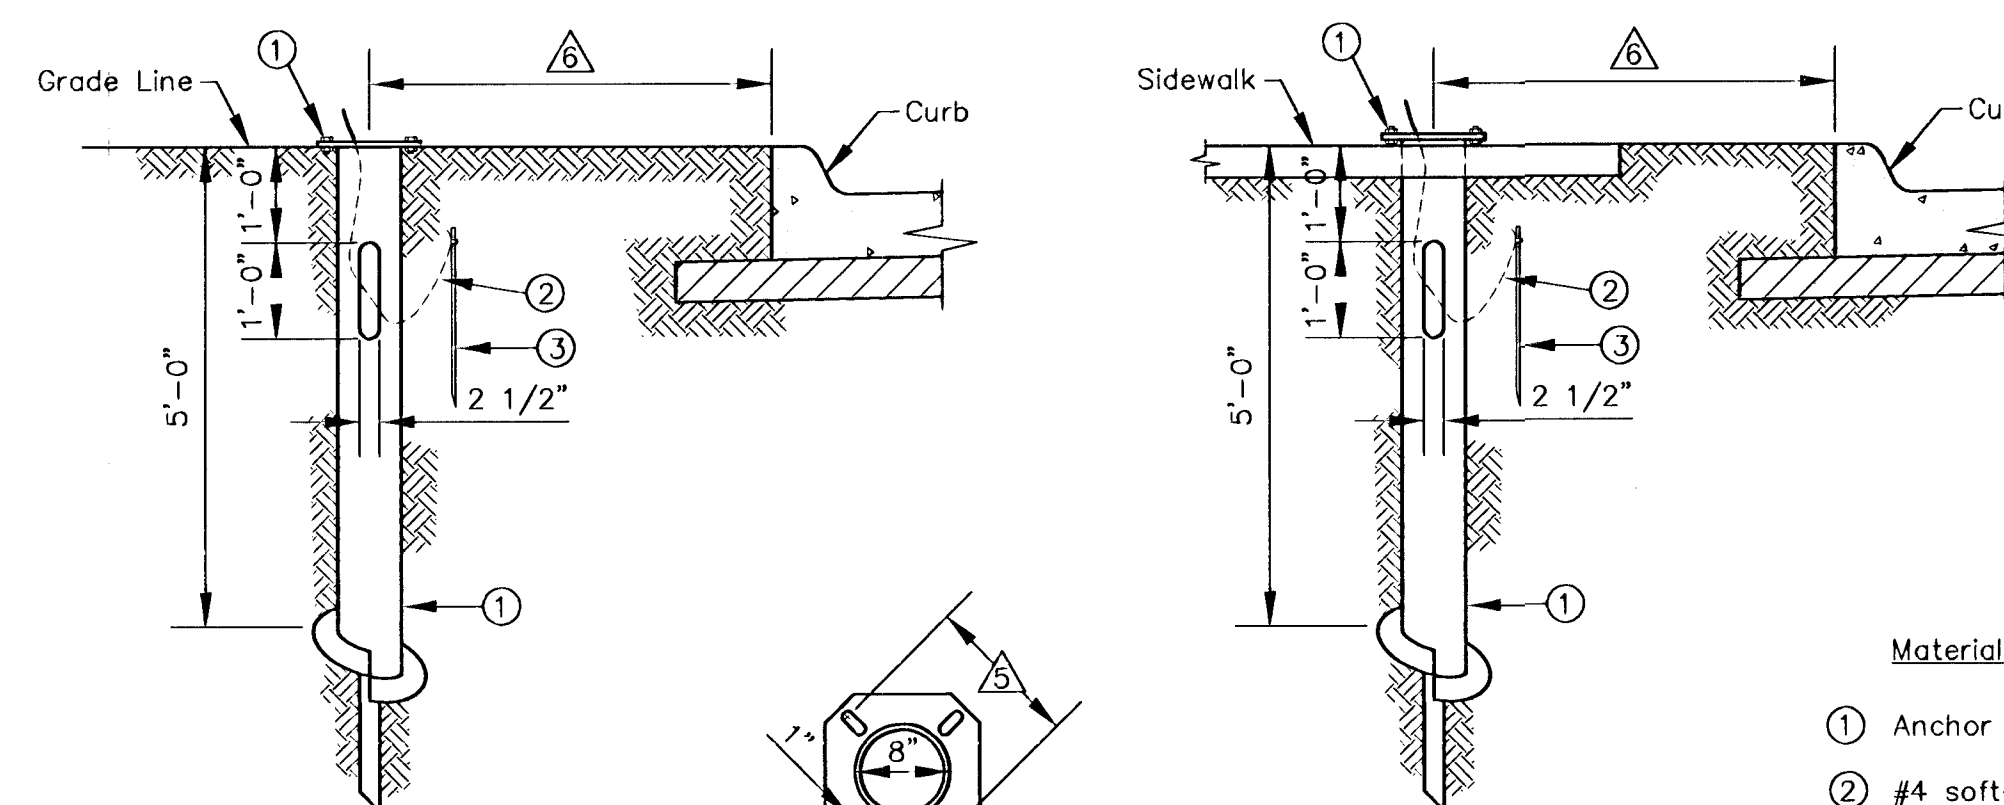
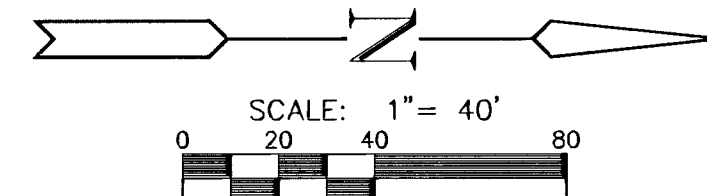
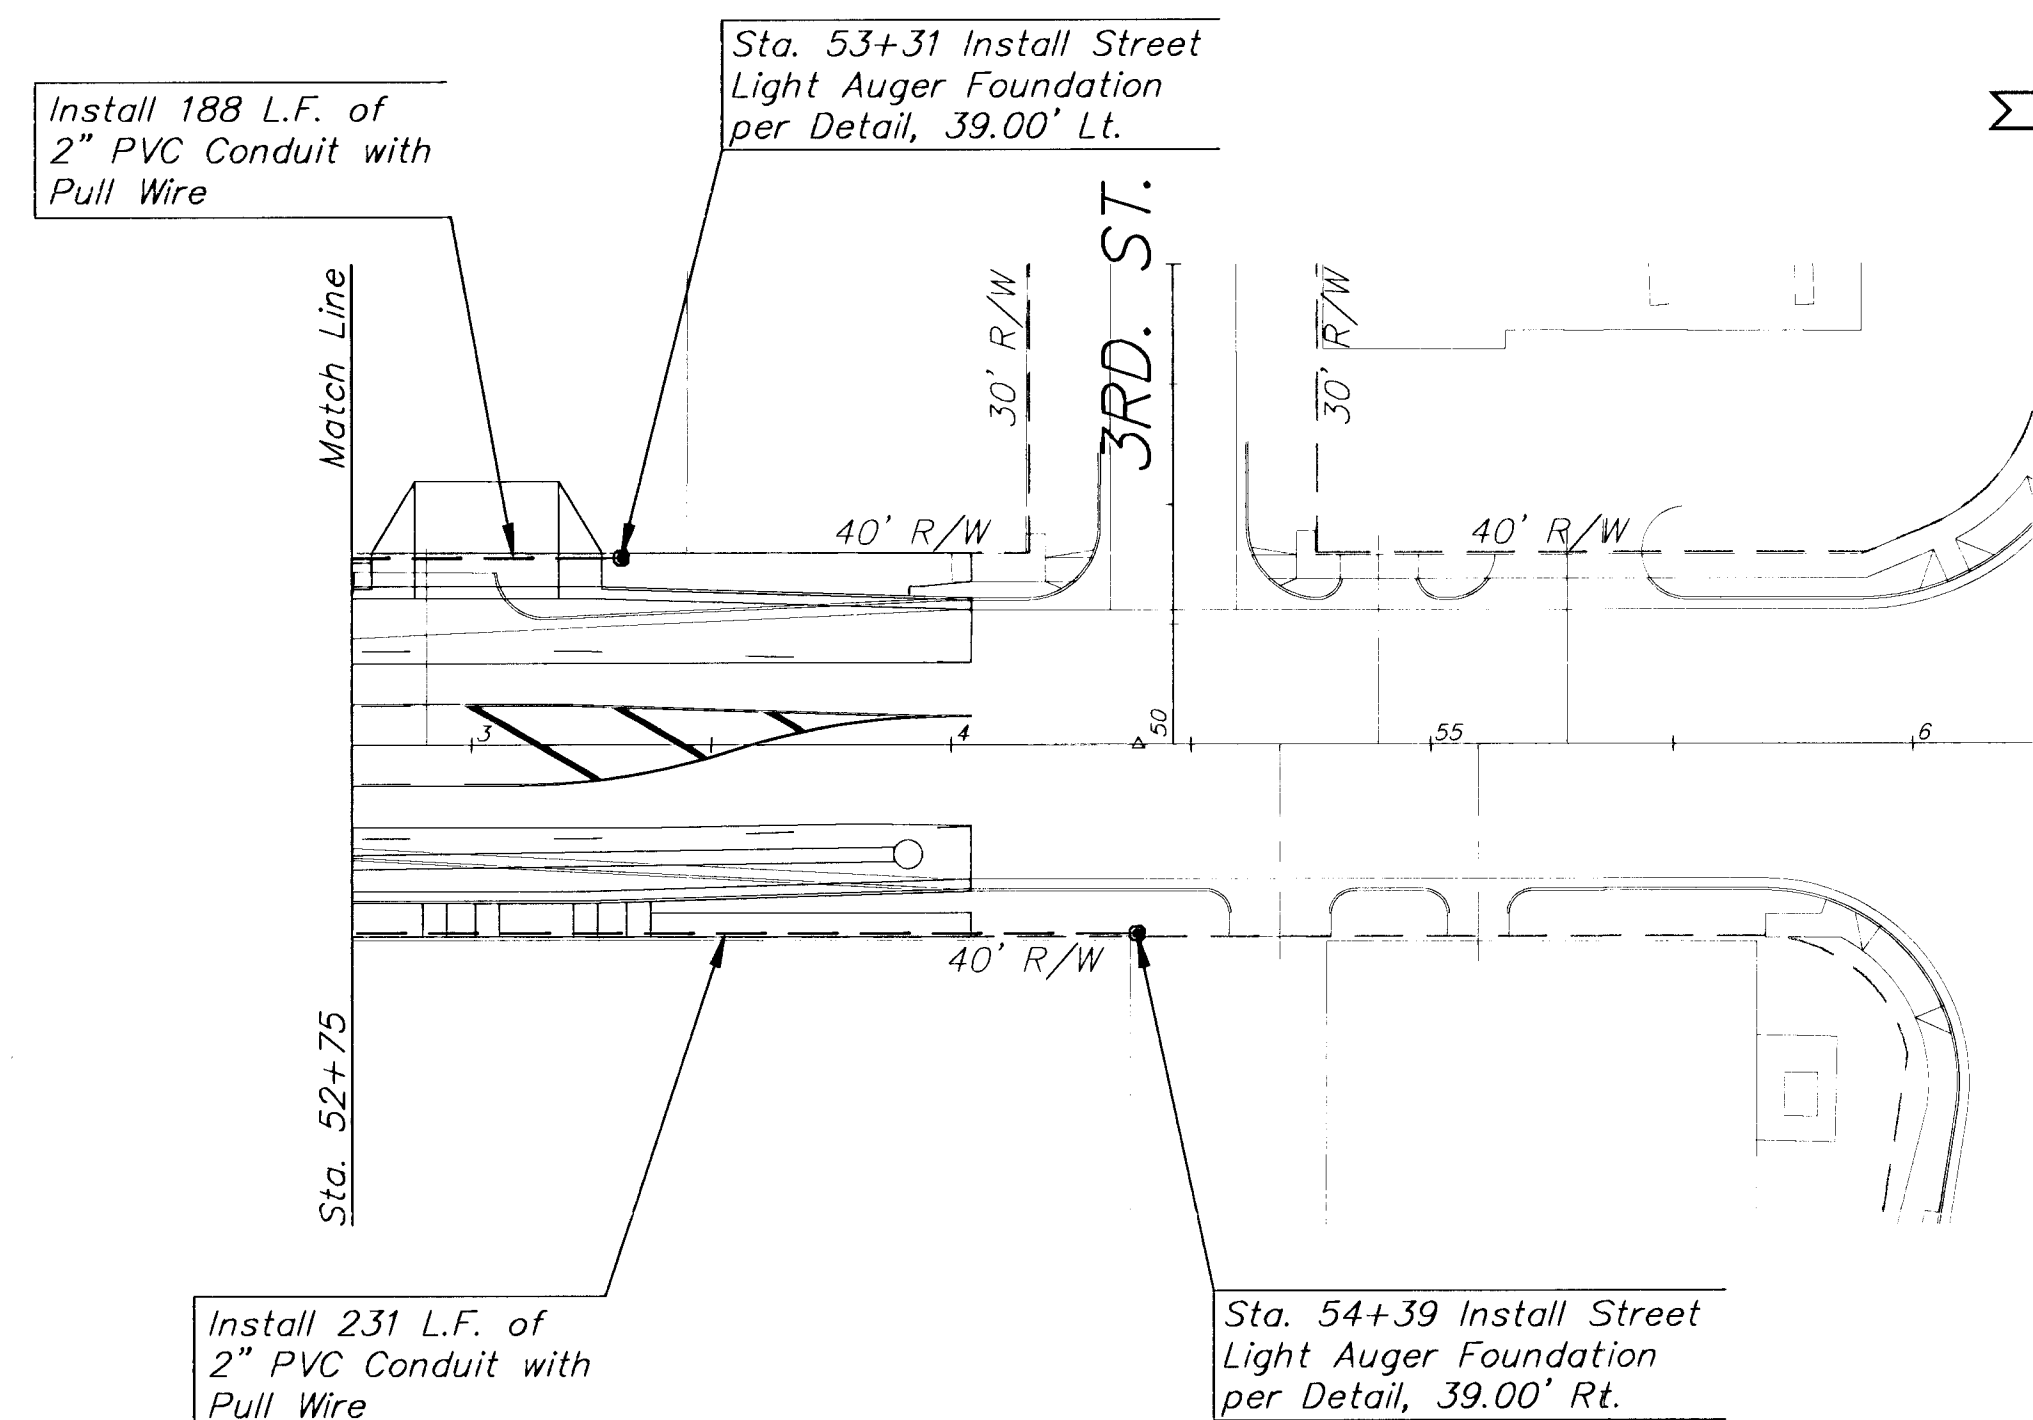


FIG. 1

BASE PLAN VIEW

FIG. 2

Notes:


1. Steel standards shall be plum on two vertical planes 90° apart.
2. All excavated dirt and concrete to be hauled away.
3. If the foundation will be installed in an area where a future sidewalk or curb has not been installed, the foundation will be installed as shown in FIG. 2.
4. Auger Foundation shall be approved for steel 30" Credenza poles, HB 8601117 as manufactured by JH Botts, Inc., or approved equal.
5. 10" to 15" bolt circles. (30" Credenza pole bolt circle=11")
6. This dimension to be 6'-0" (Typ.)
7. Requires universal driving tool and correct Kelly Bar adaptor.
8. Foundation should be installed in undisturbed soil. Where the soil is disturbed, it shall be backfilled in 6" layers and air tamped.

Material:

1. Anchor Bolts Assembly
2. #4 soft-drawn bare copper wire, furnished by KGE, installed by Contractor.
3. 5/8"x 8' Ground Rod, furnished by KGE, installed by Contractor

BILL OF MATERIALS (FOR INFORMATION ONLY)

ITEM	QUANTITY	UNIT
Conduit 2" PVC (with Pull Wire)	5811	L.F.
Street Light Auger Foundation	28	Each
Junction Box - 24" Dia.	5	Each

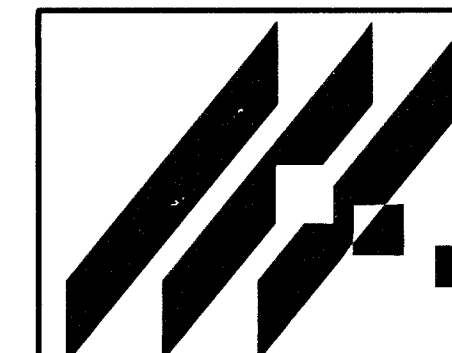

MID-KANSAS ENGINEERING
CONSULTANTS, INC.
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

SENECA STREET
PROJECT NAME

STREET LIGHTING PLAN
SHEET TITLE

DCH
DESIGN BY:

OCT. 2001
DATE

WNJ
DRAWN BY:

98092SL2
JOB NO.

DCH
CHECKED BY:

62 / 87
SHEET/OF

STREET LIGHT AUGER FOUNDATION FOR STEEL POLES