



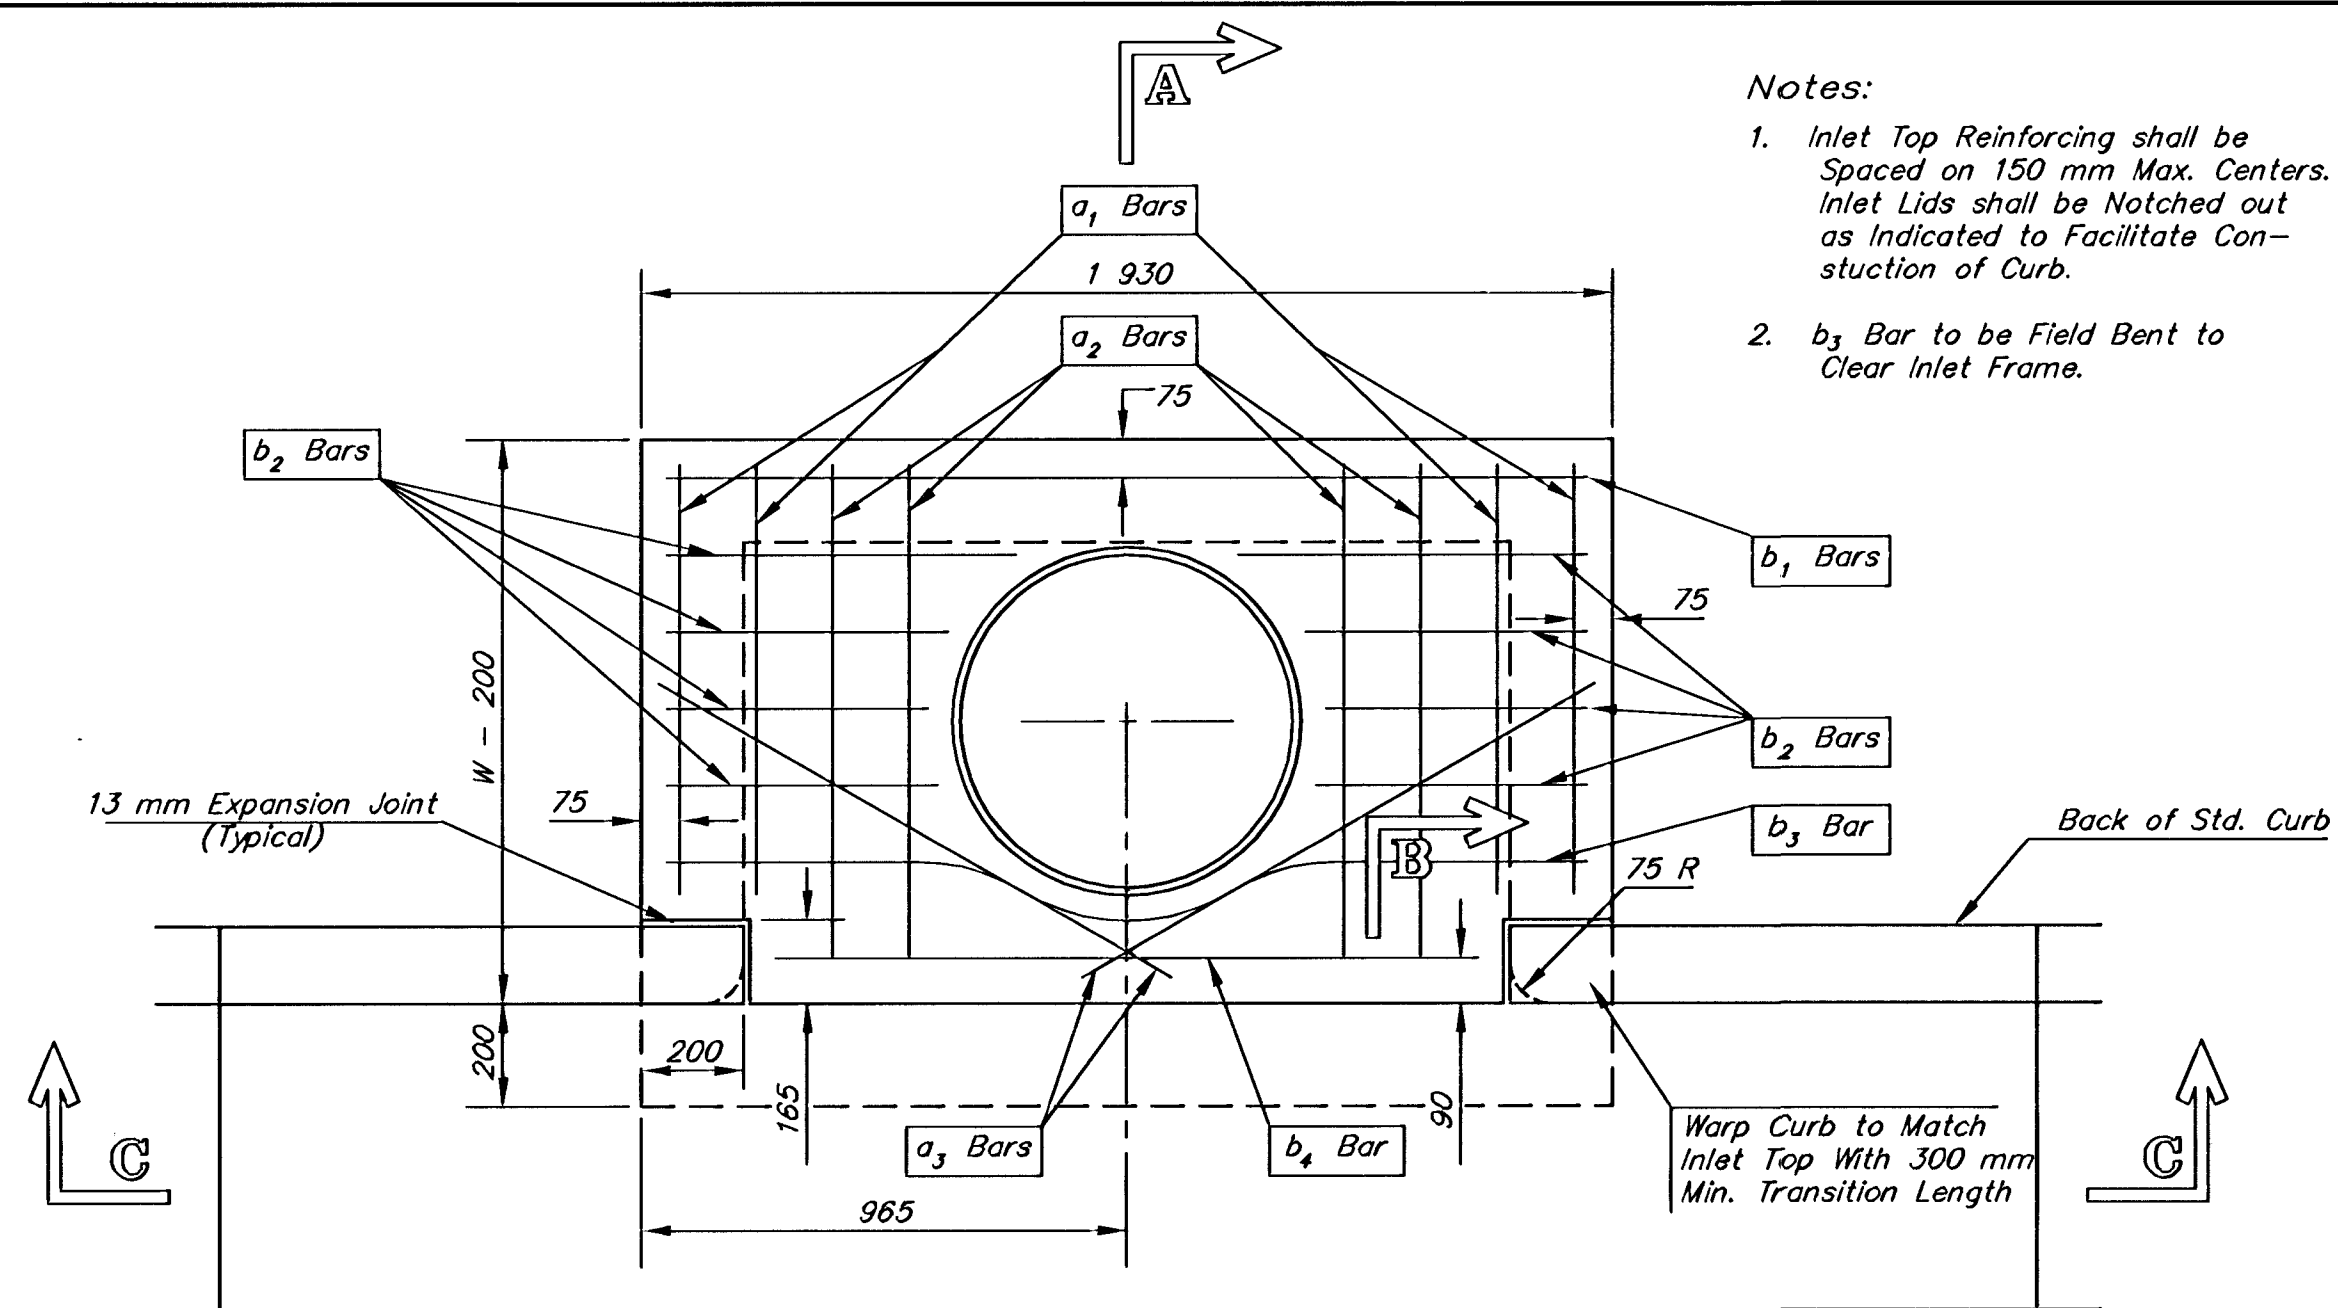

- Notes:
1. Inlet Top Reinforcing shall be Spaced on 150 mm Max. Centers. Inlet Lids shall be Notched out as Indicated to Facilitate Construction of Curb.
 2. b_3 Bar to be Field Bent to Clear Inlet Frame.

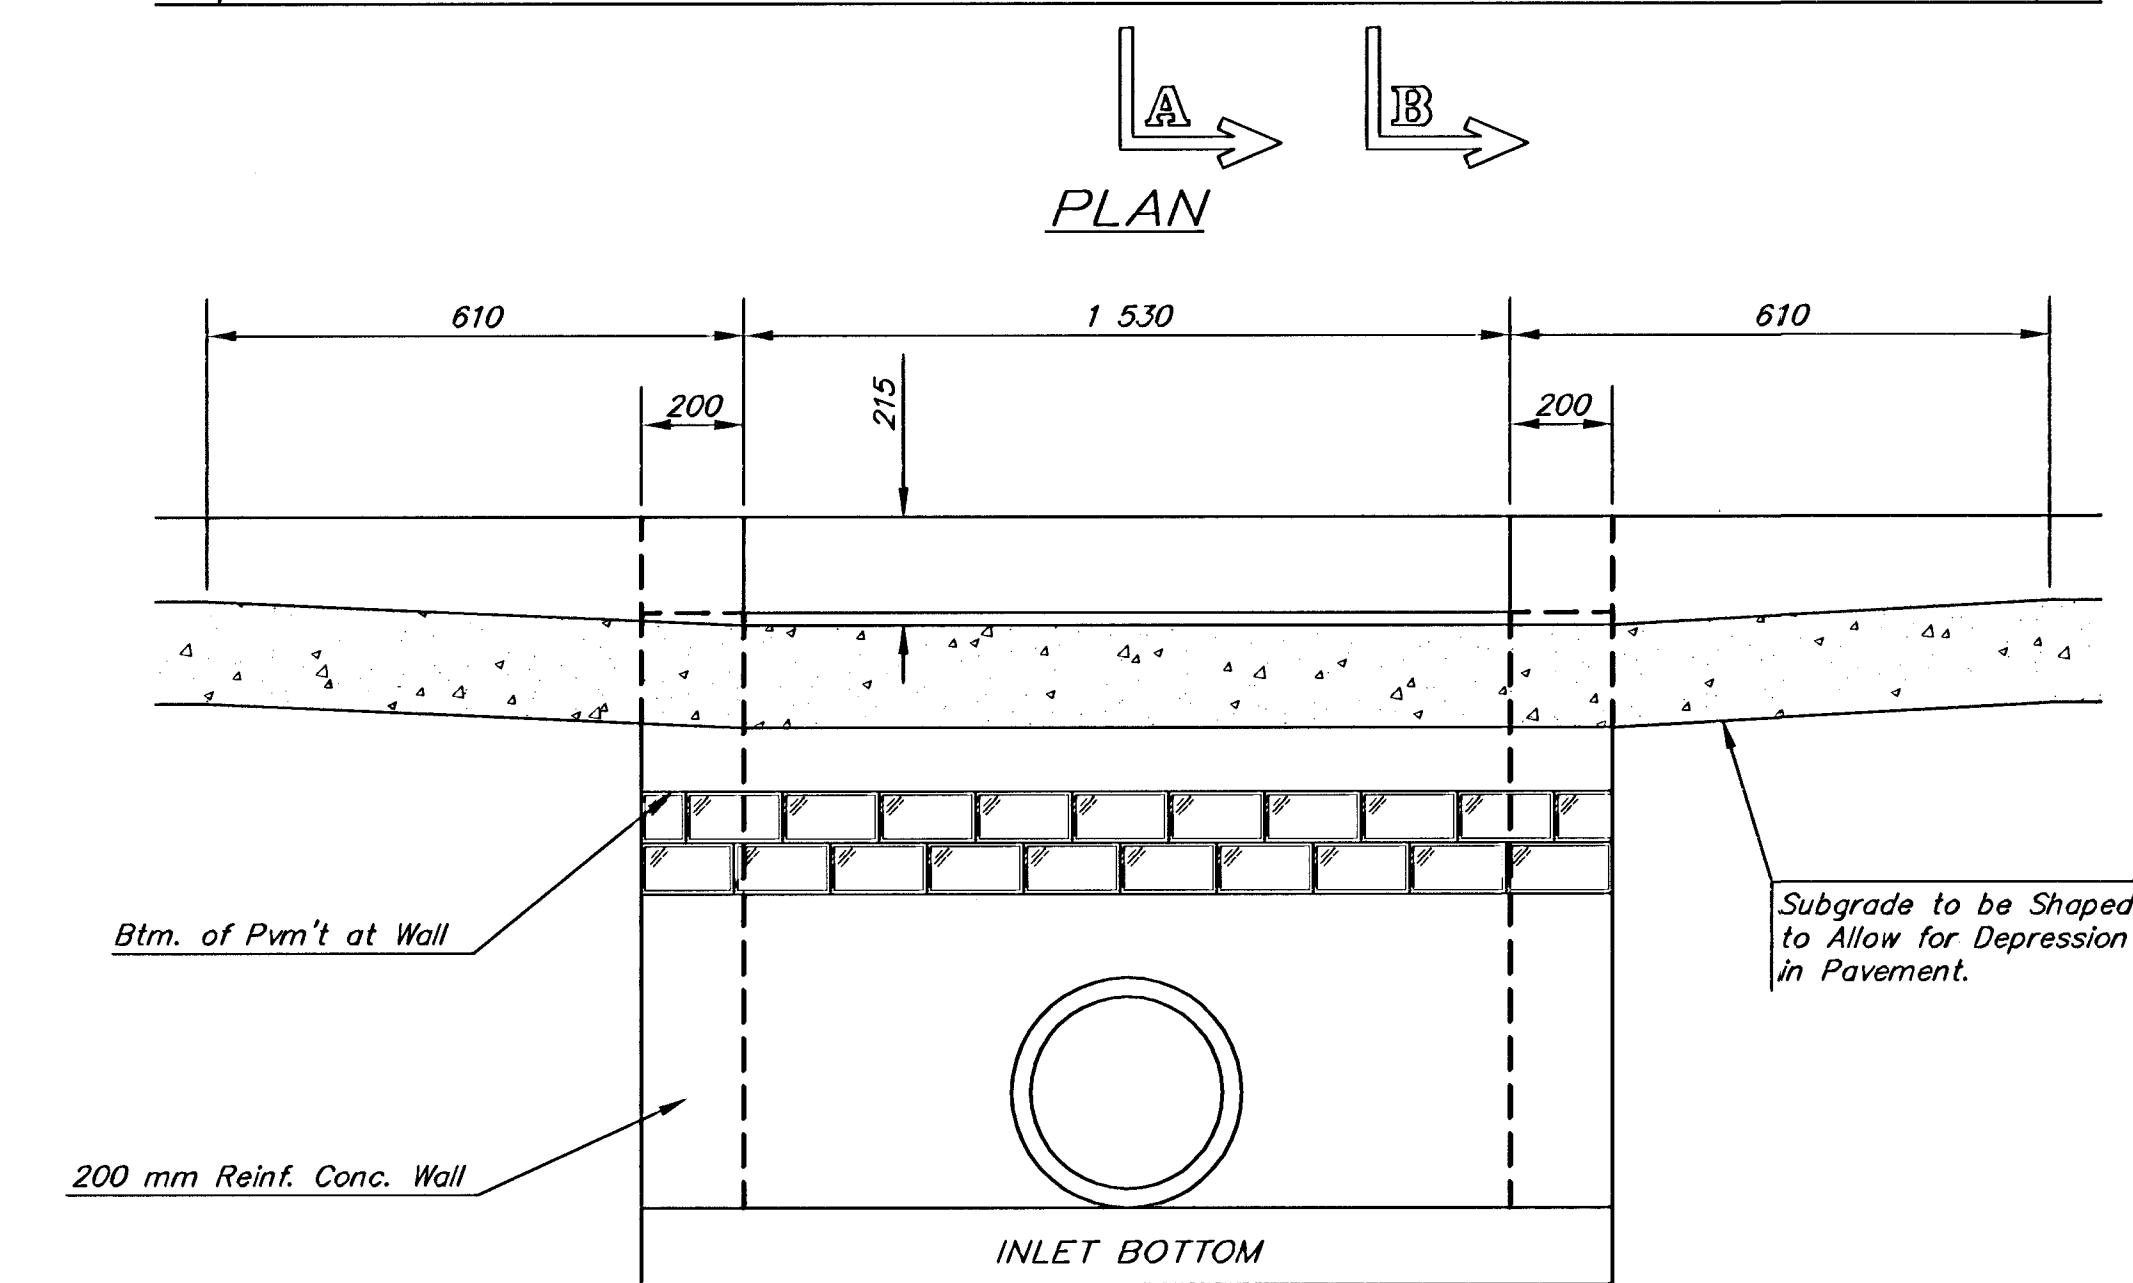


SECTION C-C

STEEL SCHEDULE


BAR	a_1	a_2	a_3	b_1					b_2	b_3	b_4	Wt. kg
NUMBER	4	4	2	1	3	5	7	9	6	1	1	
SIZE	#13	#13	#13	#13	#13	#13	#13	#13	#13	#13	#19	
LENGTH	W=1 320	1 700	2 010	1 420	1 855	-	-	-	535	1 880	1 420	27±
	W=1 630	2 310	2 615	1 525	-	1 855	-	-	535	1 880	1 420	37±
	W=1 930	2 920	3 225	1 830	-	-	1 855	-	535	1 880	1 420	46±
	W=2 240	3 530	3 835	2 135	-	-	-	1 855	535	1 880	1 420	55±
	W=2 540	4 140	4 445	2 440	-	-	-	-	1 855	535	1 880	64±

Note: a_3 Bars to be Placed Approx. 50 mm Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	m ³ CONC.
1 320	1 120 x 1 930 x 190	535 mm & SMALLER	0.29±
1 630	1 430 x 1 930 x 190	600 mm & 750 mm	0.39±
1 930	1 730 x 1 930 x 190	900 mm & 1 050 mm	0.49±
2 240	2 040 x 1 930 x 190	1 200 mm & 1 350 mm	0.59±
2 540	2 340 x 1 930 x 190	1 500 mm & 1 680 mm	0.69±

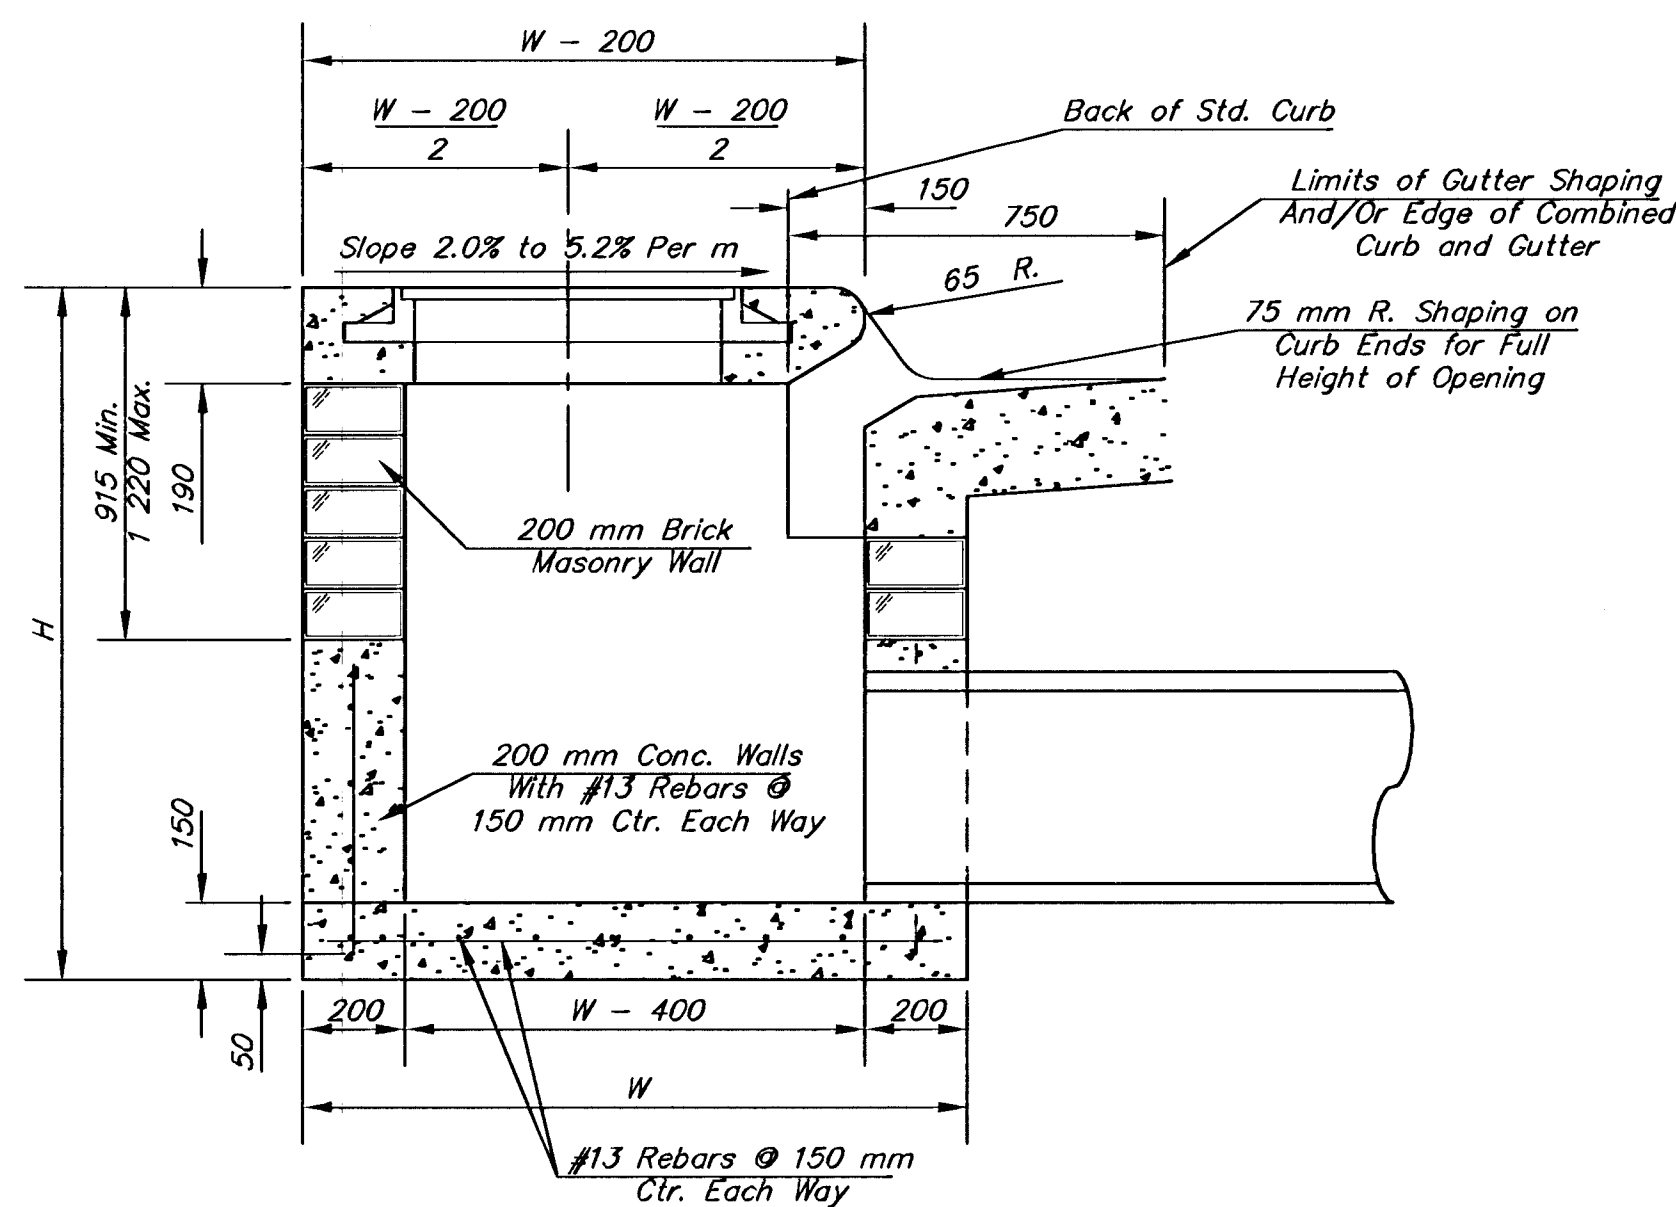


SECTION A-A

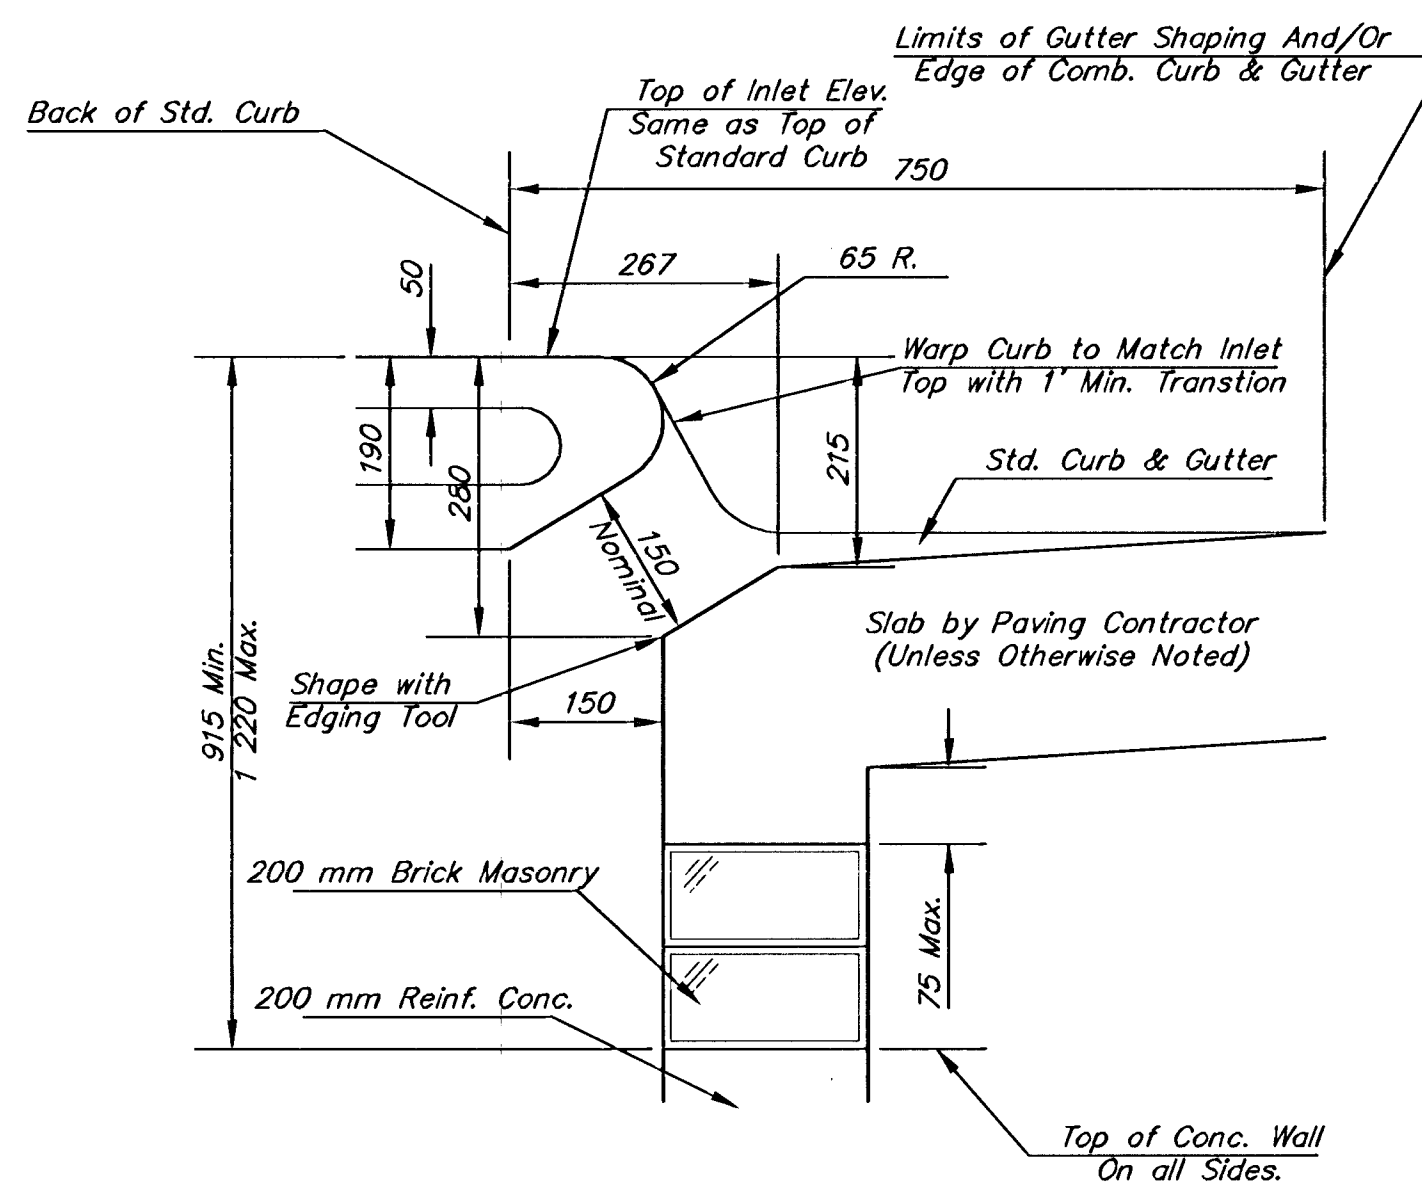

SECTION B-B


GENERAL NOTES

1. Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix.
2. Contractor shall have the option of constructing 200 mm brick masonry walls between the concrete inlet base and top on this inlet when W=1 930 mm and H=2 135 mm or less.
3. Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
4. The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

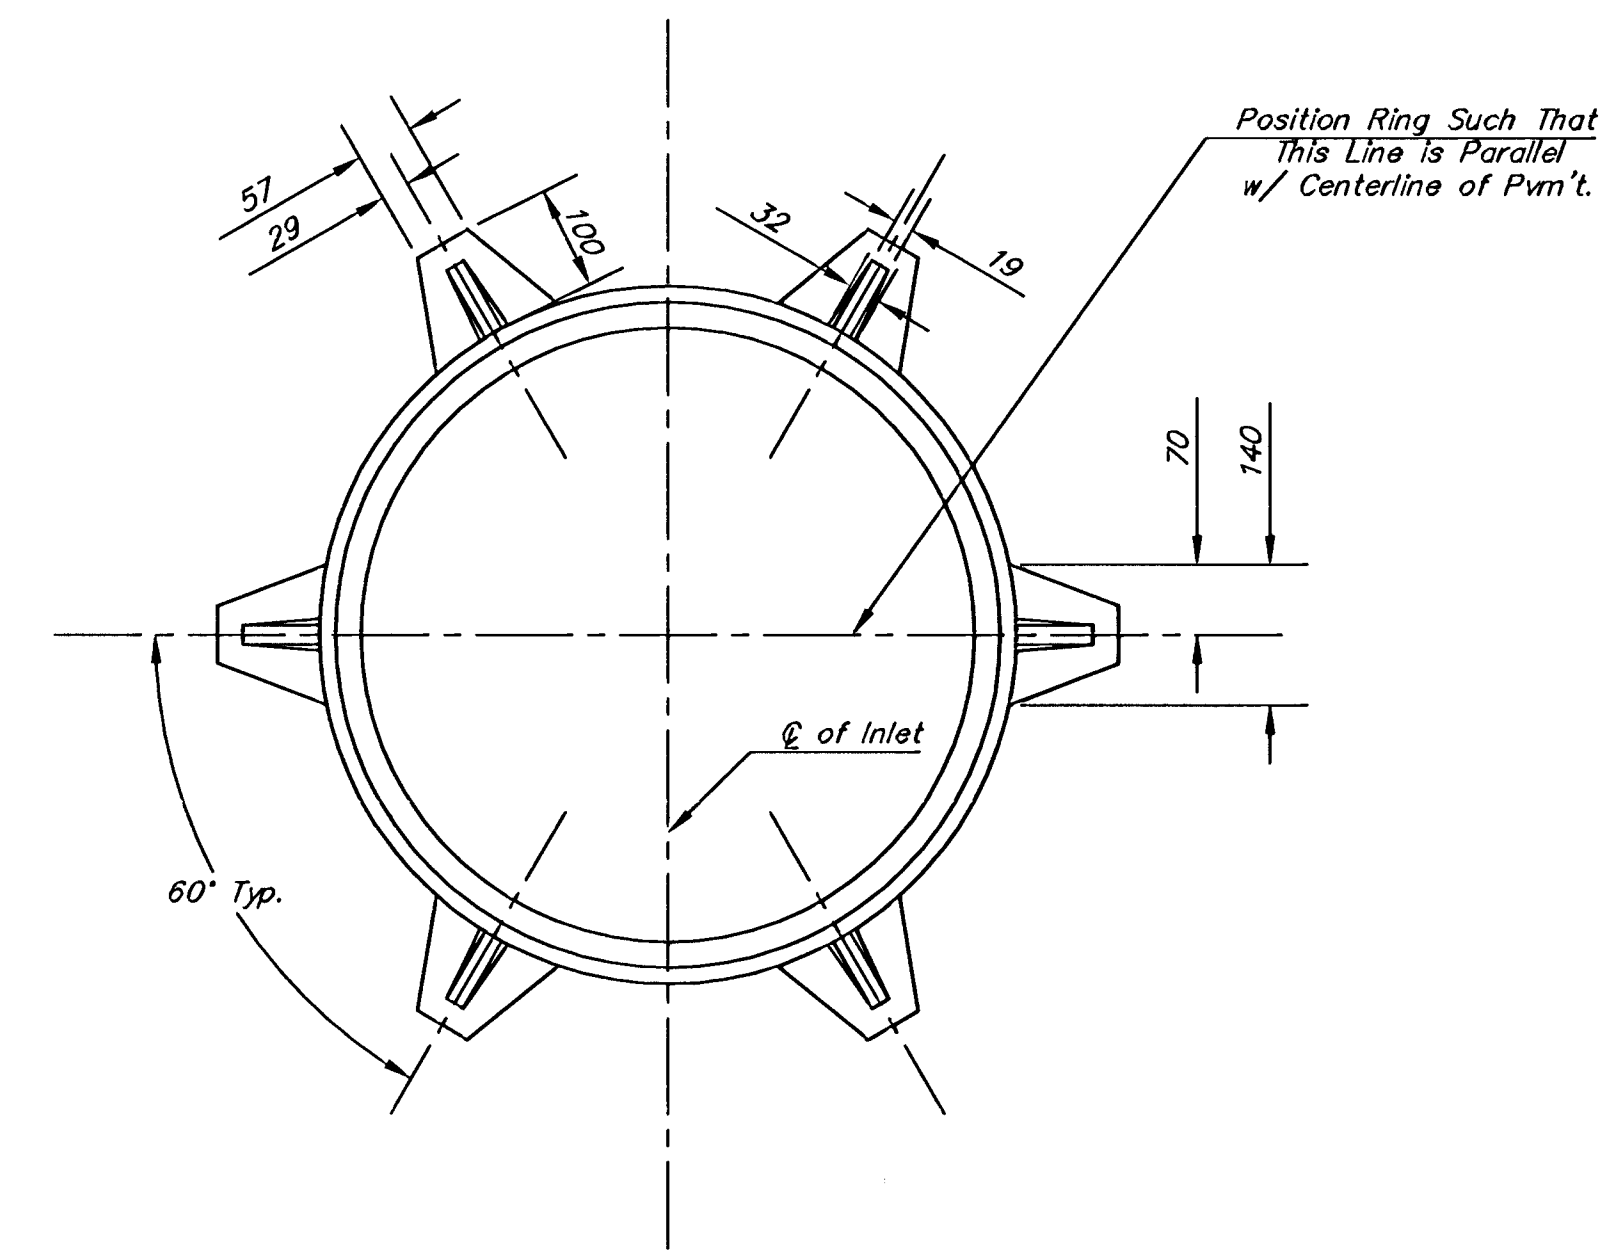

MANHOLE RING AND COVER

*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

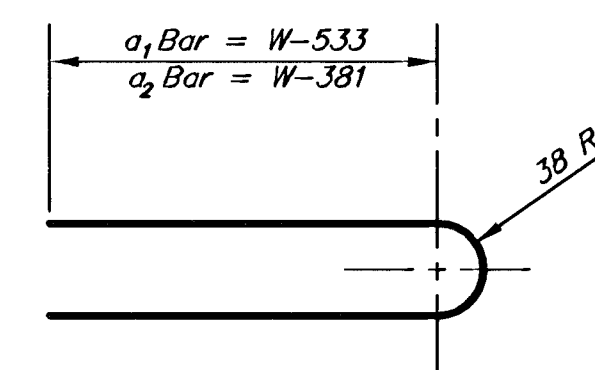

BENDING DIAGRAM

THE CITY OF WICHITA CITY ENGINEER'S OFFICE CITY HALL - SEVENTH FLOOR 455 NORTH MAIN STREET WICHITA, KANSAS 67202 (316) 268-4501 (316) 268-4114 FAX	STANDARD TYPE 1 CURB INLET OPENING = 150 x 1 530	
	M. E. LINDEBAK P.E. - CITY ENGINEER	
	PROJECT NUMBER 87 N-0287-01	INDEX CODE XXXXXX
	DATE MAR 96	SHEET 36 OF 107