BENCHMARK:

BM #1 - Mag Nail in Asphalt Parking Lot Pavement.
Elev. = 1305.73 (NAVD 88)

BM #2 - Chiseled "X" on Top of Curb on the South Curb Return of Park Drive
Elev. = 1306.28 (NAVD 88)

Prior to Beginning Construction, The Contractor Shall Excavate the Ex. 8" Water Line at Sta. 0+00.00 to Verify Size and Location. All Necessary Adjustments to the Proposed and Existing Water Lines to Make the Connections, Including Additional Water Line and Fittings, Shall be Considered SUBSIDIARY to the Water Line Installations.

Washington Avenue
Addition
Sherwin Williams
1705 N Wabash Ave.

Jake R. Kirkland Revocable Trust
3700 Palos Verdes
Valley Center, KS 67147

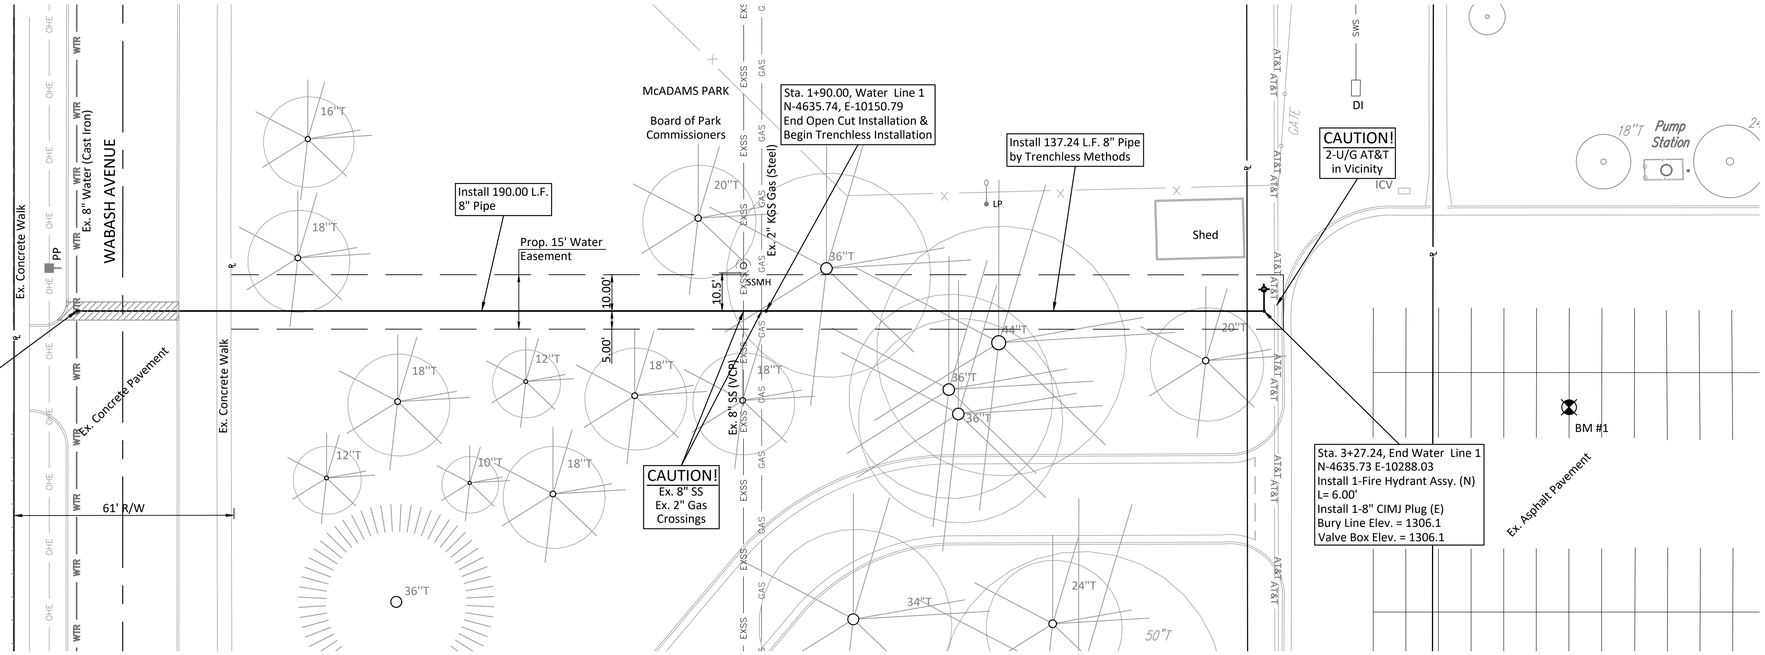

Sta. 0+00.00, Begin Water Line 1
N-4635.76, E-9960.79
City of Wichita to Tap Ex. 8" Cast Iron Water Line and Install 8" Tapping Sleeve and Valve. Contractor to Install Valve Box and Block as Necessary.
Valve Box Elev. = 1305.8

Sta. 3+27.24, End Water Line 1
N-4635.73 E-10288.03
Install 1-Fire Hydrant Assy. (N)
L= 6.00'
Install 1-8" CIMJ Plug (E)
Bury Line Elev. = 1306.1
Valve Box Elev. = 1306.1

Note:
Pavement, Sidewalks, Etc. To Be Removed Are Indicated By:

SCALE:
1" = 20' Horizontal
1" = 5' Vertical

WATER LINE 1

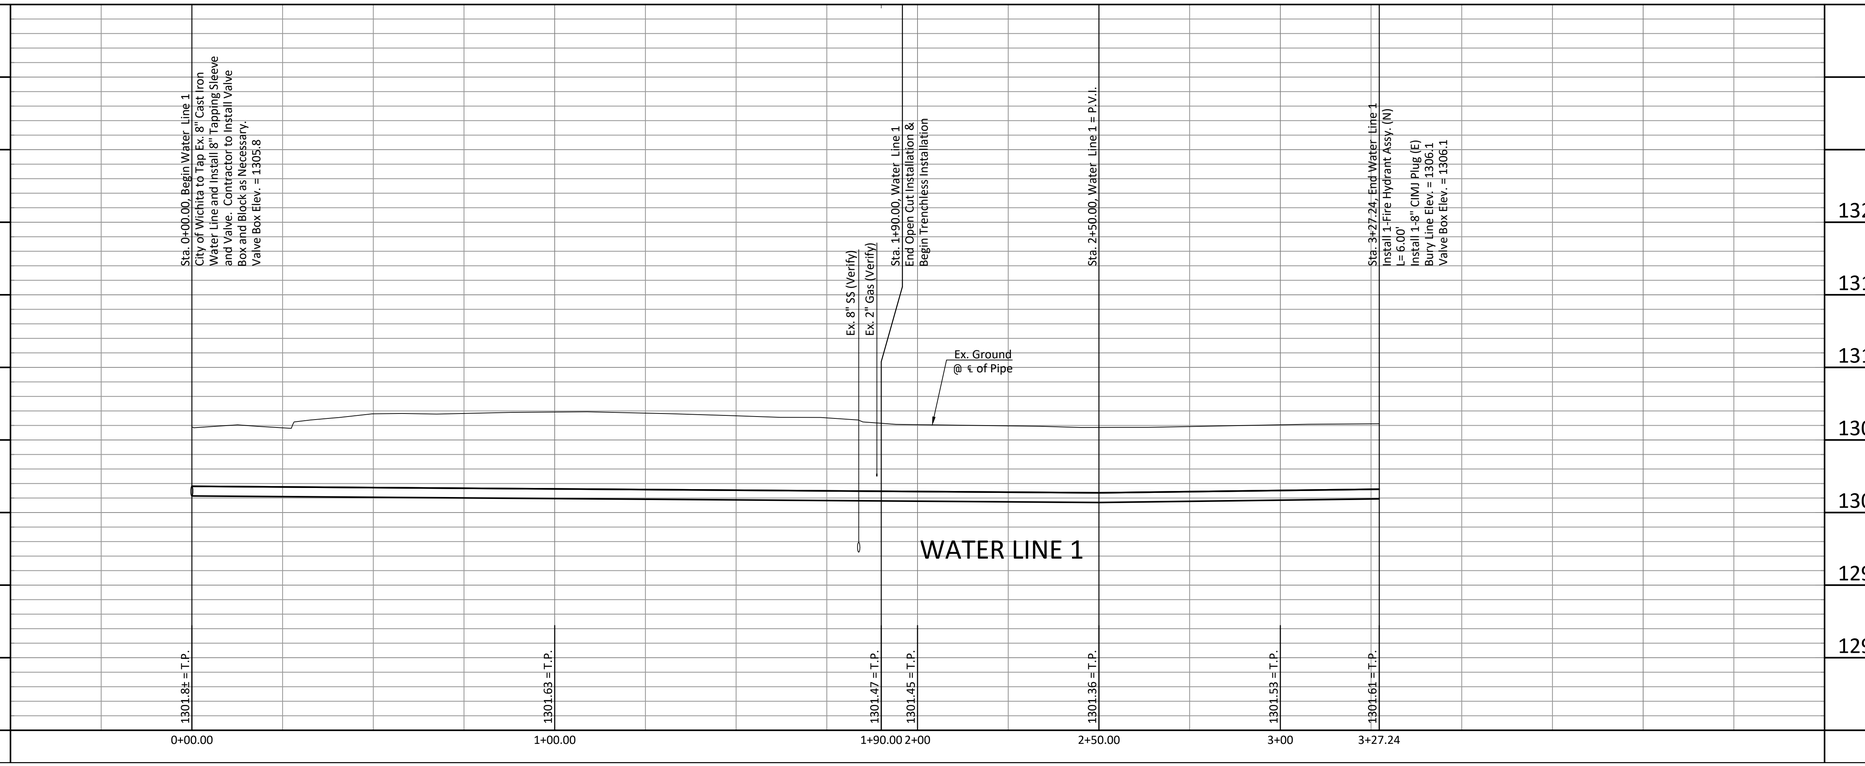

BAUGHMAN COMPANY
315 Ellis St. Wichita, KS 67211 316-262-7271
BaughmanCo.com

CAPITAL IMPROVEMENT PROJECT
McAdams Park Water Line
Sta. 0+00.00 - Sta. 3+27.24
McAdams Park Water Line Improvements

PROJECT NUMBER: 448-90910
INTERNAL NUMBER: 18-04-E991
DESIGN: TPV
DRAWN: TPV
DATE: July 2018
SHEET 3 OF 10