

**Notes:**  
 The downspout boot/shoe shall be considered **SUBSIDIARY** to the bid item, "Pipe, SWS 8"

All work, labor, and material necessary to install the downspout boot/shoe and connect the pipe to the proposed inlet shall be considered **SUBSIDIARY** to the bid item, "Pipe, SWS 8"

The 8" pipe shall be PVC unless otherwise noted on the plans. Material other than PVC shall be submitted and approved by the Engineer.



The Contractor shall not damage any part of the existing side of the building structure upon installation. The Contractor is responsible for any damage to the existing building upon installation and shall repair the exterior to its original state.

The downspout boot/shoe is required to have a cleanout hole for easy access to clean out the line.

Shop drawings shall be submitted for approval prior to the downspout boot/shoe being installed. The materials used shall meet the City of Wichita Specifications and approved material lists.

Minimum slope for the 8" pipe needs to be 1.0% to maintain cleanout velocity into the inlet.

DOWNSPOUT BOOT/SHOE DETAIL  
 N.T.S.

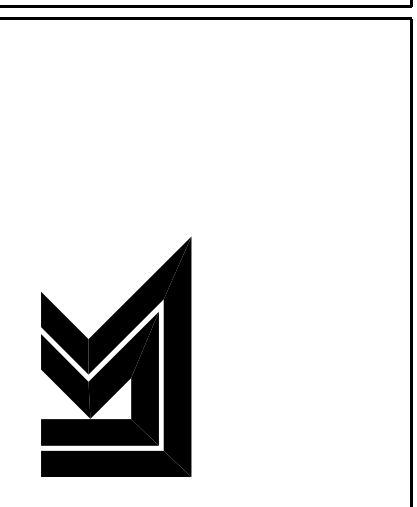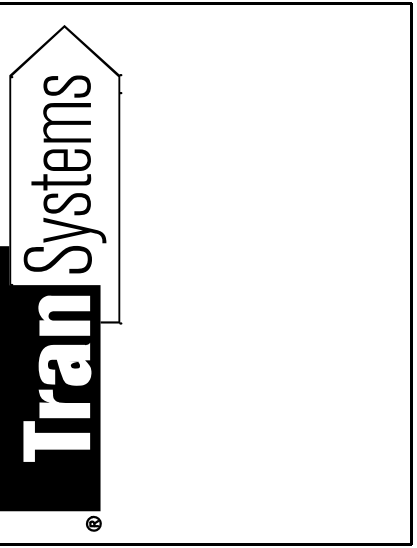

2ND STREET IMPROVEMENTS  
 SANTA FE TO WASHINGTON IN OLD TOWN

REVISIONS:	MARK	DATE	DESCRIPTION

PROJ NO: 472-85284  
 SCALE: N.T.S.  
 DATE: 7/11/2018  
 DESIGNED BY: TAU  
 DRAWN BY: TAU  
 CHECKED BY: MDB

SHEET TITLE:  
**DOWNSPOUT  
 BOOT/SHOE  
 DETAIL**

SHEET NO.  
**32**