
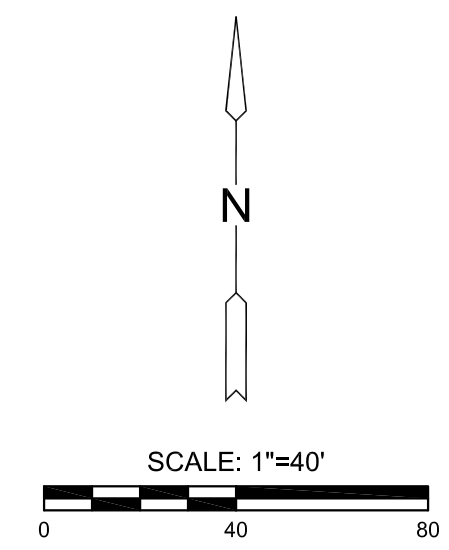


ST. STA. 10+31.86, 55.5 RT.
 1-FIRE HYDRANT ASSEMBLY
 L=10'
 BURY LINE=1278.60
 VALVE BOX=1278.35
 CONTRACTOR TO FIELD VERIFY
 EXIST. WATER LINE LOCATION &
 ELEVATION

NOTE:
 CONTRACTOR TO VERIFY LOCATION
 AND ELEVATION OF EXISTING WATER
 LINE PRIOR TO CONSTRUCTION.

ST. STA. 10+64.78, 238.6' LT.
 1-FIRE HYDRANT ASSEMBLY
 L=4'
 BURY LINE=1279.25
 VALVE BOX=1279.07
 CONTRACTOR TO FIELD VERIFY
 EXIST. WATER LINE LOCATION &
 ELEVATION

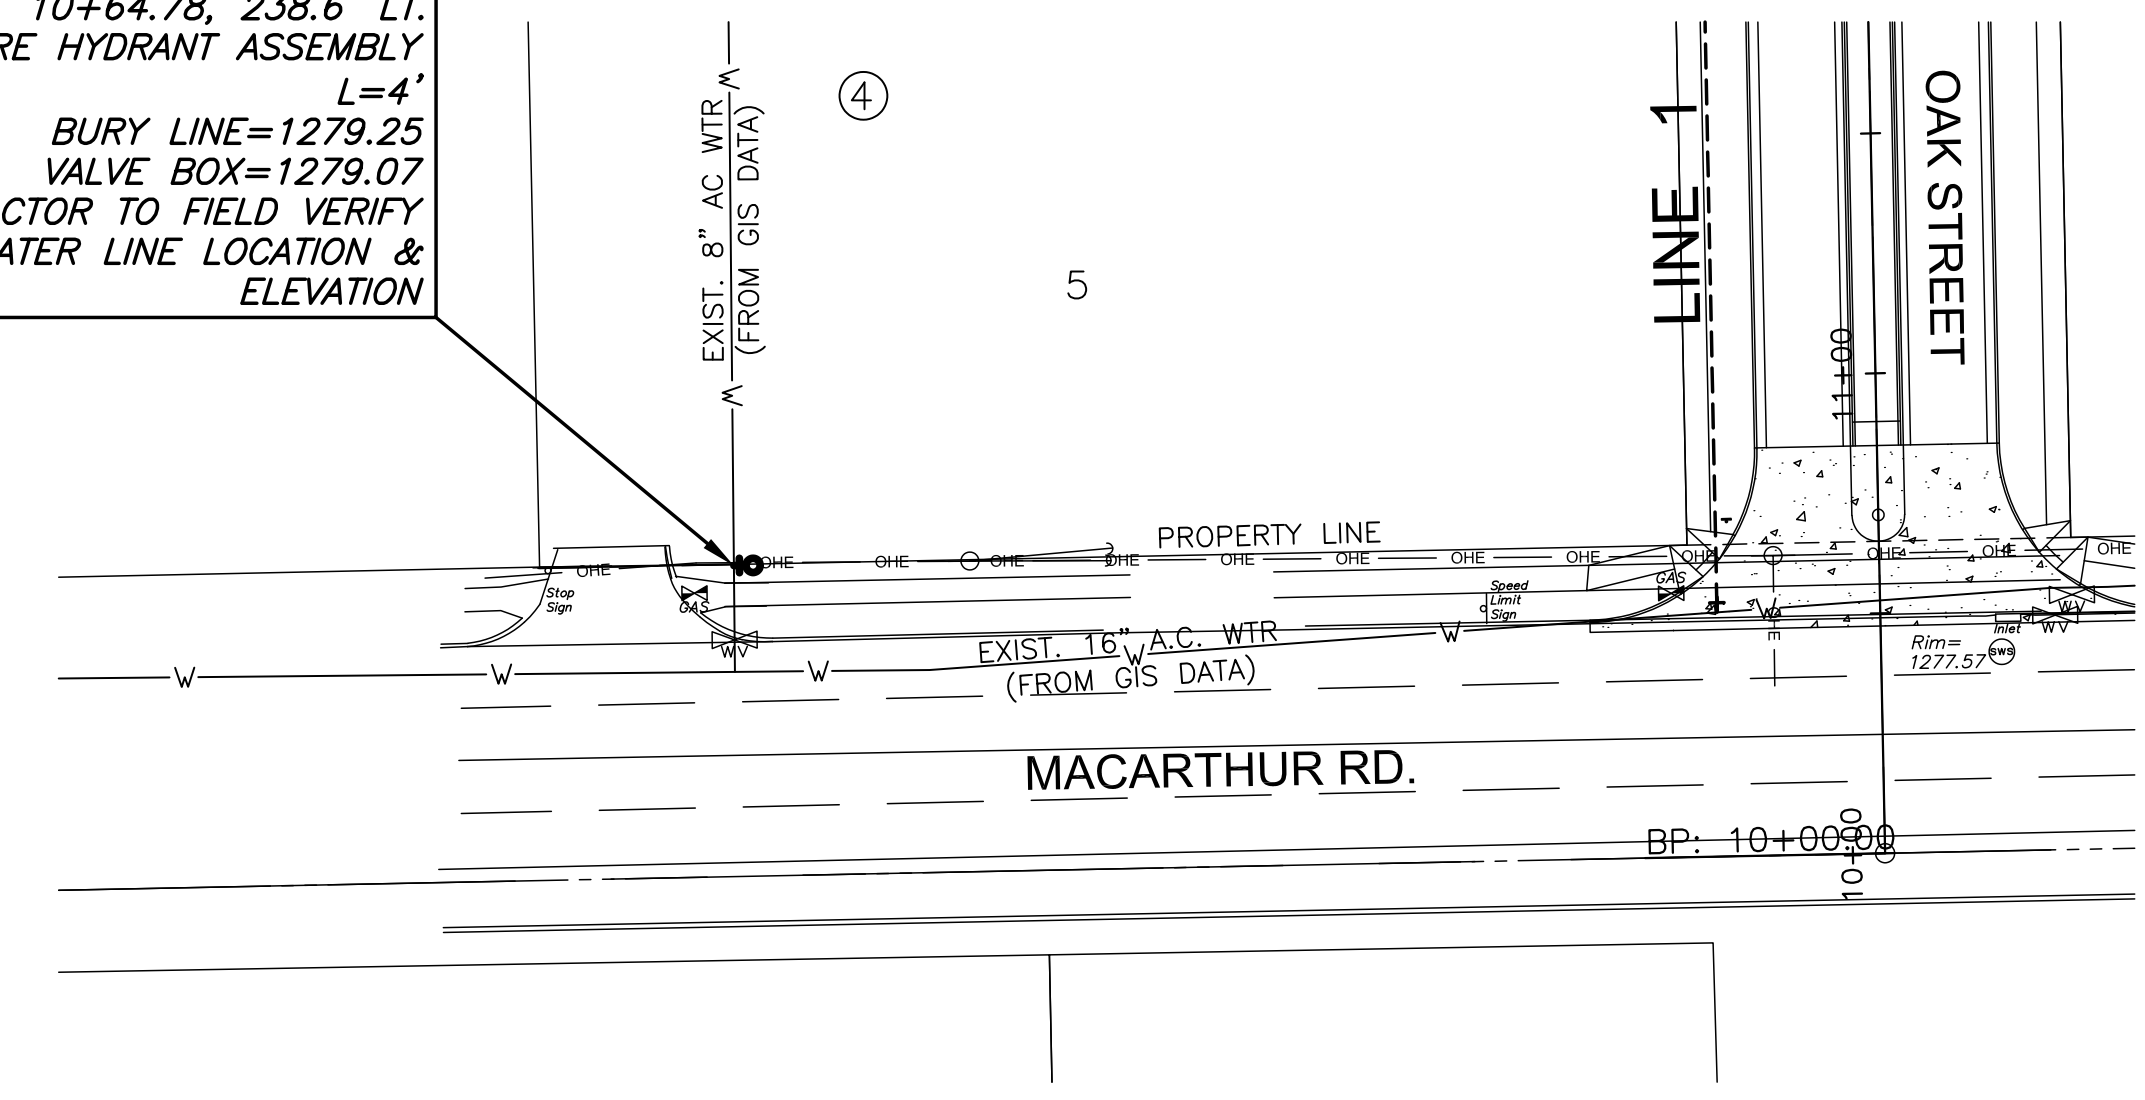

WATER DISTRIBUTION PLANS FOR
STEEPLE BAY ADDITION
 WICHITA, KANSAS

©2018
 MKEC Engineering
 All Rights Reserved
 www.mkec.com
 These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

FIRE HYDRANT ADDITIONS

PROJECT NO.	448-90894	
DATE	JULY 2018	
SCALE	1"=40'	
DESIGNED	DRAWN	CHECKED
SPE	MKB	SPE

NO.	REVISION	DATE

SHEET NO.
 06 OF 15

