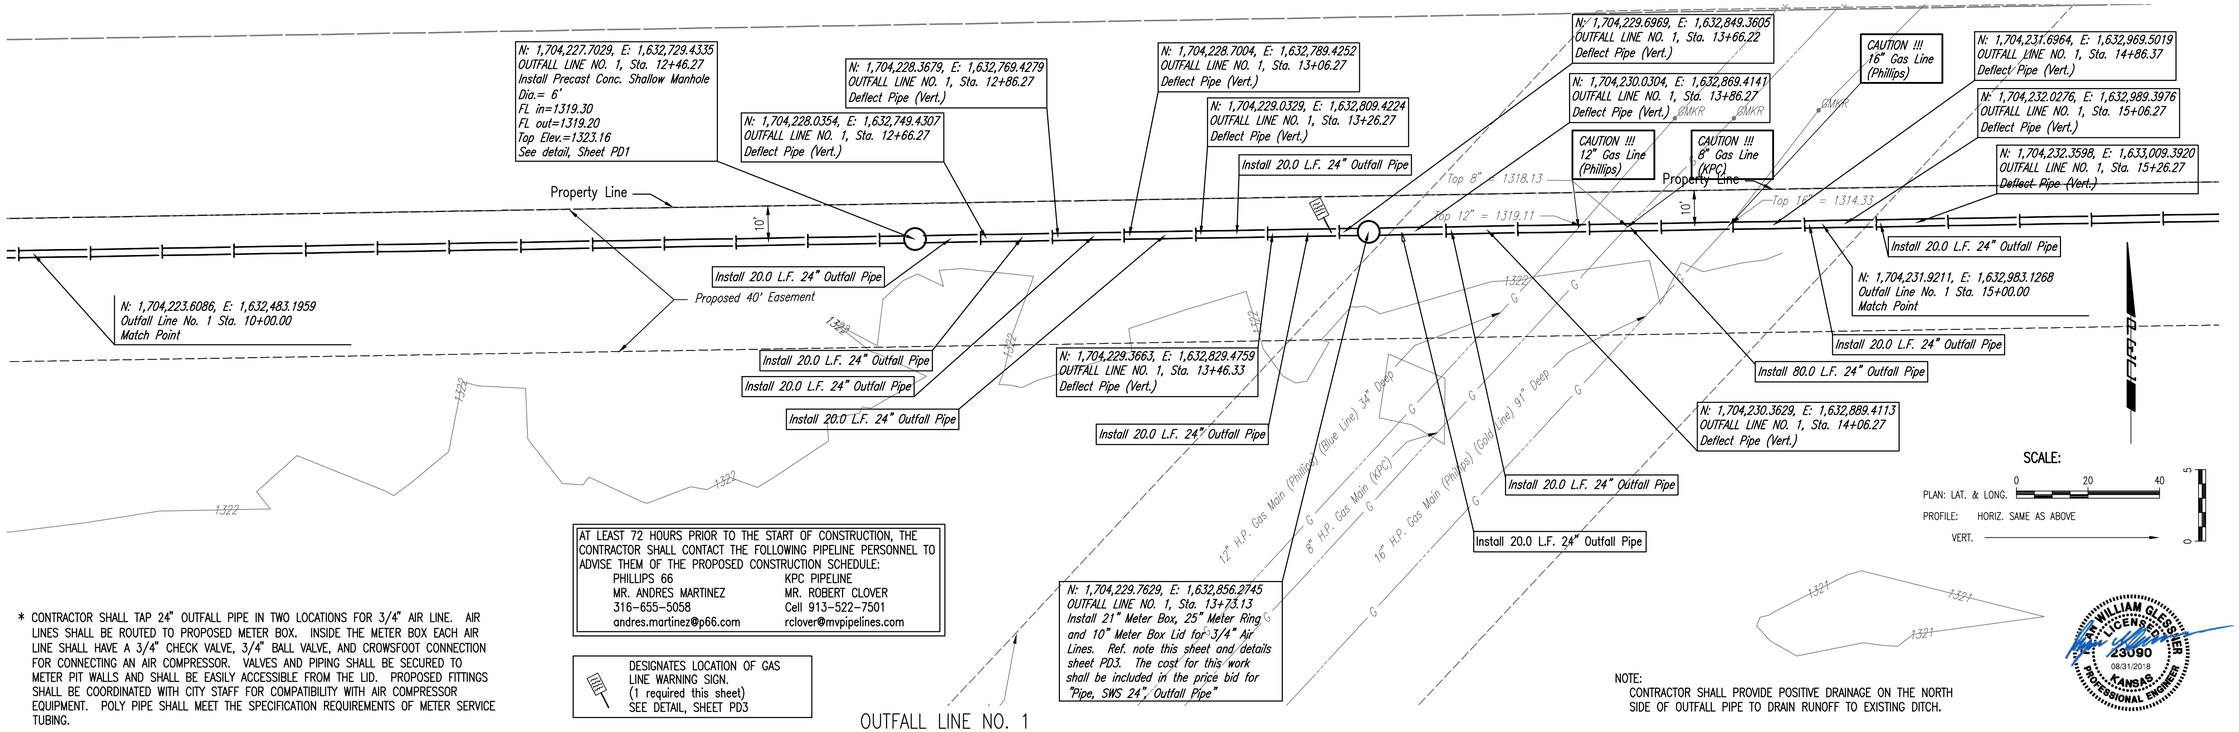

AT LEAST 72 HOURS PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR SHALL CONTACT THE FOLLOWING PIPELINE PERSONNEL TO ADVISE THEM OF THE PROPOSED CONSTRUCTION SCHEDULE:

PHILLIPS 66	KPC PIPELINE
MR. ANDRES MARTINEZ	MR. ROBERT CLOVER
316-655-5058	Cell 913-522-7501
andres.martinez@p66.com	rclover@mvpipelines.com

DESIGNATES LOCATION OF GAS LINE WARNING SIGN.
(1 required this sheet)
SEE DETAIL, SHEET PD3

* CONTRACTOR SHALL TAP 24" OUTFALL PIPE IN TWO LOCATIONS FOR 3/4" AIR LINE. AIR LINES SHALL BE ROUTED TO PROPOSED METER BOX. INSIDE THE METER BOX EACH AIR LINE SHALL HAVE A 3/4" CHECK VALVE, 3/4" BALL VALVE, AND CROWSFOOT CONNECTION FOR CONNECTING AN AIR COMPRESSOR. VALVES AND PIPING SHALL BE SECURED TO METER PIT WALLS AND SHALL BE EASILY ACCESSIBLE FROM THE LID. PROPOSED FITTINGS SHALL BE COORDINATED WITH CITY STAFF FOR COMPATIBILITY WITH AIR COMPRESSOR EQUIPMENT. POLY PIPE SHALL MEET THE SPECIFICATION REQUIREMENTS OF METER SERVICE TUBING.

OUTFALL LINE NO. 1

NOTE:
CONTRACTOR SHALL PROVIDE POSITIVE DRAINAGE ON THE NORTH SIDE OF OUTFALL PIPE TO DRAIN RUNOFF TO EXISTING DITCH.

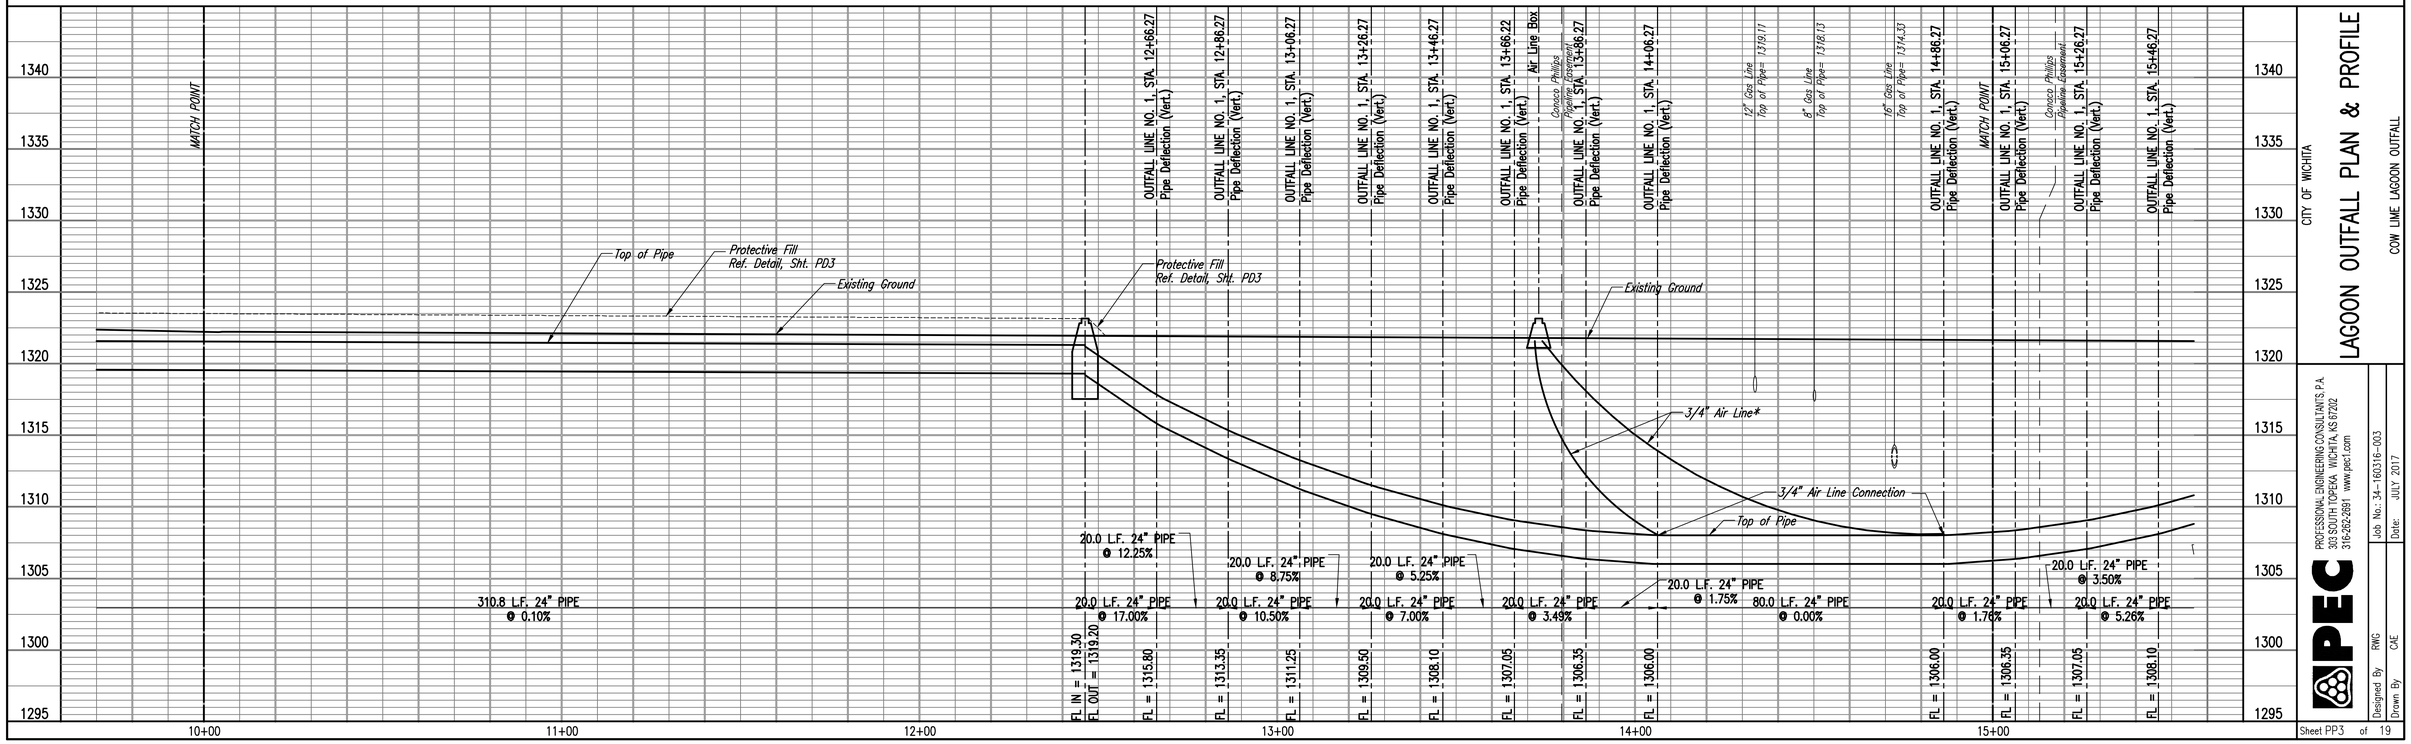

CITY OF WICHITA

LAGOON OUTFALL PLAN & PROFILE

COW LINE LAGOON OUTFALL

PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
303 SOUTH TOPEKA WICHITA, KS 67202
316-262-2691 www.pec1.com

Job No.: 34-160316-003
Date: JULY 2017
Designed By RWG
Drawn By CAE
Sheet PP3 of 19

PLAN | CHECKED | CHECKED | BY | DATE

PROFILE | CHECKED | CHECKED | BY | DATE

Saved 08-30-2018 9:48:00 AM by KURTIS.DEKAT
Plot Scale 1:1 08-31-2018 8:27:33 AM by KURTIS.DEKAT
U:\Wichita-Com\2016\160316\d03\Mxd\Drawings\PP3 LAGOON OUTFALL PLAN & PROFILE