


FIRE HYDRANTS REQUIRED				
Line No. - Street, Station	Bury Line Elevation	Top of Pipe Elevation	Hydrant Bury Required	Valve Stem Extension Required
Line 1 - Greenway, 4+10.00	1280.37	1276.54	4.50	
Line 2A - Wassall, 0+14.50	1281.95	1278.12	4.50	
Line 2B - Wassall, 0+10.00	1281.95	1278.12	4.50	
Line 3 - Santa Fe, 4+58.55	1282.49	1278.16	5.00	
Line 3 - Santa Fe, 10+62.88	1283.50	1279.67	4.50	
Line 4 - Mosley, 5+00.00	1282.20	1278.37	4.50	
Line 5 - Mosley, 0+15.00	1283.10	1279.27	4.50	
Line 5 - Mosley, 7+37.00	1284.53	1280.70	4.50	
Line 5 - Mosley, 15+31.00	1285.10	1281.27	4.50	
Line 6 - Ida, 0+10.00	1283.50	1279.17	5.00	
Line 6 - Ida, 6+71.00	1284.35	1280.52	4.50	
Line 6 - Ida, 12+48.45	1285.55	1281.72	4.50	
Line 7 - Marion, 0+20.00	1283.92	1280.09	4.50	
Line 7 - Marion, 7+35.71	1282.75	1278.92	4.50	
Line 8 - Pattie, 0+24.38	1282.34	1278.51	4.50	
Line 8 - Pattie, 6+64.38	1283.61	1279.78	4.50	
Line 8 - Pattie, 13+49.38	1285.65	1281.82	4.50	
Line 9 - Ellis, 0+71.13	1281.80	1277.97	4.50	
Line 9 - Ellis, 7+05.13	1282.70	1278.37	5.00	
Line 9 - Ellis, 13+59.13	1283.40	1279.57	4.50	
Line 10, Denker, 7+15.00	1281.90	1278.07	4.50	
Line 10, Denker, 12+42.88	1281.10	1277.27	4.50	

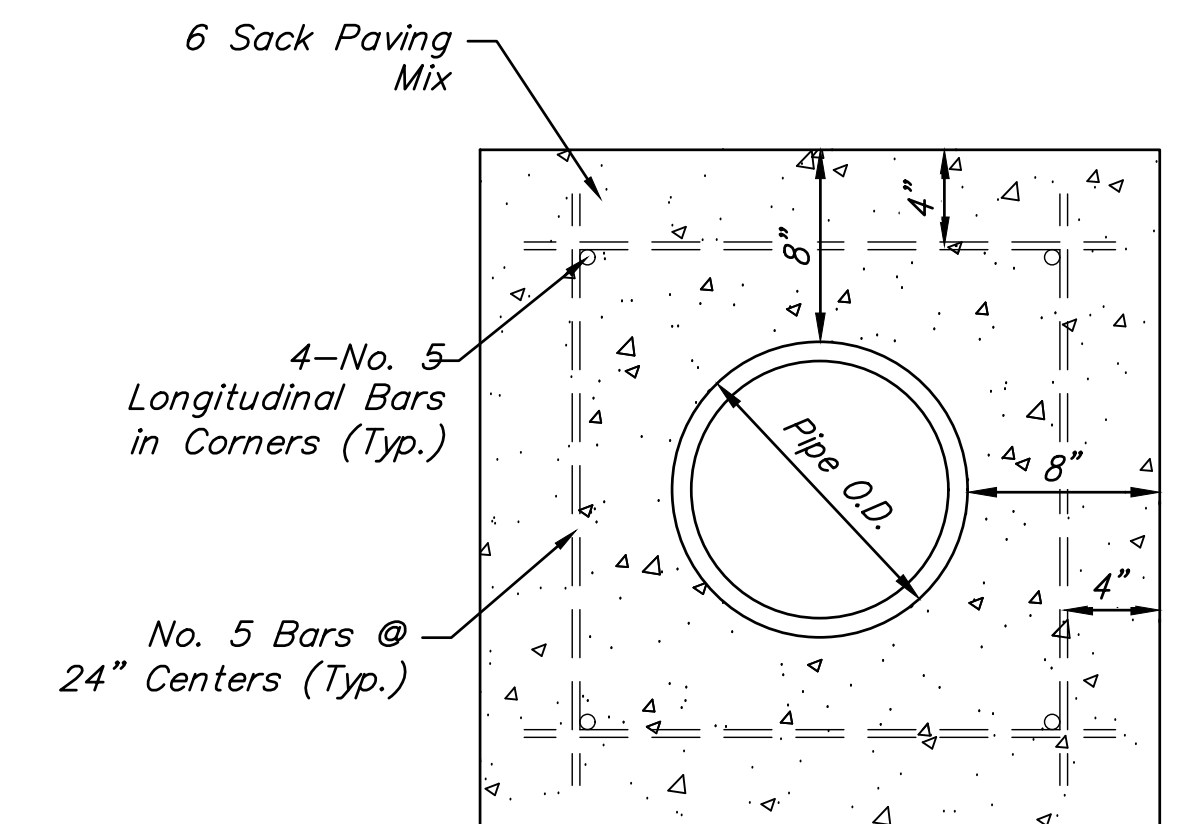

CONCRETE ENCASEMENT DETAIL

ROSE MARIE WATER - Part A Hydrant Table			
	<p>GARVER 924 N. MAIN WICHITA, KS 67203 316-264-8008 WWW.GARVERUSA.COM</p>	DATE	4/2/2018
		DESIGN	CMB / RA
PROJECT NUMBER	GARVER JOB NO.	DWG. SCALE	SHEET
448-90721	4701W	...	3
DRAWING FILE	4701W Water Details-Part A [Hydrant Table]		OF
			57