

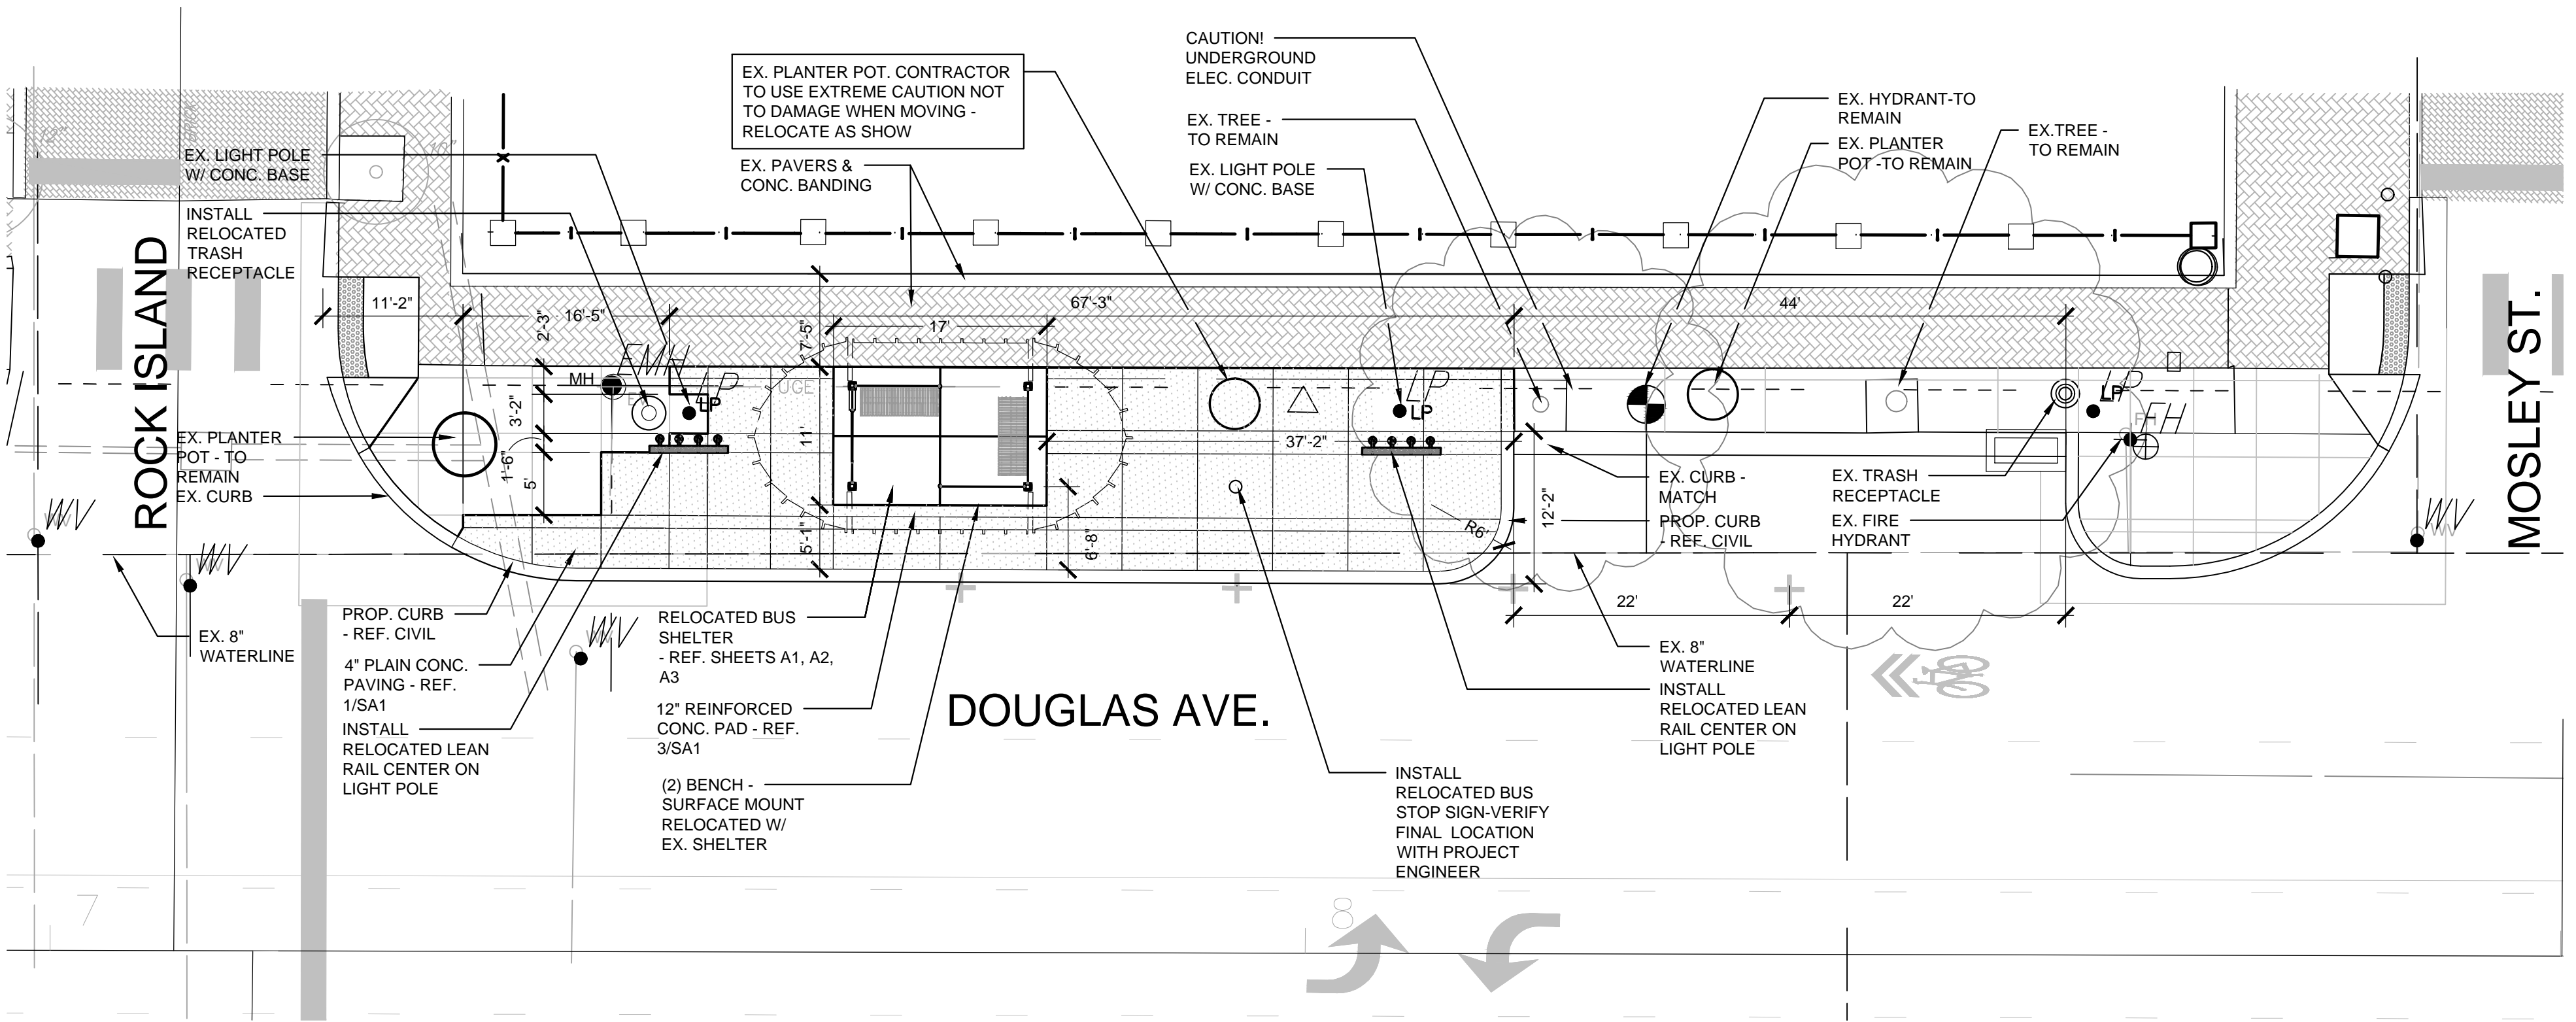


**A SITE DEMOLITION PLAN**  
 1" = 10'-0"  
 0 2.5 5 10 20  
 NORTH

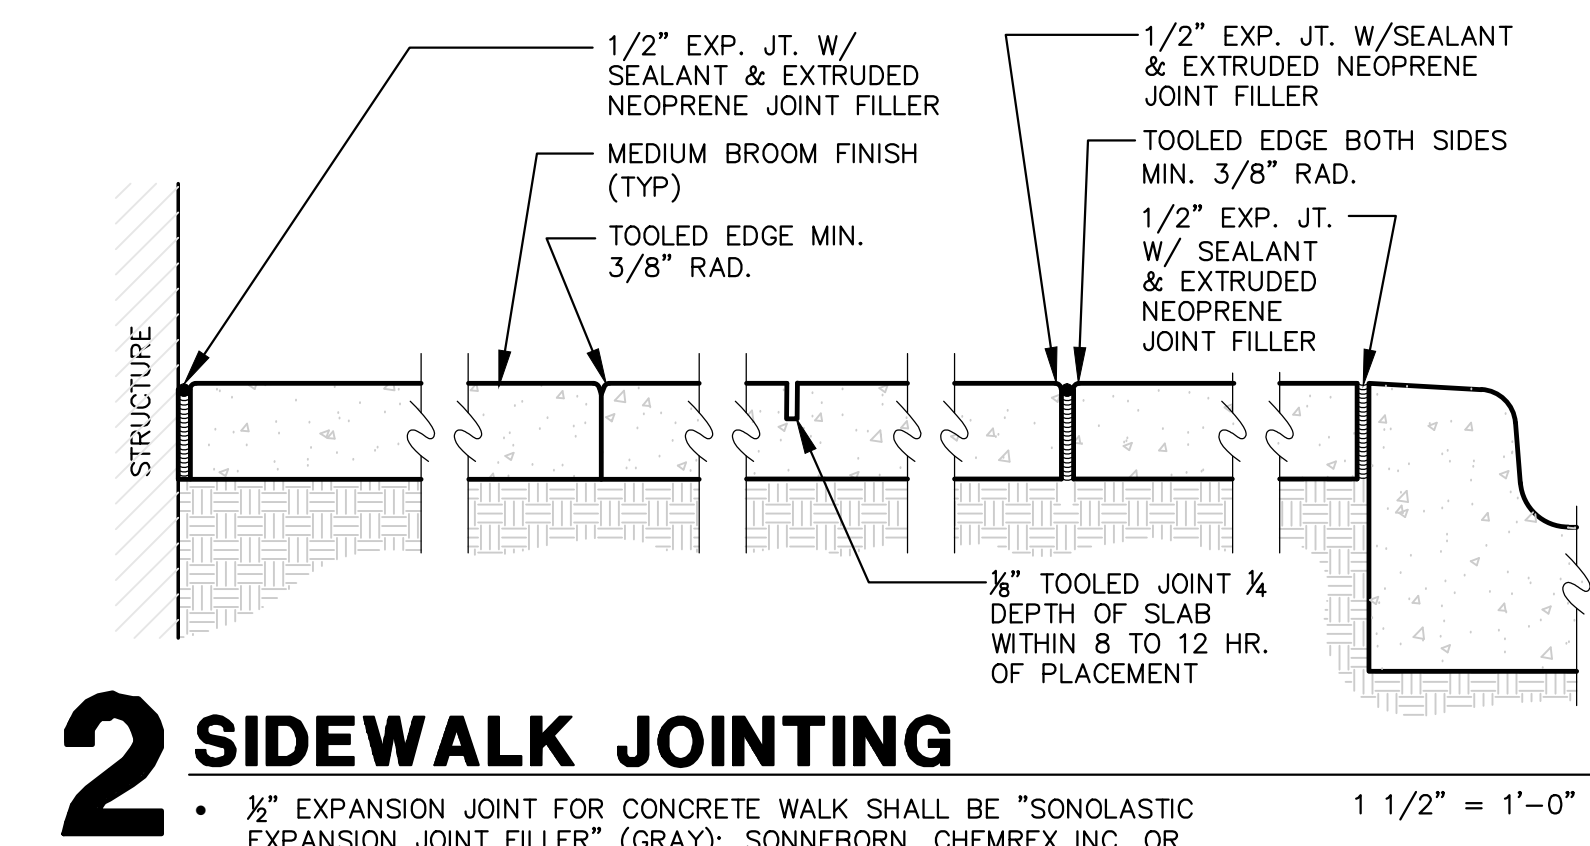


**B SITE ARCHITECTURAL PLAN**  
 1" = 10'-0"  
 0 2.5 5 10 20  
 NORTH

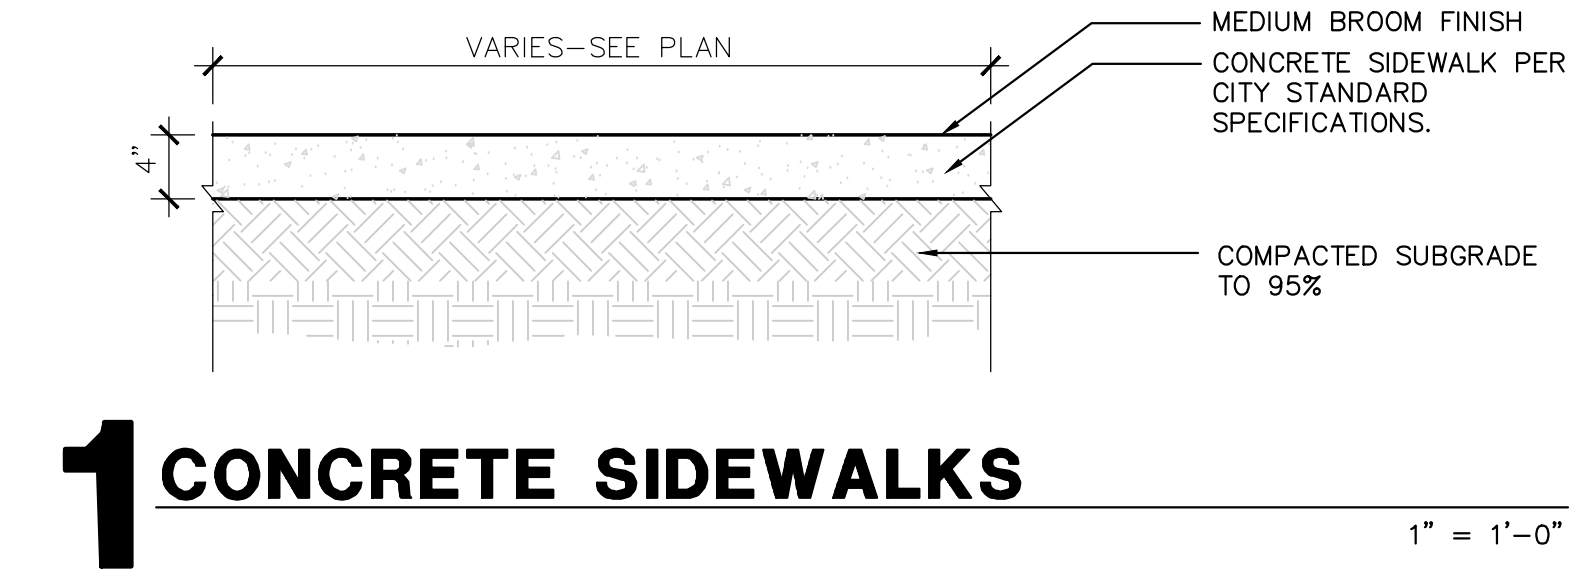

**2 SIDEWALK JOINTING**  
 1 1/2" = 1'-0"

- 1/2" EXPANSION JOINT FOR CONCRETE WALK SHALL BE "SONOLASTIC EXPANSION JOINT FILLER" (GRAY): SONNEBORN, CHEMREX INC. OR APPROVED EQUIVALENT
- SEALANT SHALL BE MULTI-PART POURABLE URETHANE SEALANT: "FOURTHANE", W.R. MEADOWS, INC. OR APPROVED EQUIVALENT.
- ALL LABOR AND MATERIALS FOR EXPANSION AND CONTRACTION JOINTS SHALL BE SUBSIDIARY TO CONCRETE SIDEWALK.

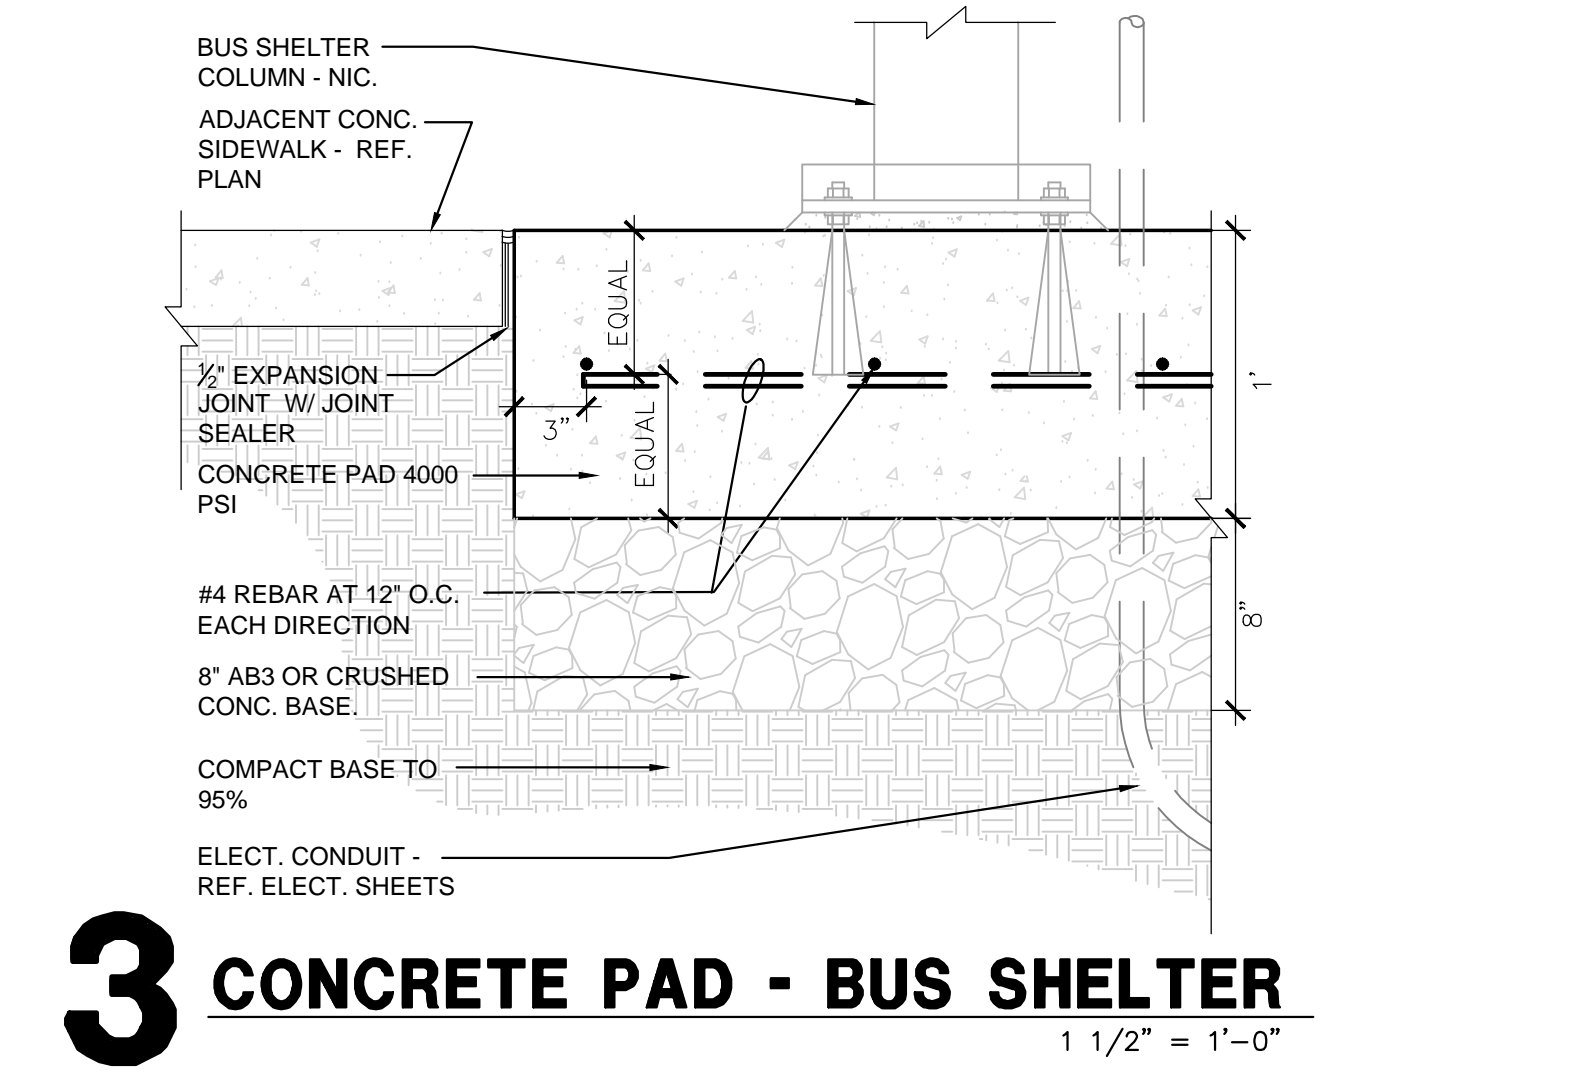

**CAST-IN-PLACE CONCRETE**  
 ALL CONCRETE SHALL HAVE THE FOLLOWING MINIMUM COMPRESSIVE STRENGTHS AT 28-DAYS.  
 • FOOTINGS AND CONCRETE COLUMNS: 4000 psi  
 • ALL AGGREGATE FOR NORMAL WEIGHT CONCRETE SHALL MEET ASTM C33. AGGREGATES SHALL BE PROPORTIONED SUCH THAT MIX DESIGN SHALL CONTAIN A MINIMUM OF 50% COARSE AGGREGATES BY GRADATION REQUIREMENTS SET FORTH IN ASTM C33. COARSE AGGREGATE SHALL MEET NO. 67 GRADING REQUIREMENTS.  
 • EXTERIOR EXPOSED CONCRETE SHALL HAVE FROM 4% TO 7% ENTRAINED AIR.

**REINFORCING STEEL**  
 ALL REINFORCING SHALL MEET ASTM A615 - 60,000.  
 ALL REINFORCING STEEL SHALL HAVE ADEQUATE COVERAGE AS INDICATED IN ACI 318 FOR THE GIVEN EXPOSURE.

DOUGLAS AVE. TRANSIT SHELTER RELOCATION  
 WICHITA, KS

**LKArchitecture**  
 Architecture • Engineering • Planning • Interior Design • Landscape Architecture

LK Architecture Inc. ©  
 345 RIVERVIEW, WICHITA, KS 67203  
 Phone (316) 268-0230 Fax: (316) 268-0205

CONTACT: Jeffery A. Best, ASLA  
 PROJECT NUMBER:

**18484**

SHEET TITLE:  
**DEMOLITION PLAN, SITE PLAN, DETAILS**

SHEET NUMBER:  
**SA2**