

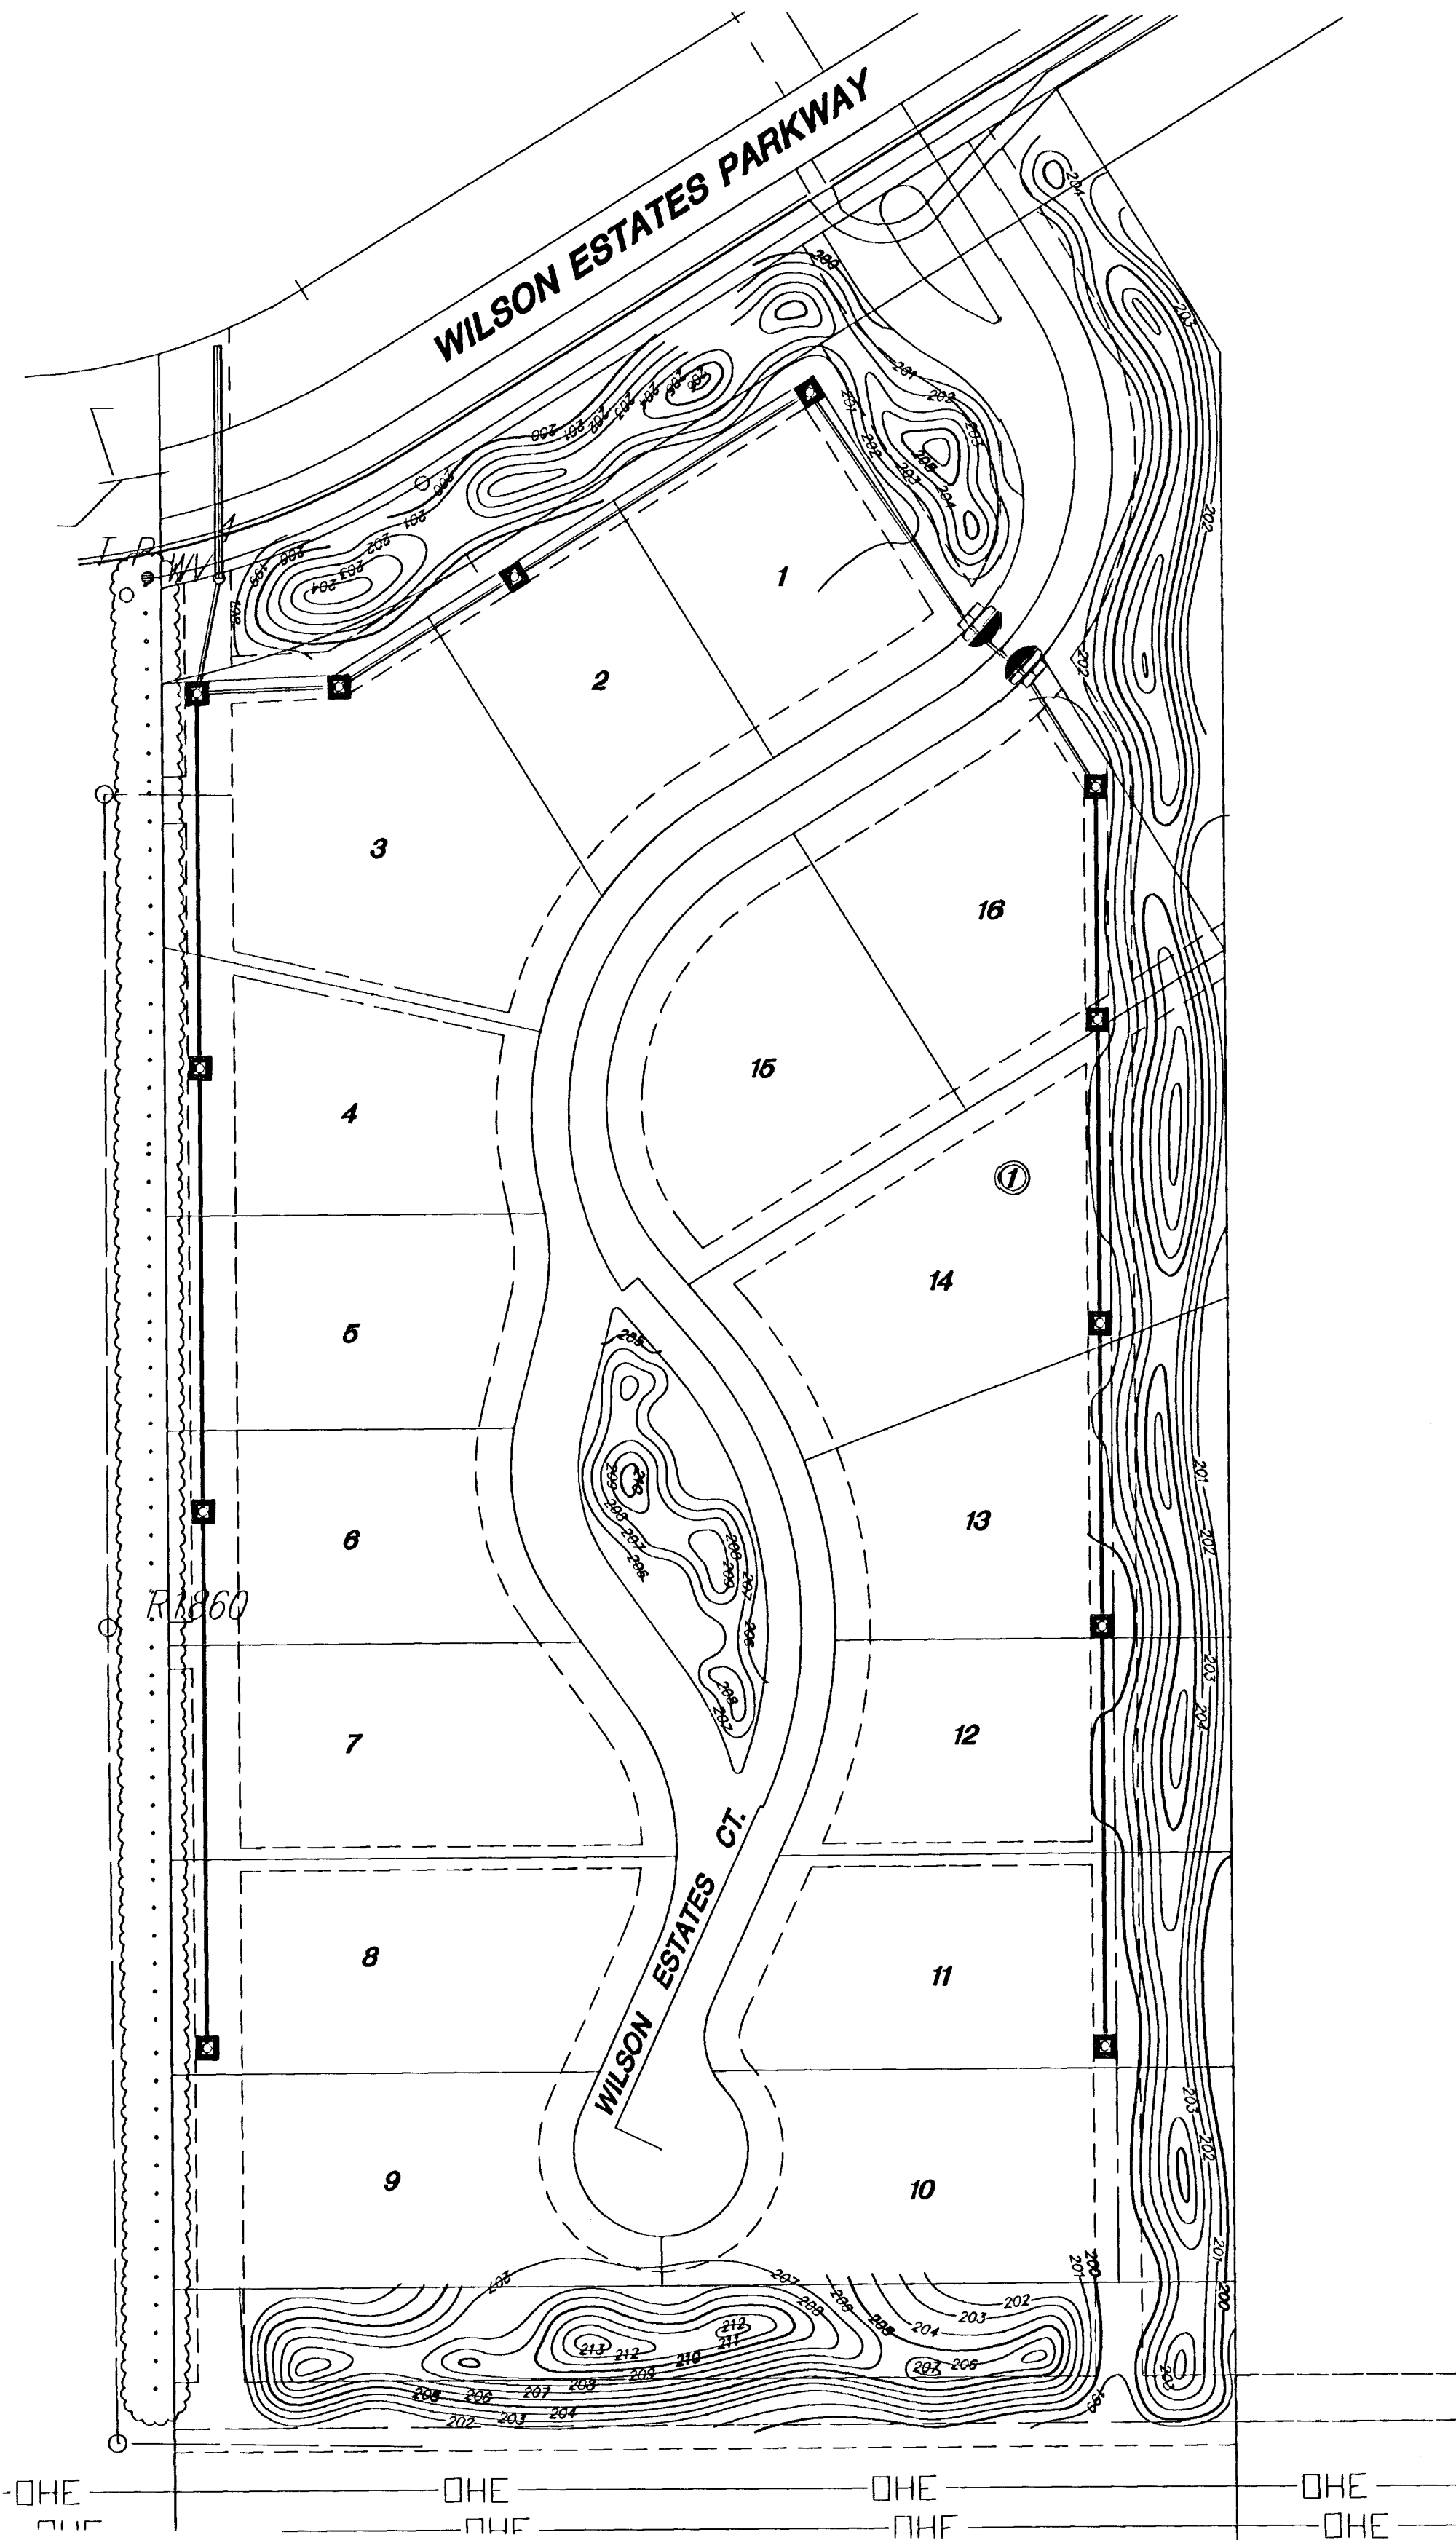


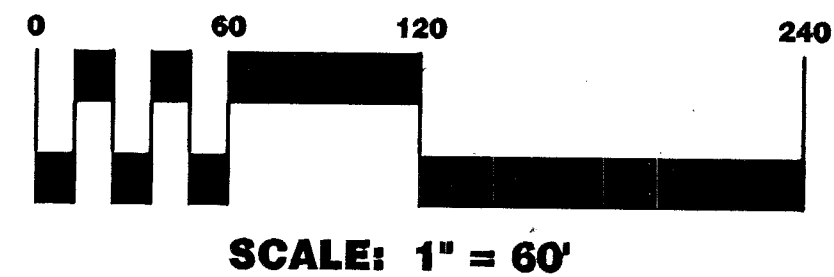

LEGEND

- EXISTING TREE ROW
- STRAW BALE DIKE OR ORGANIC FILTER BERM
- SILT FENCE OR ORGANIC FILTER TUBE
- CURB SEDIMENT TRAPS
- CURB INLET FILTER
- INLET FILTER




NOTES


- CONTRACTOR SHALL LIMIT CONSTRUCTION TO AREAS OF CUT AND FILL. ALL OTHER AREAS SHALL BE AVOIDED TO PROTECT AND PRESERVE THEIR NATURAL CHARACTER. (I.E. NO CONSTRUCTION TRAFFIC, EQUIPMENT STORAGE, ETC.)
- EROSION CONTROL IS TO MEET ALL FEDERAL, STATE, COUNTY & LOCAL CODE STANDARDS.
- ALL AREAS DISTURBED SHALL BE SEEDED AND FERTILIZED AS FOLLOWS:
ANNUAL RYE @ 250 LBS./ACRE
10-20-10 @ 350 LBS./ACRE
THIS AREA SHALL BE FINE GRADED AND THE SURFACE SHALL BE FREE FROM STICKS, SMALL STONES, AND OTHER EXTRANEOUS MATERIALS.
- CONTRACTOR SHALL PROVIDE EROSION PROTECTION THROUGHOUT PROJECT CONSTRUCTION. THE PLAN PROVIDED HERE IS FOR FINAL PROTECTION, VARIOUS PHASES OF THIS PLAN SHALL BE IMPLEMENTED OR MODIFIED TO CONTROL EROSION. MODIFICATIONS OF THE PLAN SHALL BE APPROVED BY THE OWNER'S REPRESENTATIVE.
- SEEDING AREAS SHALL BE PREPARED FOR PLANTING WITH COMMON AGRICULTURAL TECHNIQUES (I.E. TILLING, DISKING, ETC.). THE GROUND SHALL BE WORKED TO A DEPTH OF 6"-8". IT SHALL THEN BE LEFT TO SETTLE, THEN CULTIVATED & SEEDED. APPROVE WITH OWNER'S REPRESENTATIVE BEFORE PLANTING.
- ALL SEED SHALL BE DISTRIBUTED WITH AN ACCEPTABLE DRILL INTENDED FOR SUCH OPERATIONS, OR OTHER EQUIPMENT APPROVED BY THE OWNER'S REPRESENTATIVE. SEEDING DEPTH SHALL BE 1/4".
- ALL SEEDED AREAS SHALL BE IMMEDIATELY MULCHED W/FRAIRIE HAY AT 2 TONS/ACRE. ANCHOR MULCH BY CRIMPING INTO TOPSOIL WITH SUITABLE MECHANICAL EQUIPMENT.

GENERAL SEED MIX

LBS/ACRE	COMMON NAME
250 LBS.	ANNUAL RYE
FOR INFORMATION ONLY: ESTIMATED DISTURBED ACRAGE = 31 AC	

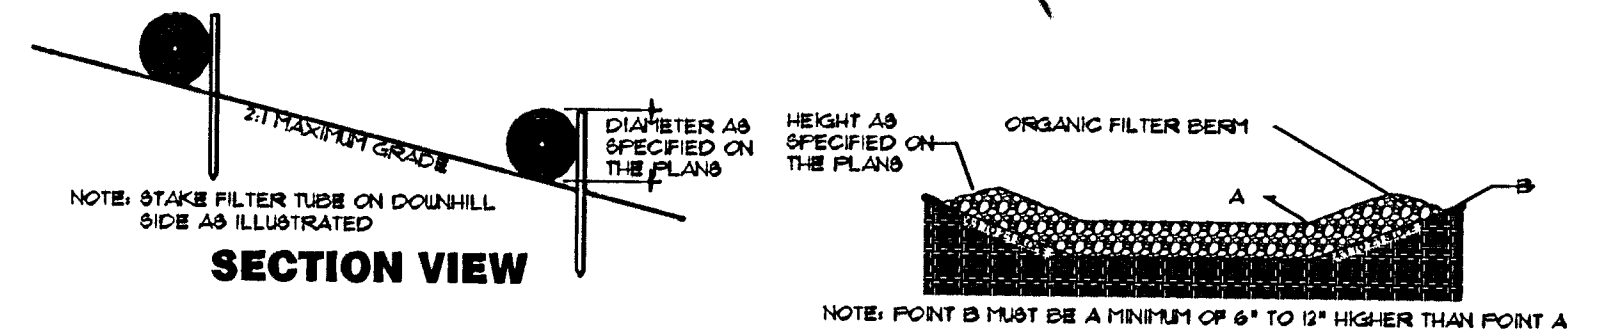

SECTION VIEW

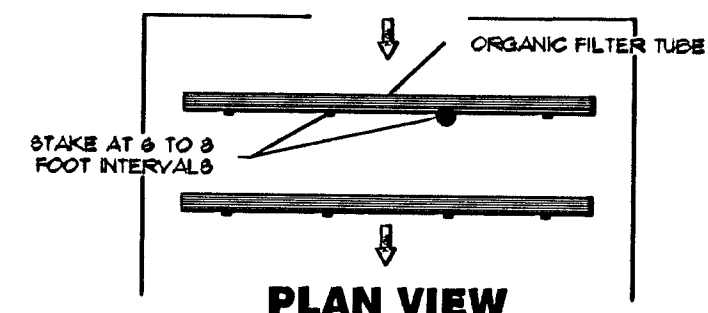

PLAN VIEW

ORGANIC FILTER TUBES

ORGANIC FILTER TUBE NOTES:


- Drainage Area:
- Limit the drainage area to 0.25 acres per 100 lineal ft. of barrier. (I.e. an area 100 ft. wide behind 100 ft. of tube meets the criteria).
 - Typically, Organic Filter Tubes can handle the same water flow or slightly more than silt fence.

- Tube Diameter: Organic Filter Tube diameter should be a minimum of 10" to 12" or as specified on plans.
- C. Place tubes on slopes less than 5% or at the bottom of steeper slopes, less than or equal to 2:1 up to 25 ft. long; on longer slopes, areas with greater flows or where maximum sediment control is desired, a larger diameter of tube should be used.
- D. If a slope exceeds 4:1 gradient, it may be necessary to stake the tube at 6 ft. to 8 ft. intervals.
- E. A sediment trench 1" to 2" deep may be constructed immediately upgrade of the Organic Filter Tube.


Material Specifications: Chipped site vegetation, composted mulch, or wood-based mulch with particulate sizes of fine (1/4" to 1/2") and coarse grades of compost/mulch with no particulate sizes exceeding 3" in length. The mixture ratio should be or may include a greater fraction of coarser blend materials (1:2) (fine: coarse).

Minimum Tube Material Specifications: 8" diameter - 22 pillar, white; Weight (gm/ft): 4.1 grams Stretch width: 14-1/2 inches Coarse count: 4.0 Pillar spacing: 7/16 inch HDPE netting UV stabilizer Fade resistant color


Maintenance Requirements: Organic Filter Tubes should be inspected weekly and after major rain events to ensure that the device is functioning properly. Remove sediment from behind tube when the depth of the sediment has built up to one-third the height of the tube. If the tube has been smashed, simply place hands on either side of tube and "fluff up" to original size. If the tube fabric has ripped, cut off at tear and re-tie each side, place new tube (patch) overlapping existing tube 3 ft. both ways.

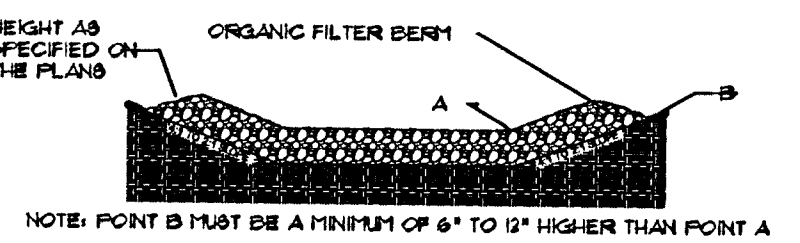

SECTION VIEW

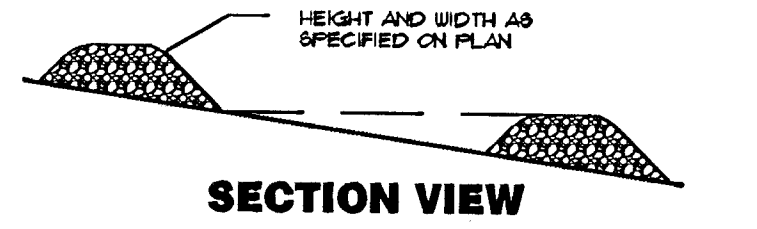

SECTION VIEW

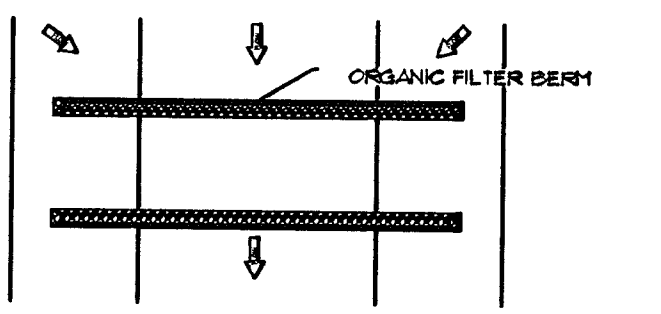

PLAN VIEW

ORGANIC CHECK DAM (FILTER BERM)

ORGANIC FILTER BERM NOTES:

- Drainage Area:
- Limit the drainage area to 0.25 acres per 100 lineal ft. of barrier (I.e. an area 100 ft. wide behind 100 ft. of berm meets the criteria).
 - Typically, berms can handle the same water flow or slightly more than silt fence.

Height: 1 ft. (minimum) to 3 ft. (maximum) or as specified on plans.

Width: 2 ft. (minimum) to 5 ft. (maximum) or as specified on plans. Place berm on slopes less than 5% or at the bottom of steeper slopes, less than or equal to 3:1 up to 20 ft. long. On longer or steeper slopes, the berm should be larger in both height and width to accommodate the higher flow rate.

Material Specifications: Chipped site vegetation, composted mulch, or wood-based mulch with particulate sizes of fine (1/4" to 1/2") and coarse grades of compost/mulch with no particulate sizes exceeding 3-1/2" in length. The mixture ratio should be or may include a greater fraction of coarser blend materials (1:2) (fine: coarse).

Maintenance Requirements: Organic Filter Berms should be inspected weekly and after major rain events to ensure that the device is functioning properly. Remove sediment from behind tube when the depth of the sediment has built up to one-third the height of the berm by raking. Contractor shall immediately correct all deficiencies, rehabilitating berm, if necessary, in accordance with the original specifications.

H:\CIVIL\96186\03131\DWG\PAV\03131ER6.DWG



MKEC
ENGINEERING
CONSULTANTS
411 N. WEBB ROAD
WICHITA, KS. 67206
316 - 684 - 9600

WILSON FARMS FOURTH ADDITION
PROJECT NAME

EROSION CONTROL & SEEDING
SHEET TITLE

DFL DESIGN BY:	DMU DRAWN BY:	JAG CHECKED BY:
OCTOBER 2003 DATE	03131ER6 DRAWING NAME	20 / 32 SHEET / OF