


**BENCHMARK:**  
 "□" in top of curb adjacent to the southwest corner of Lot 6, Block A, Rocky Ford 2nd Addition.  
 Elev. = 1385.10 NAVD88

City of Wichita Benchmark Disk Adjacent to fire hydrant at east end of the south return, Lori & Lori Ct, NW Cor., Lot 11, Blk C, Rocky Ford 2nd Addition.  
 Elev. = 1383.10 NAVD88


"□" in top of curb adjacent to the southwest corner of Lot 14, Block C, Rocky Ford 2nd Addition.  
 Elev. = 1380.11 NAVD88

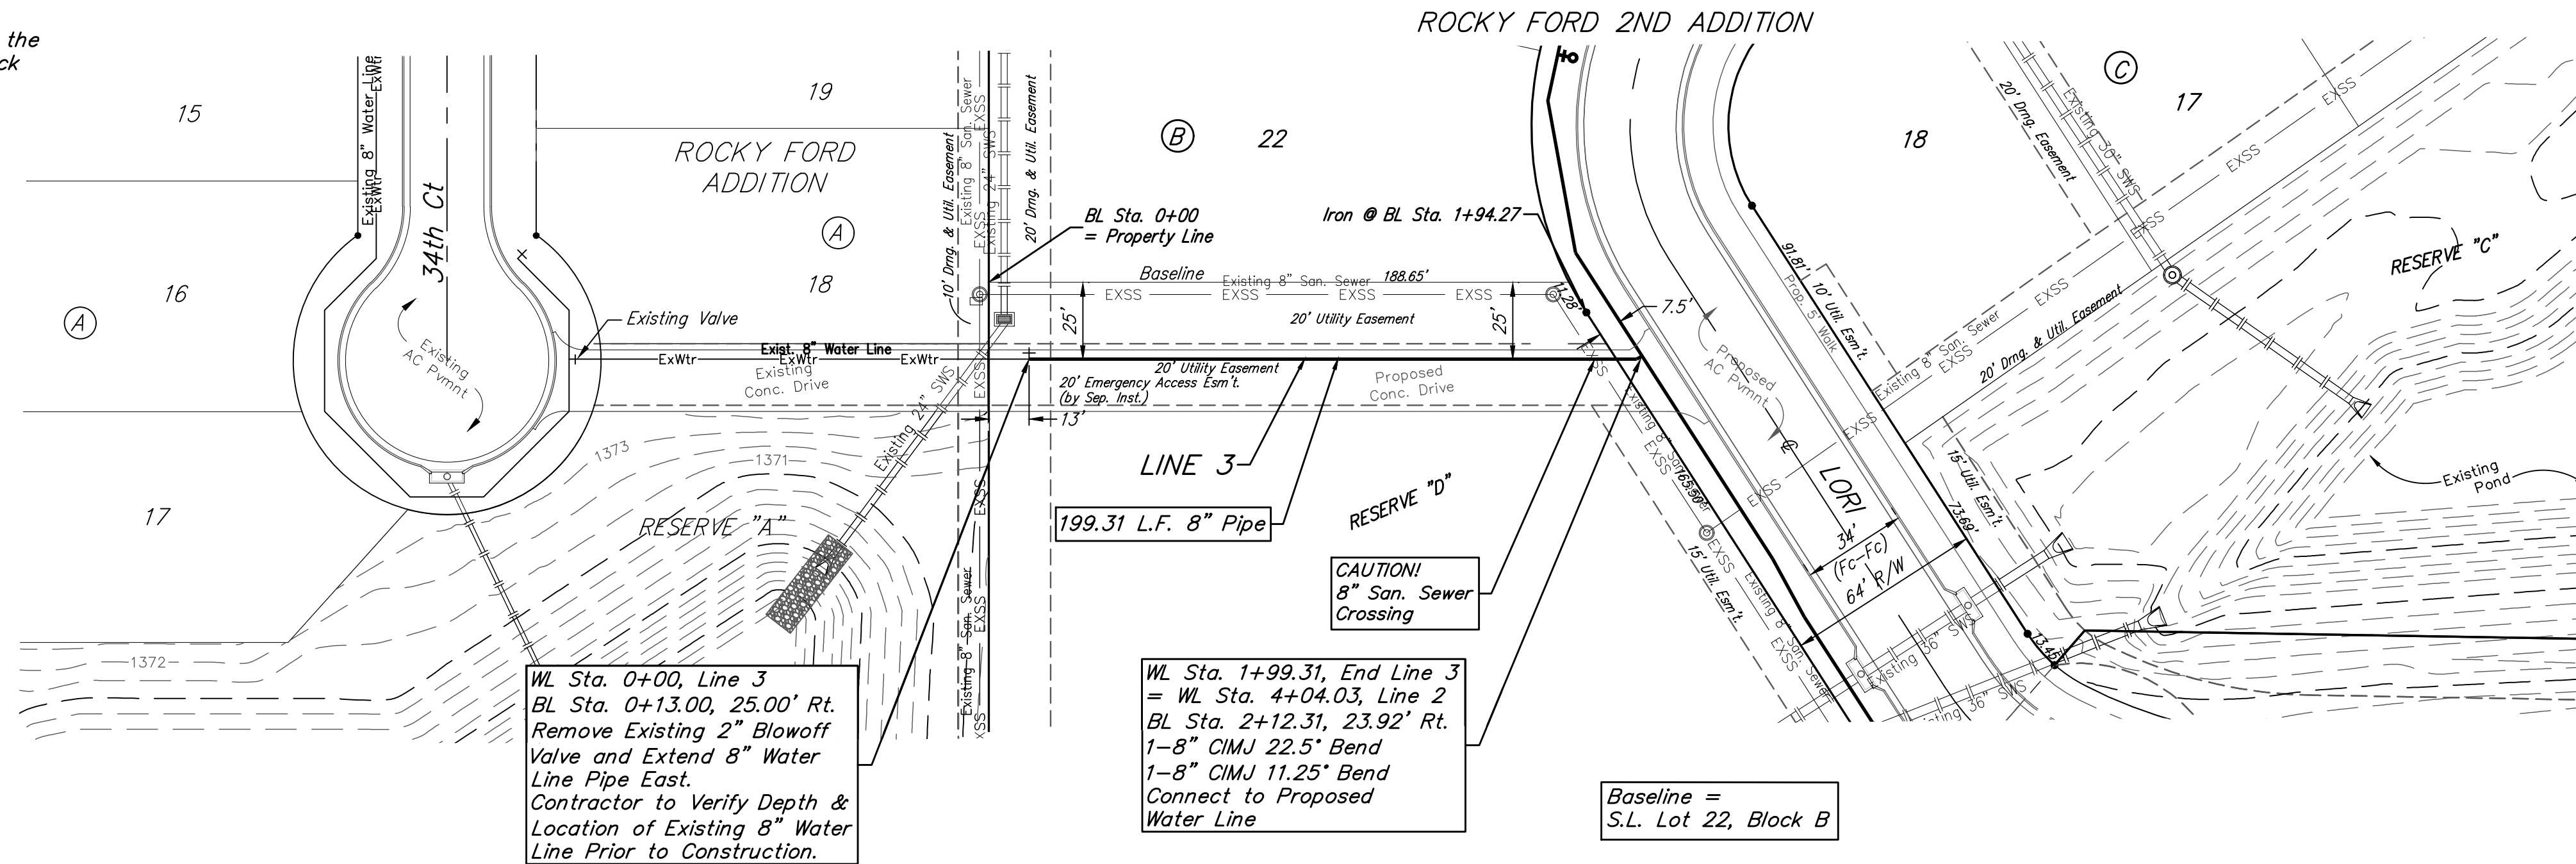

WL Sta. 0+00, Line 3  
 BL Sta. 0+13.00, 25.00' Rt.  
 Remove Existing 2" Blowoff Valve and Extend 8" Water Line Pipe East.  
 Contractor to Verify Depth & Location of Existing 8" Water Line Prior to Construction.

WL Sta. 1+99.31, End Line 3  
 = WL Sta. 4+04.03, Line 2  
 BL Sta. 2+12.31, 23.92' Rt.  
 1-8" CIMJ 22.5' Bend  
 1-8" CIMJ 11.25' Bend  
 Connect to Proposed Water Line

Baseline =  
 S.L. Lot 22, Block B

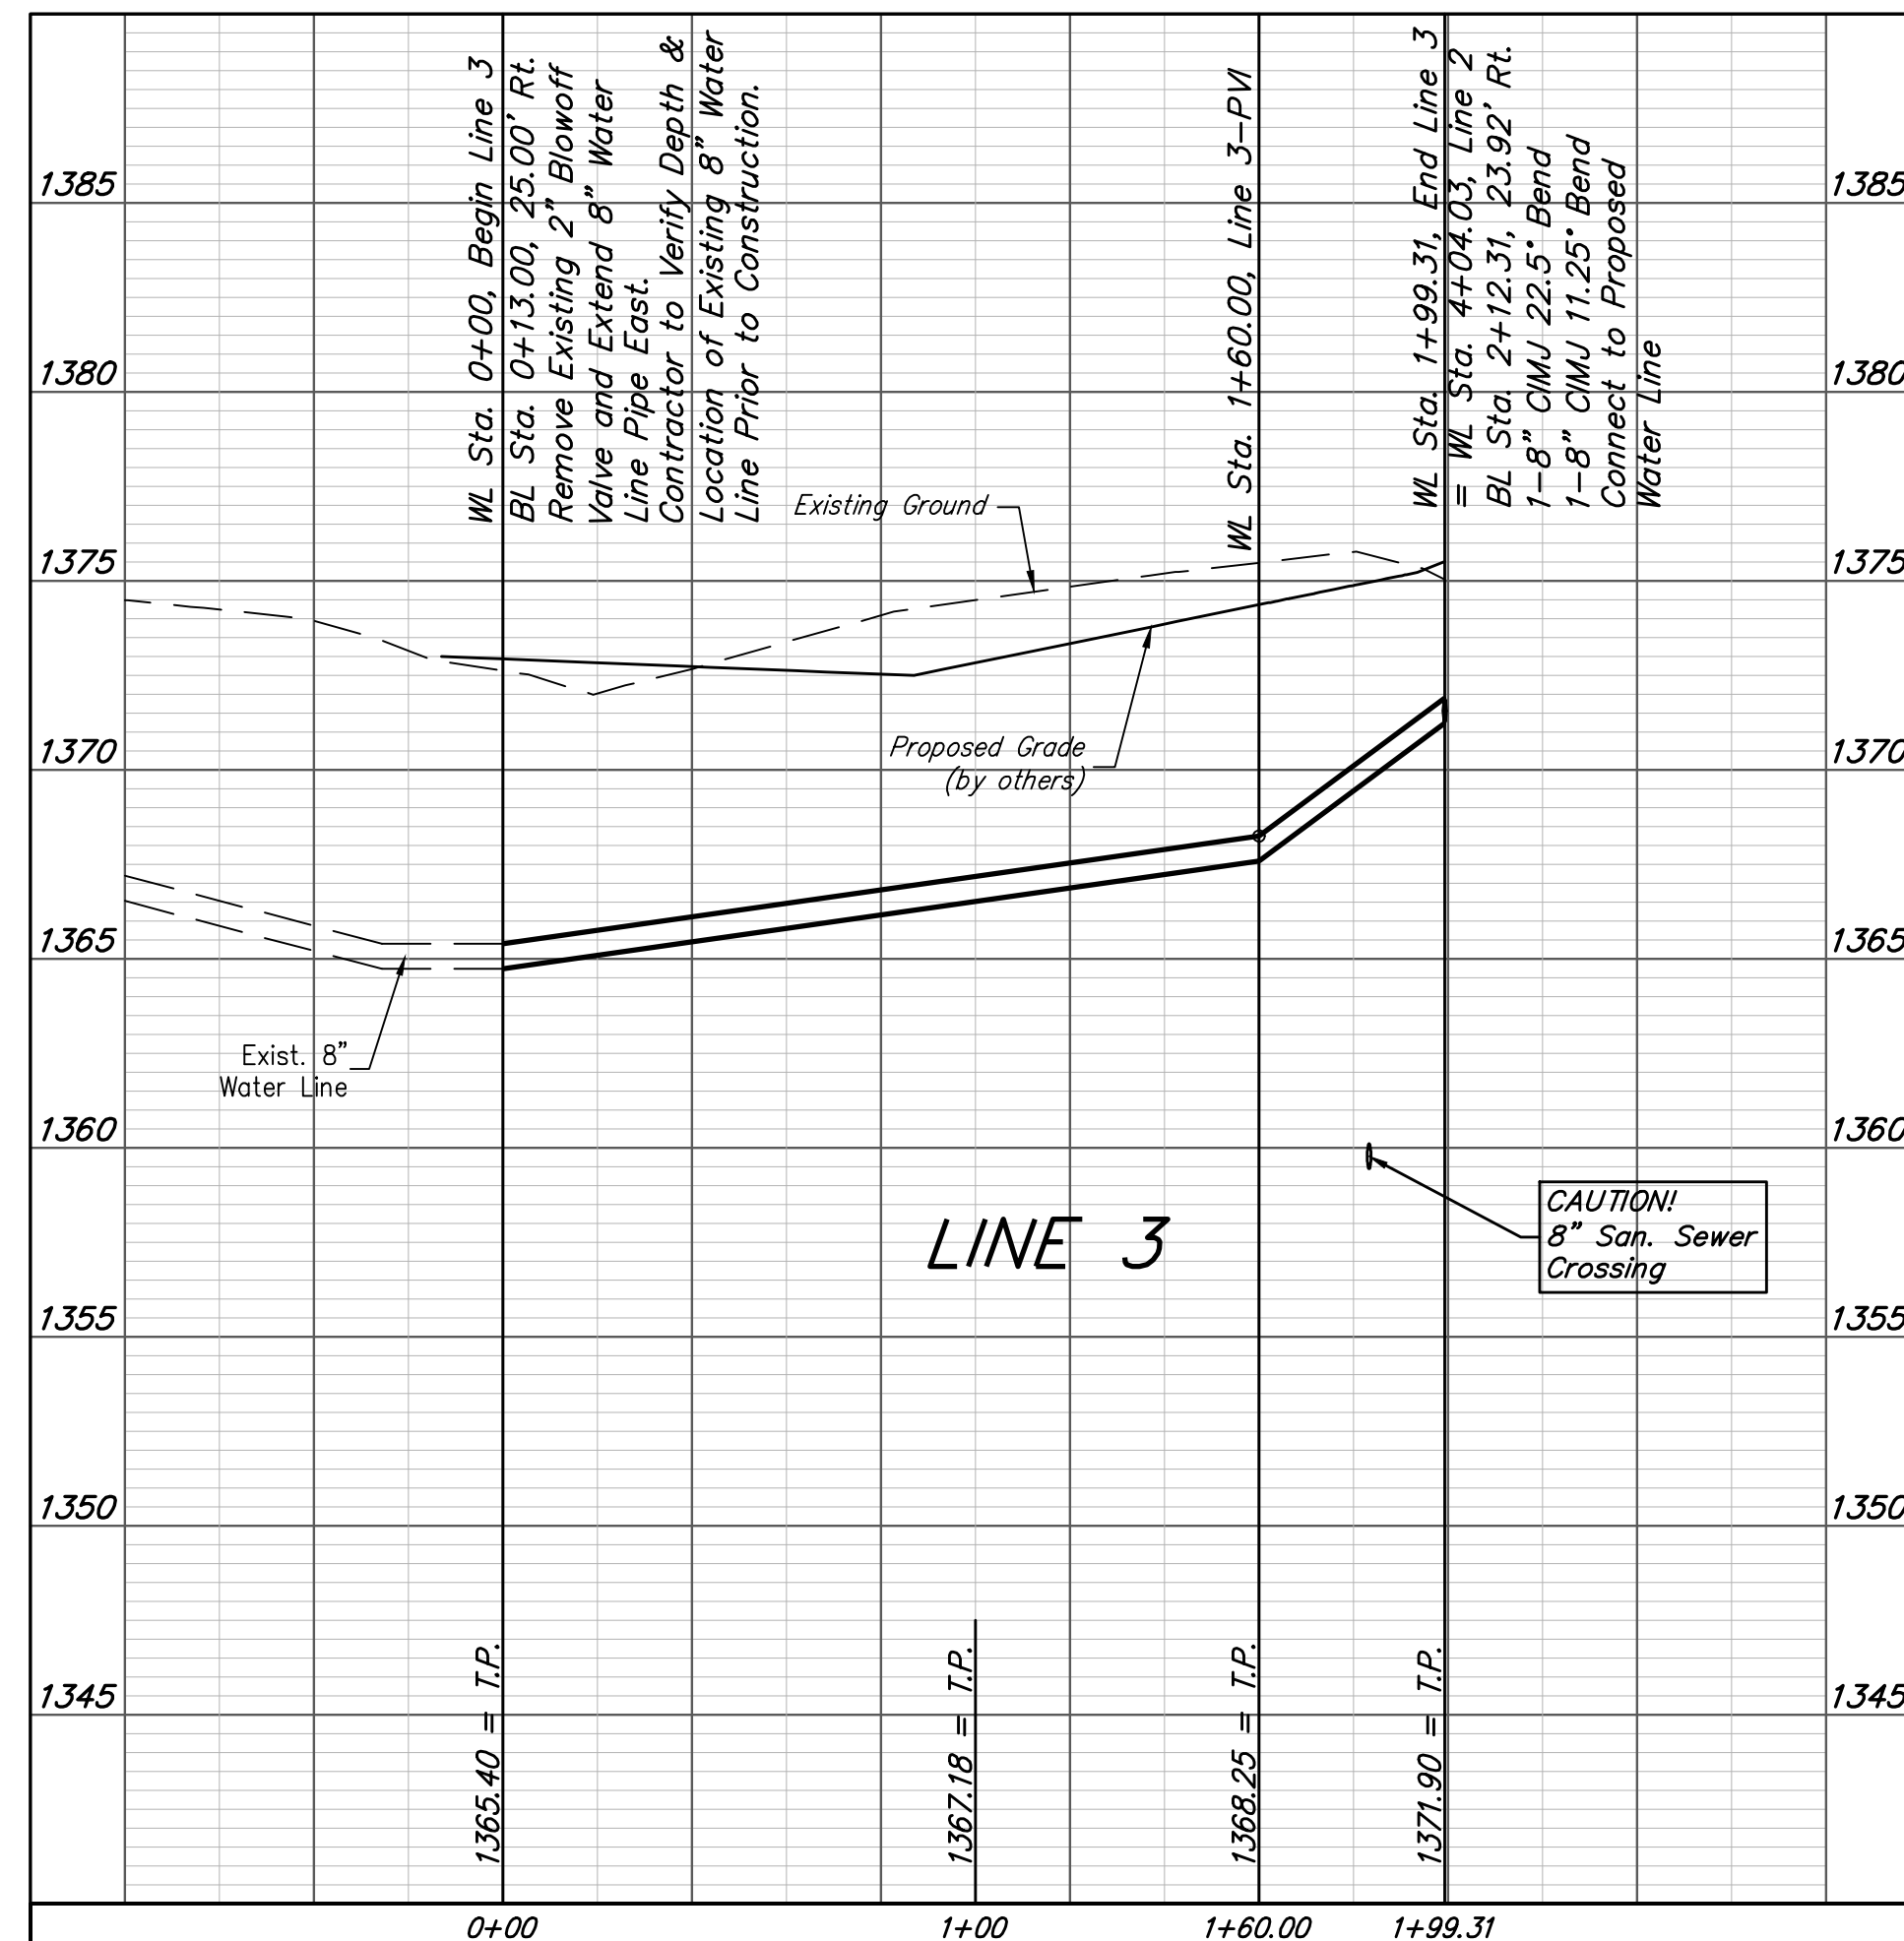

		Rocky Ford 2nd Addition - Phase II	
		<b>LINE 3</b>	
Water Distribution System			
<small>Baughman Company, P.A. 315 Ellis St. Wichita, KS 67211 P 316-262-7271 F 316-262-0149          ENGINEERING   SURVEYING   PLANNING   LANDSCAPE ARCHITECTURE</small>			
PROJECT NUMBER 448-9086S	DESIGN AEG	DRAWN JAK	
REVISIONS:	APPROVED	DATE 2/11/19	
	SCALE Noted		
	SHEET		<b>6 OF 14</b>