


1 inch = 30 feet




CAUTION 8" VCP SANITARY SEWER. MAINTAIN A MINIMUM OF 24" OF CLEARANCE WITH CROSSING. CONTRACTOR TO FIELD VERIFY DEPTH.

CAUTION, MAINTAIN A MINIMUM OF 10' BETWEEN THE EDGE OF THE SANITARY SEWER MANHOLE AND THE EDGE OF THE PROPOSED WATER MAIN

250 LF 6" PIPE LINE 3

CAUTION EXISTING 8" WATER MAIN

	EXISTING WATER MAINS
	PROPOSED FIRE HYDRANT
	PROPOSED WATER MAIN
	PROPOSED BLOW OFF VALVE
	PROPOSED VALVE
	EXISTING FIRE HYDRANT
	SS MANHOLES
	SEWER MAINS
	STORM STRUCTURES
	STORM CONDUIT
	CUT & CAP

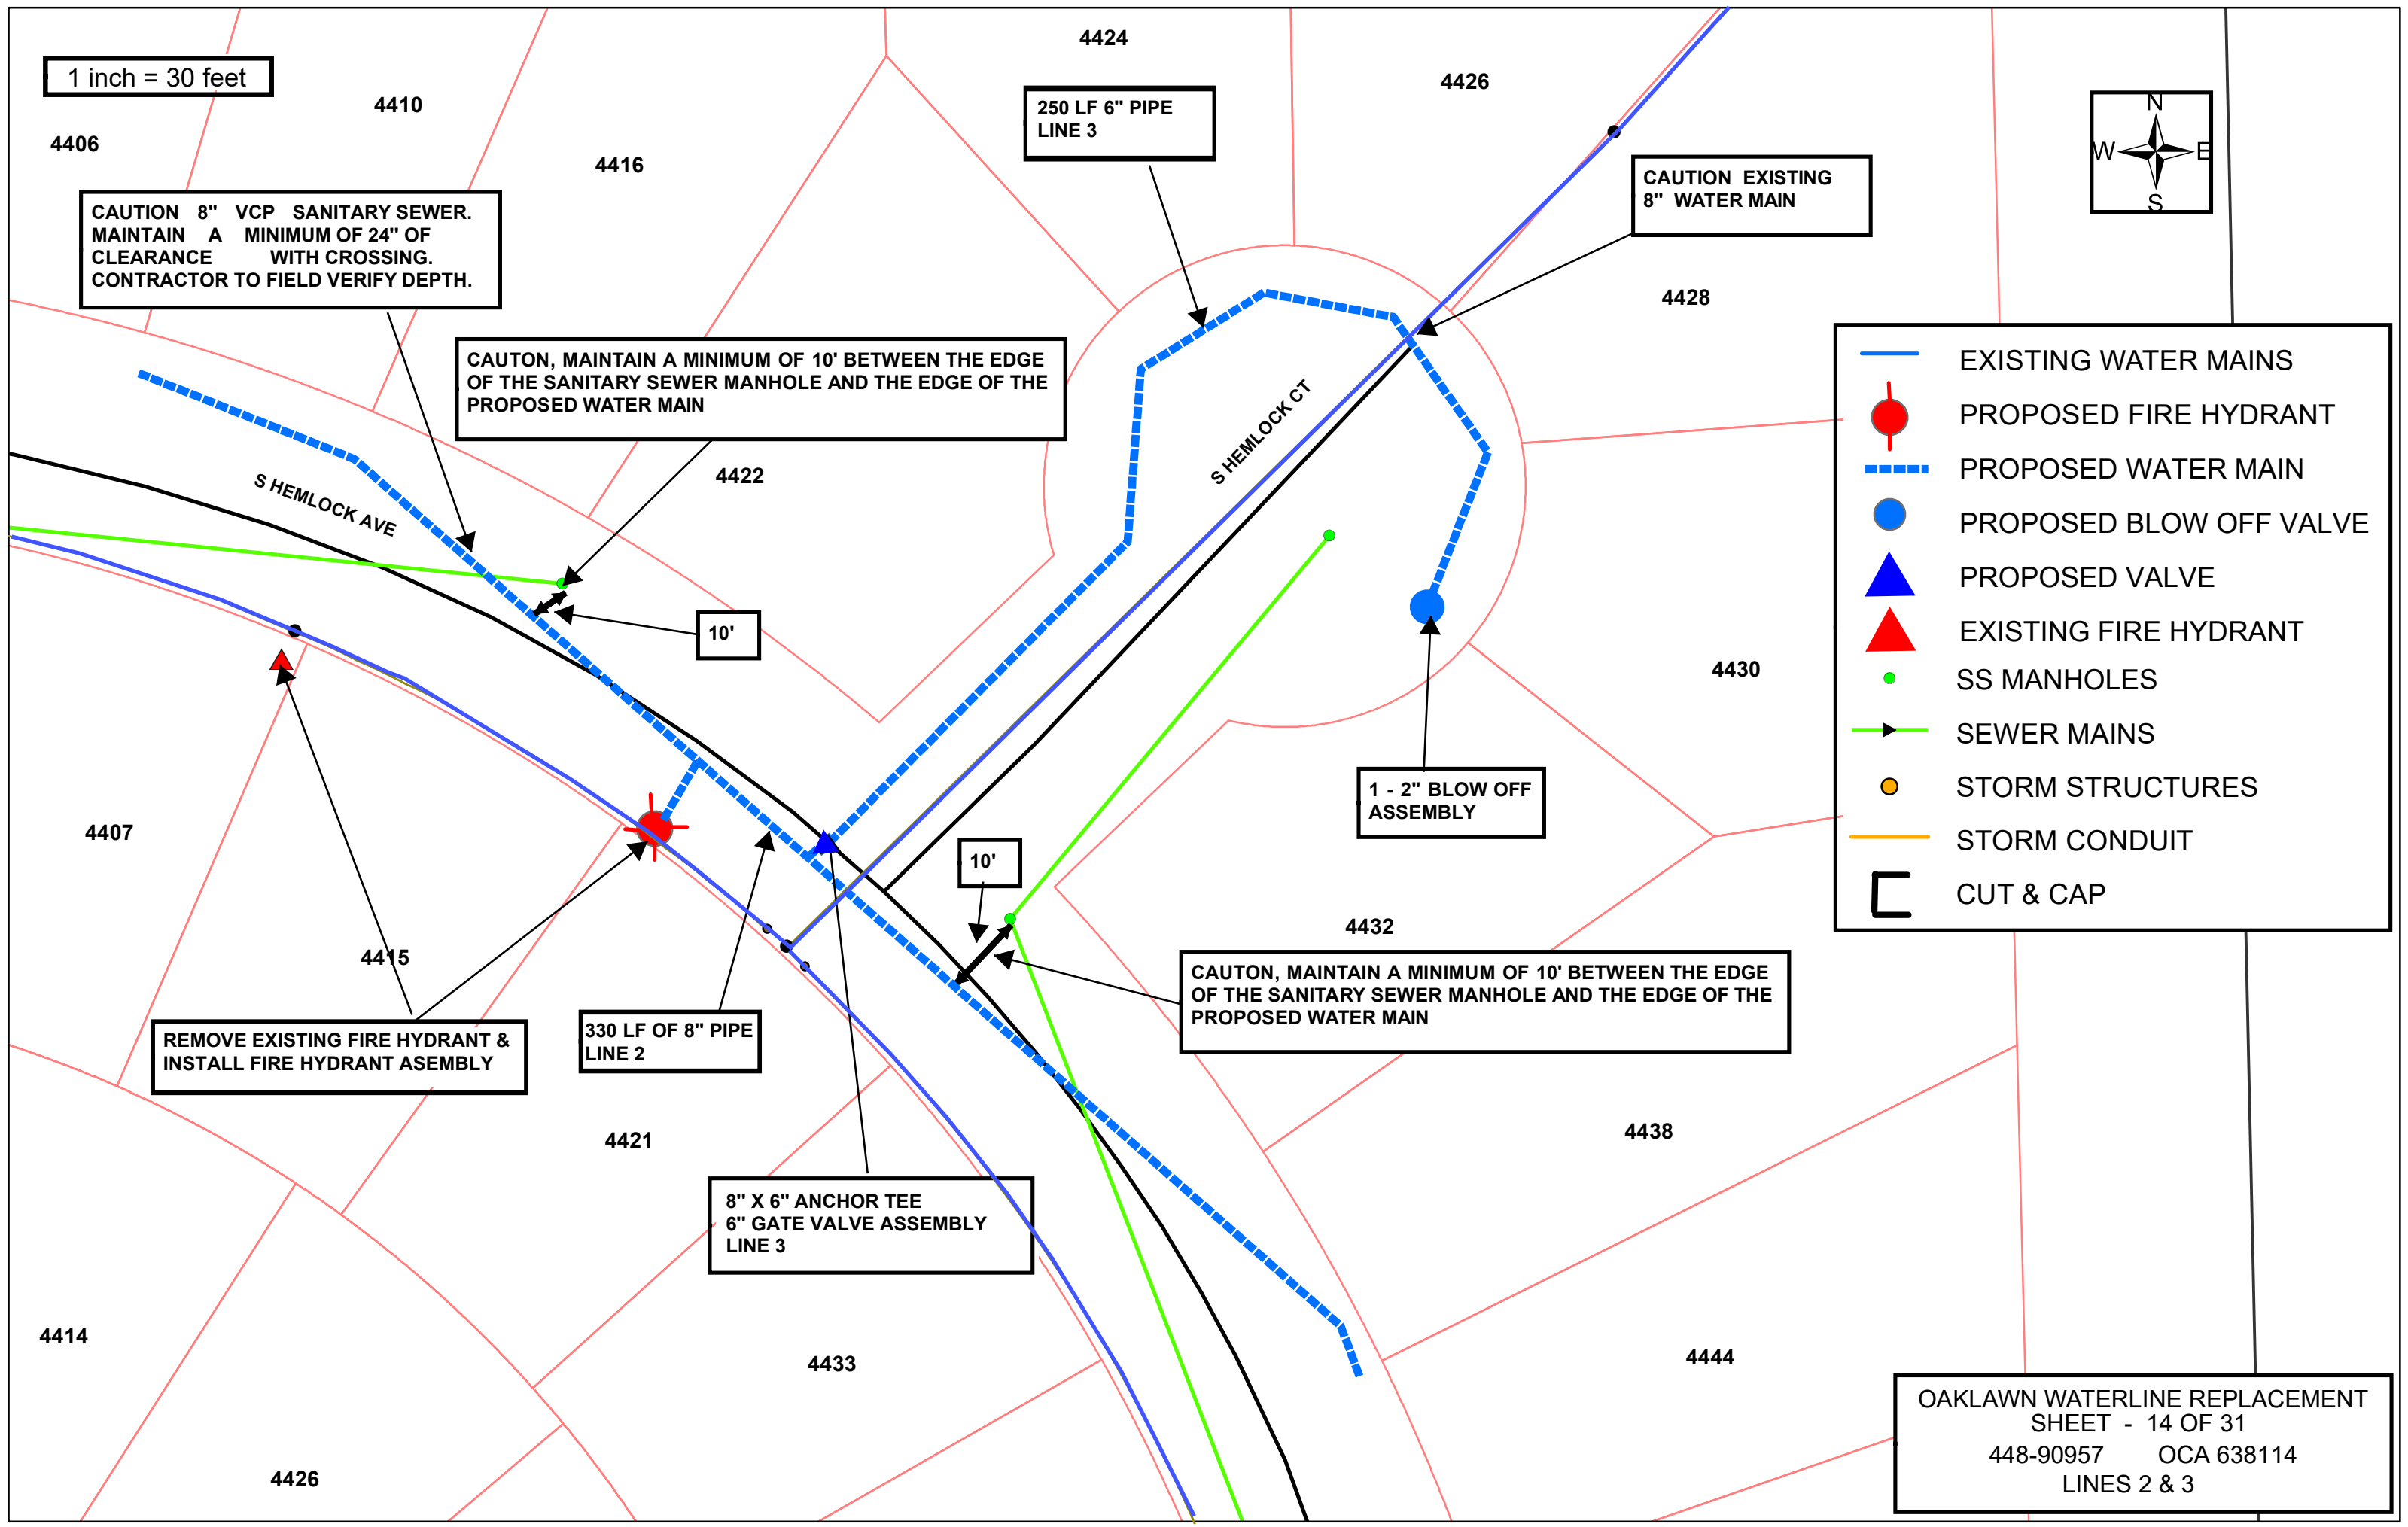

REMOVE EXISTING FIRE HYDRANT & INSTALL FIRE HYDRANT ASEMBLY

330 LF OF 8" PIPE LINE 2

8" X 6" ANCHOR TEE 6" GATE VALVE ASSEMBLY LINE 3

1 - 2" BLOW OFF ASSEMBLY

CAUTION, MAINTAIN A MINIMUM OF 10' BETWEEN THE EDGE OF THE SANITARY SEWER MANHOLE AND THE EDGE OF THE PROPOSED WATER MAIN

OAKLAWN WATERLINE REPLACEMENT
 SHEET - 14 OF 31
 448-90957 OCA 638114
 LINES 2 & 3