









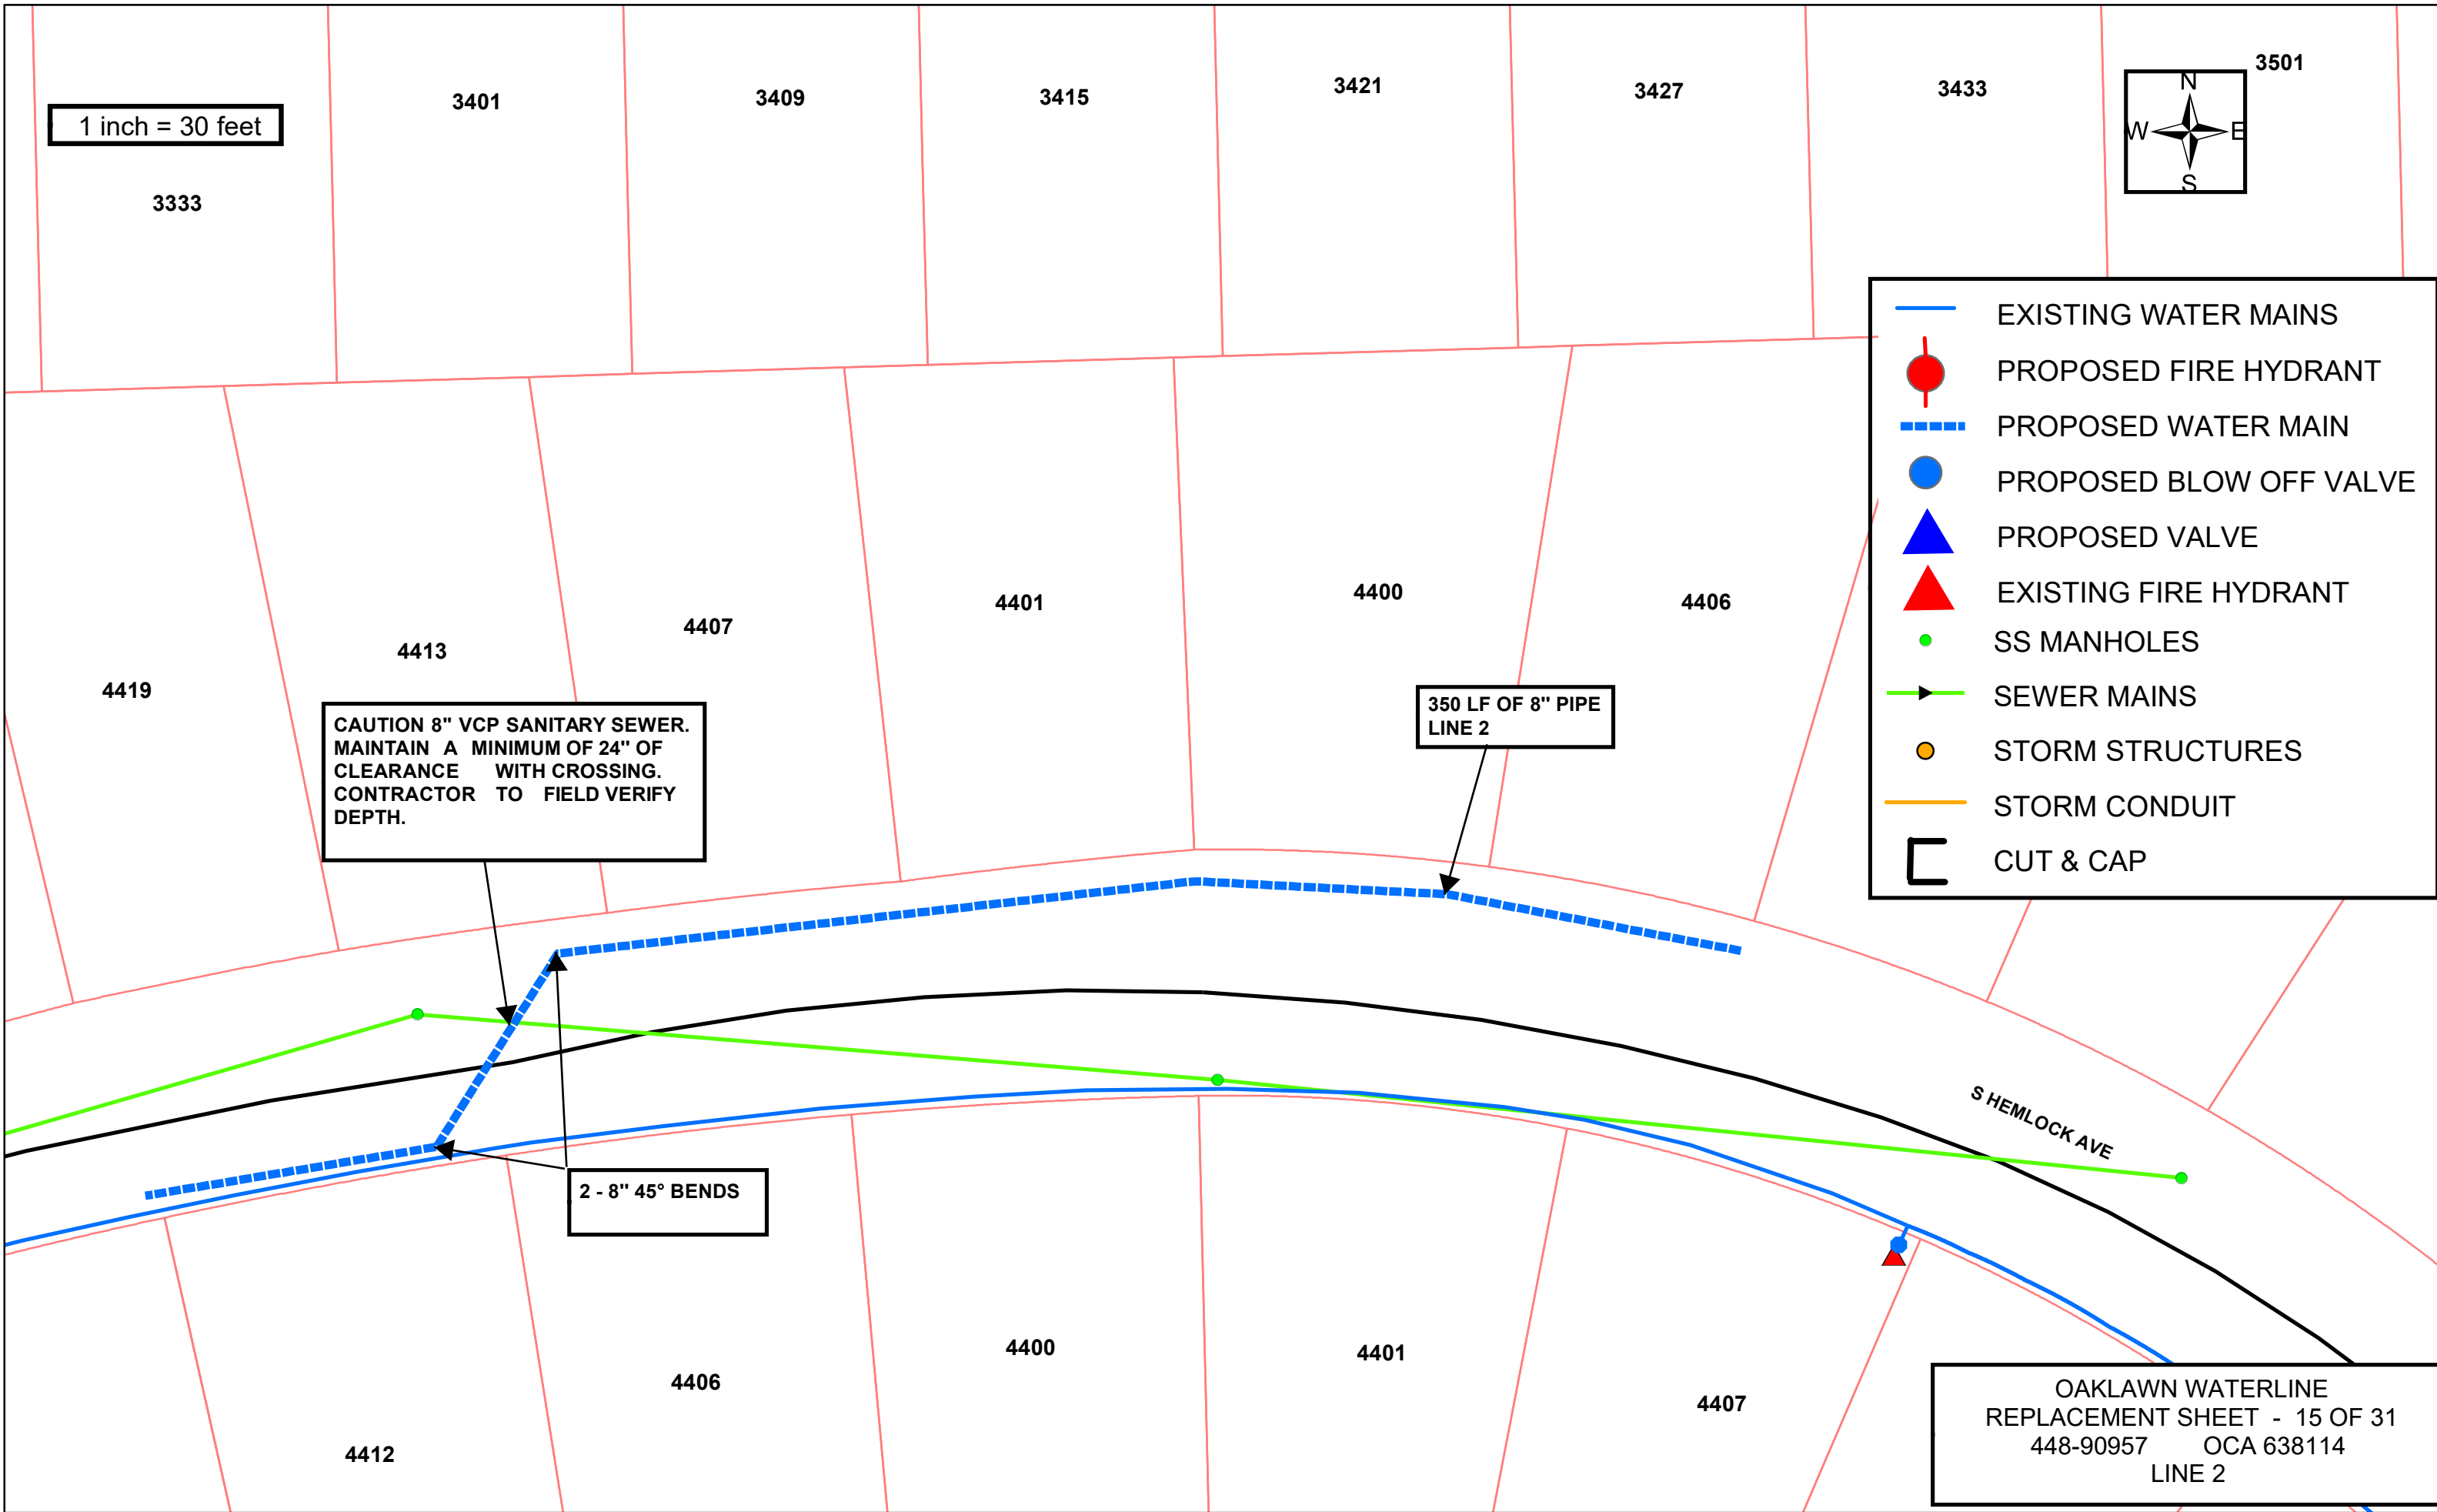




1 inch = 30 feet



CAUTION 8" VCP SANITARY SEWER.
MAINTAIN A MINIMUM OF 24" OF
CLEARANCE WITH CROSSING.
CONTRACTOR TO FIELD VERIFY
DEPTH.

350 LF OF 8" PIPE
LINE 2

2 - 8" 45° BENDS

-  EXISTING WATER MAINS
-  PROPOSED FIRE HYDRANT
-  PROPOSED WATER MAIN
-  PROPOSED BLOW OFF VALVE
-  PROPOSED VALVE
-  EXISTING FIRE HYDRANT
-  SS MANHOLES
-  SEWER MAINS
-  STORM STRUCTURES
-  STORM CONDUIT
-  CUT & CAP

OAKLAWN WATERLINE
REPLACEMENT SHEET - 15 OF 31
448-90957 OCA 638114
LINE 2