


1 inch = 30 feet



	EXISTING WATER MAINS
	PROPOSED FIRE HYDRANT
	PROPOSED WATER MAIN
	PROPOSED BLOW OFF VALVE
	PROPOSED VALVE
	EXISTING FIRE HYDRANT
	SS MANHOLES
	SEWER MAINS
	STORM STRUCTURES
	STORM CONDUIT
	CUT & CAP


CONNECT TO 8" GATE VALVE  
INSTALL 40 LF OF 8" PIPE (NW) 1 - 90° BEND  
8" X 6" REDUCER 6" DICL PIPE AS NEEDED  
CONNECT TO EXISTING 6" PIPE. LINE 4

350 LF OF 8" PIPE  
LINE 2

INSTALL FIRE HYDRANT ASSEMBLY  
- MAINTAIN 10' CLEARANCE FROM  
EXISTING SANITARY SEWER LINE

CUT & CAP A MAXIMUM OF 2'  
FROM 6" AC WATER MAIN

8" X 8" TEE 2 - 8" GATE VALVES (NE & SW)  
1 - 8" ANCHOR VALVE (NW)  
1 - 8" ANCHOR COUPLING  
4 LF OF 8" DICL PIPE

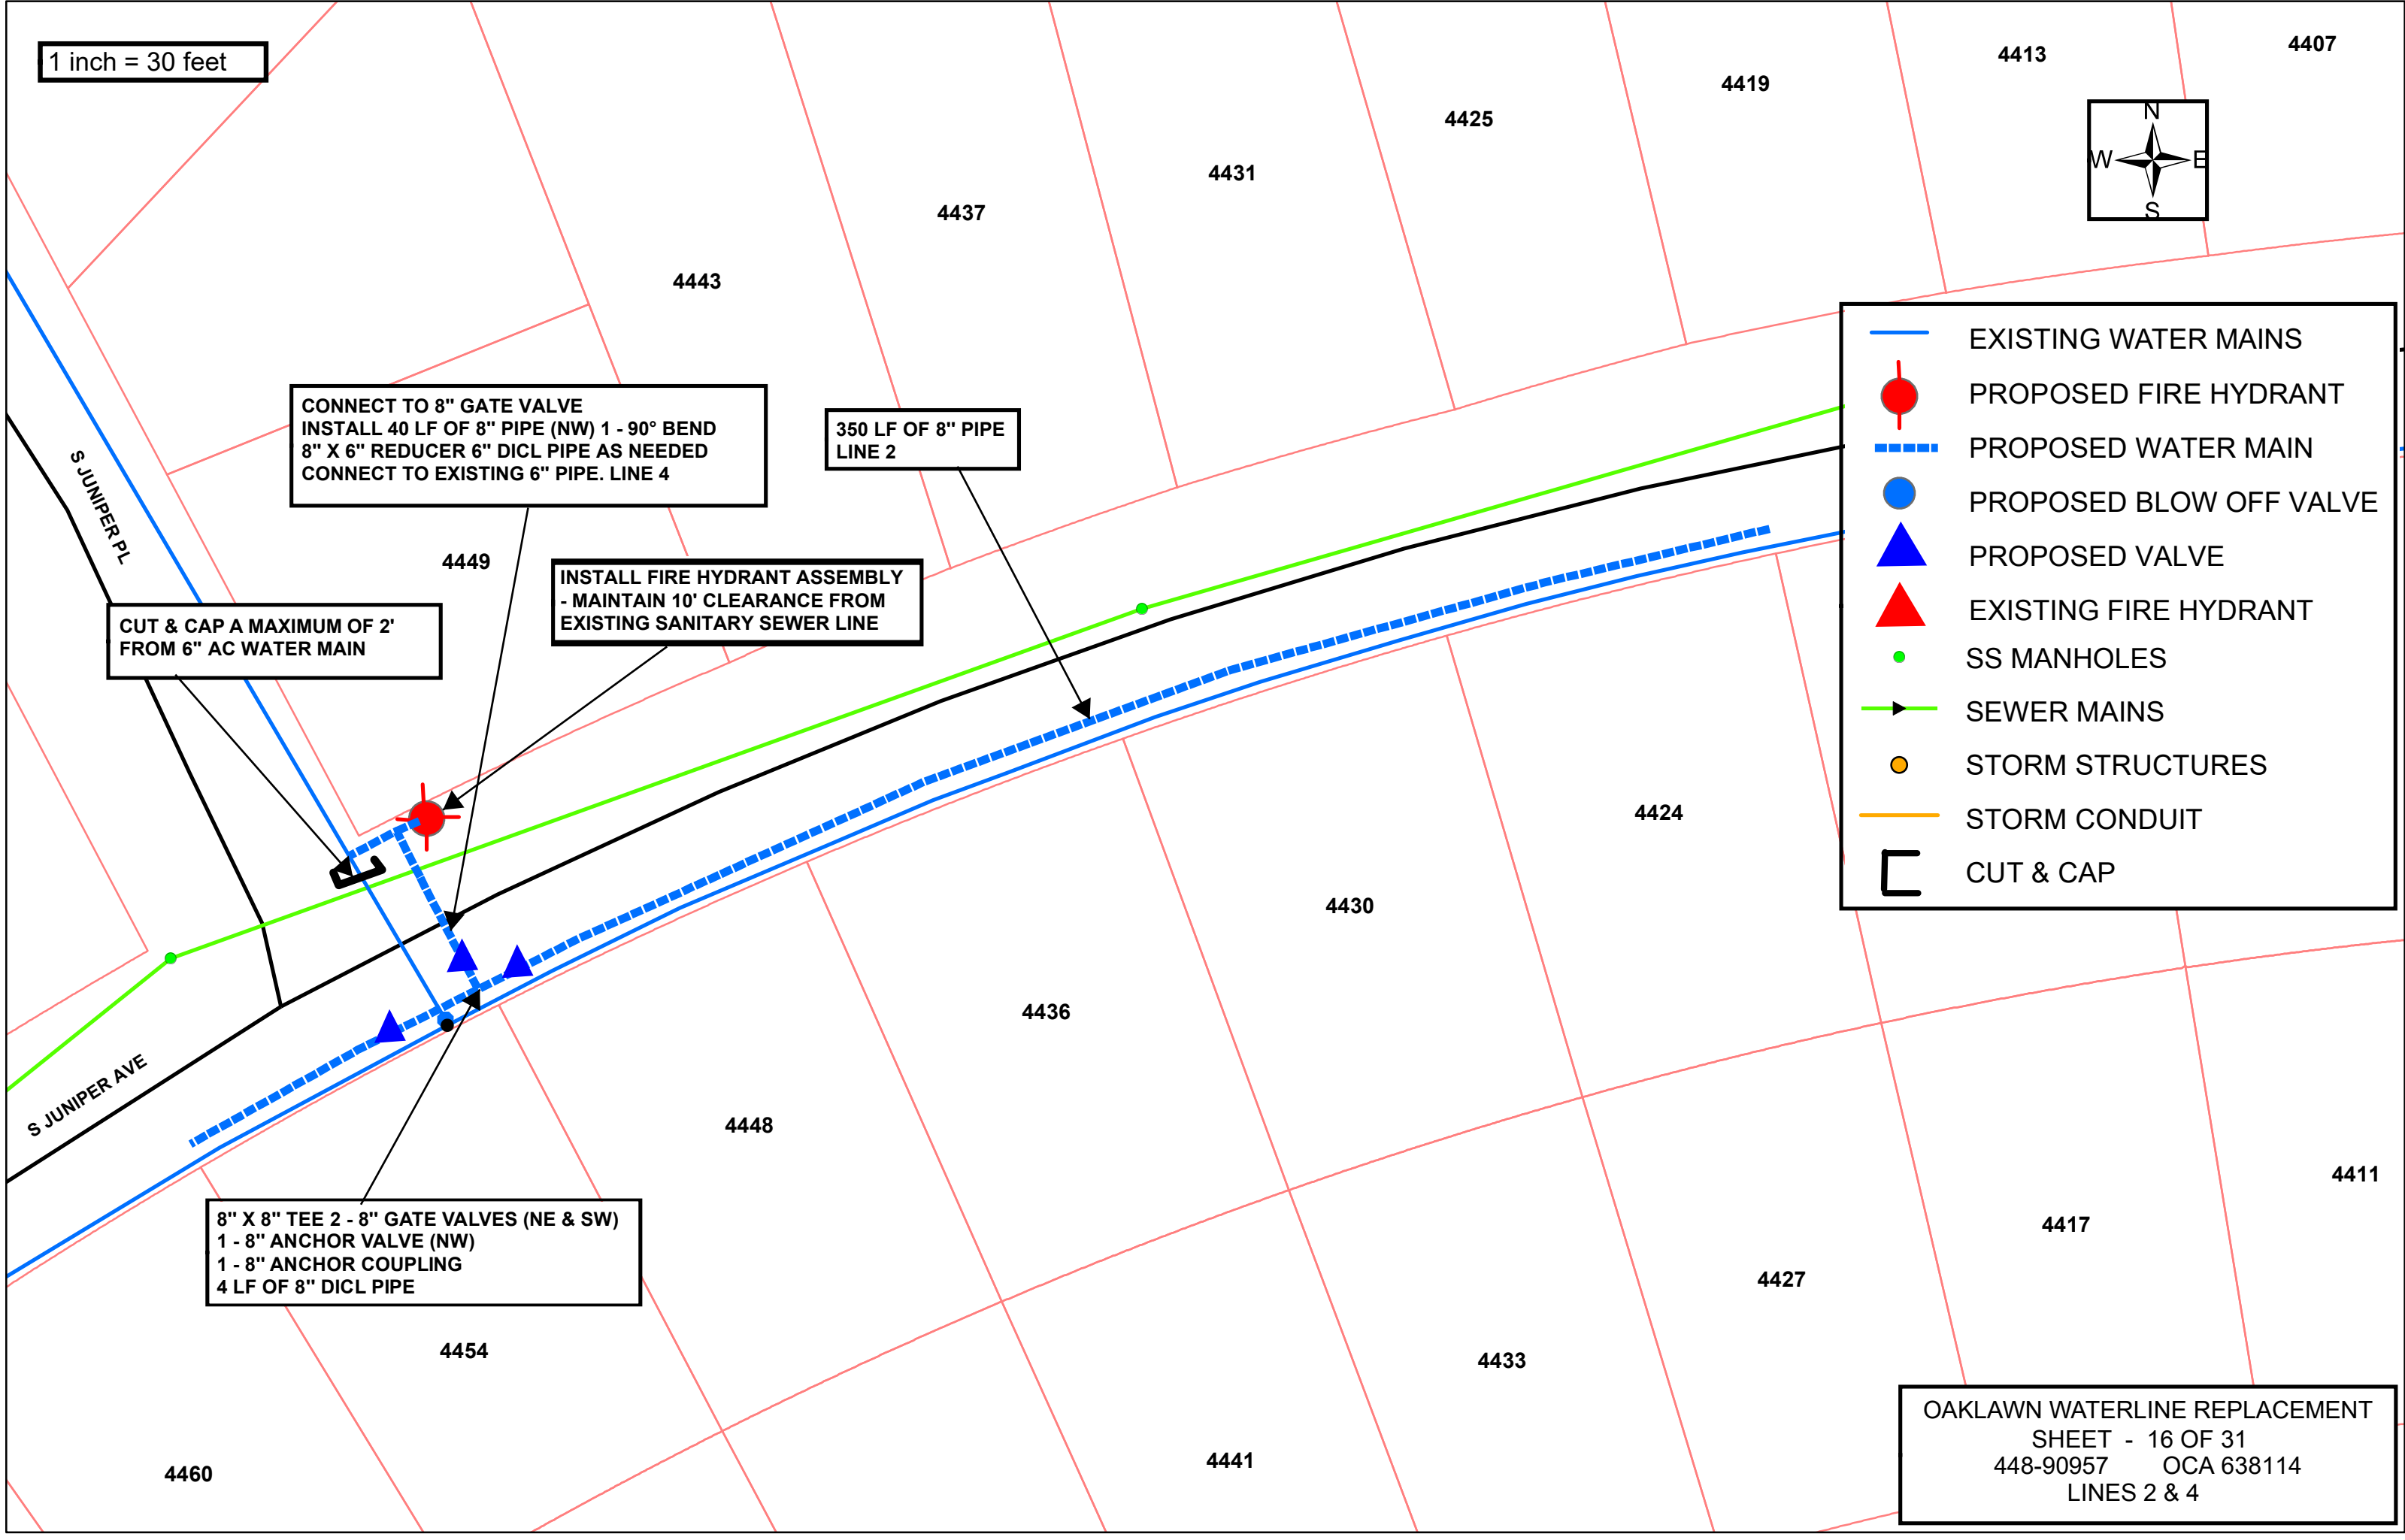

OAKLAWN WATERLINE REPLACEMENT  
SHEET - 16 OF 31  
448-90957 OCA 638114  
LINES 2 & 4