



1 inch = 30 feet



	EXISTING WATER MAINS
	PROPOSED FIRE HYDRANT
	PROPOSED WATER MAIN
	PROPOSED BLOW OFF VALVE
	PROPOSED VALVE
	EXISTING FIRE HYDRANT
	SS MANHOLES
	SEWER MAINS
	STORM STRUCTURES
	STORM CONDUIT
	CUT & CAP

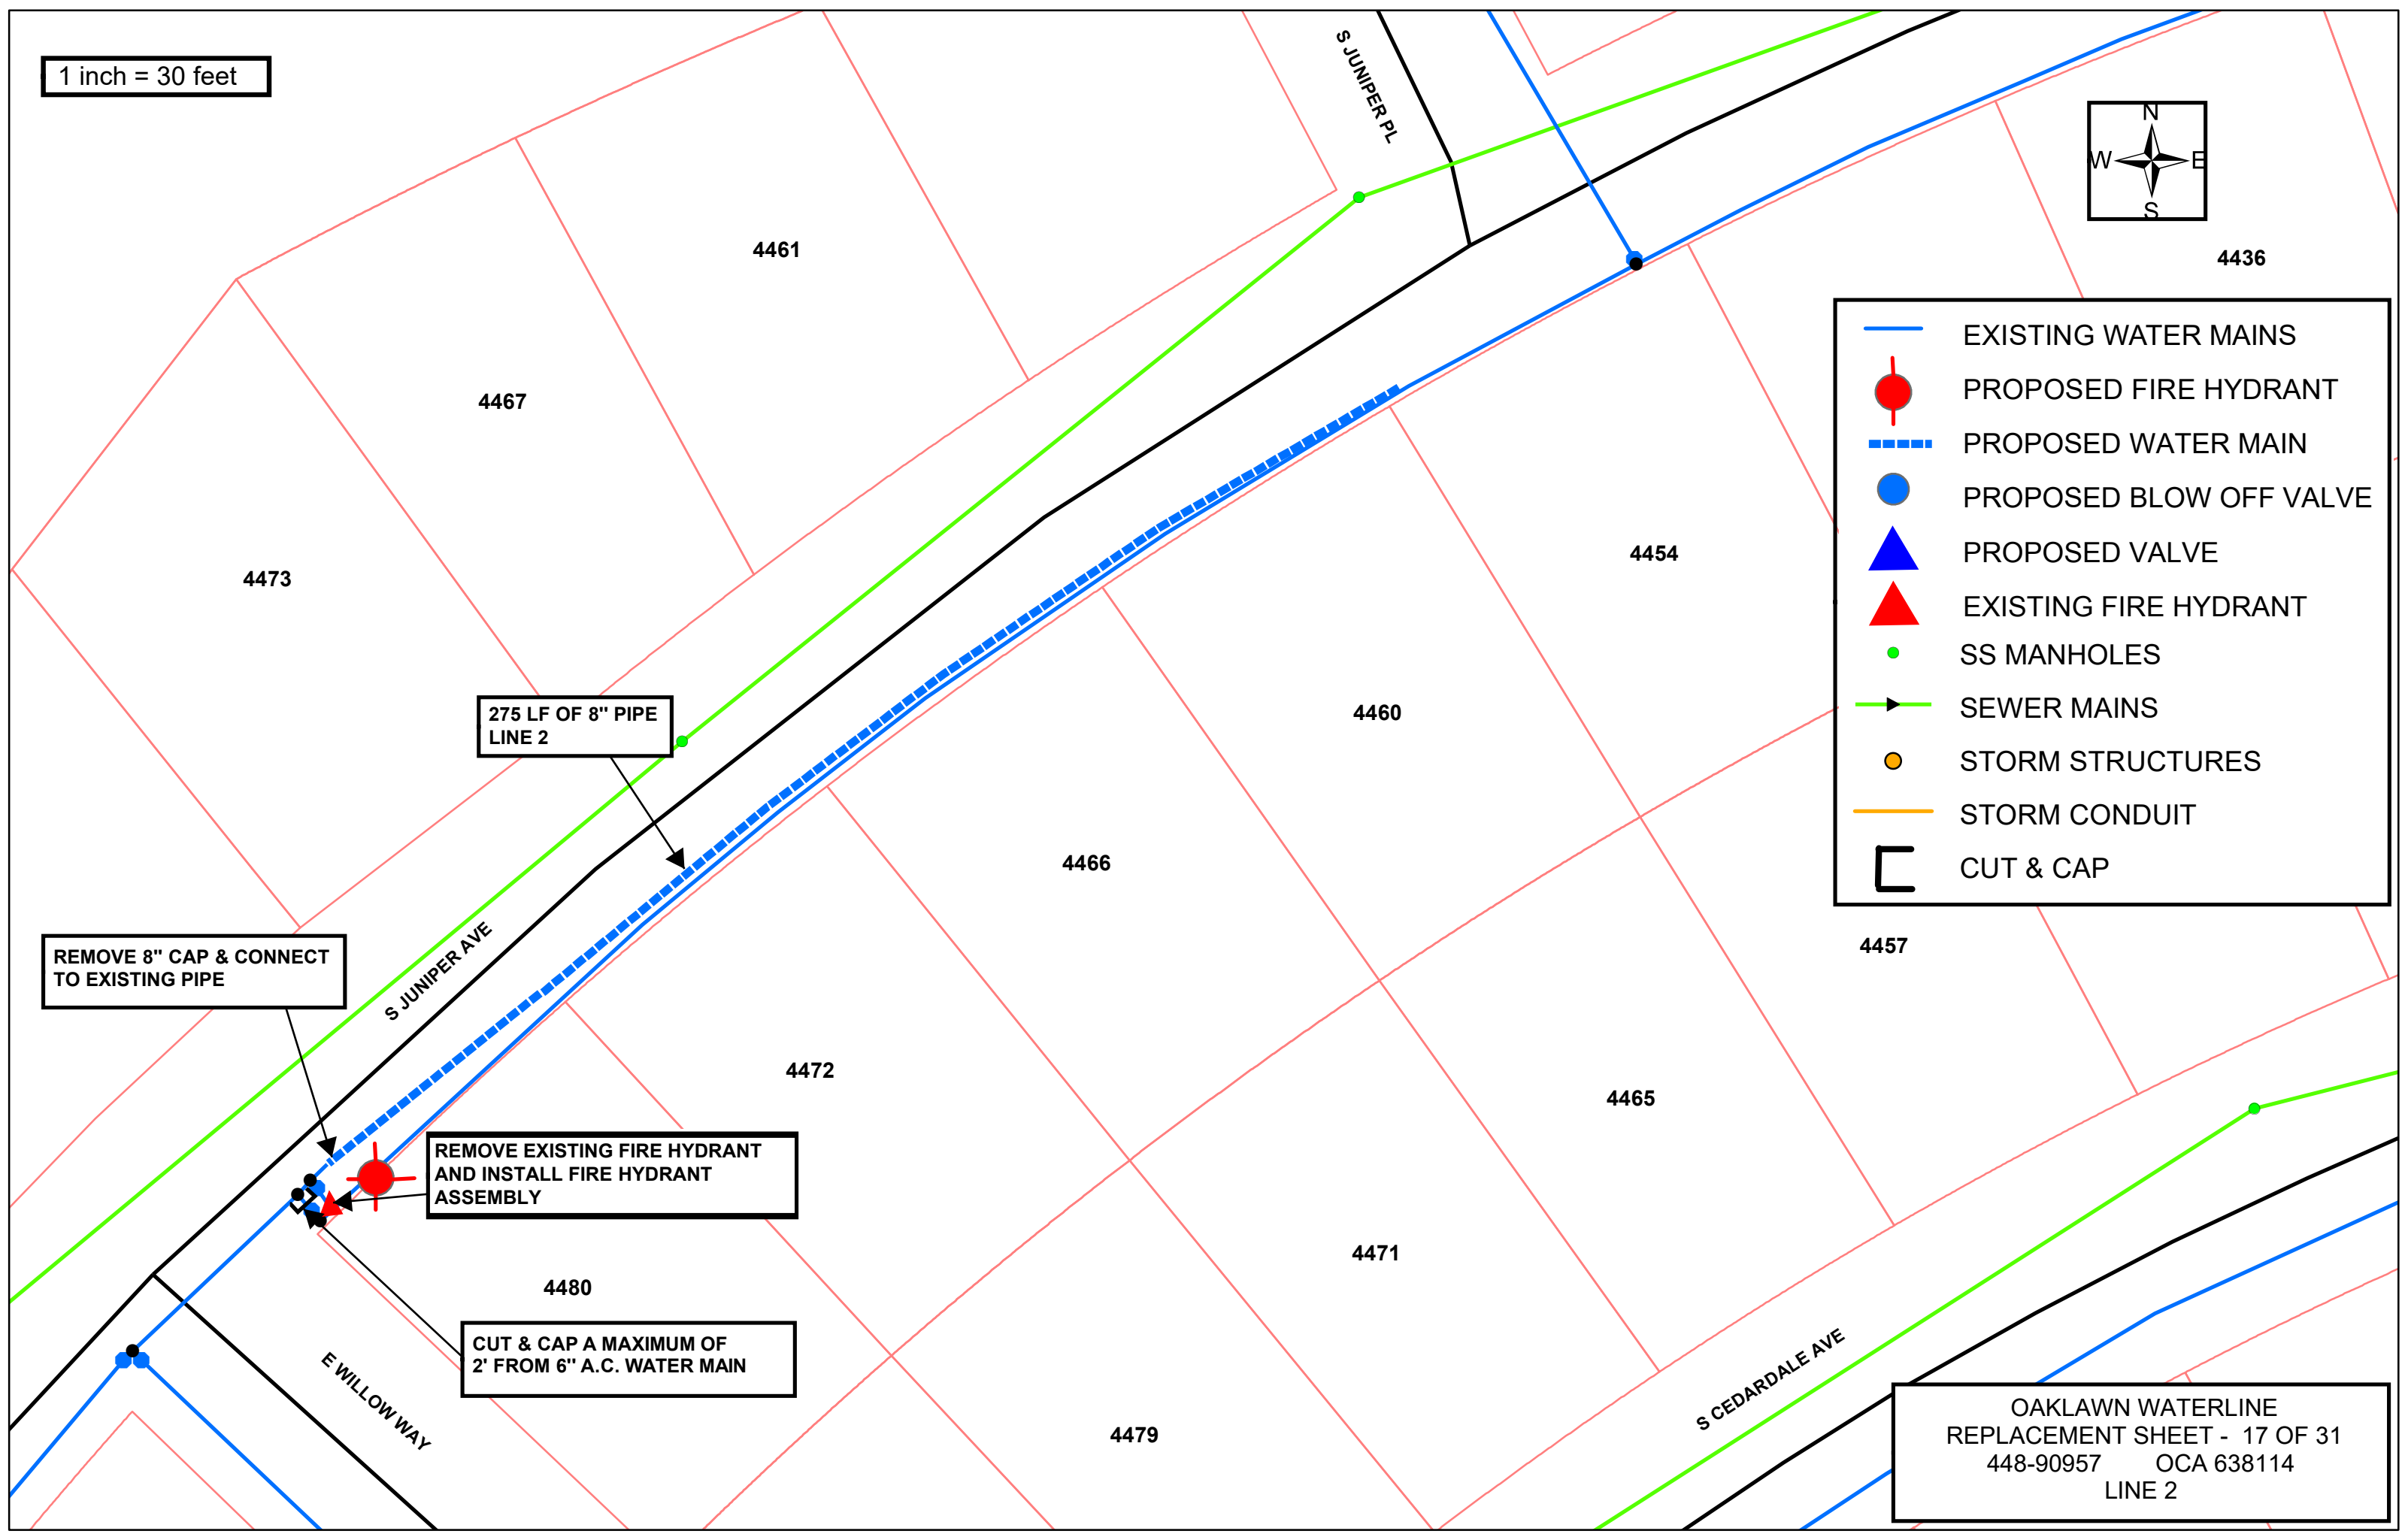

REMOVE 8" CAP & CONNECT TO EXISTING PIPE

275 LF OF 8" PIPE LINE 2

REMOVE EXISTING FIRE HYDRANT AND INSTALL FIRE HYDRANT ASSEMBLY

CUT & CAP A MAXIMUM OF 2' FROM 6" A.C. WATER MAIN

OAKLAWN WATERLINE
 REPLACEMENT SHEET - 17 OF 31
 448-90957 OCA 638114
 LINE 2