



1 inch = 30 feet



	EXISTING WATER MAINS
	PROPOSED FIRE HYDRANT
	PROPOSED WATER MAIN
	PROPOSED BLOW OFF VALVE
	PROPOSED VALVE
	EXISTING FIRE HYDRANT
	SS MANHOLES
	SEWER MAINS
	STORM STRUCTURES
	STORM CONDUIT
	CUT & CAP

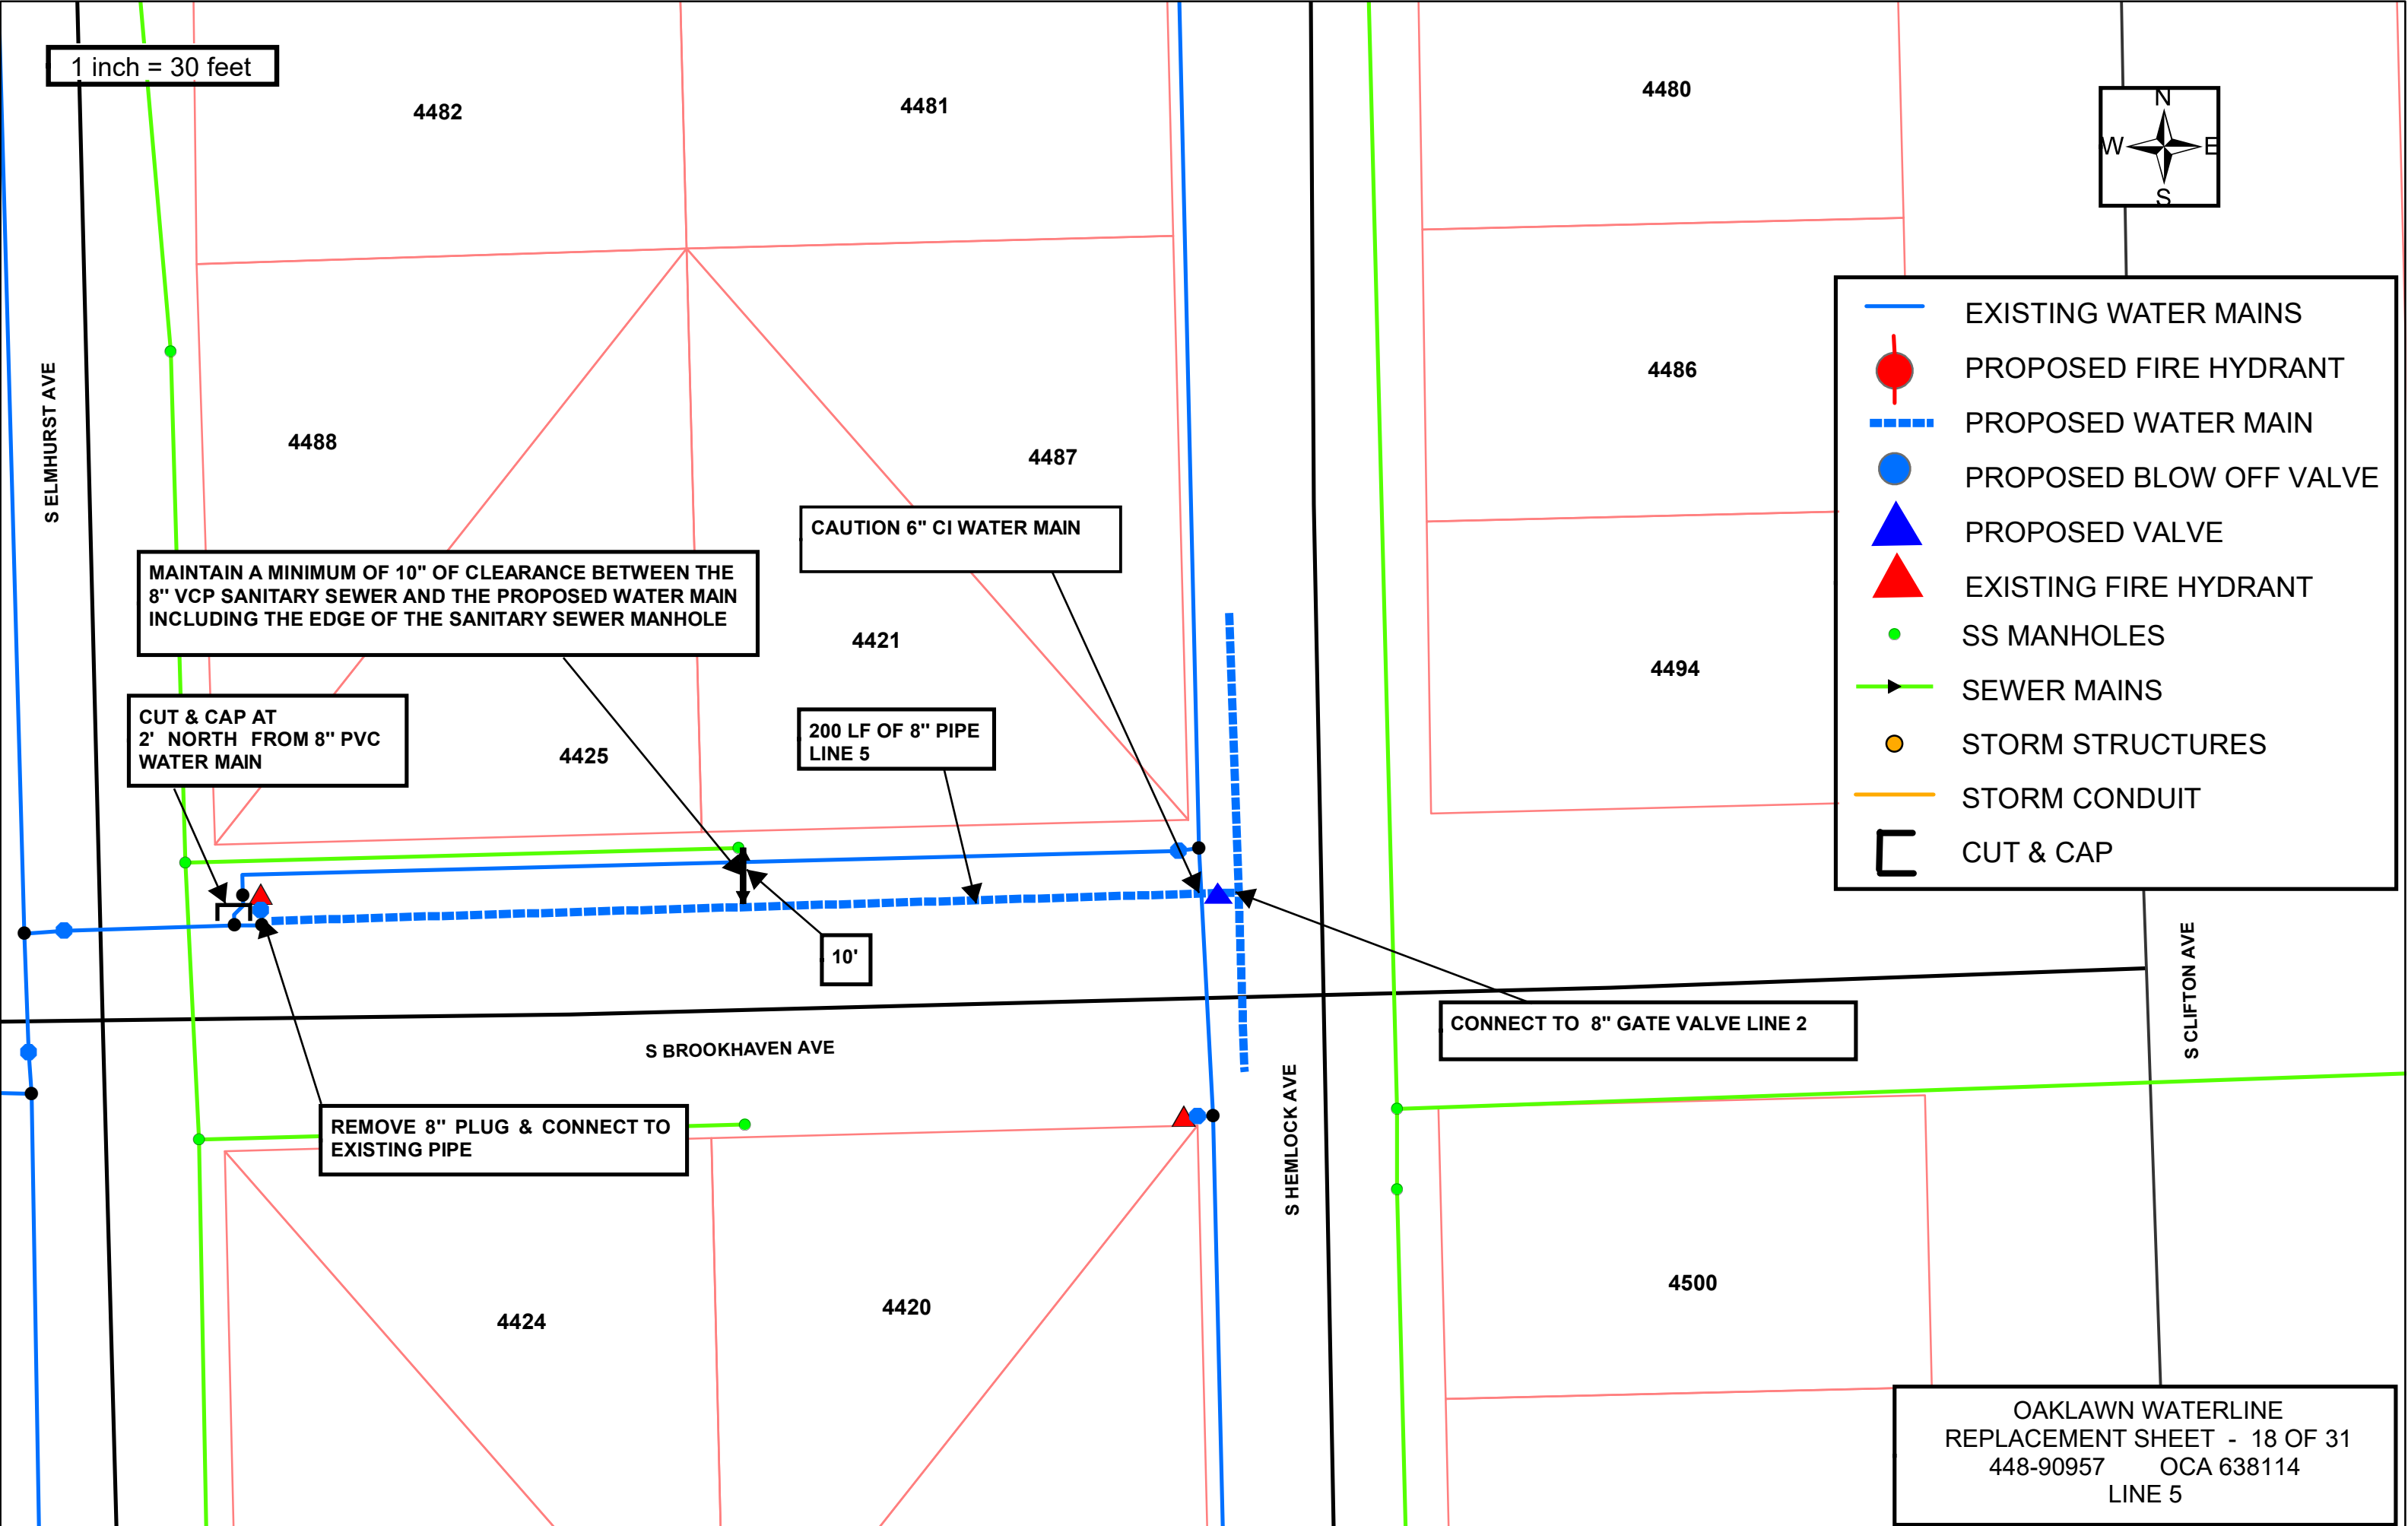

MAINTAIN A MINIMUM OF 10" OF CLEARANCE BETWEEN THE 8" VCP SANITARY SEWER AND THE PROPOSED WATER MAIN INCLUDING THE EDGE OF THE SANITARY SEWER MANHOLE

CAUTION 6" CI WATER MAIN

CUT & CAP AT 2' NORTH FROM 8" PVC WATER MAIN

200 LF OF 8" PIPE LINE 5

10'

CONNECT TO 8" GATE VALVE LINE 2

REMOVE 8" PLUG & CONNECT TO EXISTING PIPE

OAKLAWN WATERLINE
 REPLACEMENT SHEET - 18 OF 31
 448-90957 OCA 638114
 LINE 5