



1 inch = 30 feet

REMOVE EXISTING FIRE HYDRANT AND INSTALL FIRE HYDRANT ASSEMBLY

250 LF OF 8" PIPE LINE 2



	EXISTING WATER MAINS
	PROPOSED FIRE HYDRANT
	PROPOSED WATER MAIN
	PROPOSED BLOW OFF VALVE
	PROPOSED VALVE
	EXISTING FIRE HYDRANT
	SS MANHOLES
	SEWER MAINS
	STORM STRUCTURES
	STORM CONDUIT
	CUT & CAP

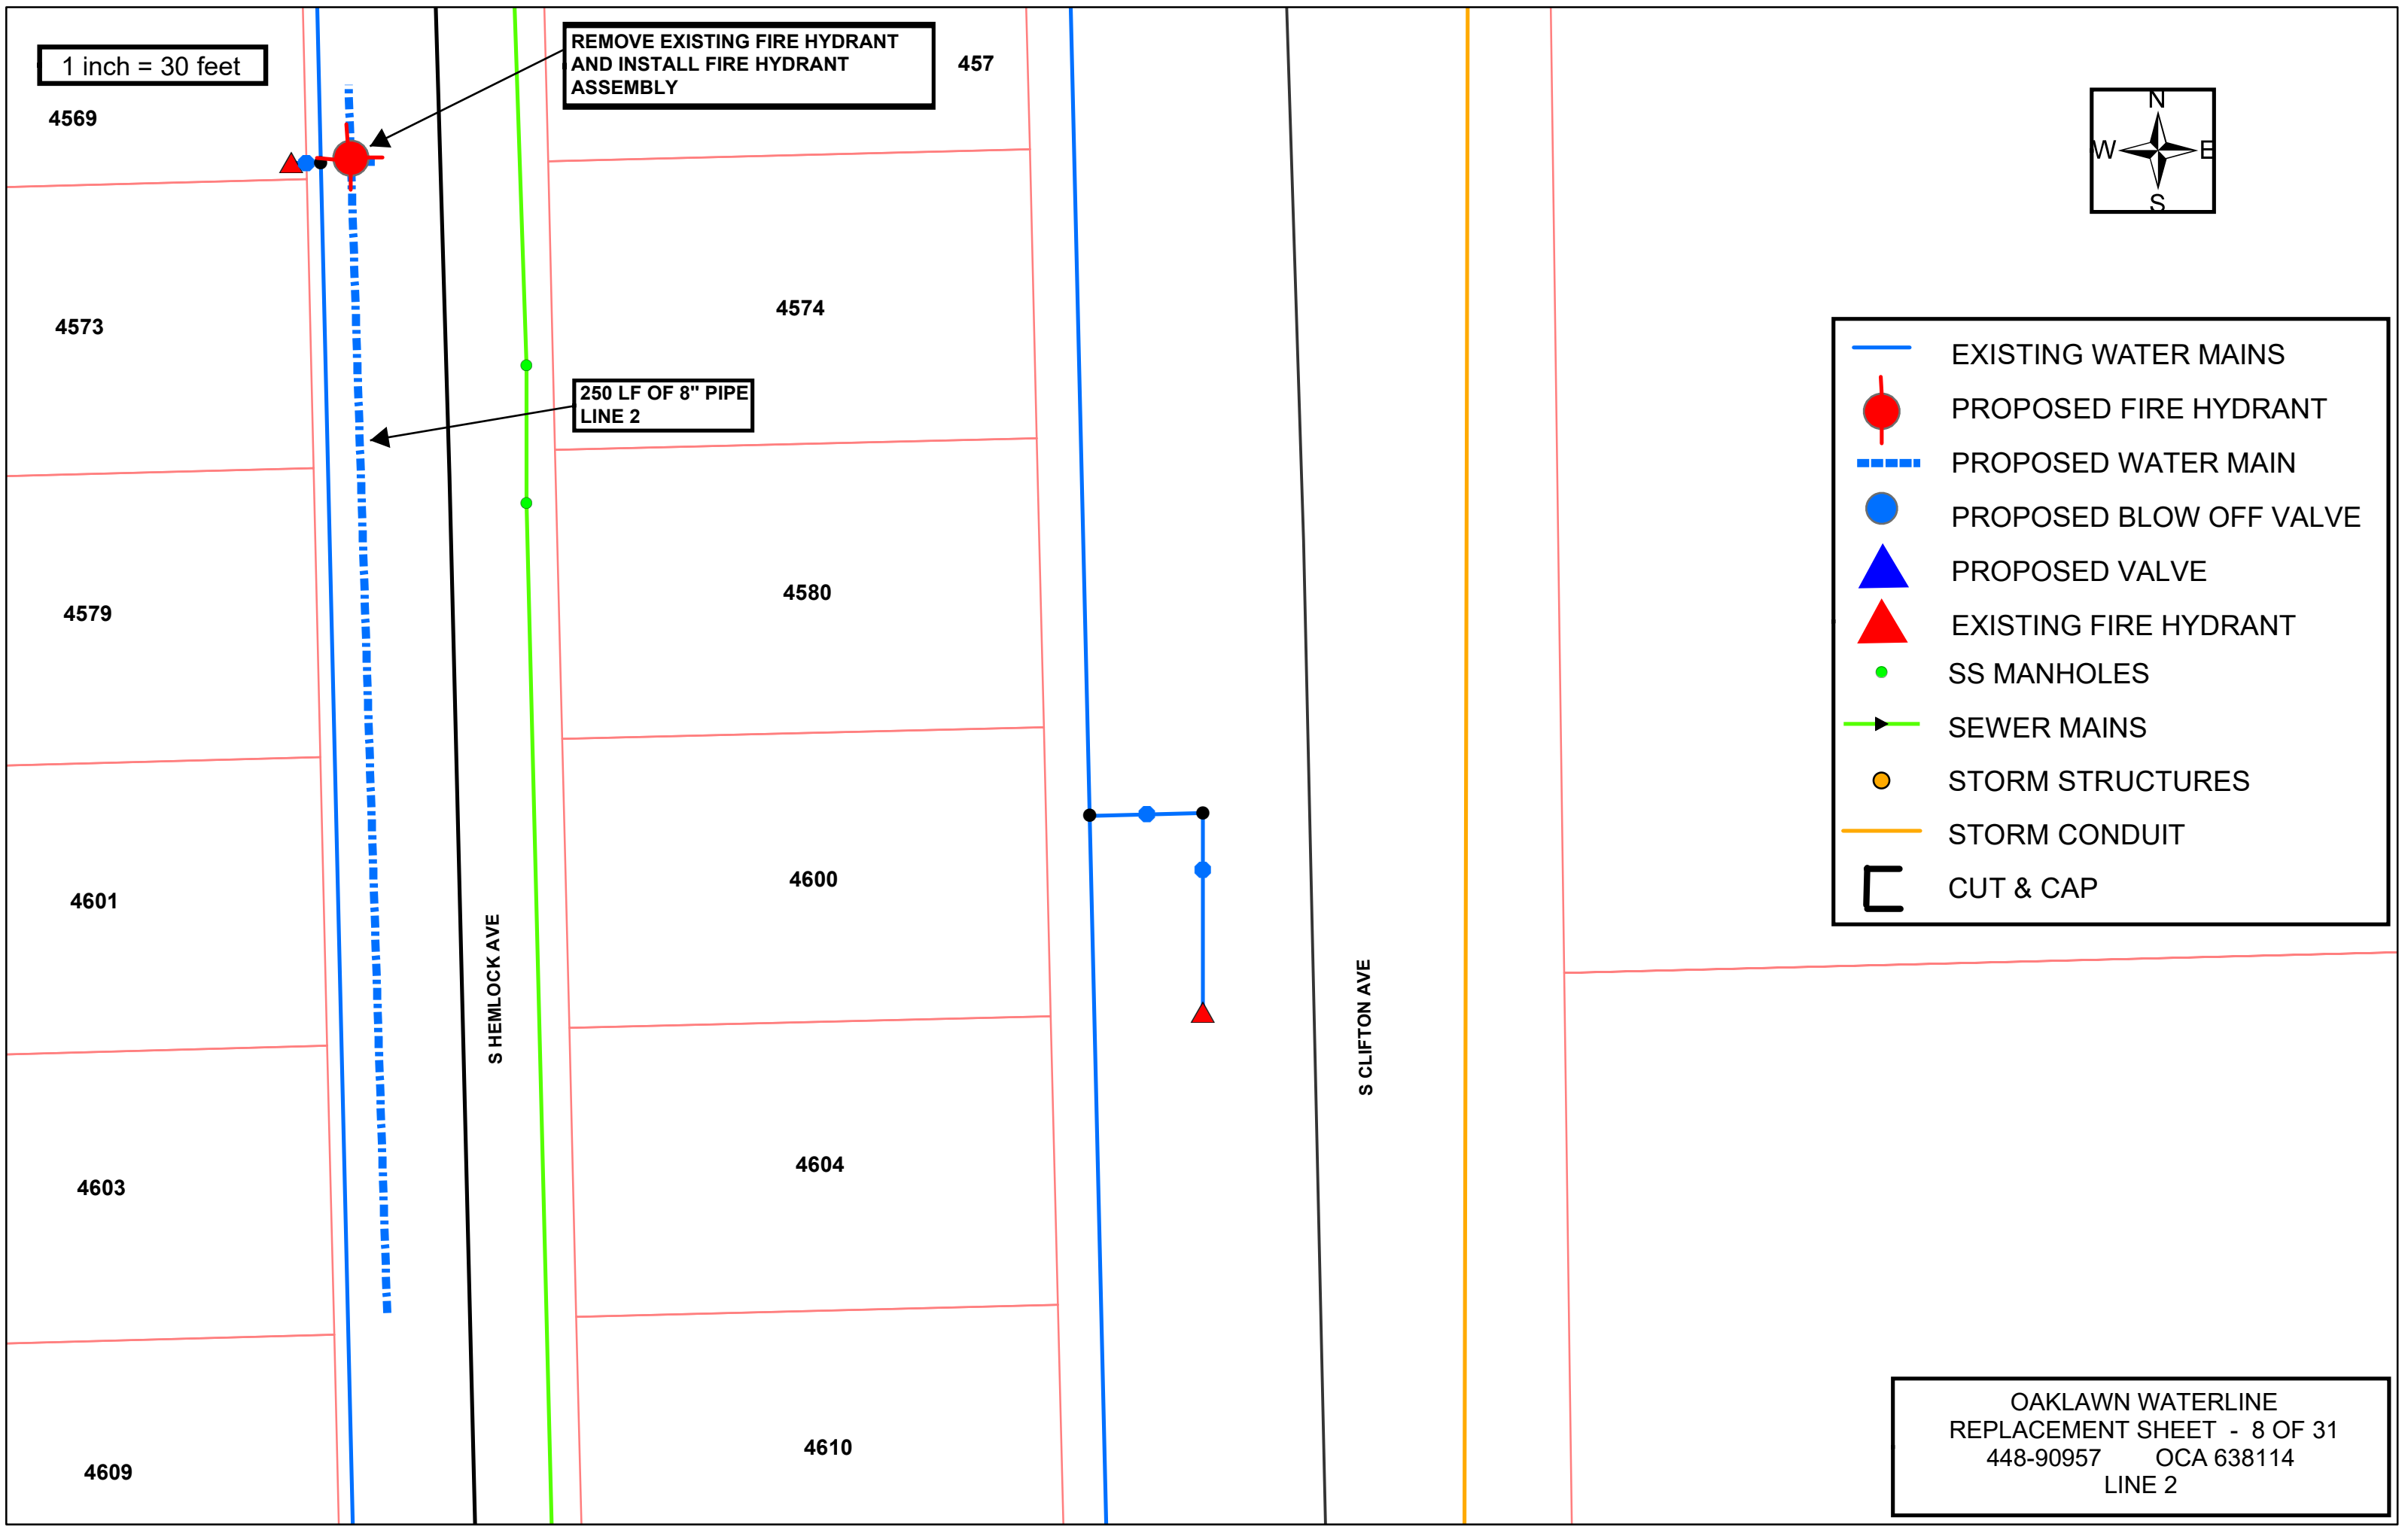

OAKLAWN WATERLINE  
 REPLACEMENT SHEET - 8 OF 31  
 448-90957 OCA 638114  
 LINE 2