


SECTION - MODIFICATION
SCALE: 1/2" = 1'-0"

Pipe Support Notes:
Where applicable the Contractor shall utilize existing pipe supports by making adjustments as required.
Add additional pipe supports as necessary.
Remove existing pipe supports that will not be reused.



SECTION - DEMOLITION
SCALE: 1/2" = 1'-0"

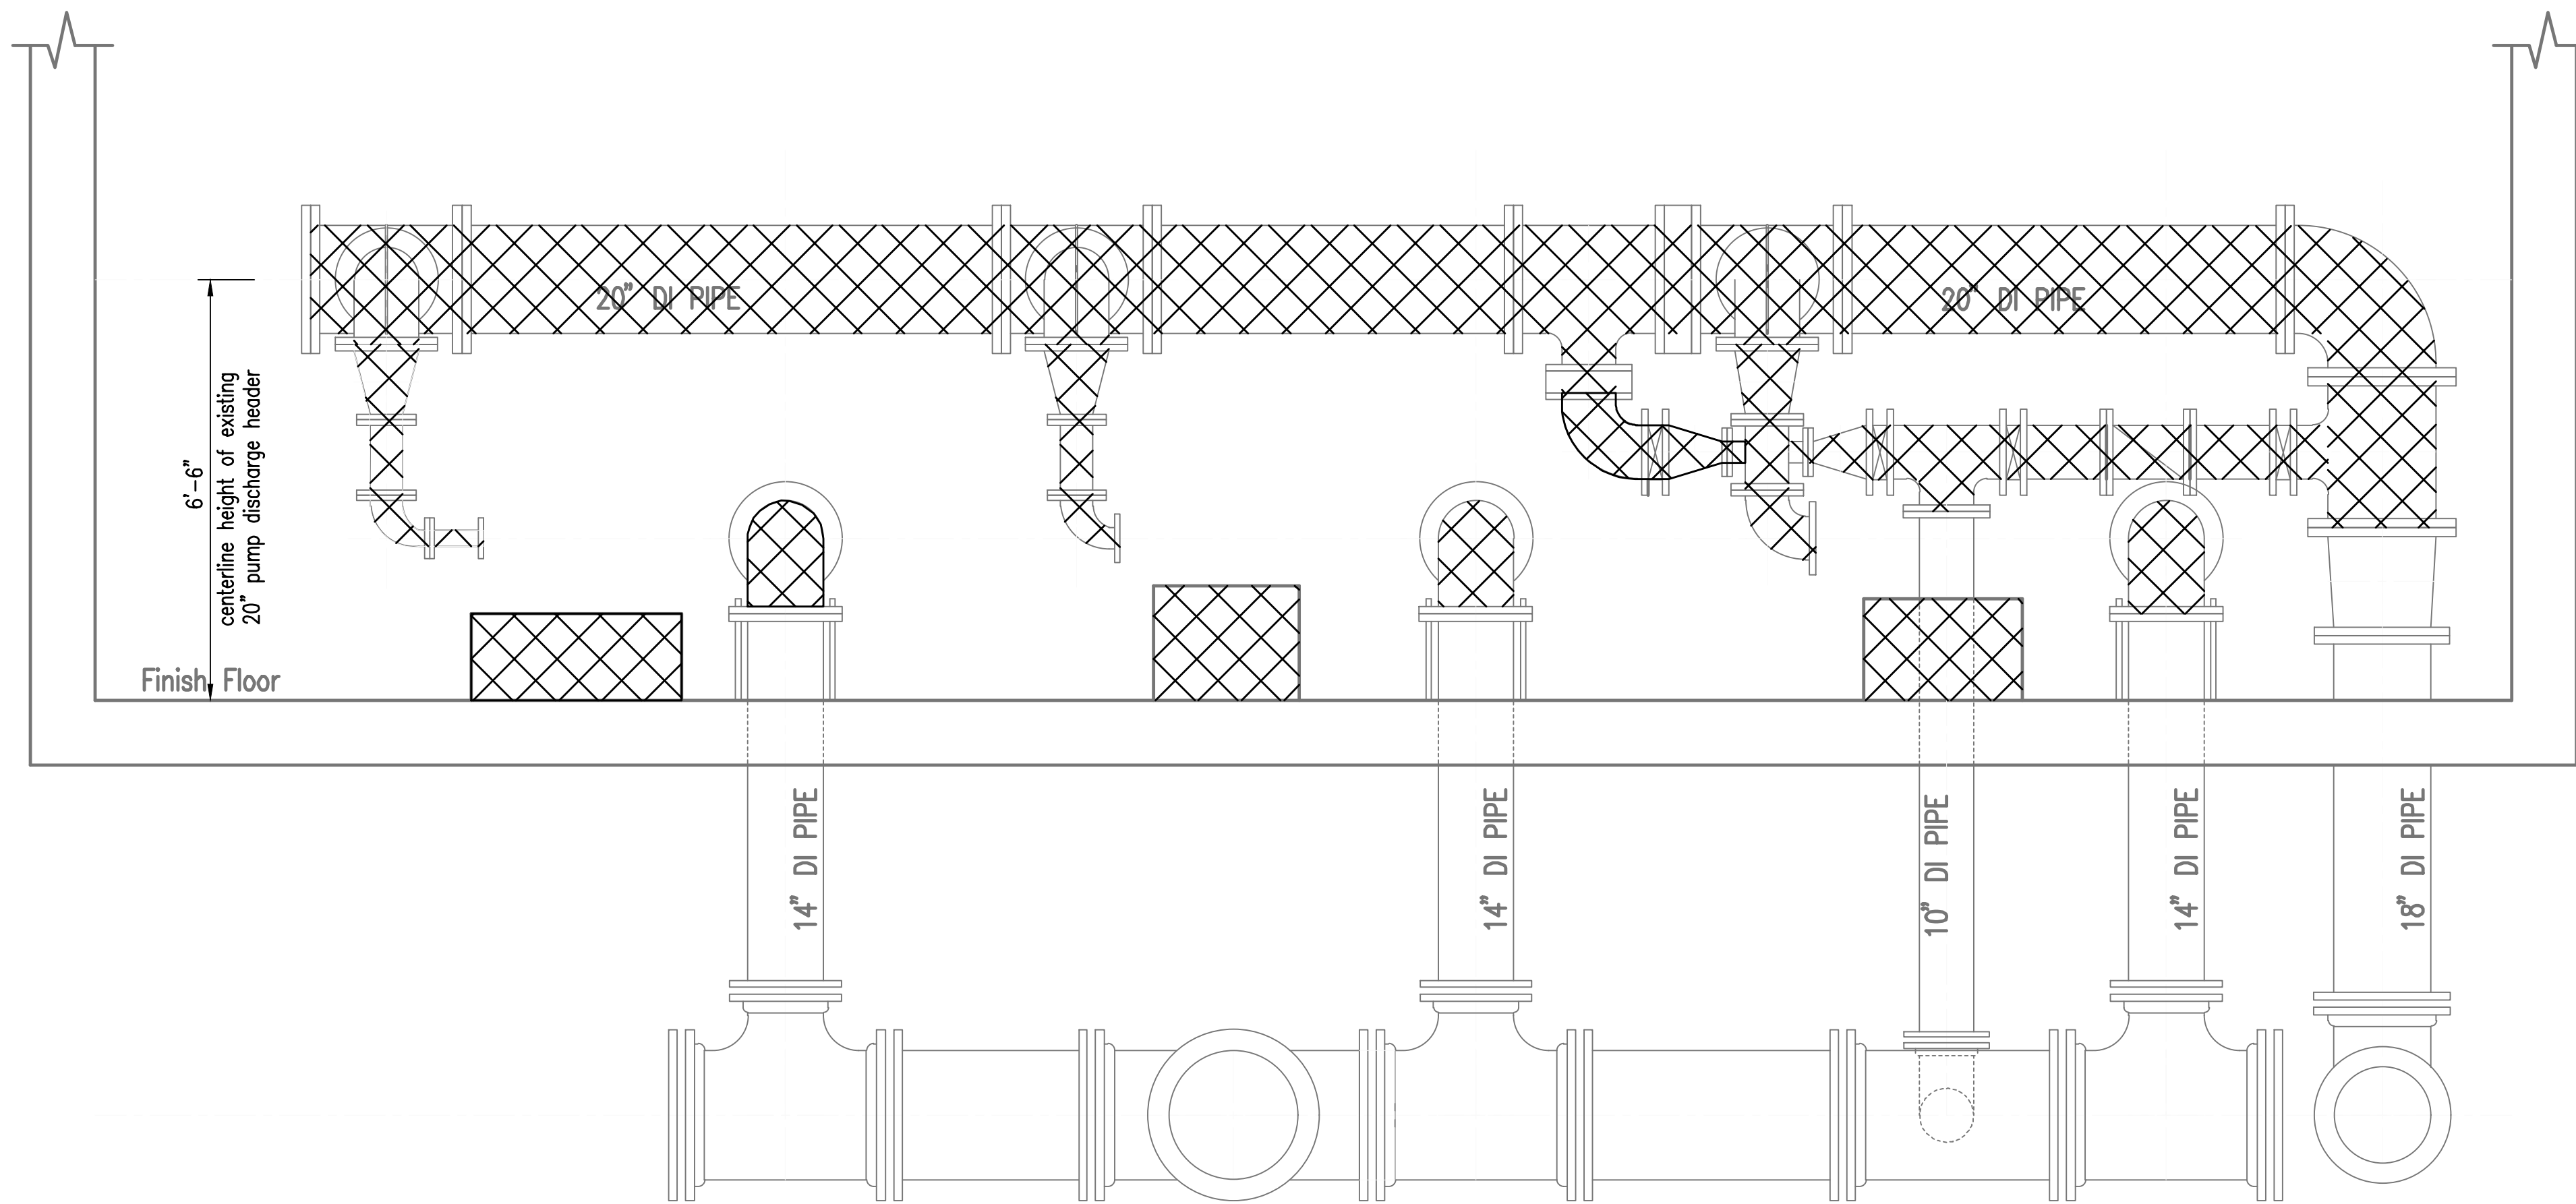

Indicates piping or equipment needs to be adequately supported. Supports such as Wall Brackets, Clevis Hangers and Steel or Concrete supports shall be positioned to adequately support the pipe. The Contractor shall also install any additional pipe supports deemed necessary. The Contractor shall submit to the Engineer for approval the type of pipe support and proposed location(s) for installation.

DENOTES PIPING, EQUIPMENT AND CONCRETE PADS FOR REMOVAL.

Note:
The Contractor shall coordinate the concrete pump base dimensions and mounting requirements with the selected pump manufacturer.

No.	Revision	By	Date
CITY OF WICHITA, KANSAS			
PIPING SECTIONS DEMOLITION / MODIFICATION			
37TH STREET BOOSTER PUMP STATION IMPROVEMENTS			
P.E.C.		PROFESSIONAL ENGINEERING CONSULTANTS, P.A. 303 SOUTH TOPEKA WICHITA, KS 67202 316-262-2891 www.pec1.com	
Designed by	NDF	Job No.	34-170920-000
Drawn by		Date	DECEMBER 2018
			Sht. C4 of 5

