KEYED NOTES:

#	
O1	PROVIDE 70A. 3P. 480V CIRCUIT BREAKER THAT MATCHES EXISTING PANEL MANUFACTURER, TYPE, AND A.I.C RATING. UPDATE NAMPLATE DIRECTORY AS REUQIRED.
O2	VERIFY WHICH BREAKER SERVES UNIT #2. PROVIDE 70A BREAKER FOR THE PROPOSED UNIT.

GENERAL ONE-LINE DIAGRAM NOTES:

1. UNLESS OTHERWISE NOTED, ALL CIRCUIT BREAKERS AND/OR SWITCHES ARE THREE POLE.
2. ALL ELECTRICAL EQUIPMENT AND WIRING SHOWN IN A LIGHT LINE, IS EXISTING TO REMAIN.
3. ALL ELECTRICAL EQUIPMENT AND WIRING SHOWN IN A DARK LINE, IS NEW WORK UNDER THIS CONTRACT.
4. ALL ELECTRICAL EQUIPMENT AND WIRING SHOWN IN A DARK DASHED LINE, IS TO BE REMOVED UNDER THIS CONTRACT.

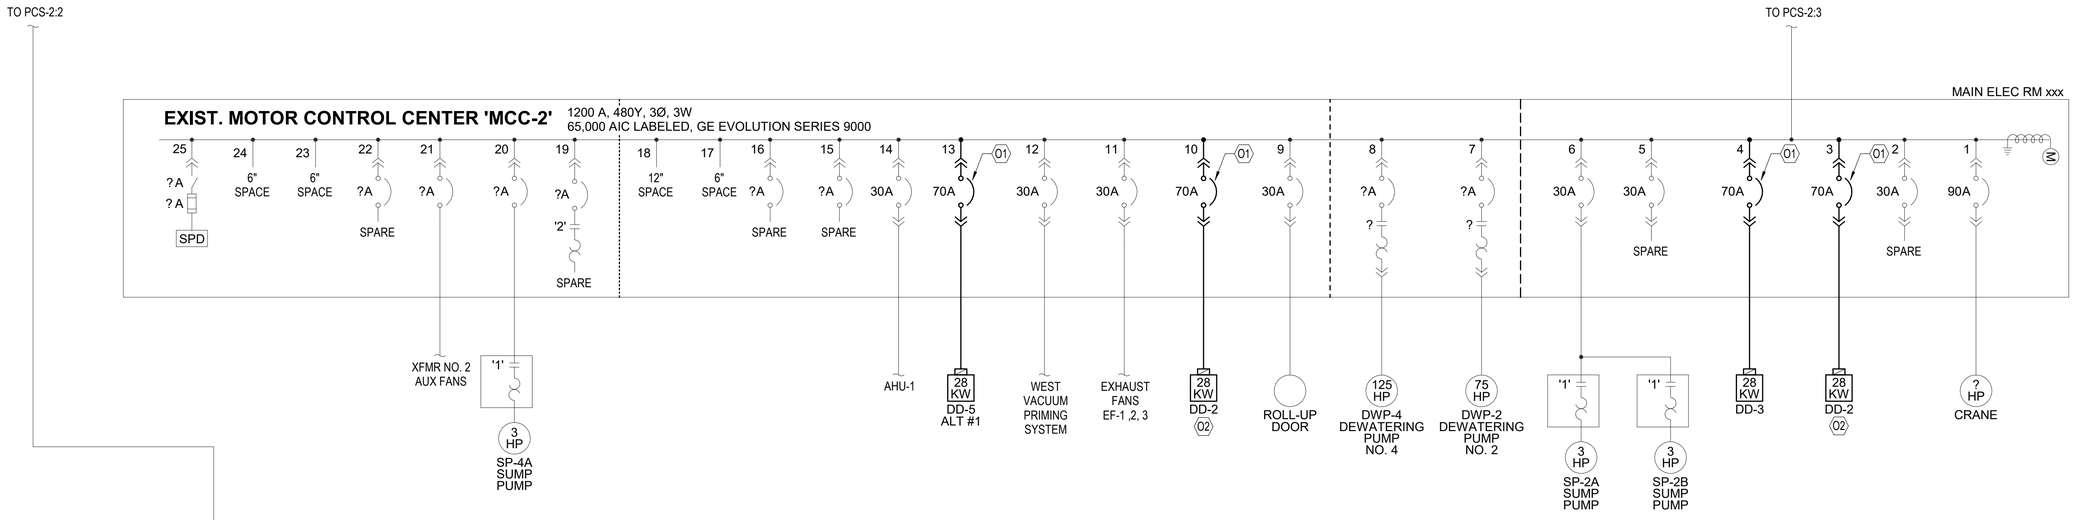

1 PARTIAL ELECTRICAL ONE-LINE DIAGRAM

N0 SCALE

PEC
PROFESSIONAL ENGINEERING CONSULTANTS
303 SOUTH TOPEKA
WICHITA, KS 67202
316-262-2691 www.pec1.com

CITY OF WICHITA

ROBERT D. BIBY LICENSED 17443 11-13-19 KANSAS PROFESSIONAL ENGINEER

2020 HESS PUMP STATION
DEHUMIDIFIER REPLACMENT
WICHITA, KS

ELECTRICAL ONE-LINE DIAGRAM

JOB NO.197043-008
DATE 11/13/19
DRAWN BY ABP
CHECKED BY RDB

E0.2

11/13/2019 10:32:18 AM
C:\Users\adam.potter\Documents\197043-008-Master Elec-R19_adam.potter@pec1.com.rvt