TYPICAL CONCRETE DITCH LINING
Not to scale

GENERAL NOTES:
1. All Work To Be Performed In Accordance With The City of Wichita Storm Sewers & Drainage Standard Specifications.

2. All Concrete, Reinforcement, Removal, Labor, Excavation, Backslope Grading, and All Other Incidentals Shall Be Incidental To Concrete Ditch Lining Bid Item.

3. All Exposed Concrete Edges Shall Be Beveled 3/4".

4. All Reinforcing Steel To Have Minimum of 1-1/2" Concrete Cover.

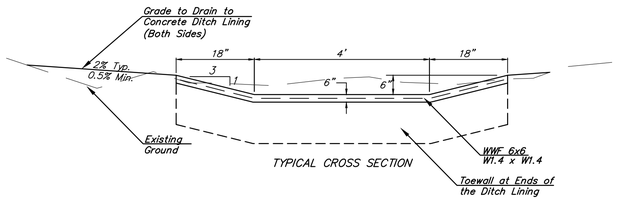

*SEE SANITARY SEWER PLANS FOR DETAIL OF CONCRETE ENCASED SANITARY SEWER CROSSING CONCRETE DITCH LINING SECTION

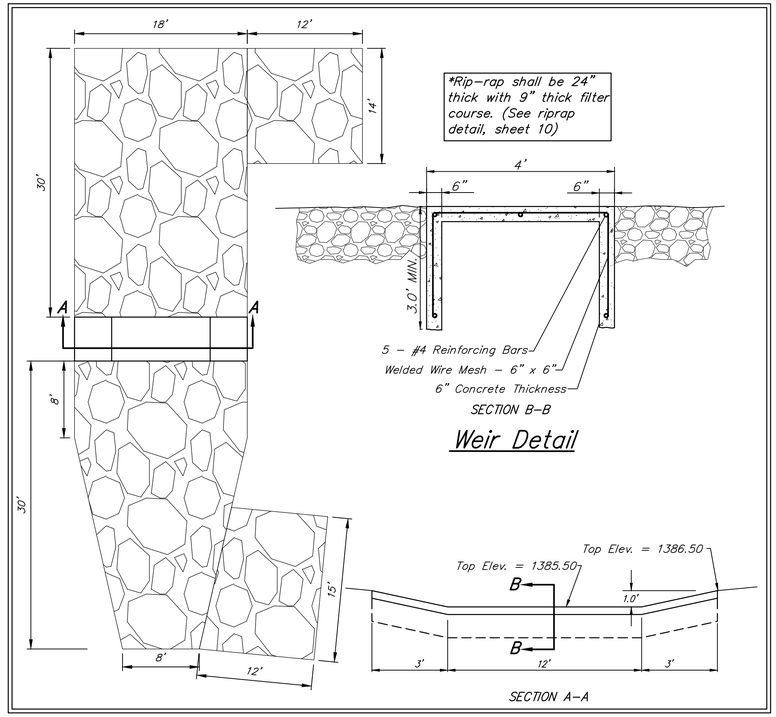

Weir Detail

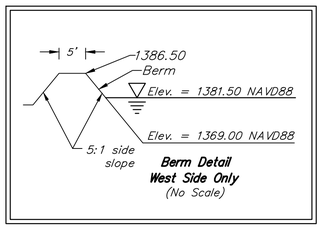

Berm Detail
West Side Only
(No Scale)

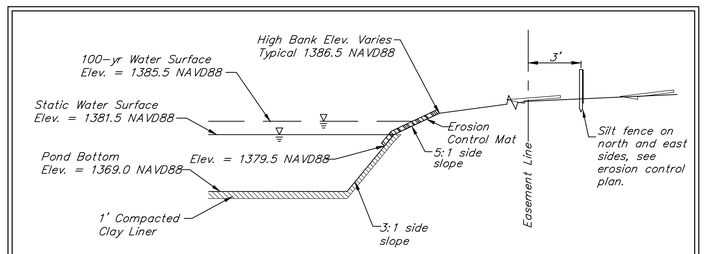

Typical Section Detail
(No Scale)

Baughman Company, P.A.
315 Ellis St. Wichita, KS 67211 P 316.262.2221 F 316.262.2149
Civil Engineering & Planning Consultants COA#E-2005 exp. 10/31/2018
Drawn: Designed: Approved: Date: 11/17/17

FIREFLY WAY ADDITION
POND DETAILS
STORM WATER DRAIN IMPROVEMENTS

REVISIONS:

SHEET 8A
OF 20