



NOTES:  
 1. COORDINATE T-STAT VOLTAGE REQUIREMENTS WITH MANUFACTURER'S RECOMMENDATIONS. PROVIDE LV TRANSFORMER IF REQUIRED.

1  
E6 EXHAUST FAN PANEL SCHEMATIC DETAIL  
SCALE: NONE

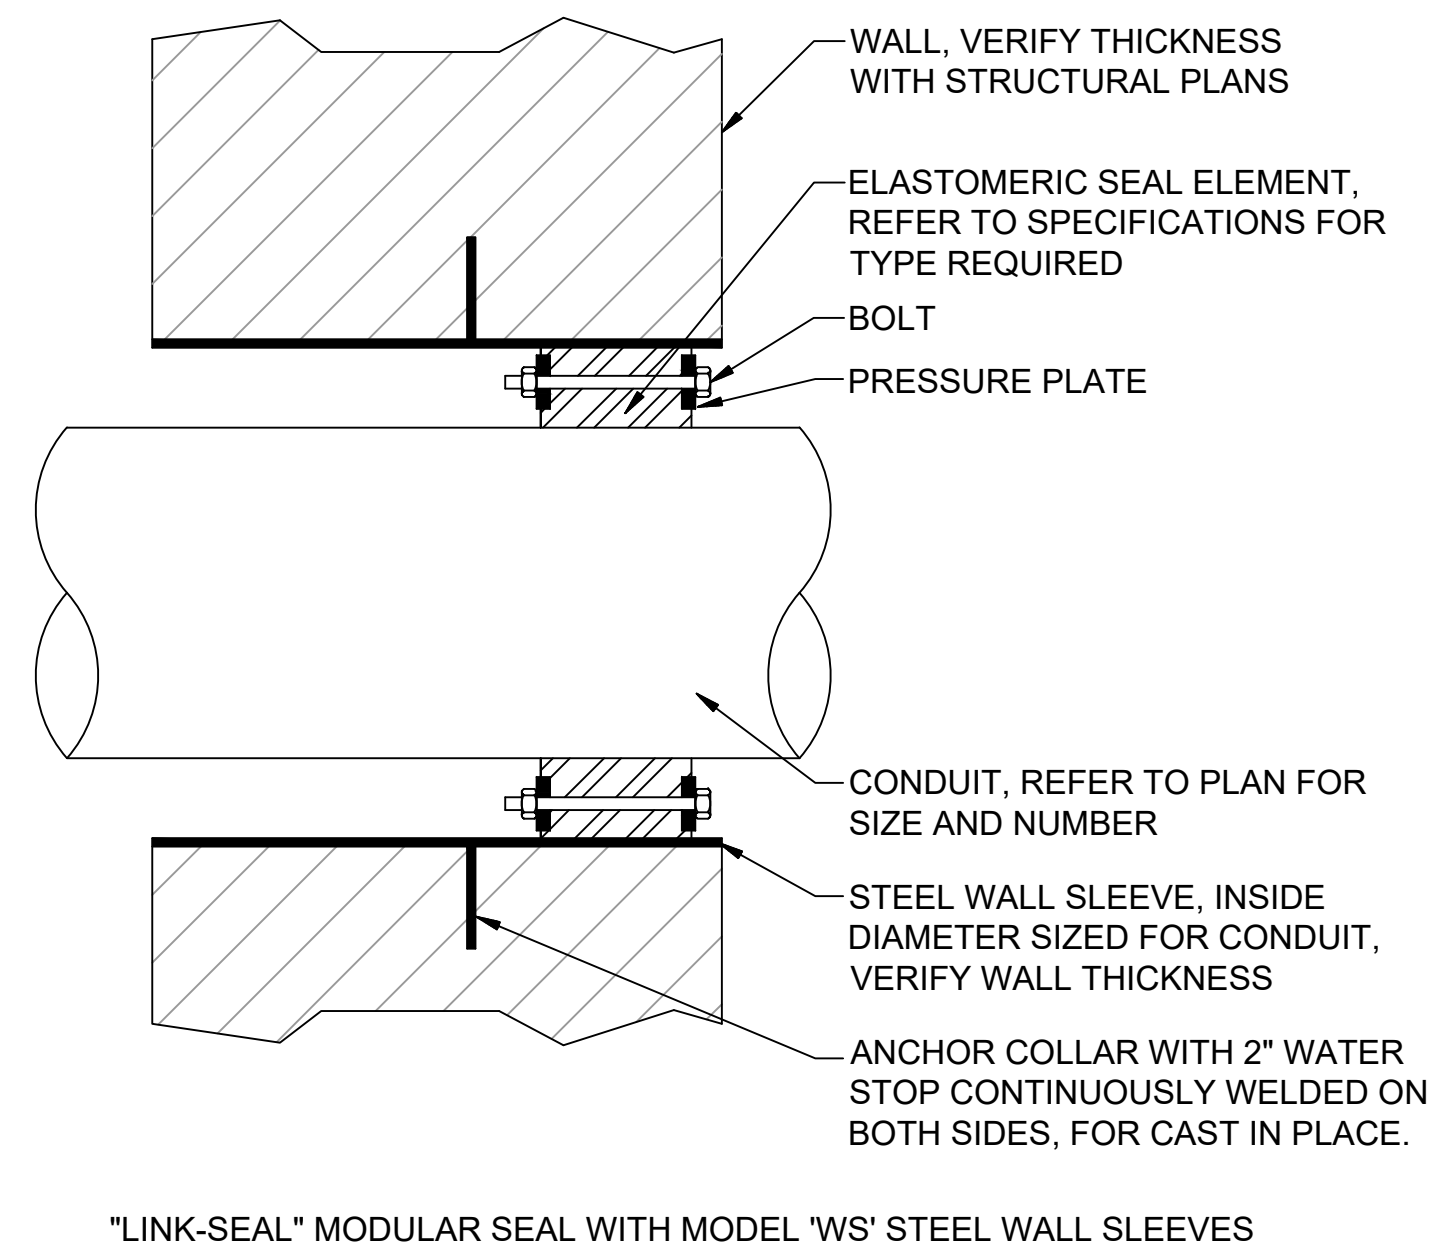

2  
E6 TYPICAL WATER STOP SEALING DETAIL  
SCALE: NONE

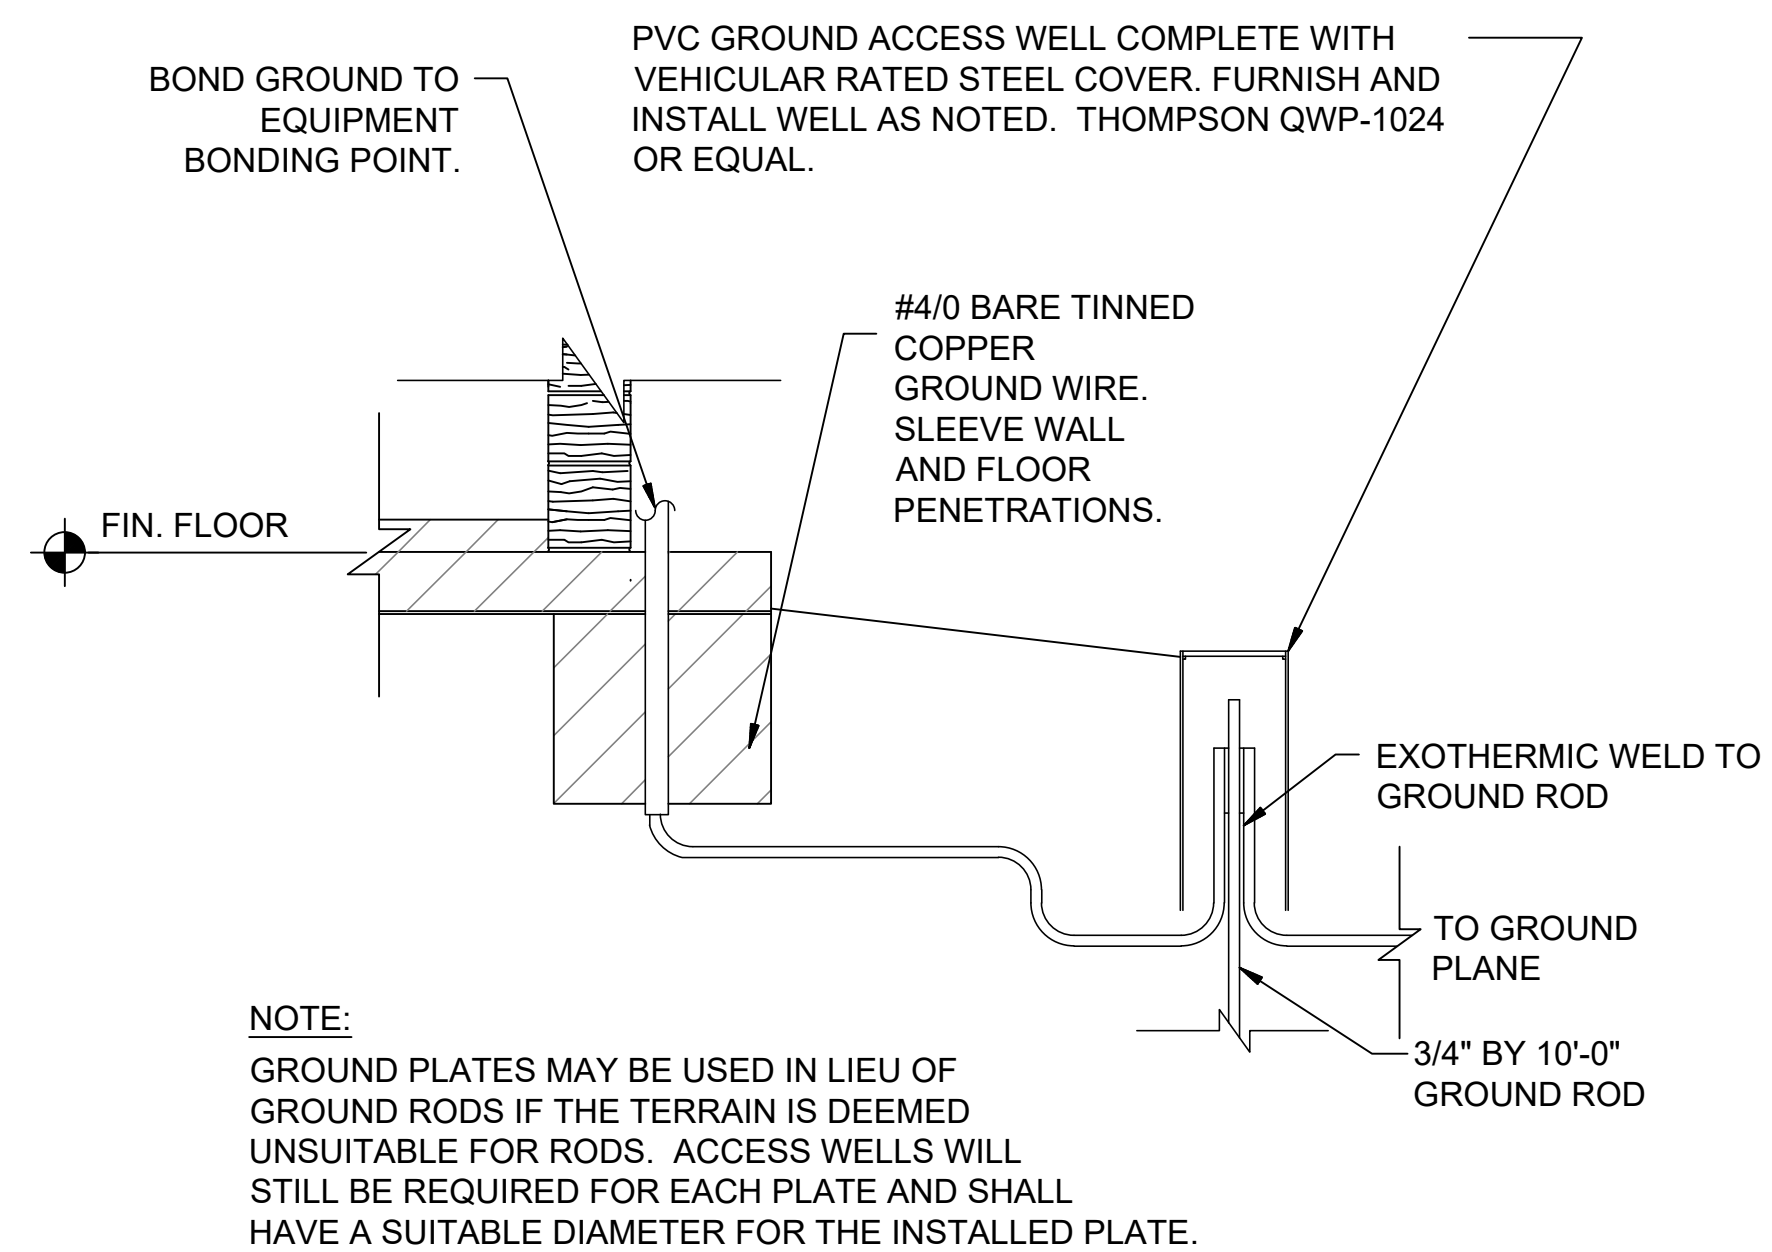

NOTE:  
 GROUND PLATES MAY BE USED IN LIEU OF GROUND RODS IF THE TERRAIN IS DEEMED UNSUITABLE FOR RODS. ACCESS WELLS WILL STILL BE REQUIRED FOR EACH PLATE AND SHALL HAVE A SUITABLE DIAMETER FOR THE INSTALLED PLATE.

3  
E6 GROUND ROD CONNECTION DETAIL  
SCALE: NONE



© 2019 GARVER, LLC  
 THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGNS CONVEYED HEREIN, SHALL BE CONSIDERED INSTRUMENTS OF PROFESSIONAL SERVICE AND ARE PROPERTY OF GARVER, LLC. ANY USE, REPRODUCTION, OR DISTRIBUTION OF THIS DOCUMENT, ALONG WITH THE IDEAS AND DESIGN CONTAINED HEREIN, IS PROHIBITED UNLESS AUTHORIZED IN WRITING BY GARVER, LLC OR EXPLICITLY ALLOWED IN THE GOVERNING PROFESSIONAL SERVICES AGREEMENT FOR THIS WORK.



Digitally Signed 11/18/2019

REV.	DATE	DESCRIPTION	BY



CITY OF WICHITA  
 WICHITA, KANSAS  
 Consolidation of Lift Stations  
 Near 151st St. & W. Kellogg

ELECTRICAL  
 DETAILS II

JOB NO.: 17264967  
 DATE: NOV. 2019  
 DESIGNED BY: SAH  
 DRAWN BY: SAH

BAR IS ONE INCH ON ORIGINAL DRAWING  
 0 1"  
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER  
**E6**  
 SHEET NUMBER **19 OF 36**

File: L:\2017\17264967 - LS 53 Replacement No. 1\Drawings\K\PS-E5, E6, E7, E8.dwg Last Save: 11/16/2019 3:24 PM Last saved by: SAHalexy  
 Last plotted by: Haydock, Joseph C. Plot Style: AECmono.ctb Plot Scale: 1:0.4255 Plot Date: 11/18/2019 3:22 PM Plotter used: DWG To PDF.pc3