


NOTES:

1. PROVIDE OTHER GROUNDING CONNECTIONS AS SPECIFIED IN NEC SECTION 250.50.
2. LABEL EACH GROUNDING ELECTRODE CONDUCTOR AND BONDING JUMPER.
3. WHERE CONDUCTORS ARE ROUTED IN FERROUS CONDUIT, BOND BOTH ENDS OF THE CONDUIT TO THE CONDUCTOR.


1 SYSTEM GROUNDING DETAIL - PANEL
NO SCALE

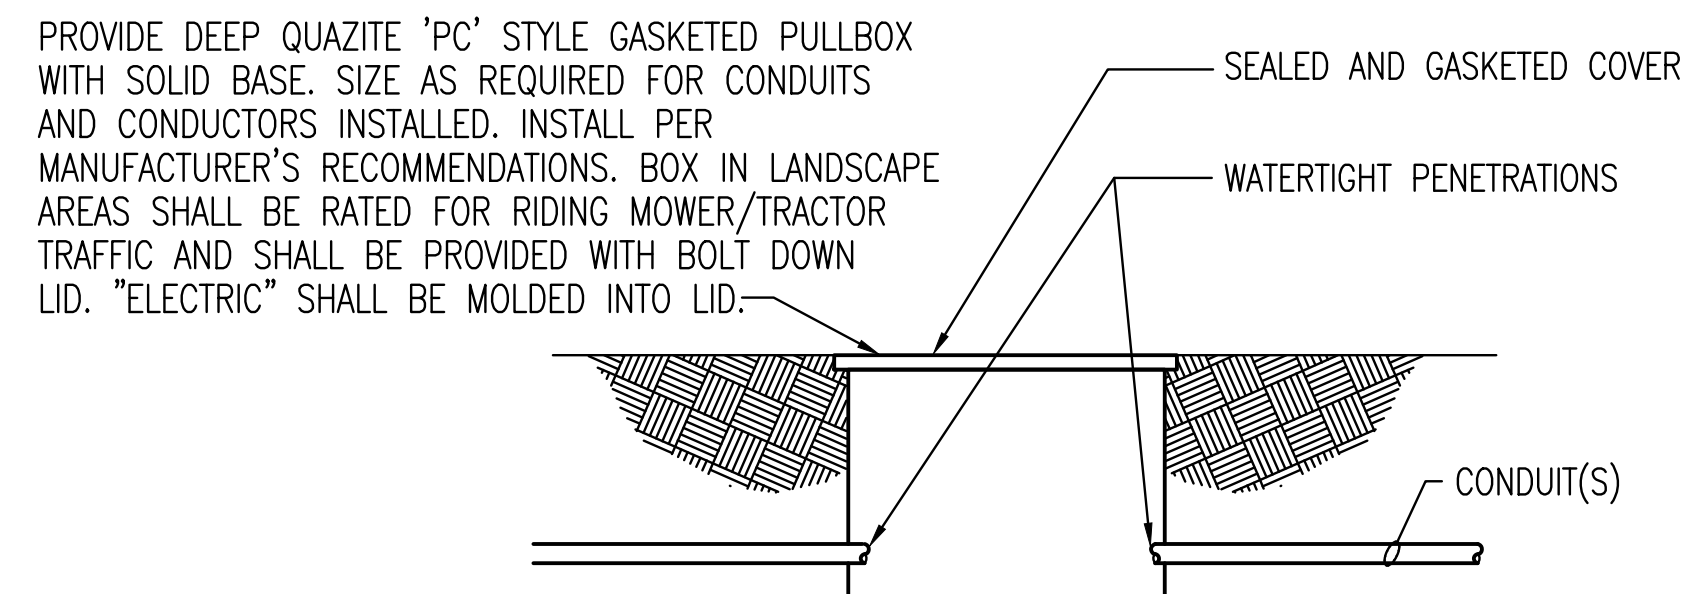

PROVIDE DEEP QUAZITE 'PC' STYLE GASKETED PULLBOX WITH SOLID BASE. SIZE AS REQUIRED FOR CONDUITS AND CONDUCTORS INSTALLED. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. BOX IN LANDSCAPE AREAS SHALL BE RATED FOR RIDING MOWER/TRACTOR TRAFFIC AND SHALL BE PROVIDED WITH BOLT DOWN LID. "ELECTRIC" SHALL BE MOLDED INTO LID.

NOTE: ELECTRICAL CONTRACTOR SHALL PROVIDE A PULLBOX WHERE NECESSARY SO NO RUN OF CONDUIT BETWEEN POLES OR HOMERUNS EXCEED 300'. ALL CONNECTIONS IF REQUIRED IN PULL BOX SHALL BE WATERTIGHT.

2 PULLBOX DETAIL
NO SCALE

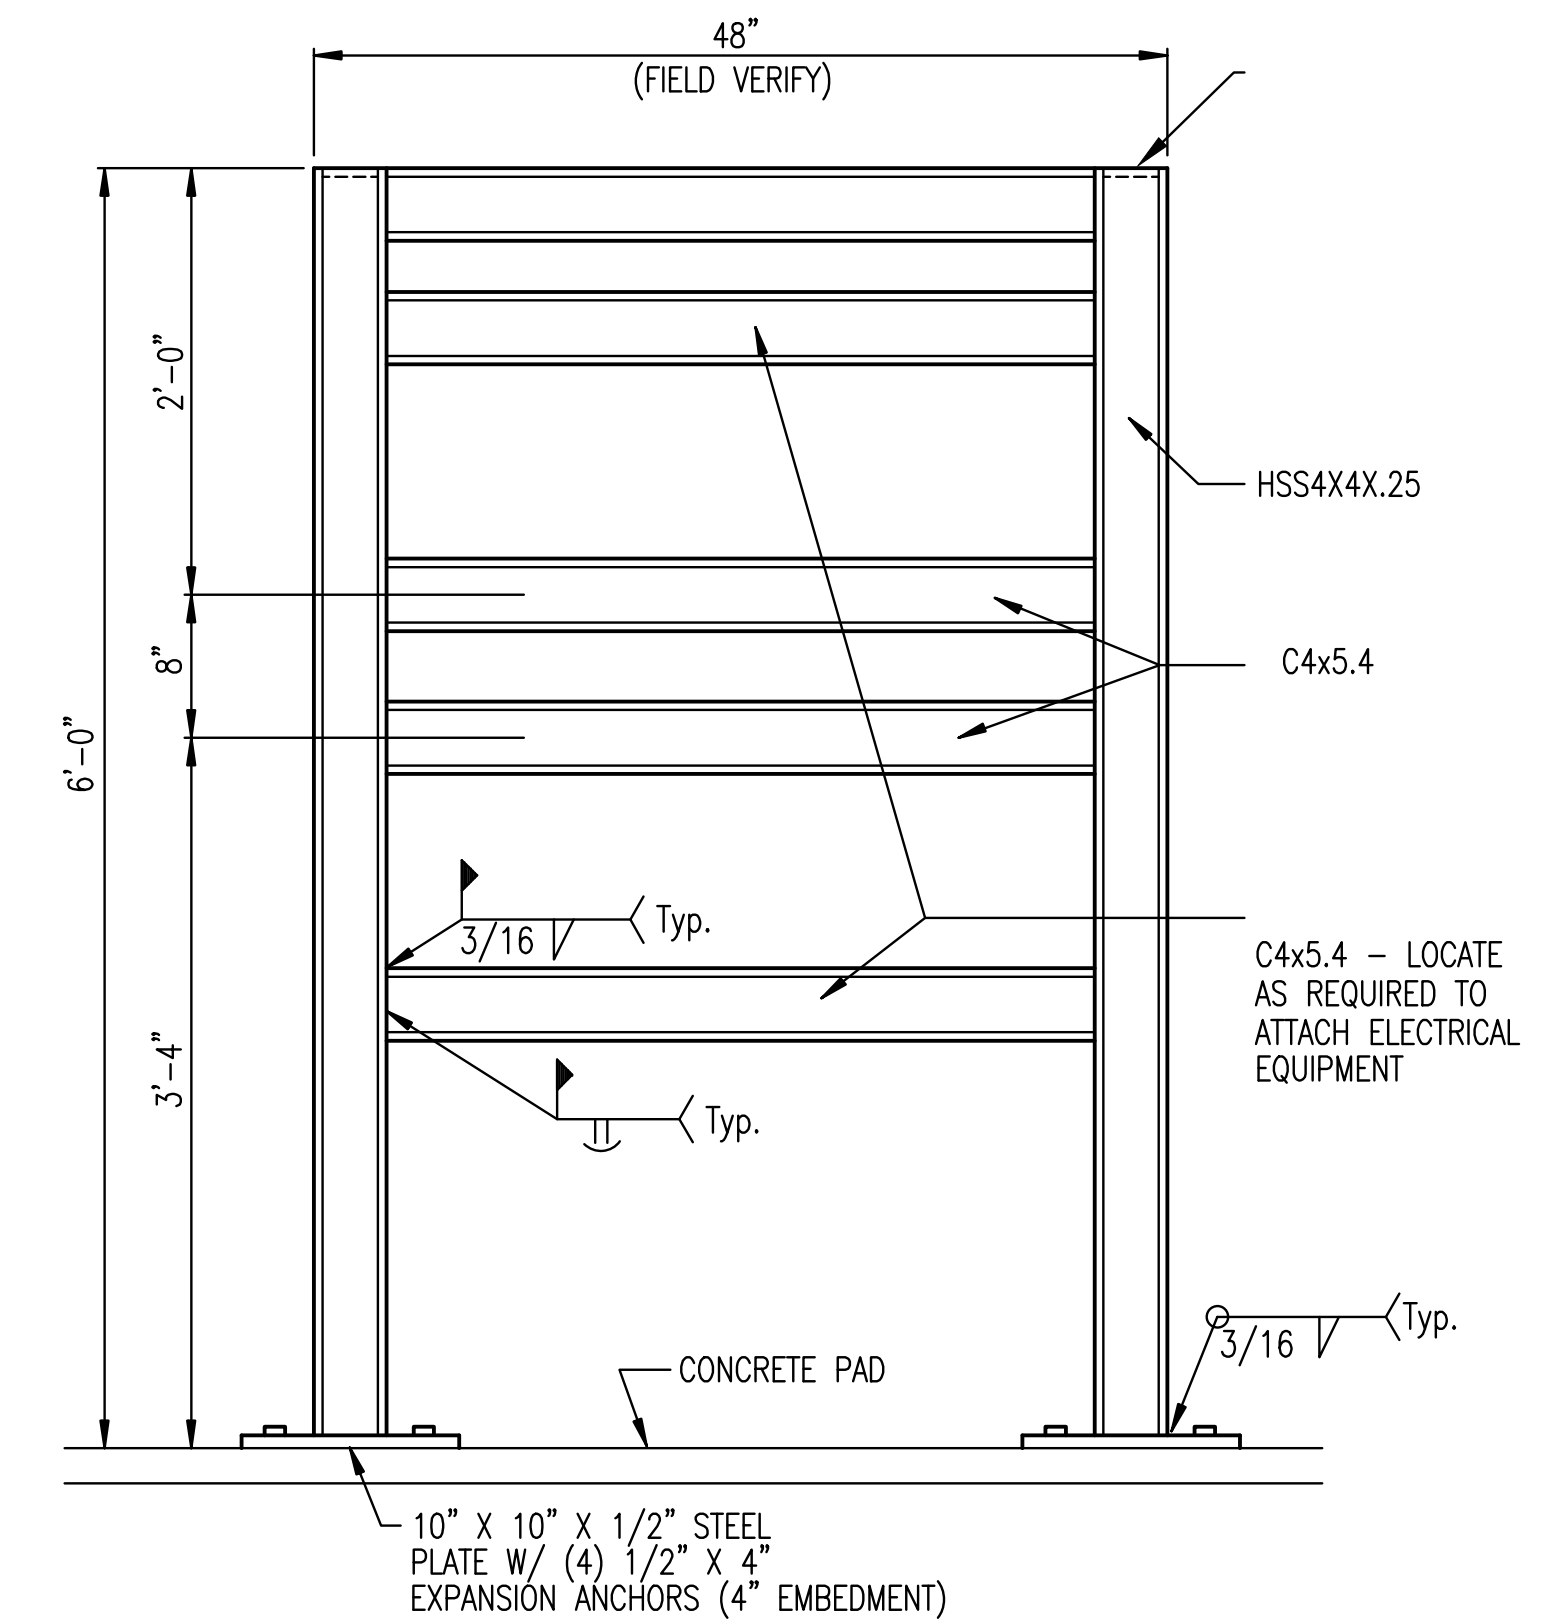

NOTE: 1. FIELD PAINT ENTIRE STEEL FRAME.
2. EXTERIOR LOCATIONS SHALL BE GALVANIZED.

3 ELECTRICAL EQUIPMENT SUPPORT
NO SCALE

PHASE 2
LANDSCAPE IMPROVEMENTS
TO SERVE
TALLGRASS EAST COMMERCIAL 2ND ADDITION

GARY JANZEN, P.E. - CITY ENGINEER
CITY OF WICHITA PROJECT NO. 468-85097

Issue:	

JOB NO.	35-197003-2,3-4319
DATE	MAY 2019
PM	BMM
DESIGNED BY	DCG
DRAWN BY	SPG
CHECKED BY	SVV

ELECTRICAL DETAILS

E101