



DIFFUSER - SURFACE-MOUNTED IN


1 LAY-IN CEILING DETAIL
NO SCALE

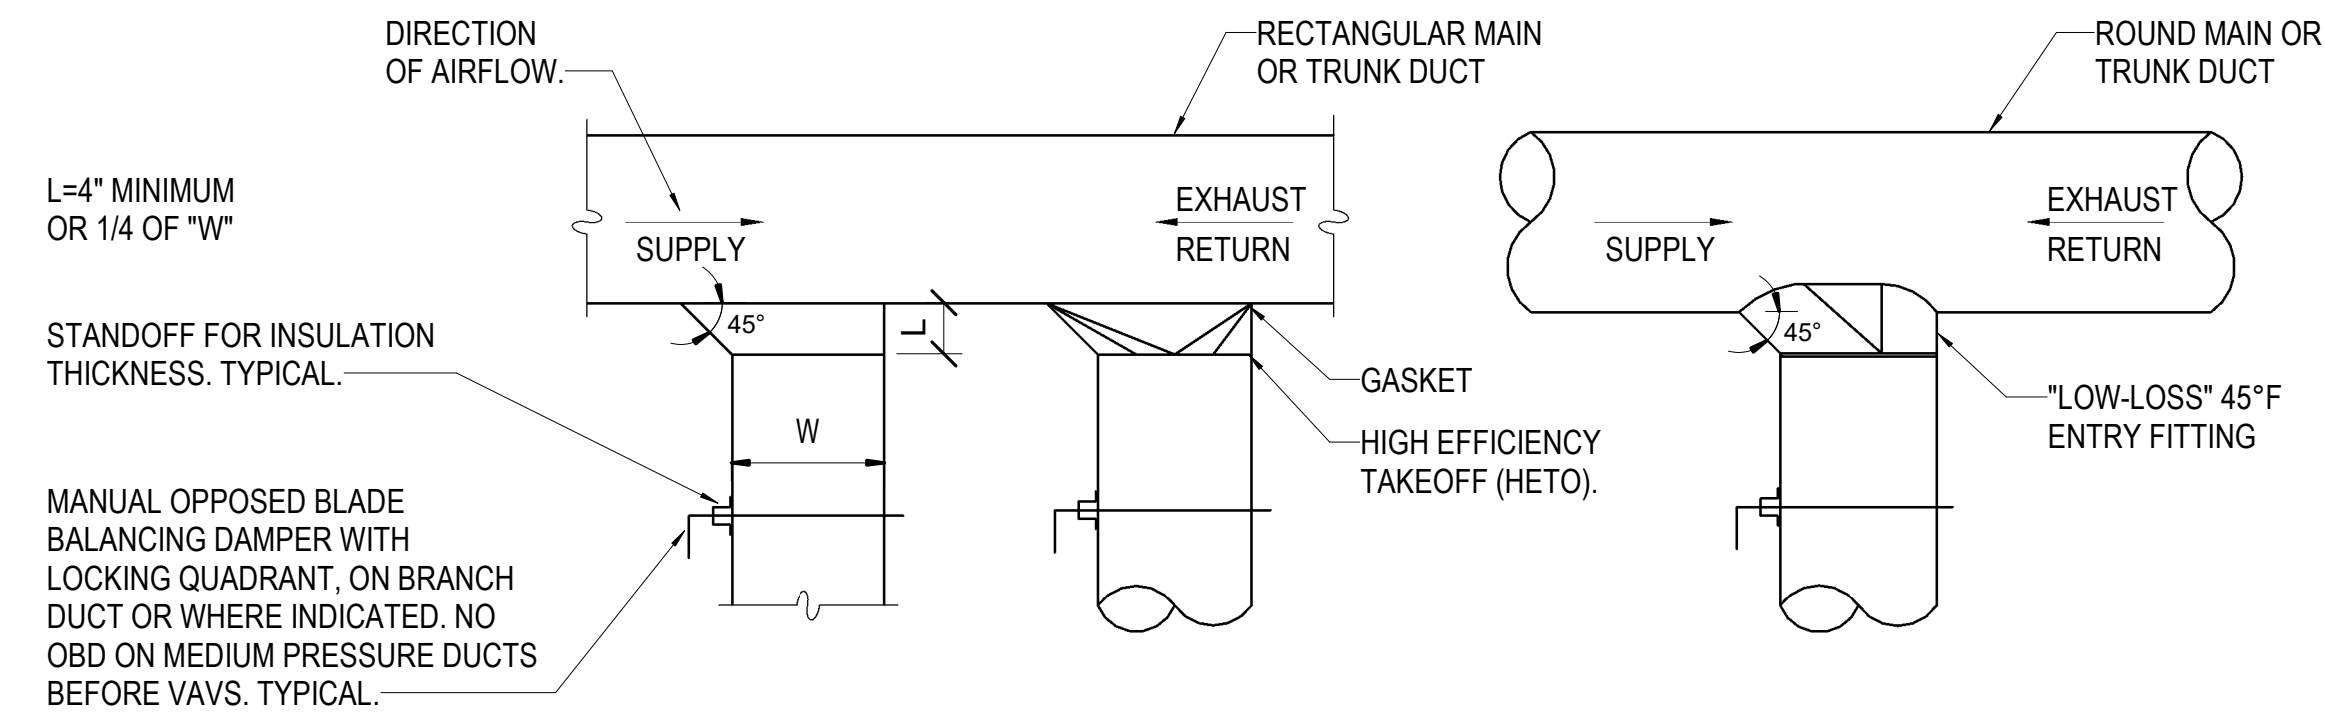


2 DUCT TAKEOFF DETAIL
NO SCALE

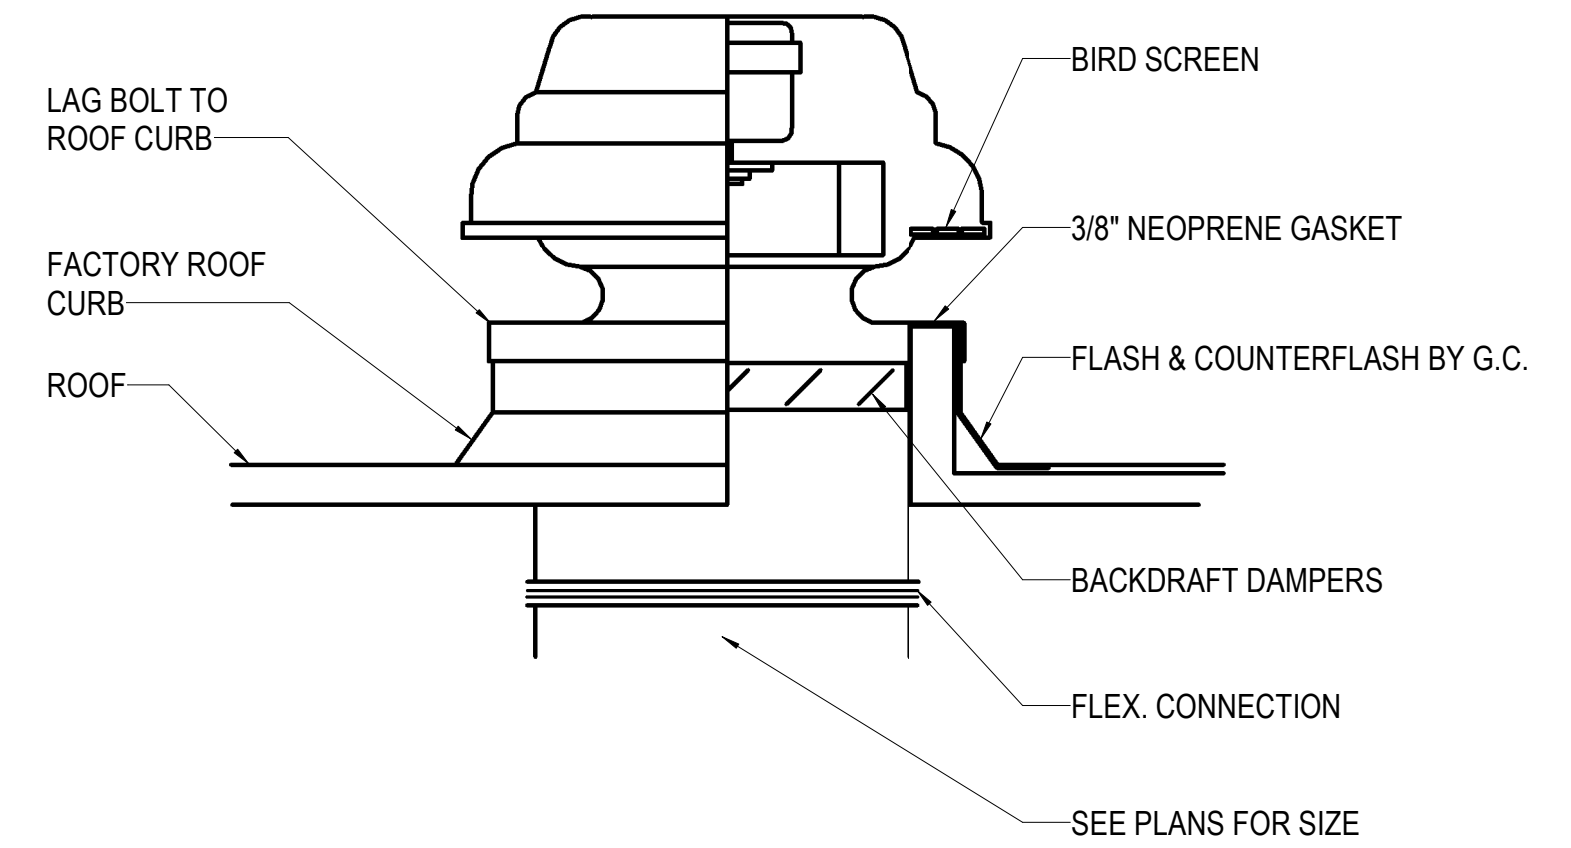


3 EXHAUST FAN DETAIL - ROOF
NO SCALE

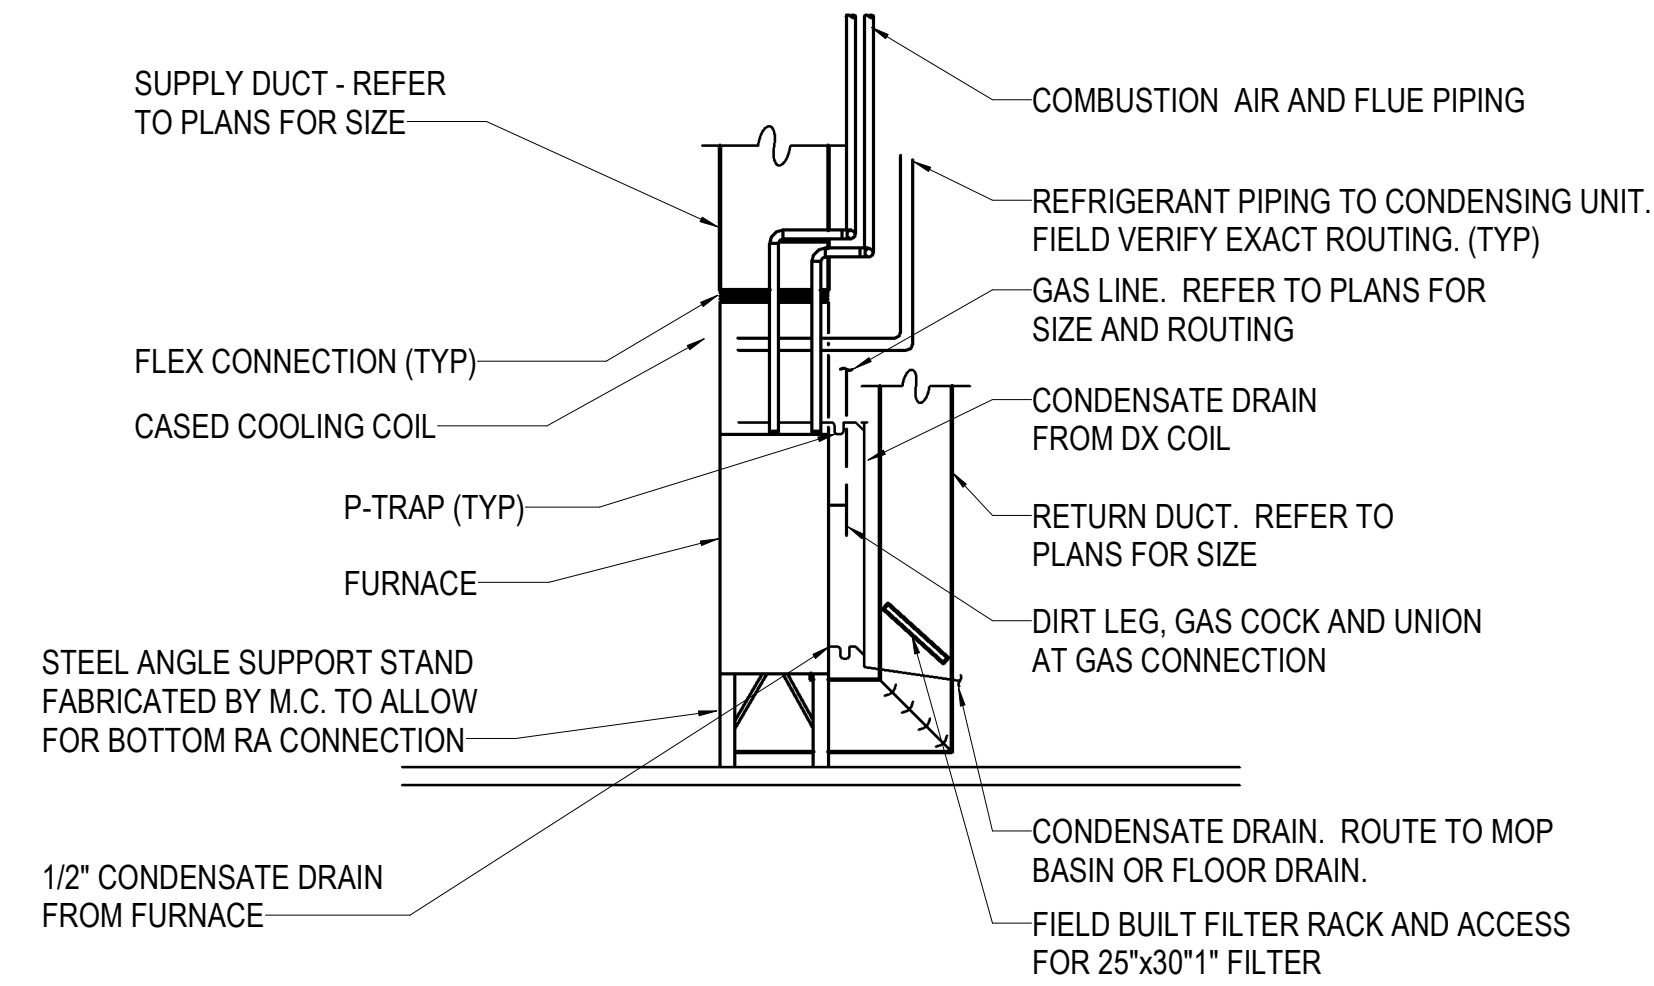


4 FURNACE INSTALLATION DETAIL
NO SCALE

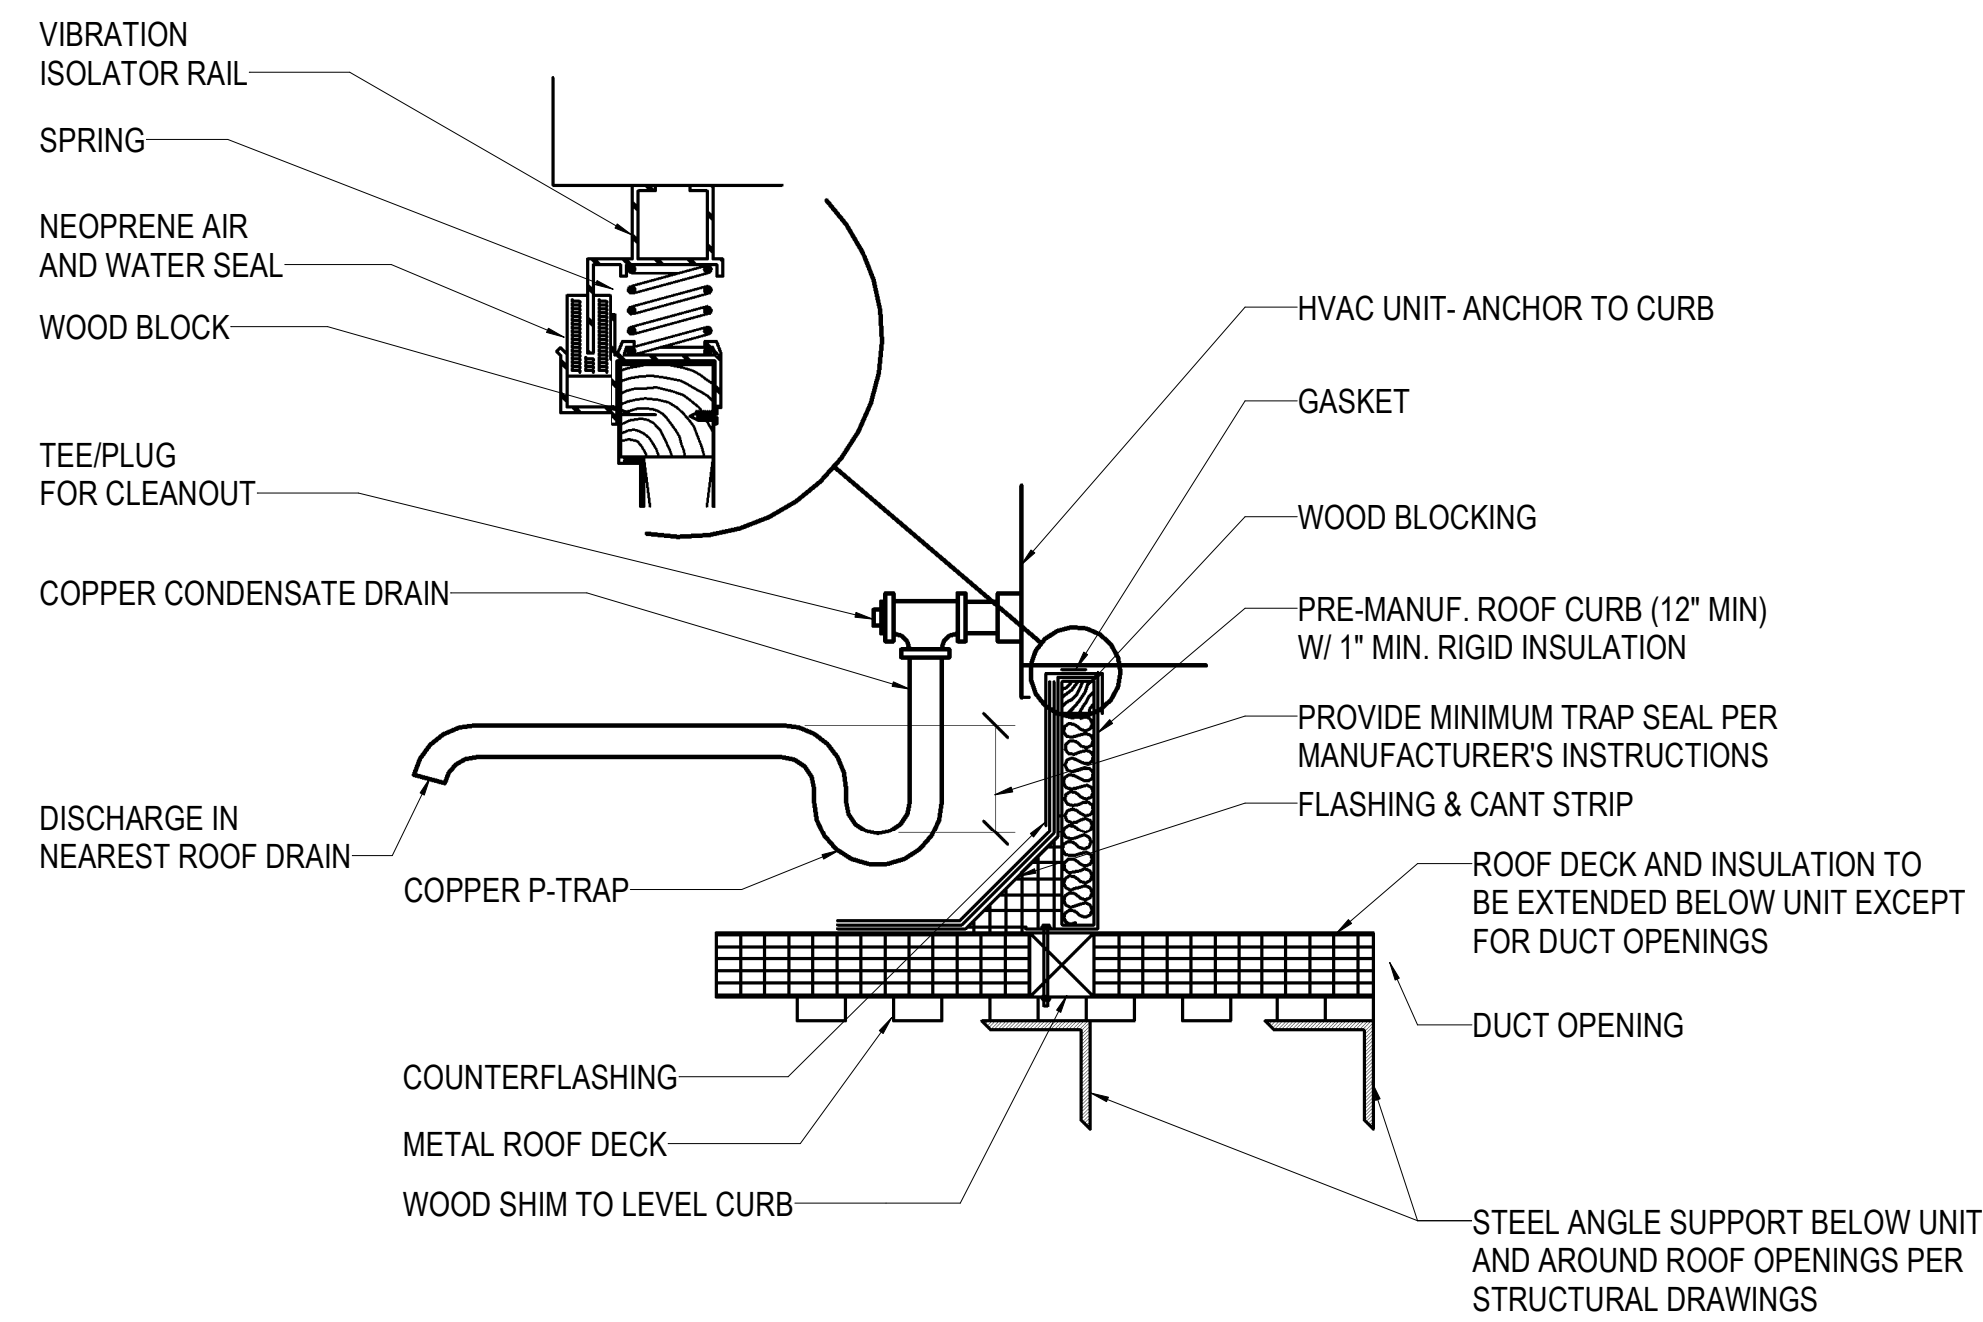


5 ROOF CURB DETAIL
NO SCALE

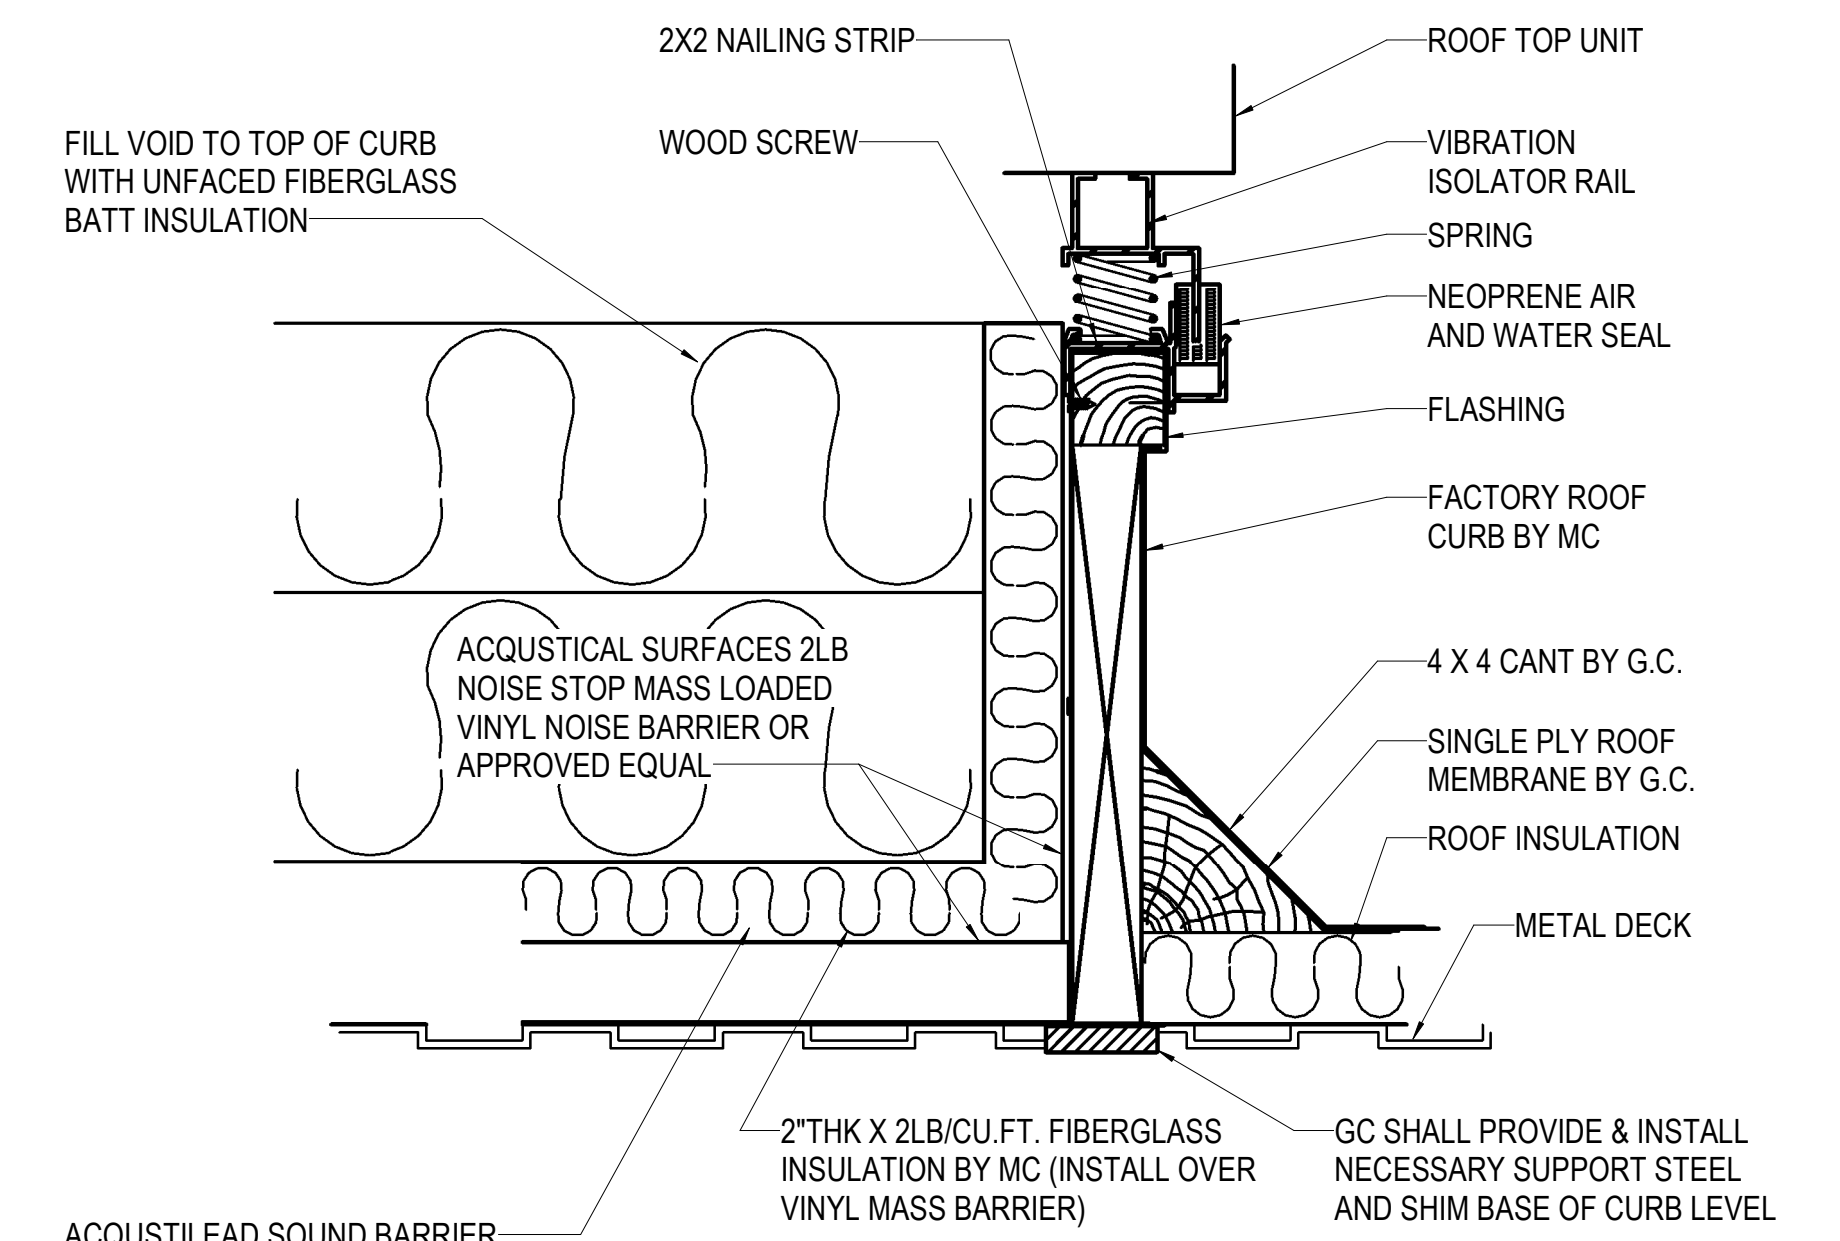

6 ROOF TOP UNIT CURB DETAIL
NO SCALE

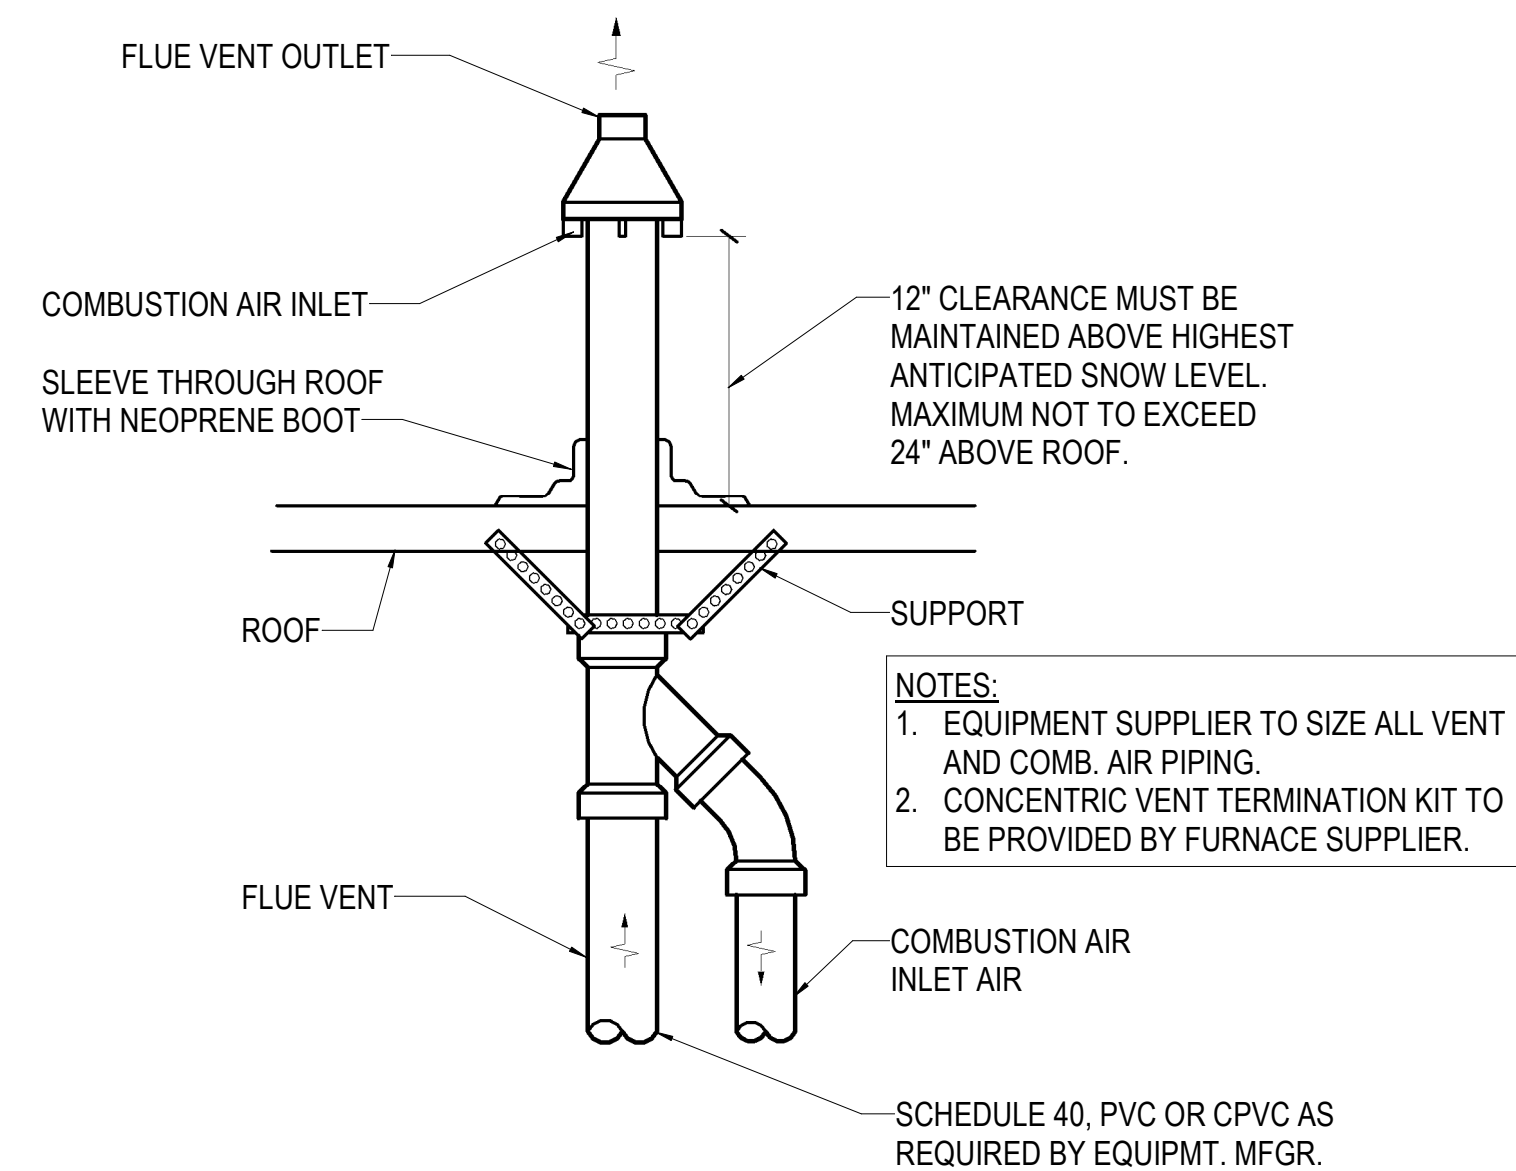

7 CONCENTRIC VENT DETAIL - FLAT ROOF
NO SCALE

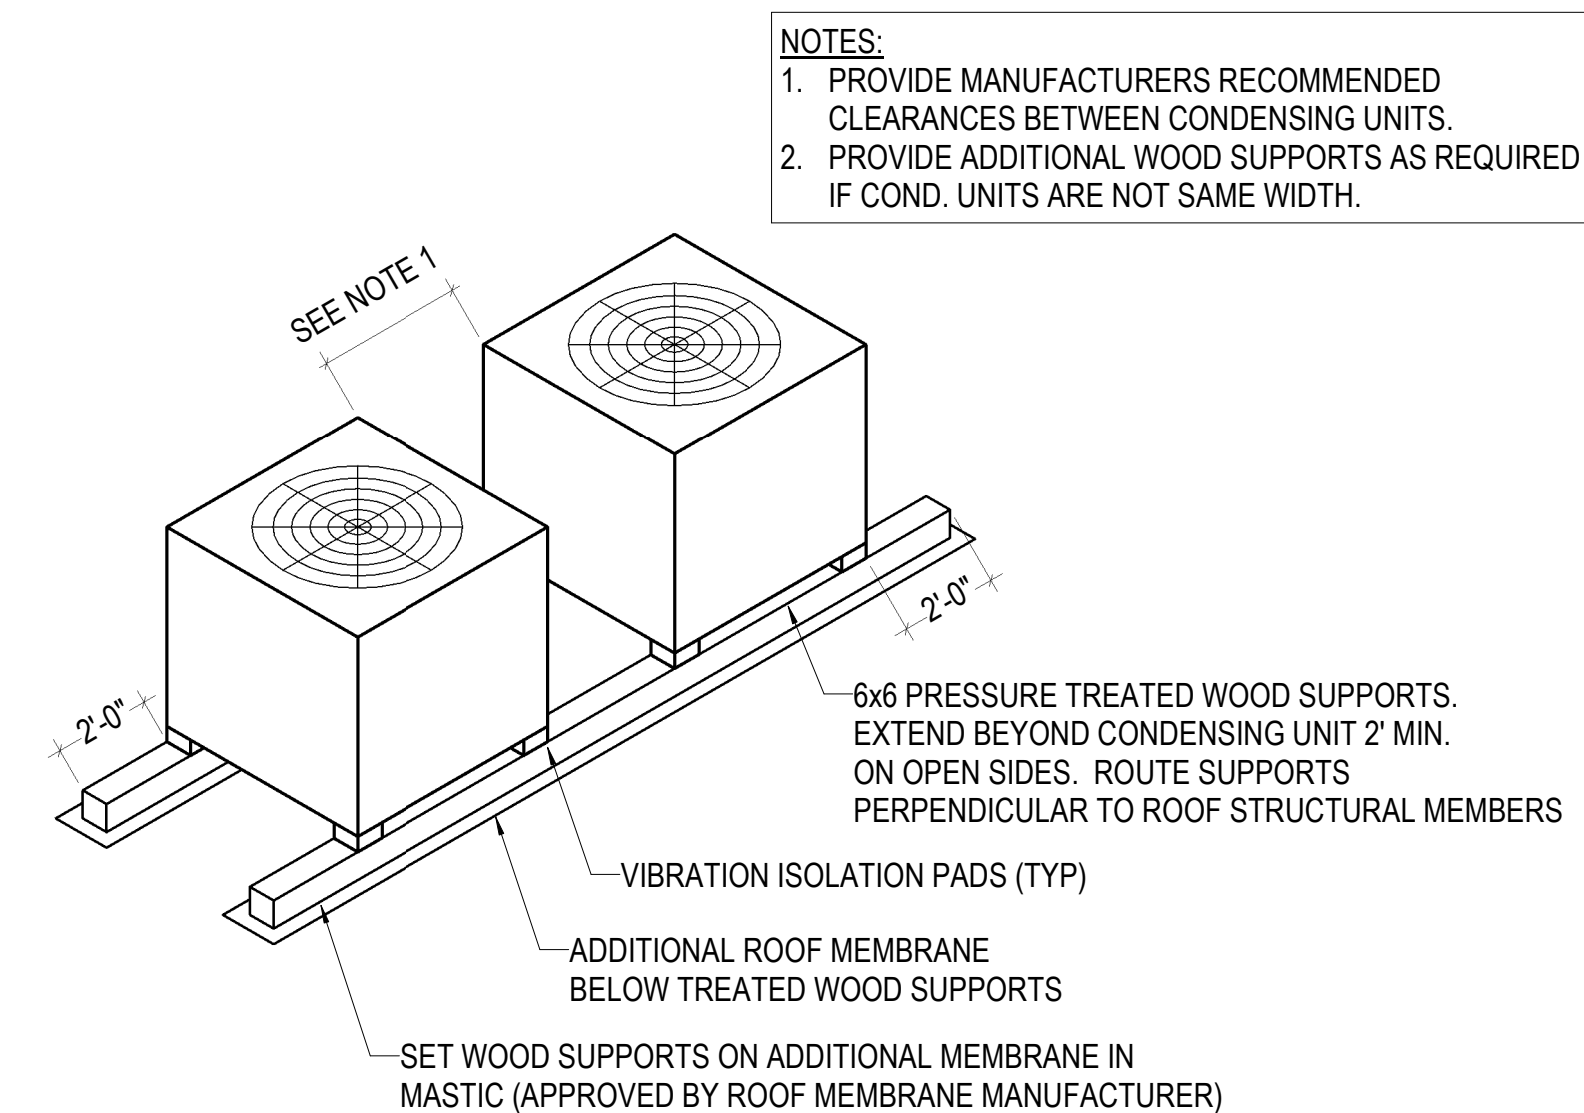

8 CONDENSING UNIT - ROOF MOUNTING
NO SCALE

NOTES:
1. PROVIDE MANUFACTURERS RECOMMENDED CLEARANCES BETWEEN CONDENSING UNITS.
2. PROVIDE ADDITIONAL WOOD SUPPORTS AS REQUIRED IF COND. UNITS ARE NOT SAME WIDTH.

2/13/2020 2:02:04 PM
BIM 360://198014-003 - Watson Park Events Center New Building/198014-003-MASTER MECH-R19.rvt