NOTE: Thrust forces produced in sanitary sewer force mains at changes in direction or size shall be restrained in order to keep the main intact. Thrust restraint may be provided by restrained joints, retainer glands, thrust blocks or tie rods.

NOTE: Contractor to coordinate with City staff to ensure proper shut down procedure and relocation of 4" sanitary force main.

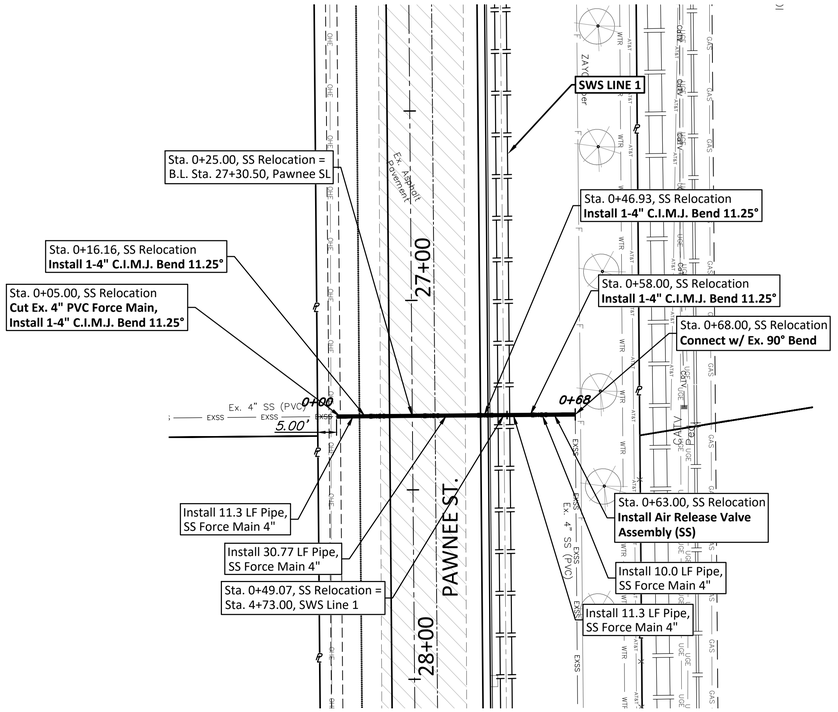



SCALE:
1" = 20' Horizontal
1" = 5' Vertical

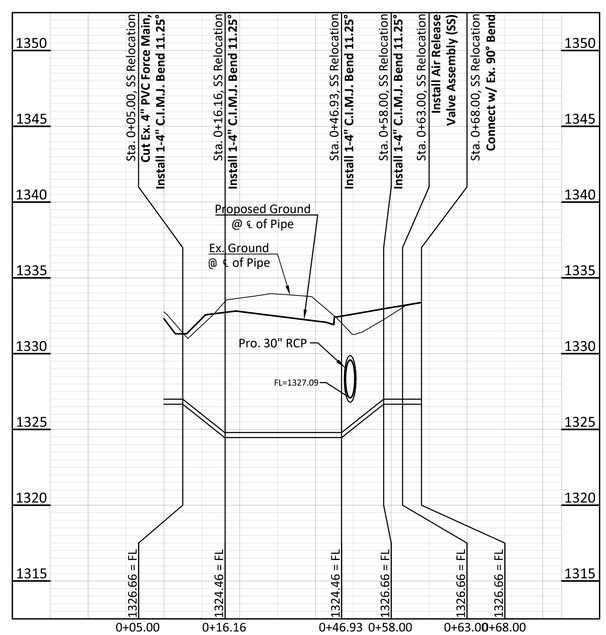

SS RELOCATION

BAUGHMAN COMPANY
315 Ellis St. Wichita, KS 67211 316-262-7271
BaughmanCo.com

PAWNEE PAVING (119TH STREET TO 135TH STREET)
SS FORCE MAIN RELOCATION
CAPITAL IMPROVEMENT PROJECT

PROJECT NUMBER: 472-2019-08556
INTERNAL NUMBER: 19-07-E316
DESIGN: LP
DRAWN: LP
DATE: Feb, 2020

file: L:\PROJECTS\PAVING, 119TH-135TH\19-07-E316\DRAWINGS\BASE.DWG