

TYPICAL SHEET PILING LINED CHANNEL SECTION

*Anchor Systems Not Required in All Locations See Plan Sheets for Locations.

Back Fill

Proposed Channel


Lumber Used for the Permanent Wale Shall be Standard Grade or Better CCA Treated Lumber.

Contractor shall use a Minimum of 16' Lengths of Wale and Shall Stagger the Joints Between Inner and Outer Wale.

Contractor Shall Use Caution when Operating Grading Equipment and Concrete Trucks Near Non-Anchored Sheet Piling to Avoid Damage to the Channel Wall.

Anchor Detail shown is Engineer's suggested method. Contractor may propose alternate wall anchoring method subject to the Engineer's approval. Cost of Anchoring to be INCIDENTAL to Sheet Piling Installation.

ANCHOR DETAIL

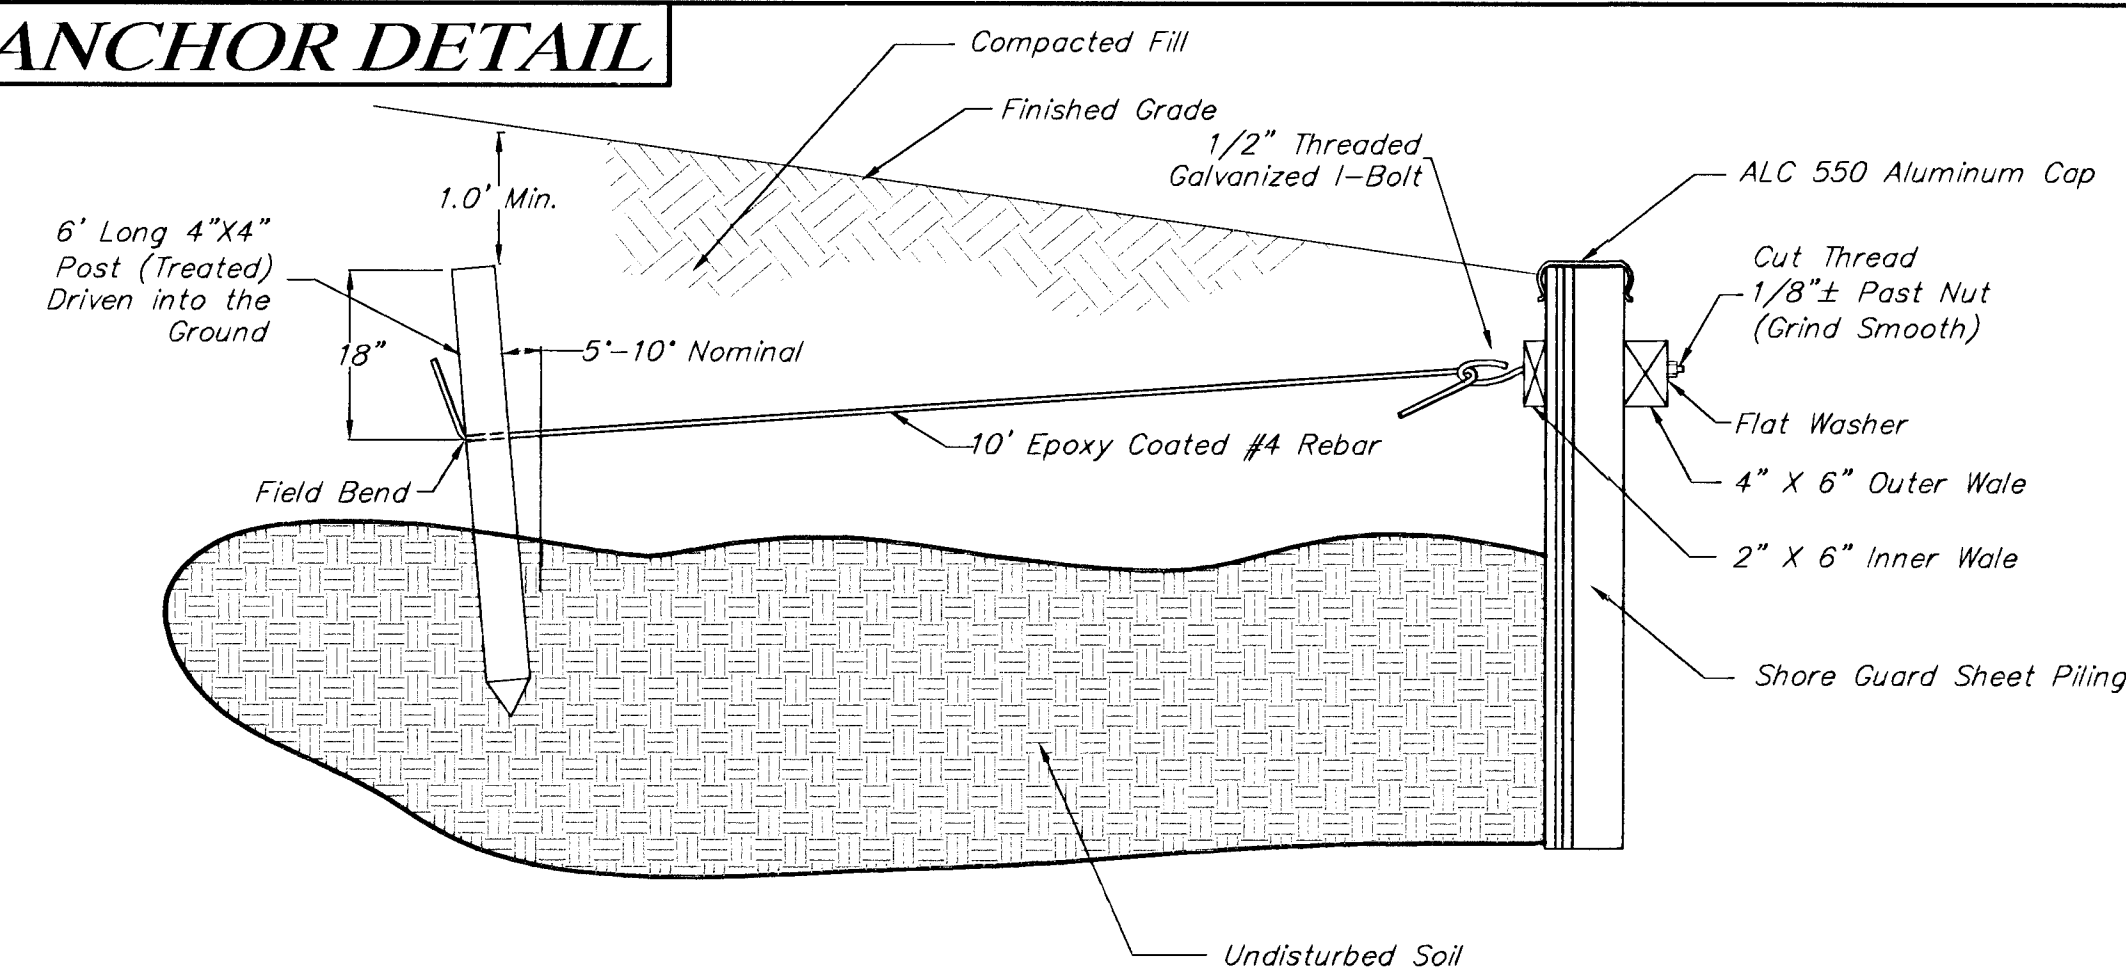

North Sheetpiling Wall - Sta. 21+37.58 to 26+50.00

NOTE: Plan View is Shown Without the Aluminum Cap to Show Detail

SHEET PILING DETAIL (PLAN VIEW)

PROJECT NUMBER 472-76-245-83324		SHEET NAME ChDetail		ENGINEERING DIRECTORY F:\Hydraulic\Pond	
DESIGN TPV/JFB	DRAWN TPV	APPROVED JFB	DATE Sept 2001	SCALE NONE	BAUGHMAN NO 99-09-E453

CAPITAL IMPROVEMENT PROJECT
CHANNEL TYPICAL SECTION and SHEET PILING DETAIL
HYDRAULIC AVENUE PAVING - INCIDENTAL DRAWING PROJECT - PHASE 2

BAUGHMAN COMPANY, P.A.
ENGINEERING, SURVEYING, & PLANNING
316-262-7271 • 315 ELLIS • WICHITA, KANSAS 67211

SHEET
6
OF
47