
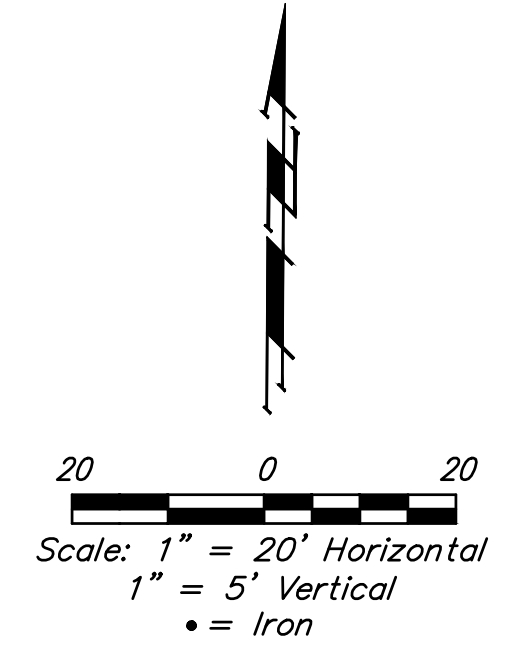



Contractor to maintain a minimum of 2' of vertical separation (O.D.-O.D.) between sanitary sewer and water line.

77-79
 WL Sta. 4+00.00, W1
 BL Sta. 3+72.01, 23.10' Rt.
 Match Point
 N=1,687,513.02 E=1,640,027.66
 73-75

81-83
 KIRKPATRICKS
 ADDITION

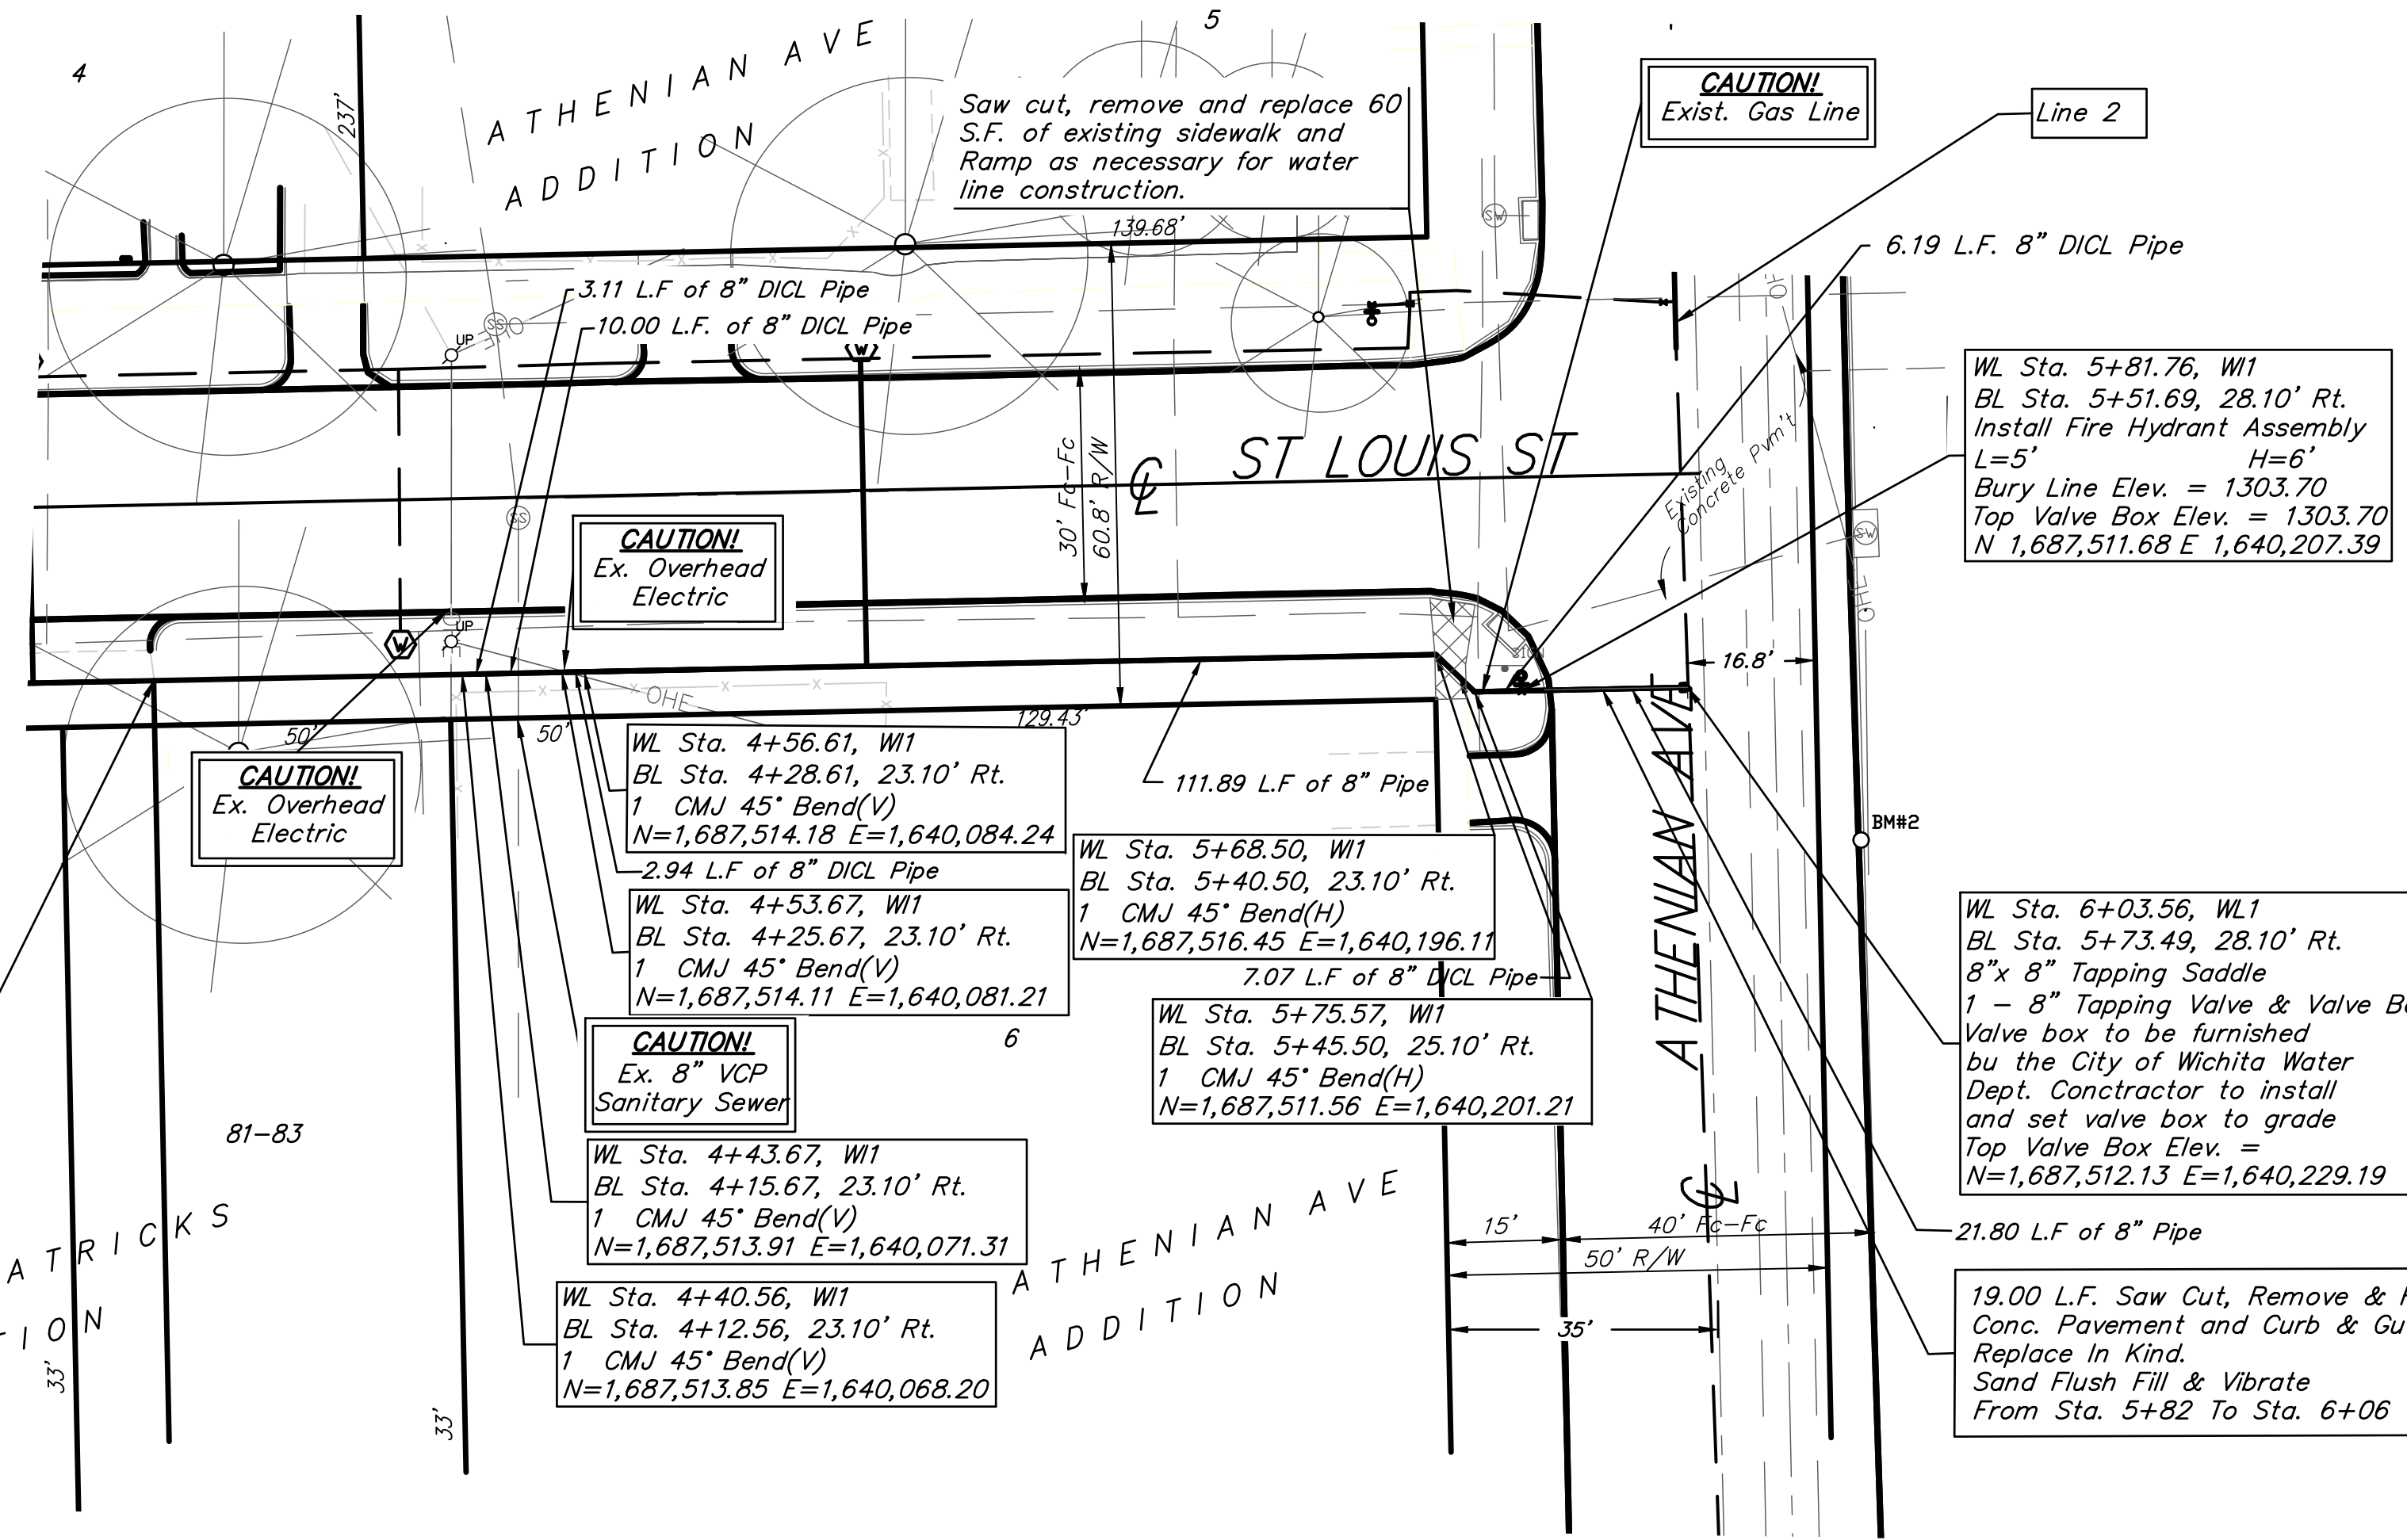

LINE 1

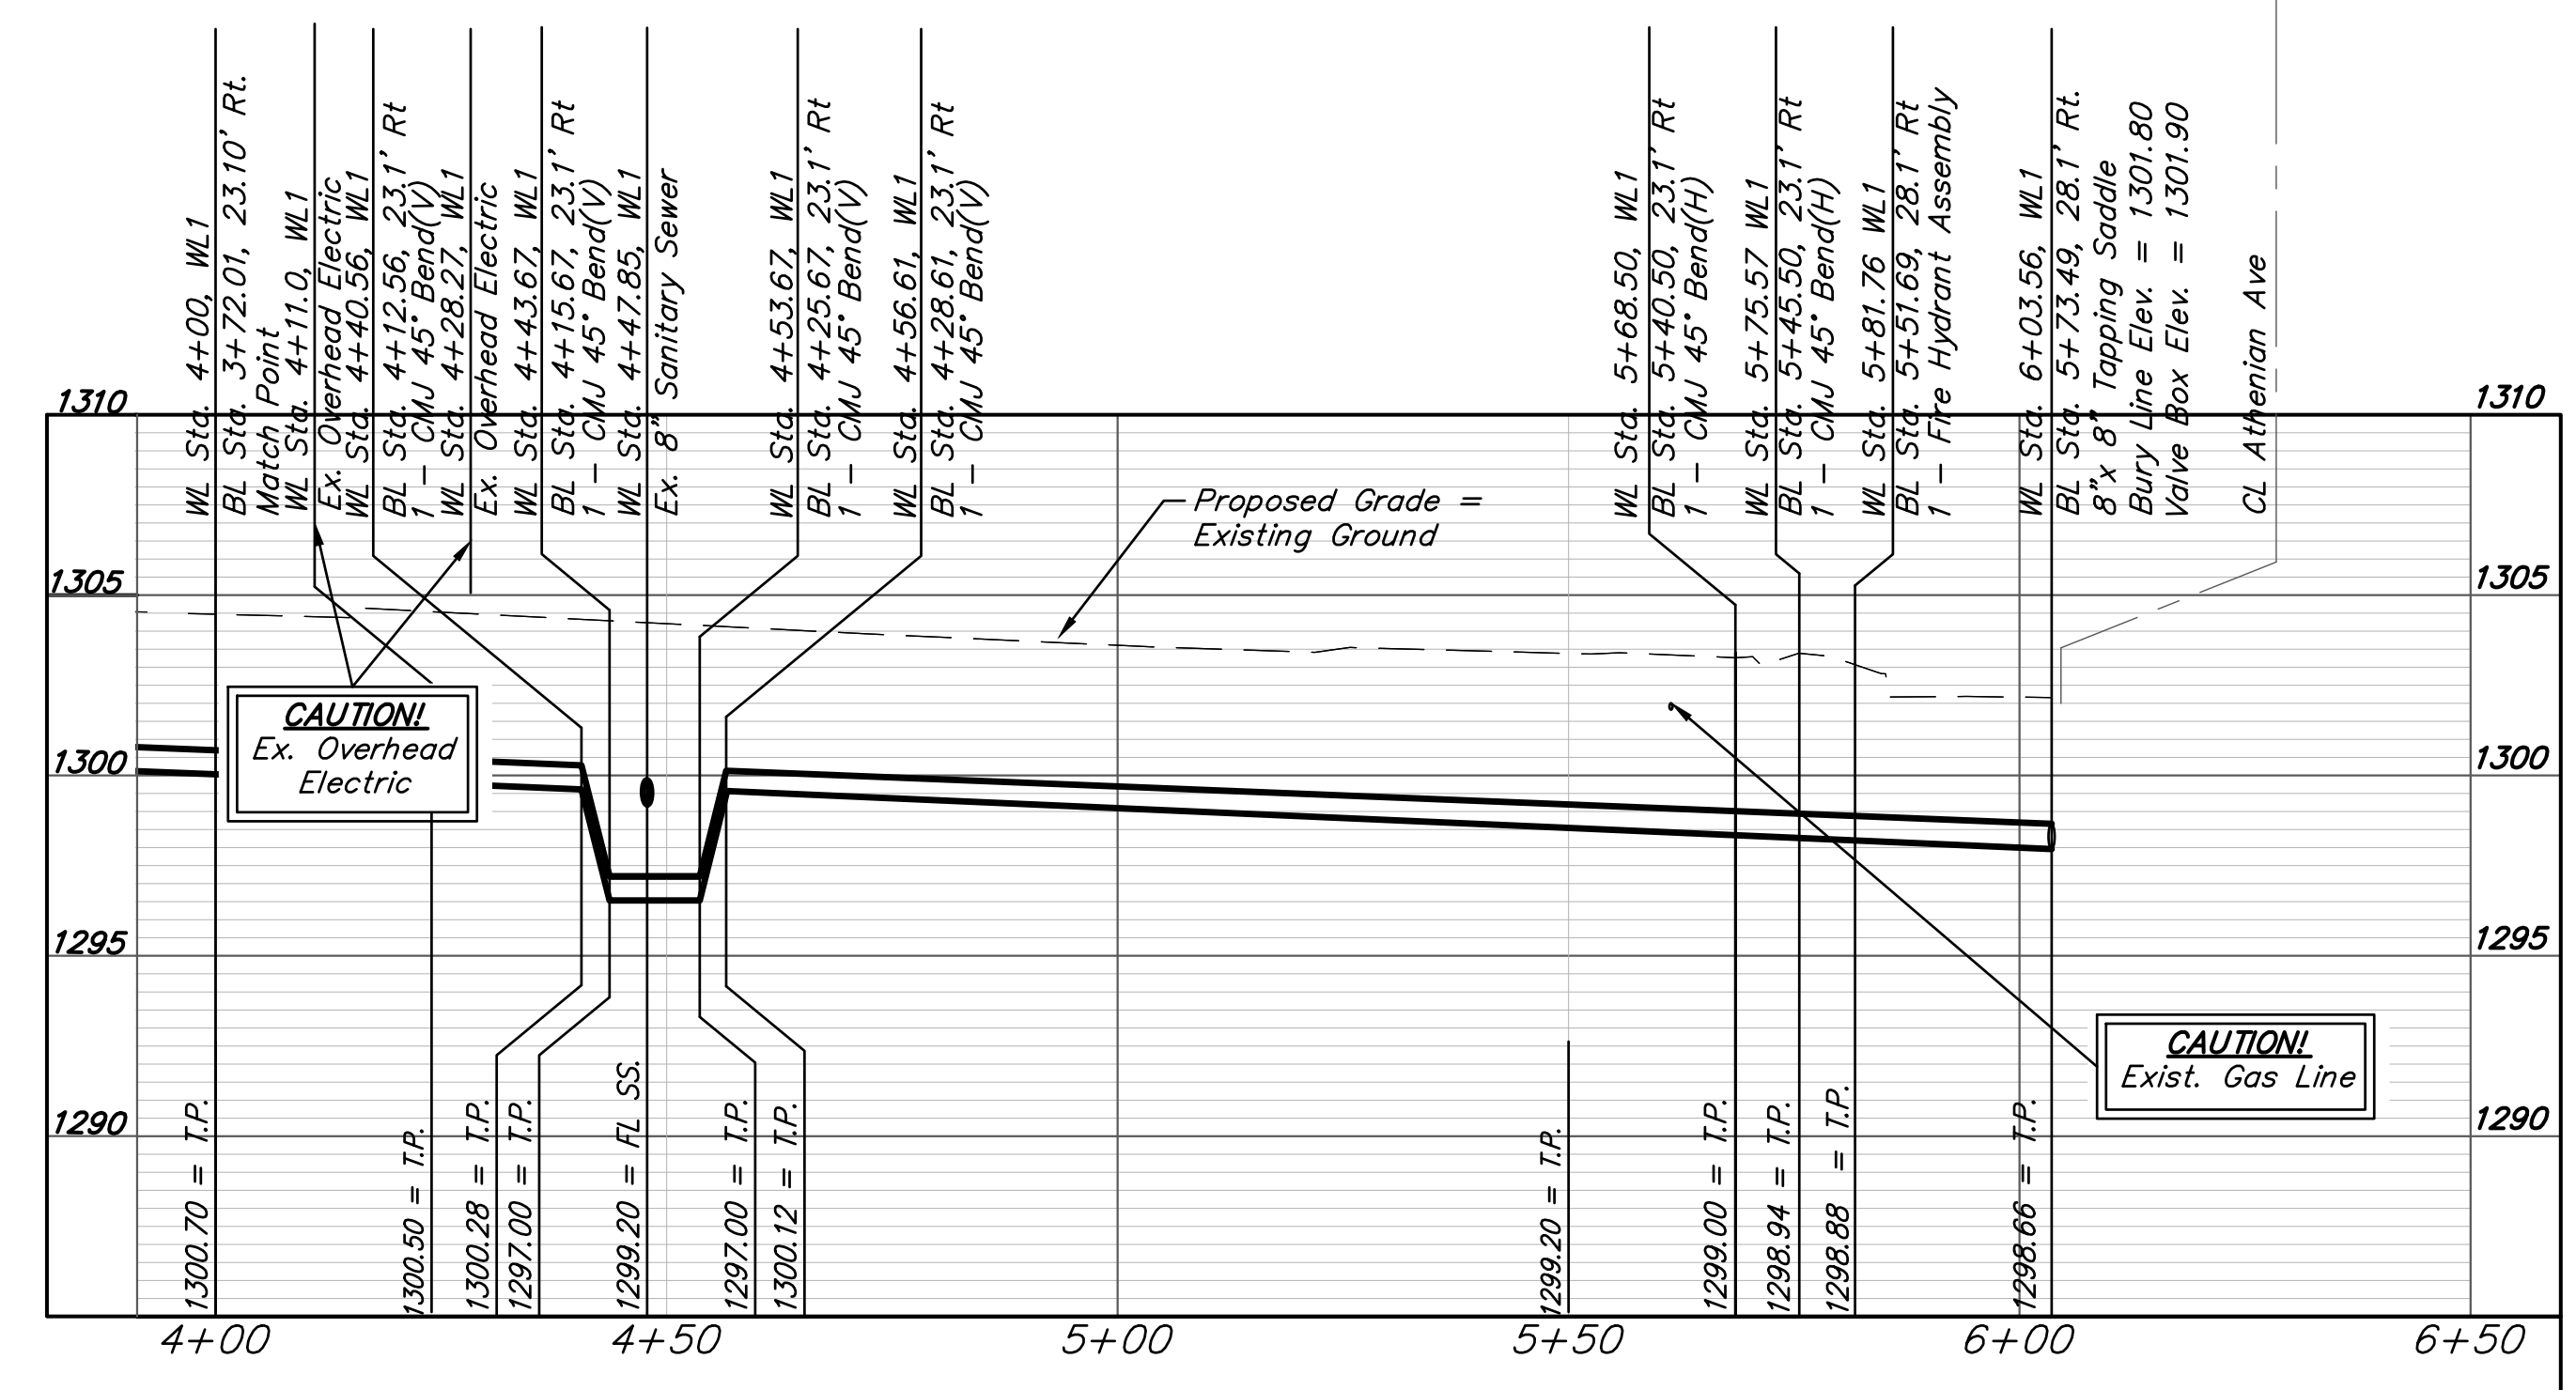

DEPTH UNKNOWN
 Contractor to Verify Depth & Location of Existing Water Line, Including service lines, Prior to Construction.



Baughman Company, P.A.
 ENGINEERING, ARCHITECTURE, PLANNING, INTERIOR DESIGN, LANDSCAPE ARCHITECTURE
 APPROVED: [Signature] DATE: 03/03/21

ATHENIAN AVE ADDITION
LINE 1
 WATER DISTRIBUTION SYSTEM