

**A DEMOLITION FLOOR PLAN**

0' 2' 4' 6' 10'

SCALE: 1/4" = 1'-0"


**DEMOLITION NOTES:**

- DEMOLITION PLANS SHOW THE GENERAL EXTENT OF THE ELECTRICAL DEMOLITION WORK. THE ELECTRICAL CONTRACTOR SHALL DISCONNECT ELECTRICAL SERVICES TO ALL EQUIPMENT BEING REMOVED, SEE MECHANICAL PLANS. OWNER SHALL HAVE THE OPTION TO RETAIN REUSABLE ITEMS, SUCH AS COVERPLATES, RECEPTACLES, LIGHTS, PANELS, ETC. NOT BEING USED IN THE FINISHED WORK. COORDINATE WITH OWNER PRIOR TO STARTING DEMOLITION. PROPERLY AND LEGALLY DISPOSE OF ALL EQUIPMENT AND MATERIALS BEING REMOVED.
- REMOVE ALL CONDUIT LEFT EXPOSED BY REMOVAL OF WALLS AND CEILINGS IN REMODELED AREAS. PLUG BOTH ENDS OF REMAINING CONDUIT IN WALL OR FLOOR WHERE CUT.
- ELECTRICAL OUTLETS, ETC. POSSIBLY CONCEALED BY STORAGE SHELVING, CASEWORK, FURNITURE, ETC. ARE NOT SHOWN AND MAY REQUIRE REMOVAL.
- GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PATCHING ALL OPENINGS IN EXISTING CONSTRUCTION AFTER REMOVAL OF EQUIPMENT, RACEWAY SYSTEMS, OUTLET BOXES, ETC.
- WHERE EQUIPMENT AND OTHER DEVICES ARE BEING REMOVED, THE CIRCUITING SHALL BE REMOVED, IF POSSIBLE, BACK TO POINT OF SUPPLY. WHERE REQUIRED, CIRCUITING SHALL BE EXTENDED TO MAINTAIN CONTINUITY OF THE CIRCUIT OR OPERATION OF THE SYSTEM.
- ALL DEVICES SHOWN DASHED ON THE DEMOLITION PLAN(S) SHALL BE REMOVED, UNLESS NOTED OTHERWISE.
- PROVIDE MATCHING BLANK COVERPLATES WHERE DEVICES ARE BEING REMOVED FROM FLUSH-MOUNTED OUTLET BOXES IN EXISTING WALLS TO REMAIN.
- FIELD VERIFY ALL EXISTING CONDITIONS AND DIMENSIONS PRIOR TO BEGINNING WORK.

**KEYED NOTES:**

- ① FIXTURE TO BE REMOVED. EXISTING BRANCH CIRCUIT AND CONTROLS TO REMAIN TO CONNECT TO PROPOSED FIXTURE.
- ② FIXTURE TO BE REMOVED. EXISTING CONDUIT AND WIRING SERVING FIXTURE TO BE REMOVED BACK TO POINT OF SUPPLY. CONTRACTOR TO ENSURE CONTINUITY OF CIRCUIT SERVING REMAINING FIXTURES IN SPACE.
- ③ EXISTING UH-4 TO BE RELOCATED. REFER TO POWER PLANS FOR PROPOSED LOCATION.
- ④ EXISTING OVERHEAD DOOR DISCONNECT SWITCH AND PUSH-BUTTON CONTROLS TO BE RELOCATED. CONDUIT AND WIRING TO BE EXTENDED AND REWORKED AS NEEDED. REFER TO POWER PLAN FOR PROPOSED LOCATION.
- ⑤ EXISTING RECEPTACLE TO BE RELOCATED, REFER TO POWER PLAN FOR PROPOSED LOCATION.

Saved 02-24-2021 11:00:33 AM by JOSE RAMOS  
 Plot Scale 1:1 03-04-2021 11:36:12 AM by JOSE RAMOS  
 U:\Wichita-Facility\180537\000\Elec\Drawings\ET01 - DEMOLITION FLOOR PLAN

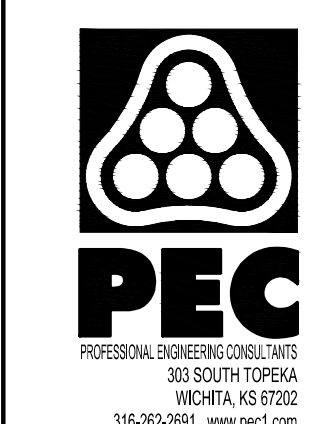

4			
3			
2			
1	CONSTRUCTION DOCUMENTS		03-04-21
No.	Revision	By	Date
CITY OF WICHITA, KANSAS			
DEMOLITION FLOOR PLAN			
STANDBY POWER GENERATION - SOUTHEAST PUMP STATION			
<b>Professional Engineering Consultants, P.A.</b> 303 S. TOPENKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	DCG	Job No.	180537-000
Drawn by	JAR	Checked by	DCG
Date	MARCH 2021	Dwg No.	E101