

SILT FENCE MATERIAL SPECIFICATIONS

GRAB TENSILE STRENGTH	100 LBS. MIN. (ASTM D4632)
MULLEN BURST STRENGTH	300 PSI MIN (ASTM D3786)
TRAPEZOID TEAR STRENGTH	60 LBS. MIN. (ASTM D4533)
WATER FLOW RATE	20 GAL/MIN/SQ.FT MIN. (ASTM D4491)
UV STABILITY	70% MIN. (ASTM D4355)

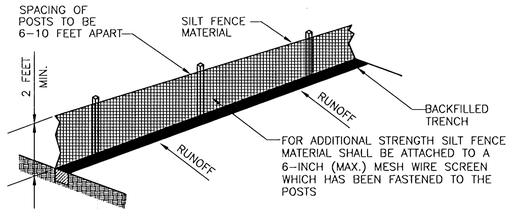

ATTACHING TWO SILT FENCES

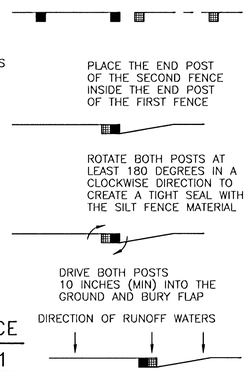

SILT FENCE
DETAIL 1

SILT FENCE INSTALLATION

SILT FENCES CAN MINIMIZE SEDIMENT FROM ENTERING STREAMS AND OTHER WATER BODIES. IN ADDITION, THEY SHOULD BE INSTALLED WHERE SEDIMENT FROM SHEET FLOW OR RILL AND GULLY EROSION WILL ENTER DIRECTLY ONTO ADJACENT LANDS.


WHEN USED TO CONTROL SEDIMENT FROM STEEP SLOPES, FILTER FENCES SHOULD BE PLACED AWAY FROM THE TOE OF A SLOPE FOR INCREASED HOLDING CAPACITY.

WHEN INSTALLING, IT IS IMPORTANT THE FABRIC MATERIAL BE ANCHORED INTO A TRENCH AND BACK FILLED.

ATTACHING TWO FILTER FENCES TOGETHER SHOULD BE COMPLETED IN A MANNER ILLUSTRATED IN DETAIL #1. BY WRAPPING THE MATERIAL AS ILLUSTRATED, A TIGHT FIT OF MATERIAL IS CREATED AND THE STRUCTURAL STABILITY OF THE FENCE MAINTAINED.

MAINTENANCE OF SILT FENCES REQUIRES THAT THE FABRIC MUST BE INSPECTED AND NEEDED REPAIRS IMPLEMENTED AFTER EVERY STORM EVENT. SEDIMENT DEPOSITS SHOULD BE REMOVED WHEN MATERIAL REACHES A DEPTH OF ONE–HALF THE FENCE HEIGHT.

WHEN THE CONTRIBUTION DRAINAGE AREA HAS BEEN ADEQUATELY STABILIZED, REMOVE ALL MATERIALS AND ANY UNSTABLE SOIL AND EITHER SALVAGE OR DISPOSE OF PROPERLY. BRING ALL DISTURBED AREAS TO PROPER GRADE, SMOOTH AND COMPACT. APPROPRIATELY STABILIZE ALL DISTURBED AREAS AROUND INLET.

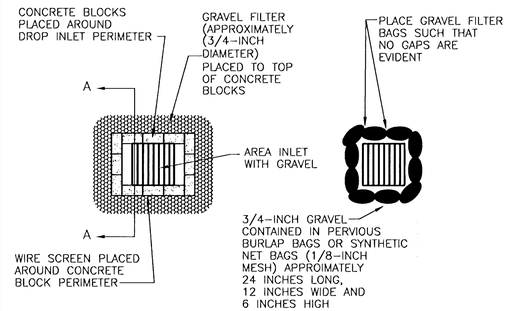

CROSS–SECTION AA | SIDE VIEW

CONCRETE BLOCK FILTER | GRAVEL FILTER BAGS

ALTERNATES FOR STRAW BALES

NOTE: GRAVEL FILTERS MAY BE USED ON PAVEMENT OR BARE GROUND

GRAVEL FILTER FOR AREA/DROP INLET
DETAIL 2

GRAVEL FILTERS FOR AREA INLETS

ALL STORM DRAINAGE SYSTEM INLETS SHOULD HAVE FILTERS INSTALLED TO TREAT RUNOFF BEFORE WATER IS DISCHARGED INTO A STREAM.


GRAVEL FILTERS WILL BE CONSTRUCTED WITH A COMBINATION OF CONCRETE BLOCKS, 1/2–INCH WIRE SCREEN AND COARSE (APPROX. 3/4–INCH DIAMETER) GRAVEL. USE OF GRAVEL SMALLER THAN 3/4–INCHES MAY RESULT IN CLOGGING OF PORES AND REDUCE THE AMOUNT OF WATER FLOWING INTO AN INLET.

GRAVEL FILTERS CAN BE USED IF THE IMMEDIATE AND ADJACENT AREA TO THE DRAIN CONSISTS OF SOIL OR PAVEMENT.

LAY ONE BLOCK ON EACH SIDE OF THE DRAINAGE STRUCTURE ON ITS SIDE IN THE BOTTOM ROW TO ALLOW FOR POOL DRAINAGE. THE FOUNDATION SHOULD BE EXCAVATED AT LEAST 2 INCHES BELOW THE REST OF THE STORM DRAIN. PLACE THE BOTTOM ROW OF BLOCKS AGAINST THE EDGE OF STORM DRAIN FOR LATERAL SUPPORT AND TO AVOID WASHOUTS WHEN OVERFLOW OCCURS. PROVIDE ADDITIONAL SUPPORT BY PLACING 2"X4"X36" WOOD STAKES THROUGH BLOCK OPENINGS. CAREFULLY FIT WIRE MESH OVER ALL BLOCK OPENINGS TO RETAIN GRAVEL. USE CLEAN GRAVEL, 3/4" TO 1/2" IN DIAMETER, PLACED 2 INCHES BELOW TOP OF BLOCKS ON A 2:1 SLOPE OR FLATTER AND SMOOTH TO EVEN GRADE.

ALL GRAVEL FILTERS INSTALLED AROUND AREA DRAINS SHOULD BE INSPECTED AND REPAIRED AFTER EACH RUNOFF EVENT. SEDIMENT SHOULD BE REMOVED WHEN MATERIAL IS WITHIN TWO INCHES OF THE TOP OF THE FILTER. PERIODICALLY, THE GRAVEL SHOULD BE RAKED TO INCREASE INFILTRATION AND FILTERING OF RUNOFF WATER.

SEDIMENT SHOULD BE REMOVED IMMEDIATELY FROM ANY TRAVELED WAY OF ROADS AND STREETS.

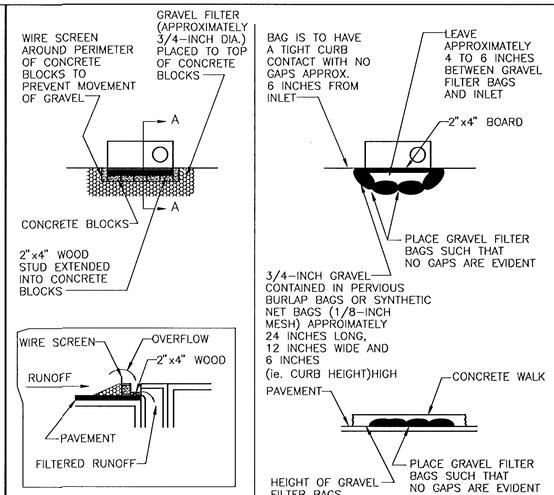

CROSS–SECTION AA | FRONT VIEW

CONCRETE BLOCK FILTER | GRAVEL FILTER BAGS

ALTERNATES FOR STRAW BALES

NOTE: GRAVEL FILTERS MAY BE USED ON PAVEMENT OR BARE GROUND

CURB INLET GRAVEL FILTER
DETAIL 3

CURB INLET GRAVEL FILTERS

ALL STORM DRAINAGE SYSTEM INLETS SHOULD HAVE FILTERS INSTALLED TO TREAT RUNOFF BEFORE WATER IS DISCHARGED INTO A STREAM.

CURB INLET GRAVEL FILTERS WILL BE CONSTRUCTED WITH A COMBINATION OF CONCRETE BLOCKS, 1/2–INCH WIRE SCREEN, COARSE (APPROX. 3/4–INCH DIAMETER) GRAVEL AND A 2"x4" WOOD BOARD FOR SUPPORT. USE OF GRAVEL SMALLER THAN 3/4 INCHES MAY RESULT IN CLOGGING OF PORES AND REDUCE THE AMOUNT OF WATER FLOWING INTO AN INLET.


GRAVEL FILTERS CAN BE USED IF THE IMMEDIATE AND ADJACENT AREA TO THE DRAIN CONSISTS OF SOIL OR PAVEMENT.

LAY BLOCKS ON THEIR SIDE TO ALLOW FOR POOL DRAINAGE. PLACE END BLOCKS AGAINST INLET STRUCTURE FOR LATERAL SUPPORT. PLACE 2"X4" WOOD STUD THROUGH END BLOCK'S OPENING TO PROVIDE SUPPORT FOR REMAINING BLOCKS. CAREFULLY FIT WIRE MESH OVER ALL BLOCK OPENINGS TO RETAIN GRAVEL. USE CLEAN GRAVE, 3/4: TO 1/2" IN DIAMETER. PLACED 2 INCHES BELOW TOP OF BLOCKS ON A 2:1 SLOPE OR FLATTER AND SMOOTH EVEN GRADE.


ALL CURB INLET GRAVEL FILTERS SHOULD BE INSPECTED AND REPAIRED AFTER EACH RUNOFF EVENT, SEDIMENT SHOULD BE REMOVED WHEN MATERIAL IS WITHIN TWO INCHES OF THE TOP OF THE FILTER. PERIODICALLY, THE GRAVEL SHOULD BE RAKED TO INCREASE INFILTRATION AND FILTERING OF RUNOFF WATERS.

SEDIMENT SHOULD BE REMOVED IMMEDIATELY FROM ANY TRAVELED WAY OF ROADS AND STREETS.


WHEN THE CONTRIBUTION DRAINAGE AREA HAS BEEN ADEQUATELY STABILIZED, REMOVE ALL MATERIALS AND ANY UNSTABLE SOIL AND EITHER SALVAGE OR DISPOSE OF PROPERLY. BRING ALL DISTURBED AREAS TO PROPER GRADE, SMOOTH AND COMPACT. APPROPRIATELY STABILIZE ALL DISTURBED AREAS AROUND INLET.

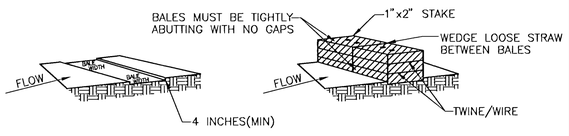

1. EXCAVATE THE TRENCH
2. PLACE AND STAKE STRAW BALES




3. BACKFILL AND COMPACT EXCAVATED SOIL

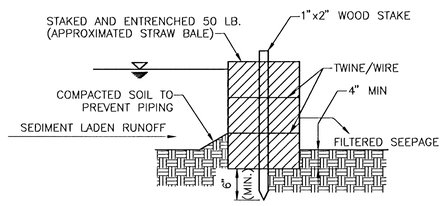

CROSS–SECTION OF A PROPERLY INSTALLED STRAW BALE

STRAW BALE DIKES FOR DRAINAGE CHANNELS
DETAIL 5

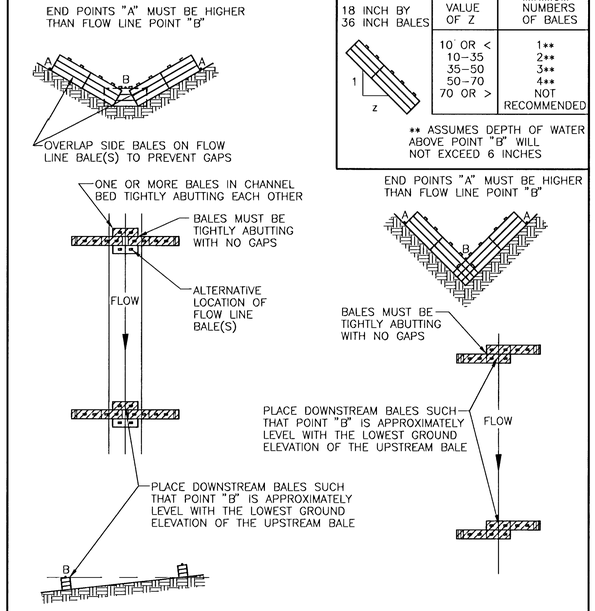


18 INCH BY 36 INCH BALES	VALUE OF Z	MINIMUM NUMBERS OF BALES
1 / z	10 OR <	1**
	10–35	2**
	35–50	3**
	50–70	4**
	70 OR >	NOT RECOMMENDED

** ASSUMES DEPTH OF WATER ABOVE POINT "B" WILL NOT EXCEED 6 INCHES

WIDE CHANNELS | NARROW CHANNELS


STRAW BALE DIKES FOR DRAINAGE CHANNELS
DETAIL 6

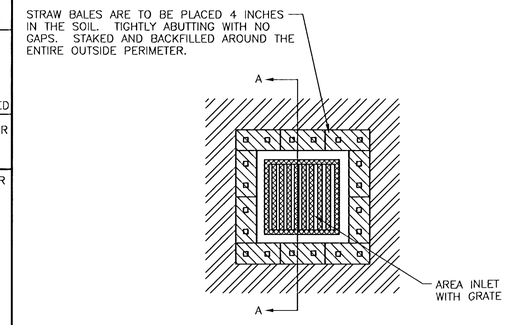

SECTION AA

NOTE: STRAW BALE FILTERS ARE NOT TO BE USED IF ADJACENT AREA TO INLET IS PAVED. SEE DETAIL 2 FOR FILTERS ON PAVED AREA

STRAW BALE FILTER FOR AREA/DROP INLET
DETAIL 7



TEMPORARY CONSTRUCTION ENTRANCE/WASH DOWN PAD
DETAIL 8

EROSION AND SEDIMENT CONTROL NOTES:

1. TEMPORARY STABILIZATION – TOPSOIL STOCK PILES AND DISTURBED PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITY TEMPORARILY CEASES FOR AT LEAST 28 DAYS WILL BE STABILIZED WITH TEMPORARY SEED AND MULCH NO LATER THAN 14 DAYS FROM THE LAST CONSTRUCTION ACTIVITY IN THAT AREA. THE TEMPORARY SEED SHALL BE RYE (GRAIN) APPLIED AT THE RATE OF 160 POUNDS PER ACRE. AFTER SEEDING, EACH AREA SHALL BE MULCHED STRAW. THE STRAW MULCH IS TO BE TACKED INTO PLACE BY A DISK WITH BLADES SET NEARLY STRAIGHT.
2. PERMANENT STABILIZATION – DISTURBED PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES PERMANENTLY CEASES SHALL BE STABILIZED NO LATER THAN 14 DAYS AFTER THE LAST CONSTRUCTION ACTIVITY.

MKEC
ENGINEERING CONSULTANTS
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

ROCKY CREEK ADDITION-HALLMARK PH 2		
PROJECT NAME		
EROSION/SEDIMENT CONTROL DETAILS		
SHEET TITLE		
JTC	DAC	JTC
DESIGN BY:	DRAWN BY:	CHECKED BY:
JUNE 2001	01123_D6	24 / 32
DATE	DRAWING NAME	SHEET / OF

G:\CIVIL\96081\HALLMARK\PHASE2\SWS\01123_D6.DWG Tue Jun 26 14:43:40 2001

H:\CIVIL\00206\SWS\00206ds5