


NOTE: MAX TRAVERSE SLOPE = 5%

SIDEWALK NOTES:

- CONTRACTOR SHALL INSTALL SIDEWALK TO MATCH EXISTING GROUND ELEVATIONS AND TO ALLOW NATURAL DRAINAGE WAYS TO CONTINUE EXCEPT WHERE GRADING IS SHOWN. COST SHALL BE SUBSIDIARY TO SIDEWALK CONSTRUCTION.
- THE SIDEWALK SHALL NOT EXCEED 5% LONGITUDINAL SLOPE AND 1/4" FT TRANSVERSE SLOPE.
- ALL SIDEWALK TO BE 8'-0" WIDE EXCEPT AS NOTED ON PLANS.

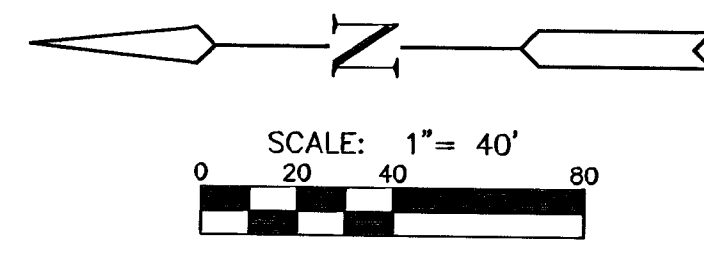

REED'S COVE ADDITION
PROJECT NAME

SIDEWALK PLAN
SHEET TITLE

LAB DESIGN BY: **KWS** DRAWN BY: **LAB** CHECKED BY: **LAB**

NOVEMBER 2004 DATE: **02121** JOB NO. **2 / 3** SHEET/OF

411 N. WEBB ROAD
WICHITA, KS. 67206
314 - 694 - 9600

H:\CIVIL\02121\Drawings\South_sidewalk_02121E1.dwg