


K
ATE

* UNDERDRAIN AGGREGATE
PERCENT OF AGGREGATE RETAINED

1"	0
3/4"	0 to 10
3/8"	45 to 80
#4	90 to 100
#8	95 to 100


ROCK QUALITY SHALL CONFORM TO THE REQUIREMENTS SPECIFIED
BY K.D.O.T. 1990 EDITION STANDARD SPECIFICATION SUBSECTION
1102 FOR DURABILITY CLASS 1.

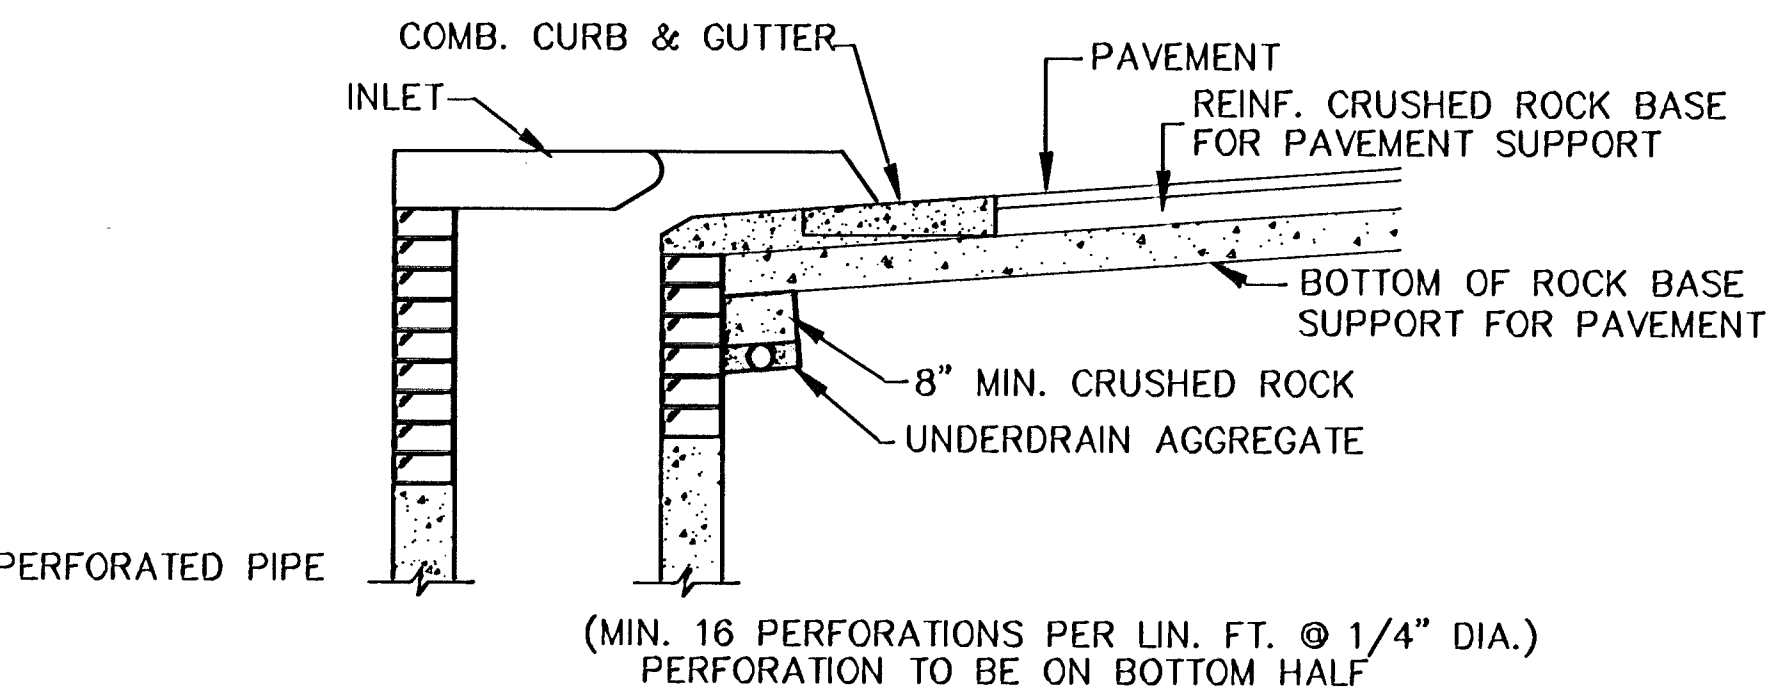


SECTION A-A

NOTE: PLACE 4" PVC PERFORATED PIPE AT ALL DRAINAGE
SUMP LOCATIONS.
COST OF UNDERDRAIN SYSTEM TO BE INCIDENTAL
TO THE REINFORCED CRUSHED ROCK SUBGRADE.
INLET TYPE MAY VARY FROM THAT SHOWN.


UNDERDRAIN DETAIL

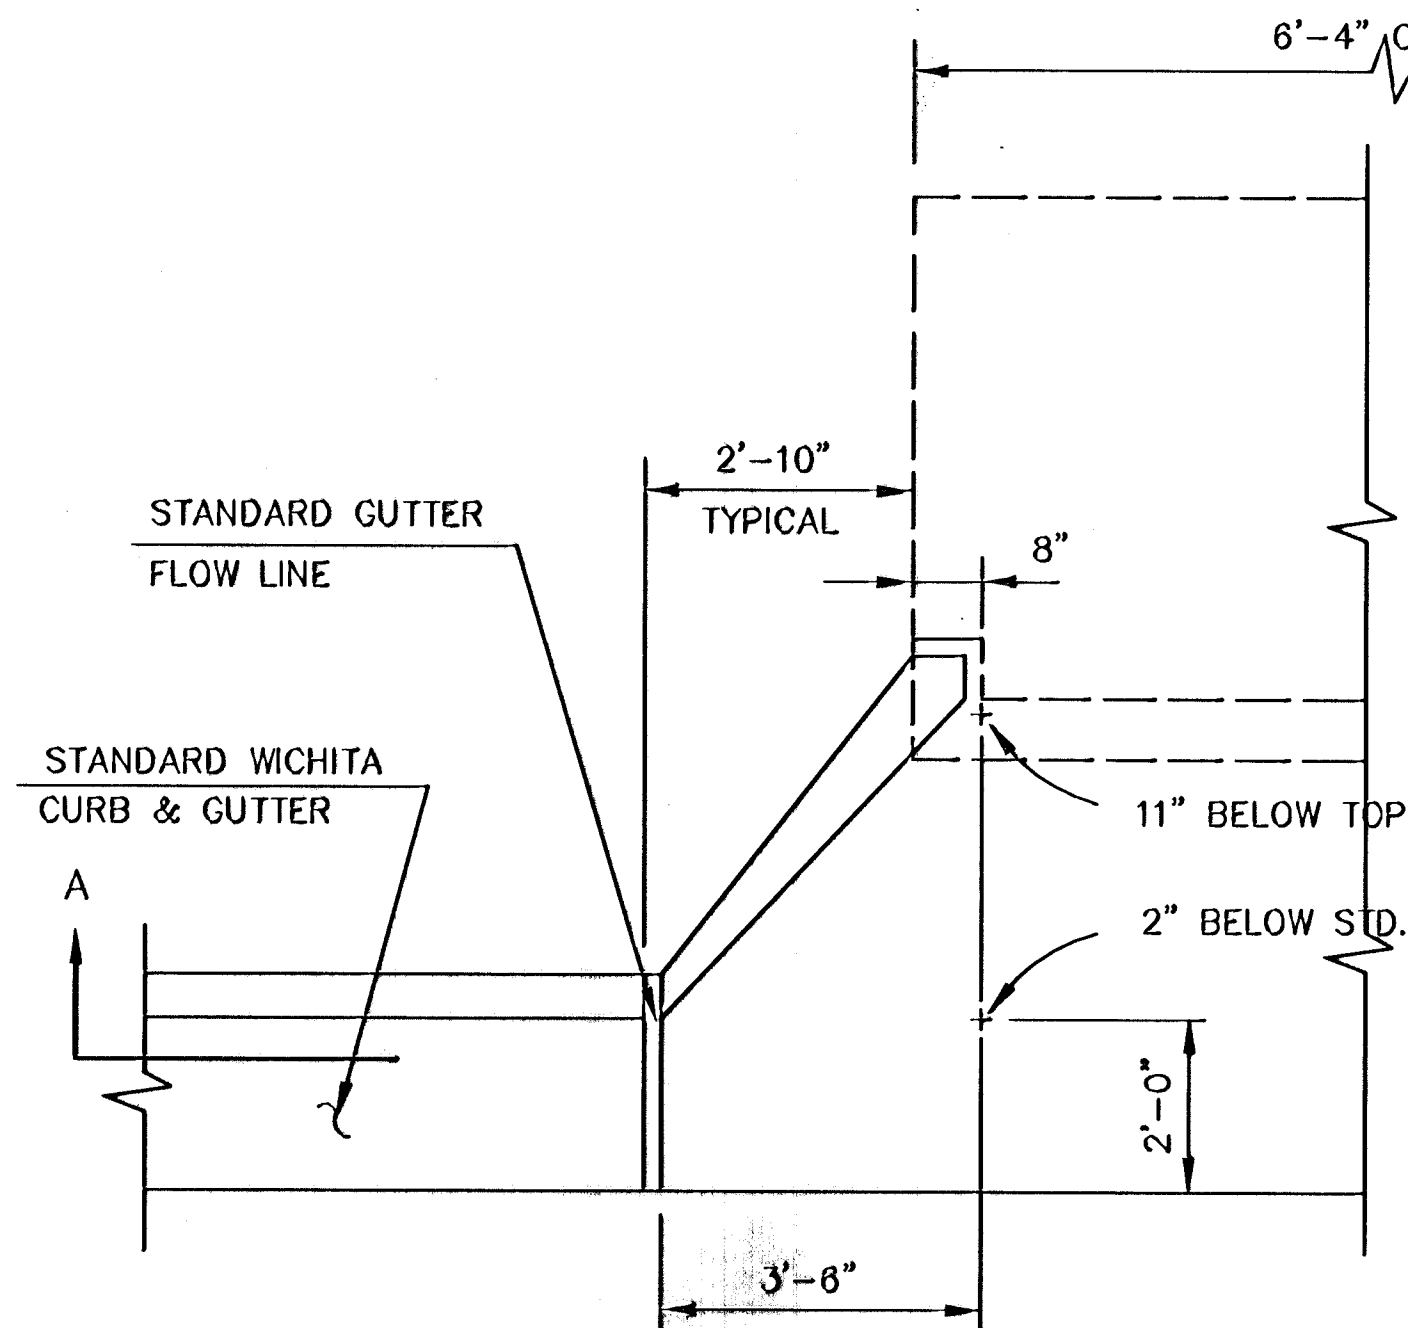

PLA

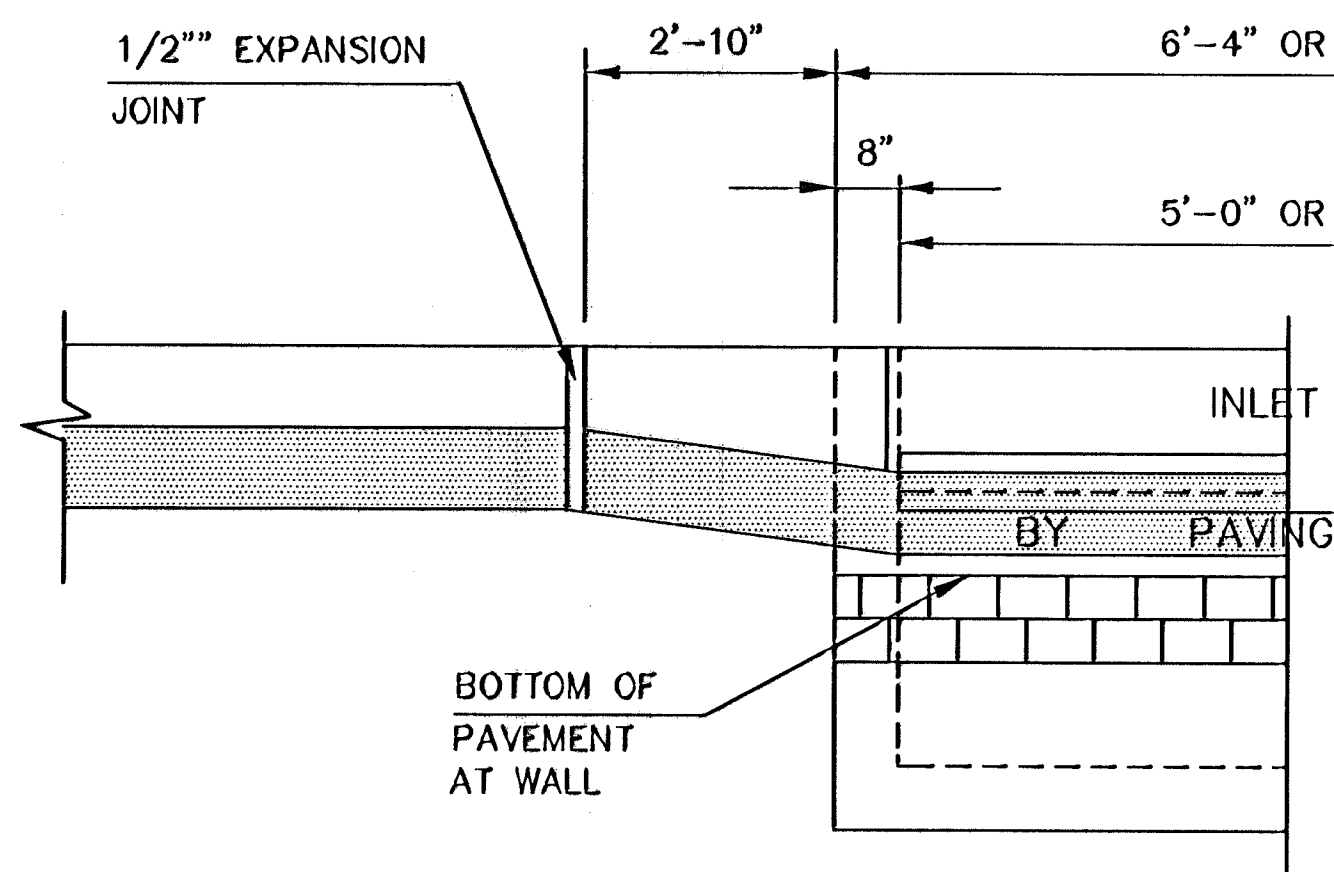

SECTION

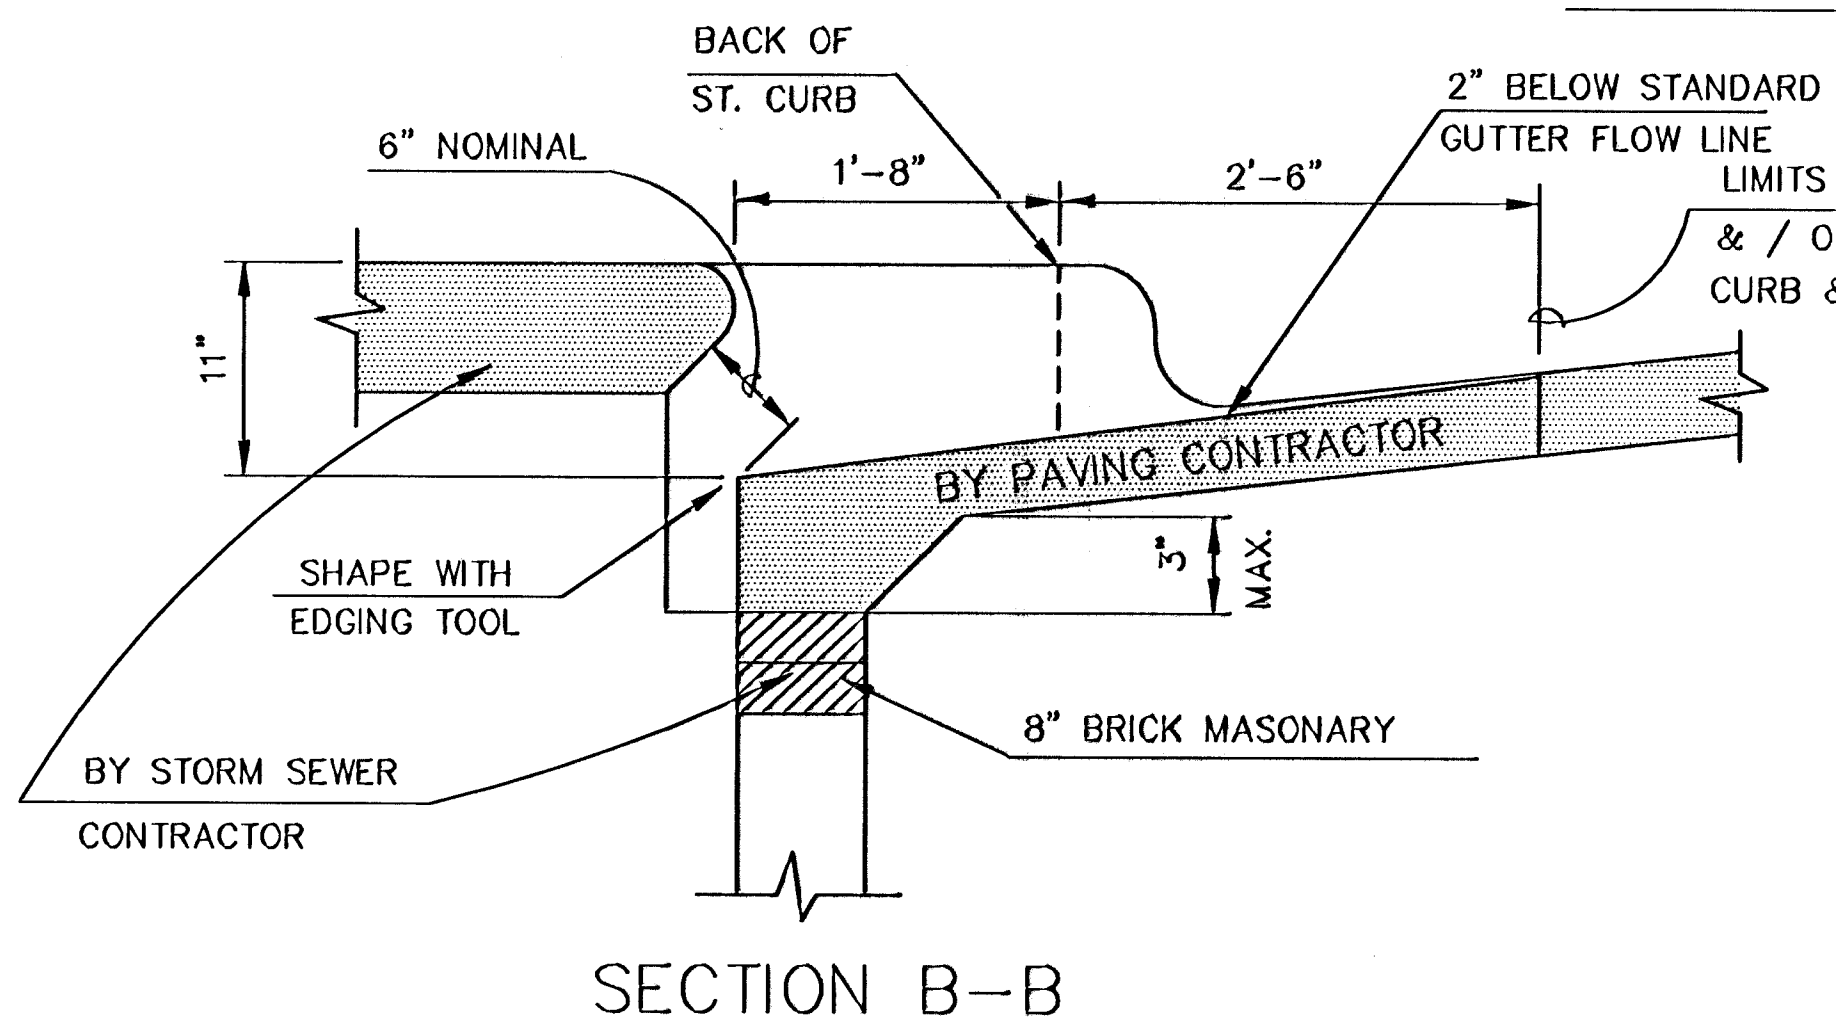

SECTION B-B

TYPE 1A INLET HOOKUP

(BY PAVING CONTRACTOR)