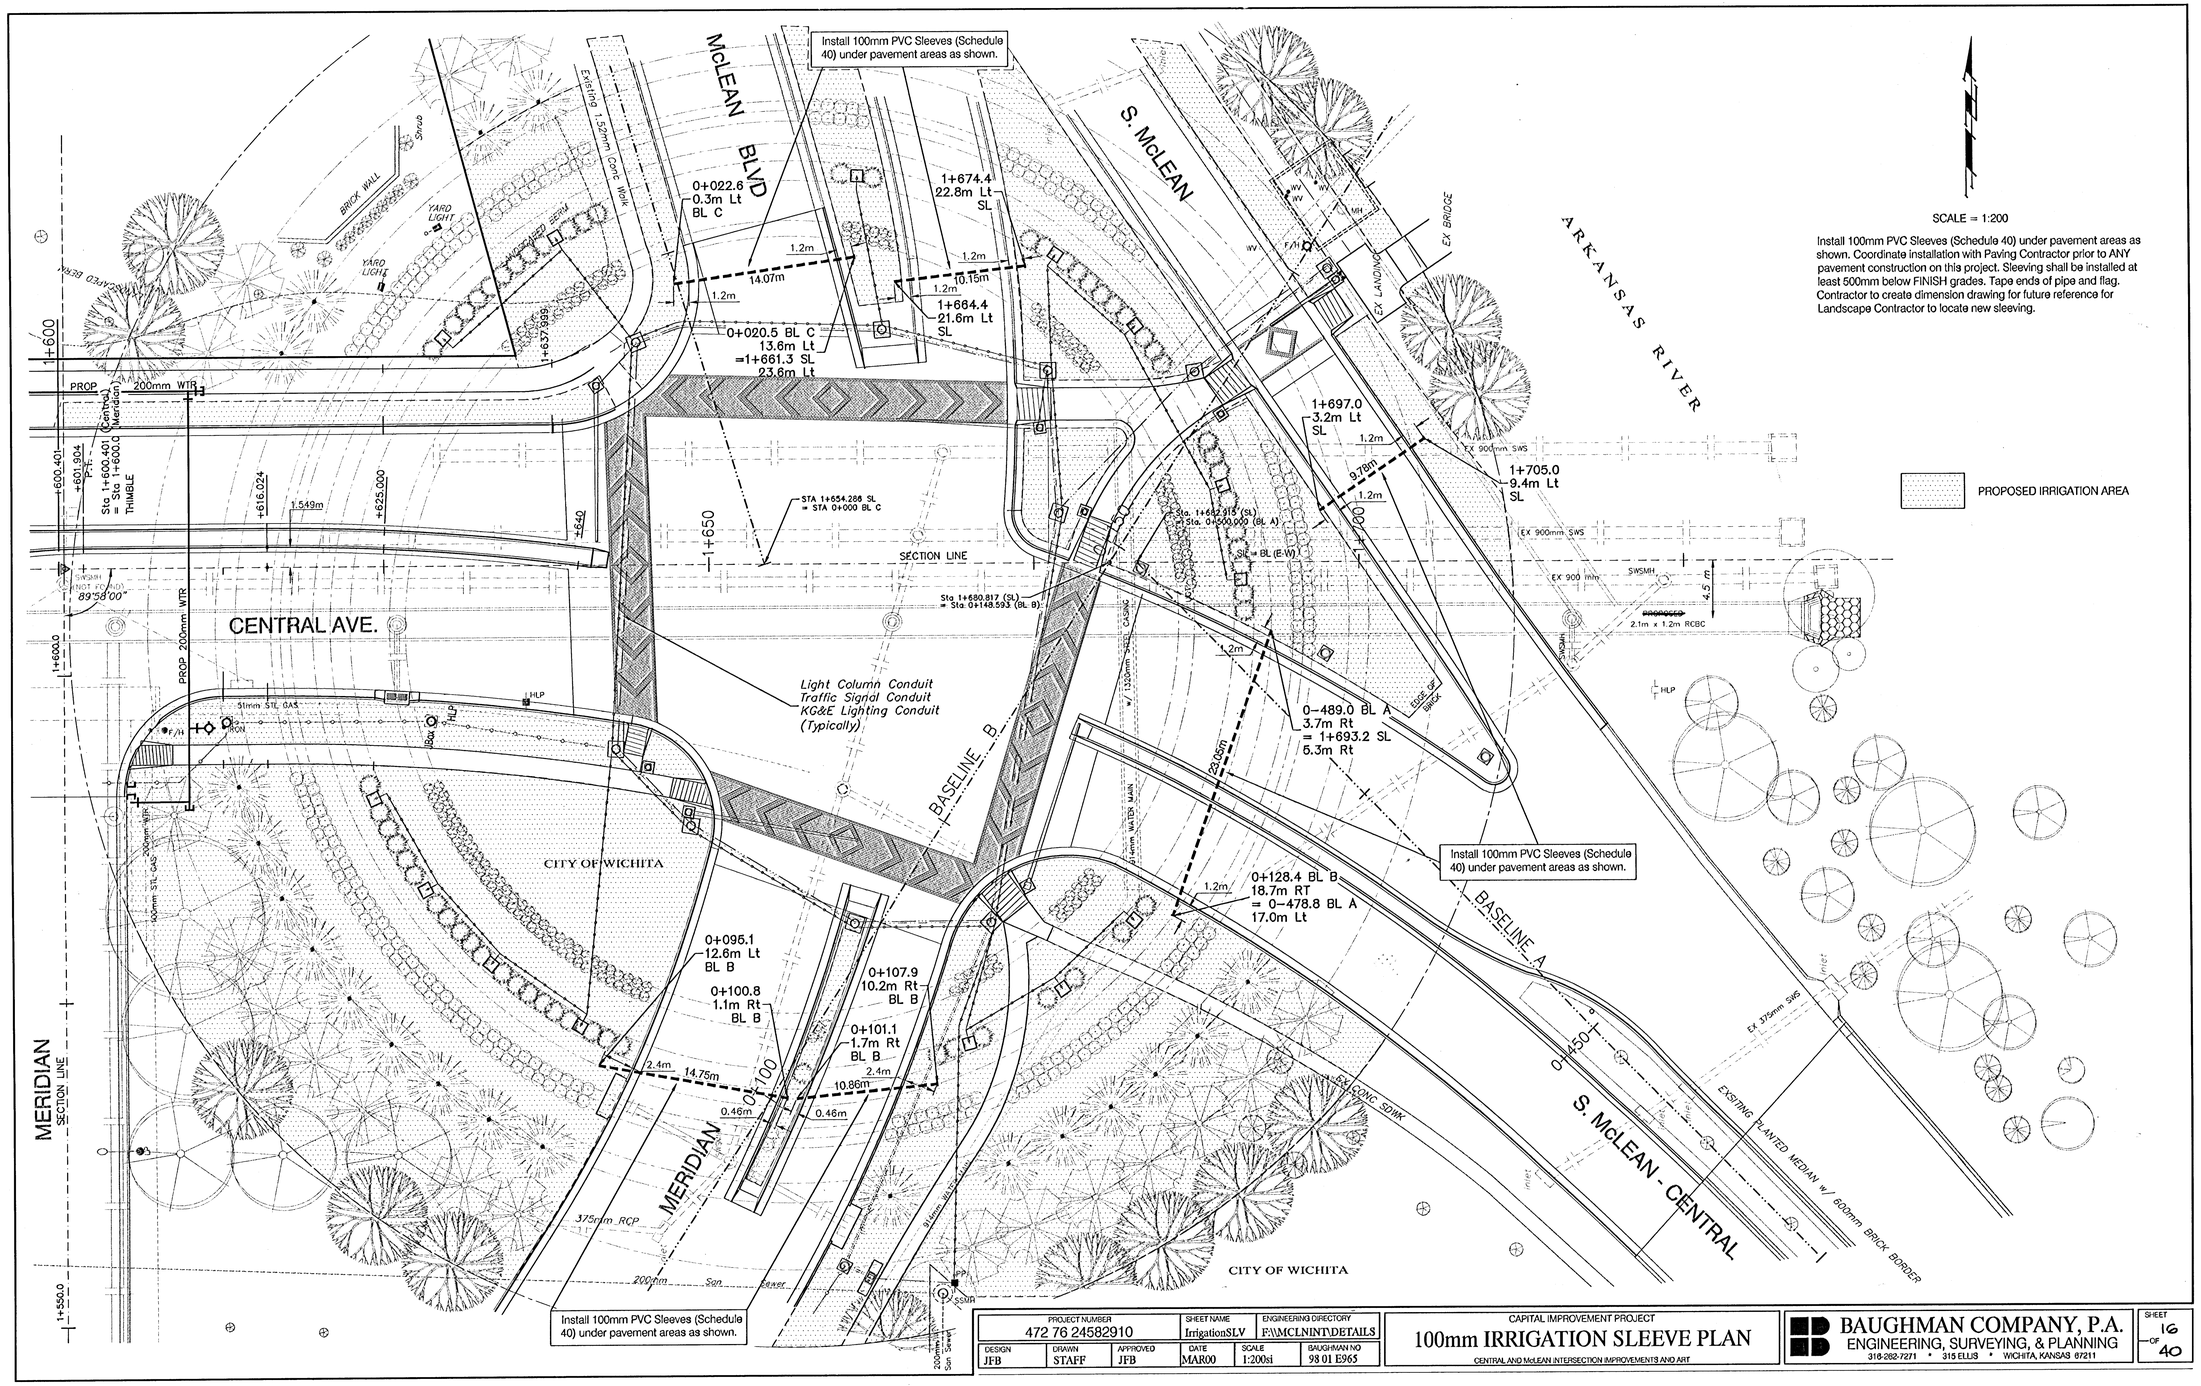

SCALE = 1:200

Install 100mm PVC Sleeves (Schedule 40) under pavement areas as shown. Coordinate installation with Paving Contractor prior to ANY pavement construction on this project. Sleeving shall be installed at least 500mm below FINISH grades. Tape ends of pipe and flag. Contractor to create dimension drawing for future reference for Landscape Contractor to locate new sleeving.

PROJECT NUMBER	SHEET NAME	ENGINEERING DIRECTORY
472 76 24582910	IrrigationSLV	F:\\MCLNINT\DETAILS

DESIGN	DRAWN	APPROVED	DATE	SCALE	BAUGHMAN NO
JFB	STAFF	JFB	MAR00	1:200si	98 01 E965

CAPITAL IMPROVEMENT PROJECT

100mm IRRIGATION SLEEVE PLAN

CENTRAL AND McLEAN INTERSECTION IMPROVEMENTS AND ART

BAUGHMAN COMPANY, P.A.
ENGINEERING, SURVEYING, & PLANNING
316-262-7271 • 315 ELLIS • WICHITA, KANSAS 67211

SHEET 16 OF 40