

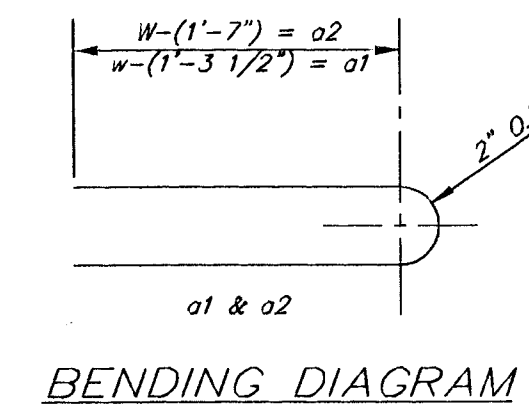
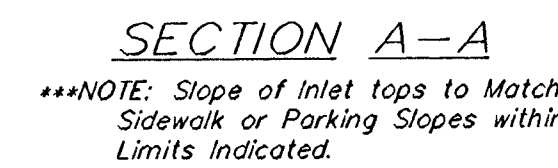
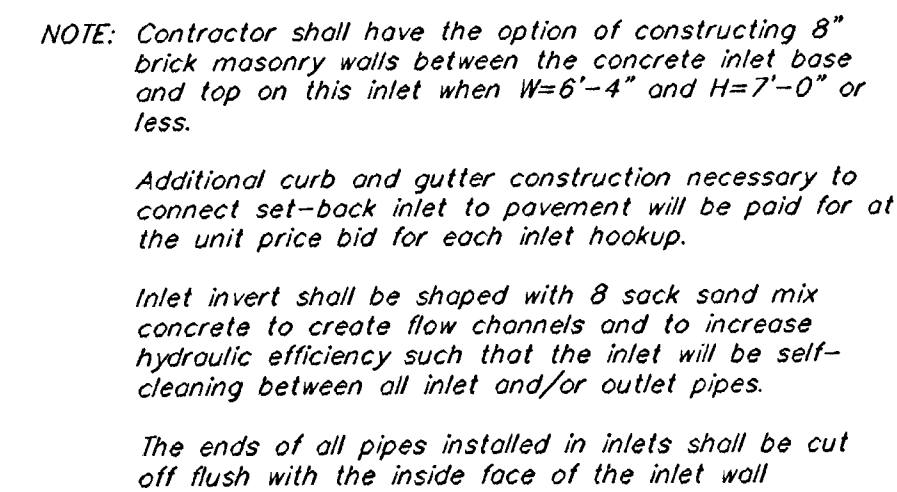


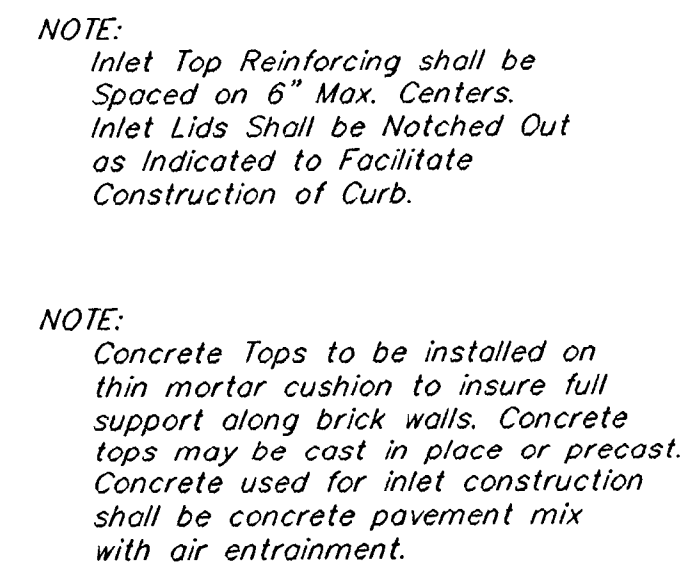


* Field Bend or Cut Reinforcing as Required for Clearance.

① $4(HI - 12")$ ($HI - 21"$) Rounded down to nearest 0.5

② $HI - 3"$

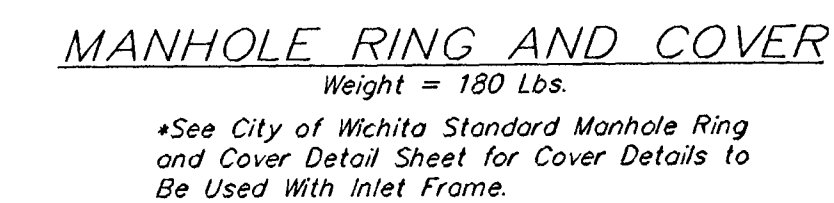

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CO.
4'-4"	3'-8" x 6'-4" x 7 1/2"	21" & SMALLER	0.38±
5'-4"	4'-8" x 6'-4" x 7 1/2"	24" & 30"	0.51±
6'-4"	5'-8" x 6'-4" x 7 1/2"	36" & 42"	0.84±
7'-4"	6'-8" x 6'-4" x 7 1/2"	48" & 54"	0.77±
8'-4"	7'-8" x 6'-4" x 7 1/2"	60" & 66"	0.90±

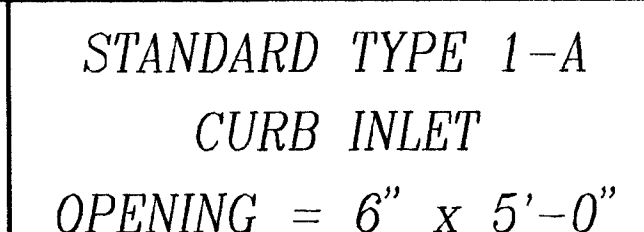

M. E. LINDEBAK P.E. - CITY ENGINEER

PROJECT NUMBER
472-82787

DATE JAN 97	SHEET 28 OF 94
----------------	----------------