

PLAN NOTES

1. E.C. SHALL COORDINATE ALL WORK WITH IRRIGATION CONTRACTOR.
2. E.C. SHALL USE EXISTING 6" SLEEVES BETWEEN ISLANDS AND CURB.
E.C. SHALL REWORK THE EXISTING 6" SLEEVES TO ALLOW 36"-48" COVER.
3. E.C. SHALL MAINTAIN A MIN. COVER OF 36" OVER ALL U.G. CONDUITS.
E.C. SHALL INCREASE CONDUIT COVER WITHIN THE STREET ISLANDS TO 48" MIN. TO CLEAR THE IRRIGATION AND TREE PLANTING EXCAVATION.
MAINTAIN 12" CLEARANCE UNDER ALL IRRIGATION PIPING.
4. E.C. SHALL PROVIDE 1ea. 15 AMP 120 VOLT UNSWITCHED CIRCUIT TO THE IRRIGATION CONTROLLER. IRRIGATION CONTROL PROVIDED AND MOUNTED BY IRRIGATION CONTRACTOR.


NOTE: INSTALL POWER RECEPTACLE LOCATIONS AS INDICATED ON LANDSCAPE PLANS, RELATIVE TO TREE LOCATIONS.

3ea. 20A 120V
CIRCUITS FROM
METER PEDESTAL



NEW METERING PEDESTAL
REF. TO METERING DETAIL
CONDUIT AND RISER
TYP.
EXISTING KGE POLE
NEW UNMETERED DIP LOC.
VERIFY EXACT LOCATION.
COORDINATE EXACT LOCATION
OF NEW METER PEDESTAL W/ ARCH.
REFER TO ALL TO ARCH DETAILS

ELECTRICAL PLAN NO. 1


1" = 30'



ELECTRICAL KEY PLAN

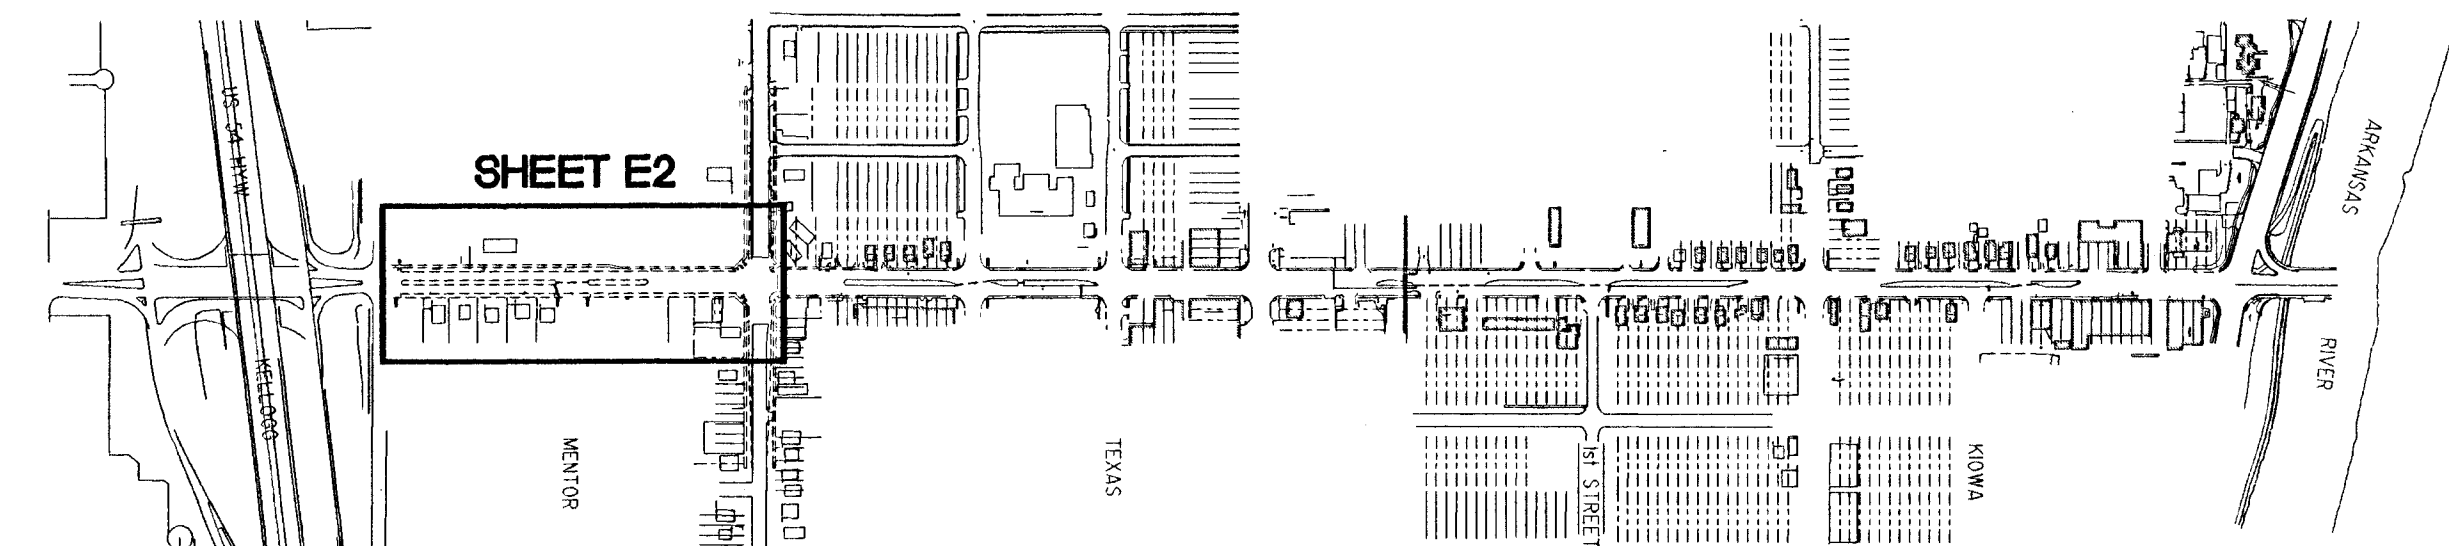

METER CENTER #1

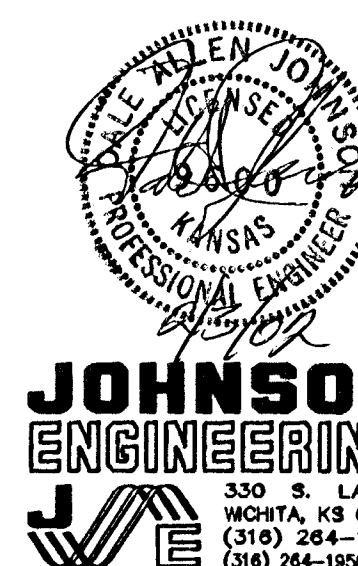

JOHNSON
ENGINEERING
CONSULTANTS
330 S. LAURA
WICHITA, KS 67211
(316) 264-1933
(316) 264-1936 FAX



MKEC
ENGINEERING CONSULTANTS
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

SENECA STREET
PROJECT NAME

ELECTRICAL PLAN NO. 1
SHEET TITLE

DAJ
DESIGN BY
2/3/03
DATE

DAJ
DRAWN BY
E2
DRAWING NAME

DAJ
CHECKED BY
E2 / 5
SHEET / OF