

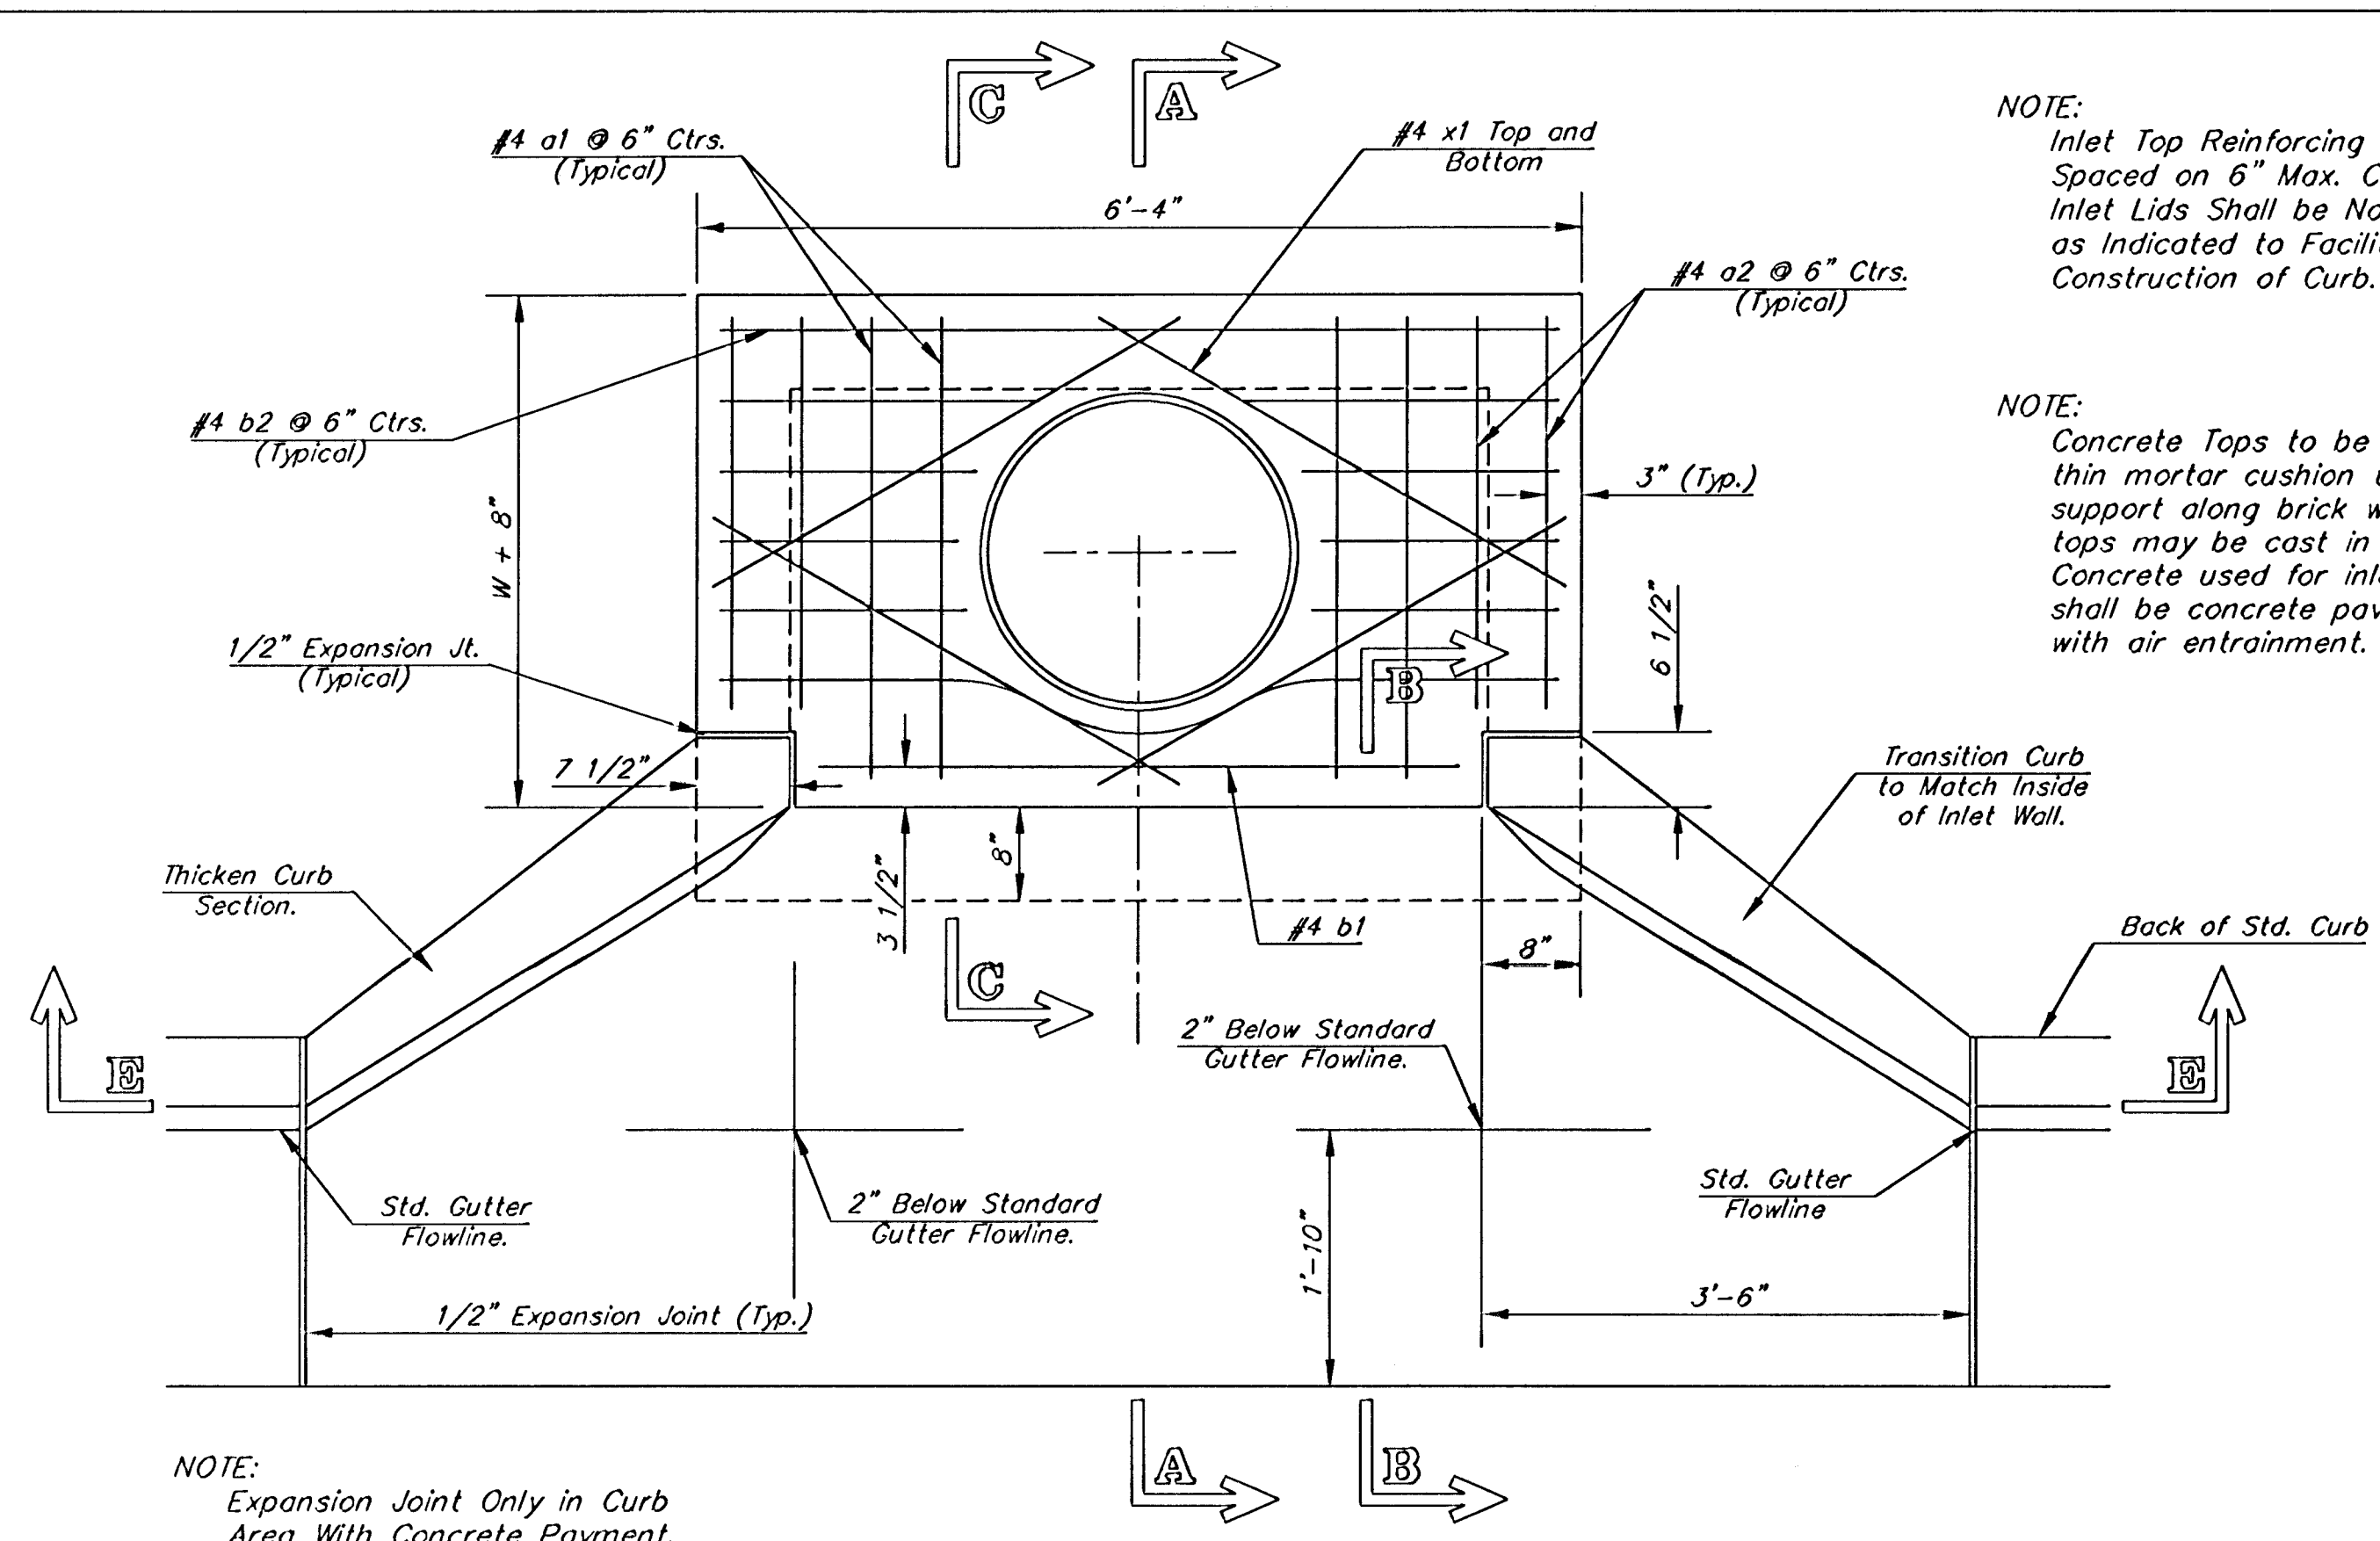


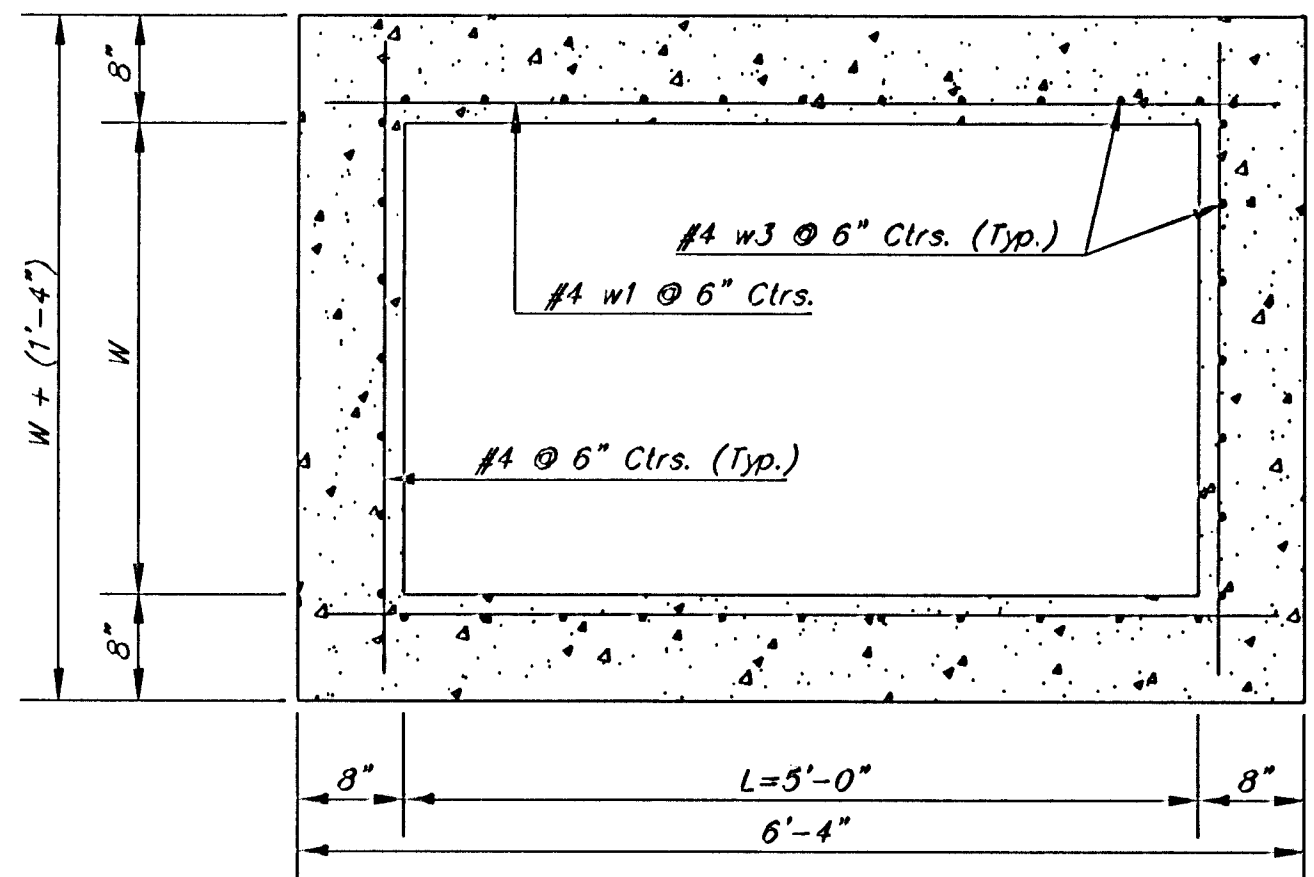


PLAN

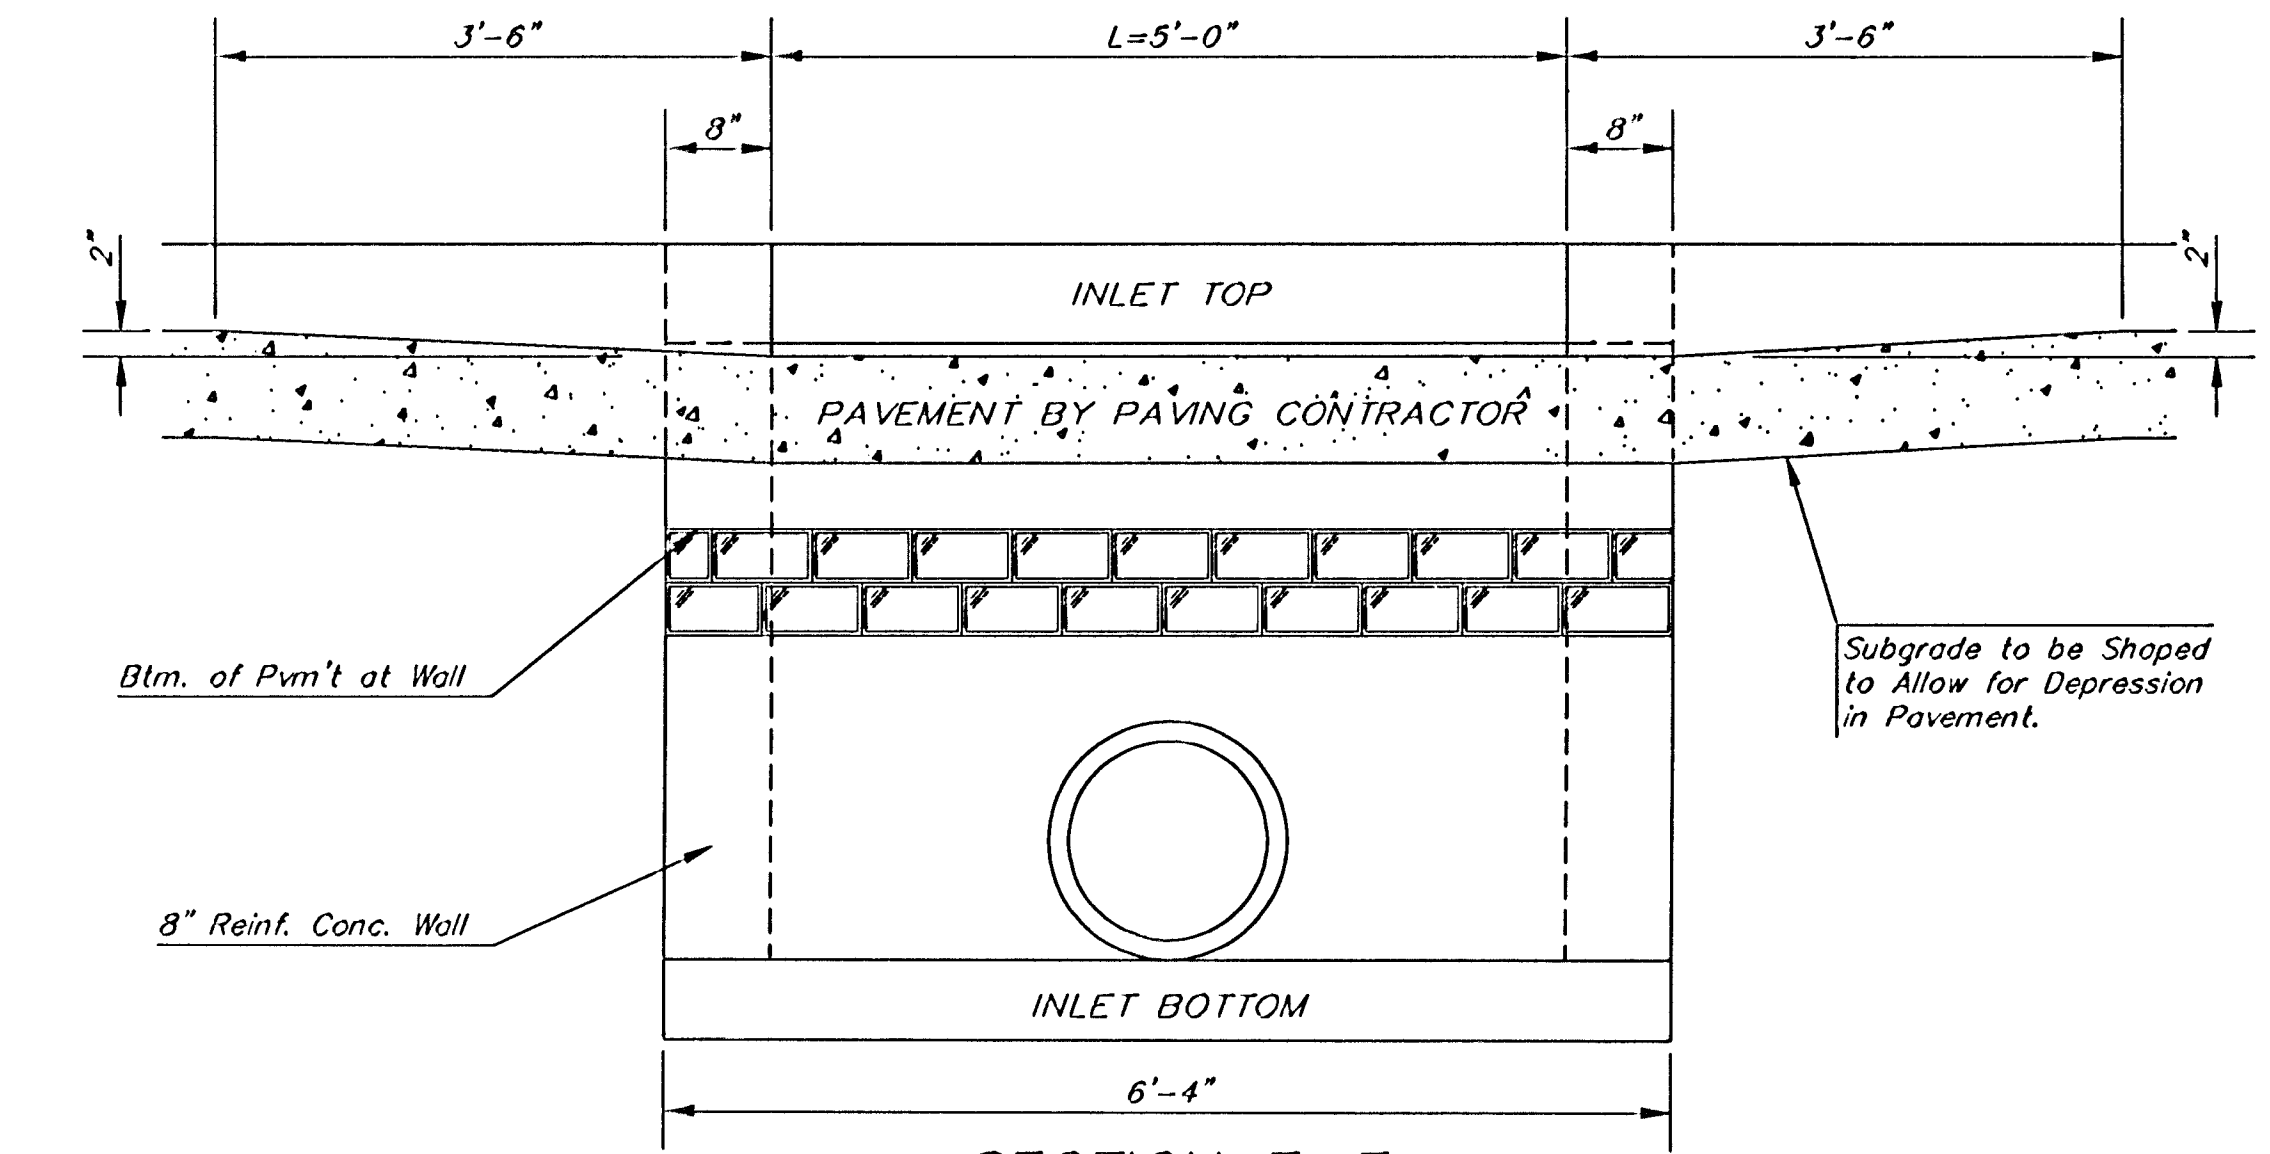


NOTE: Inlet Top Reinforcing shall be Spaced on 6" Max. Centers. Inlet Lids Shall be Notched Out as Indicated to Facilitate Construction of Curb.

NOTE: Concrete Tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix with air entrainment.

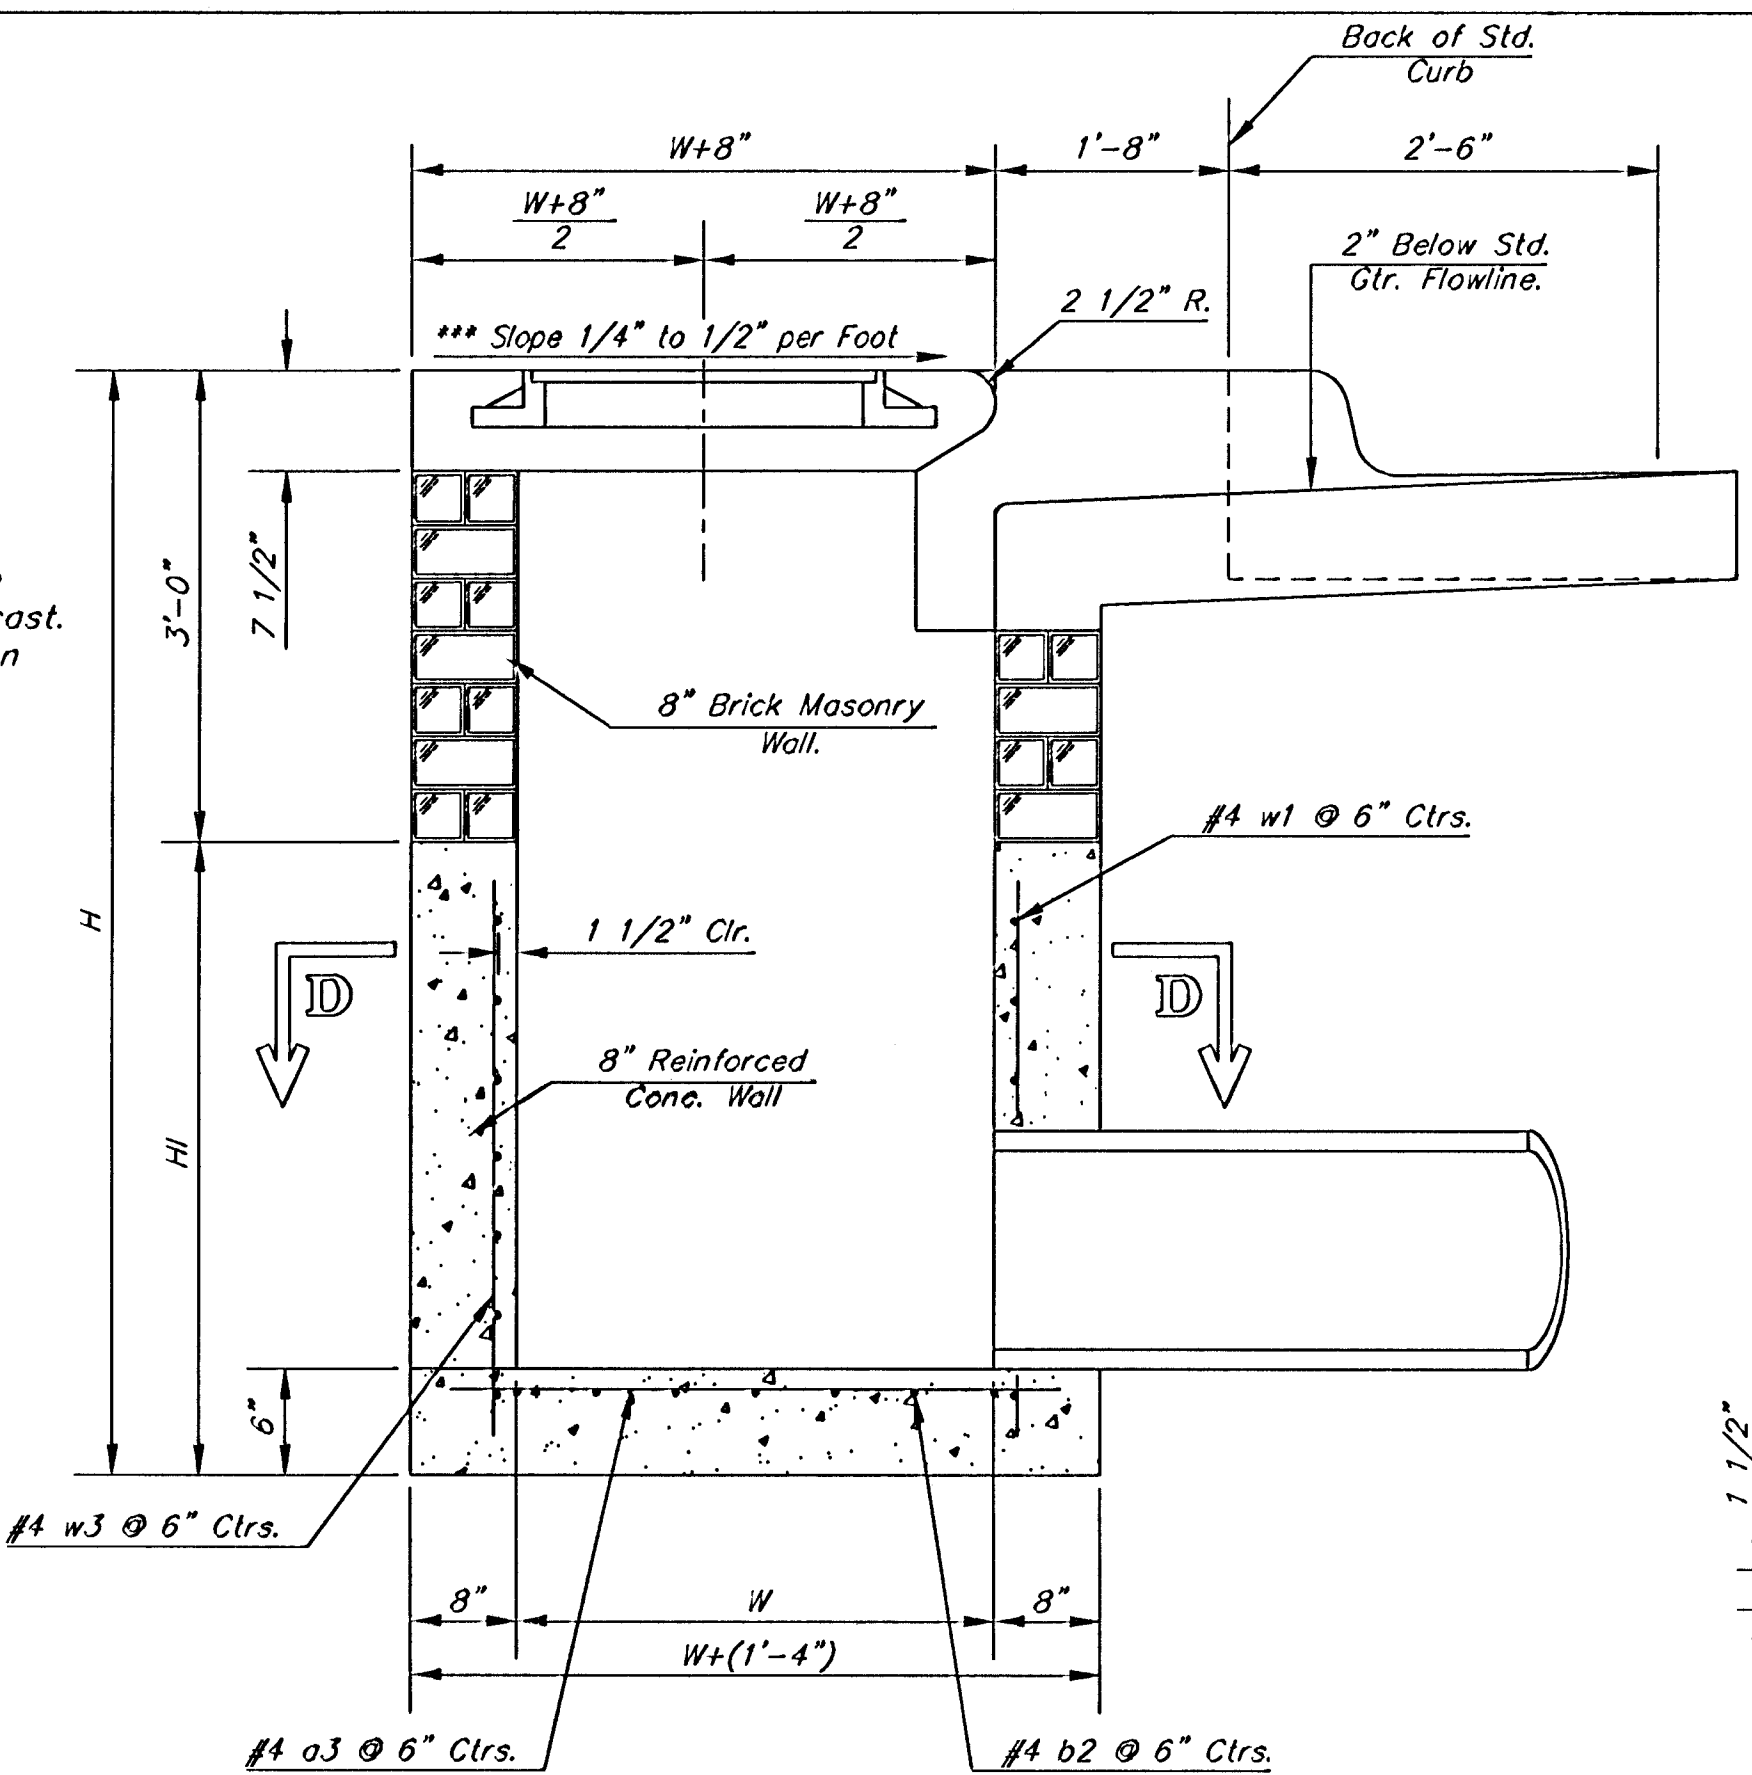

SECTION A-A

***NOTE: Slope of Inlet tops to Match Sidewalk or Parking Slopes within Limits Indicated.

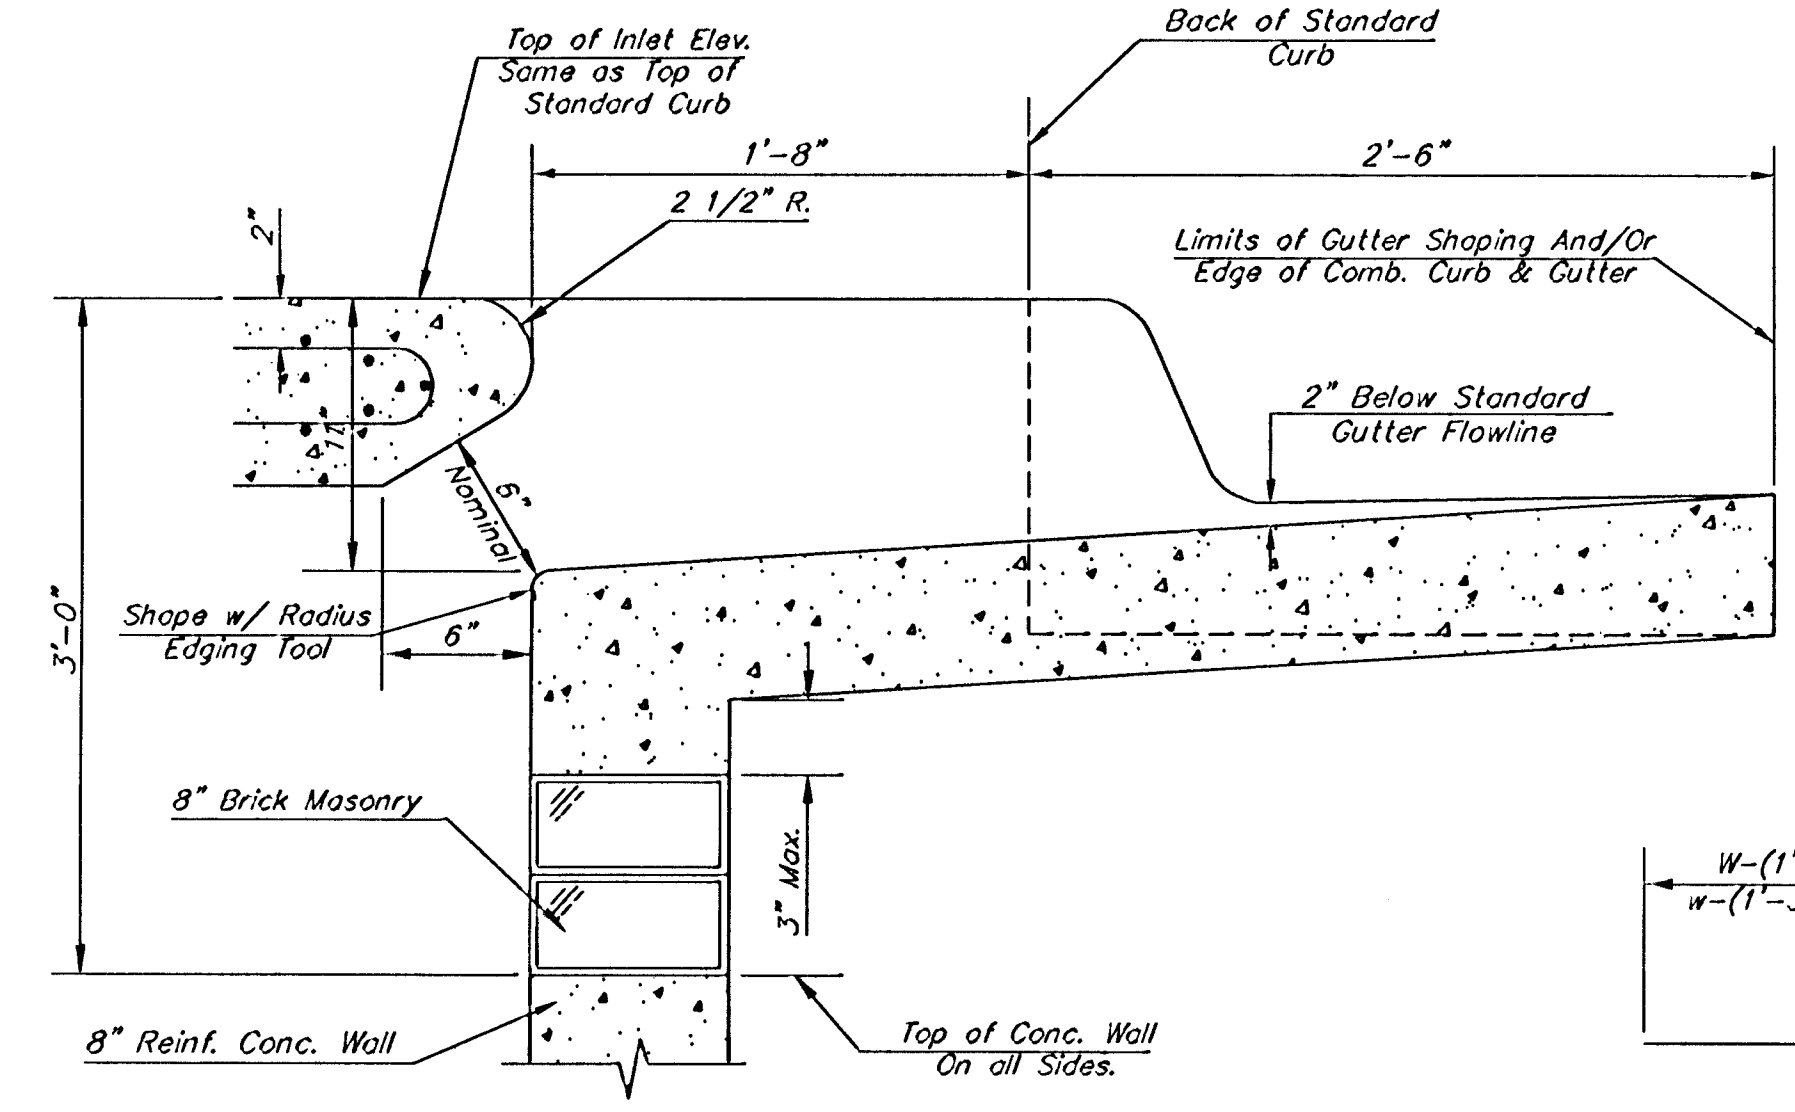


SECTION B-B

PRECAST SLAB AND FLOOR REINFORCING											
W = 3'-0"			W = 4'-0"			W = 5'-0"			W = 6'-0"		
MARK	SIZE	NO.	MARK	SIZE	NO.	MARK	SIZE	NO.	MARK	SIZE	NO.
a1	#4	6	a1	#4	6	a1	#4	6	a1	#4	6
a2	#4	4	a2	#4	4	a2	#4	4	a2	#4	4
a3	#4	13	a3	#4	13	a3	#4	13	a3	#4	13
b1	#4	1	b1	#4	1	b1	#4	1	b1	#4	1
b2	#4	23	b2	#4	29	b2	#4	35	b2	#4	41
x1	#4	8	x1	#4	8	x1	#4	8	x1	#4	8

* Field Bend or Cut Reinforcing as Required for Clearance.

① 4 (H - 12") (H - 21") Rounded down to nearest 0.5"


② H - 3"

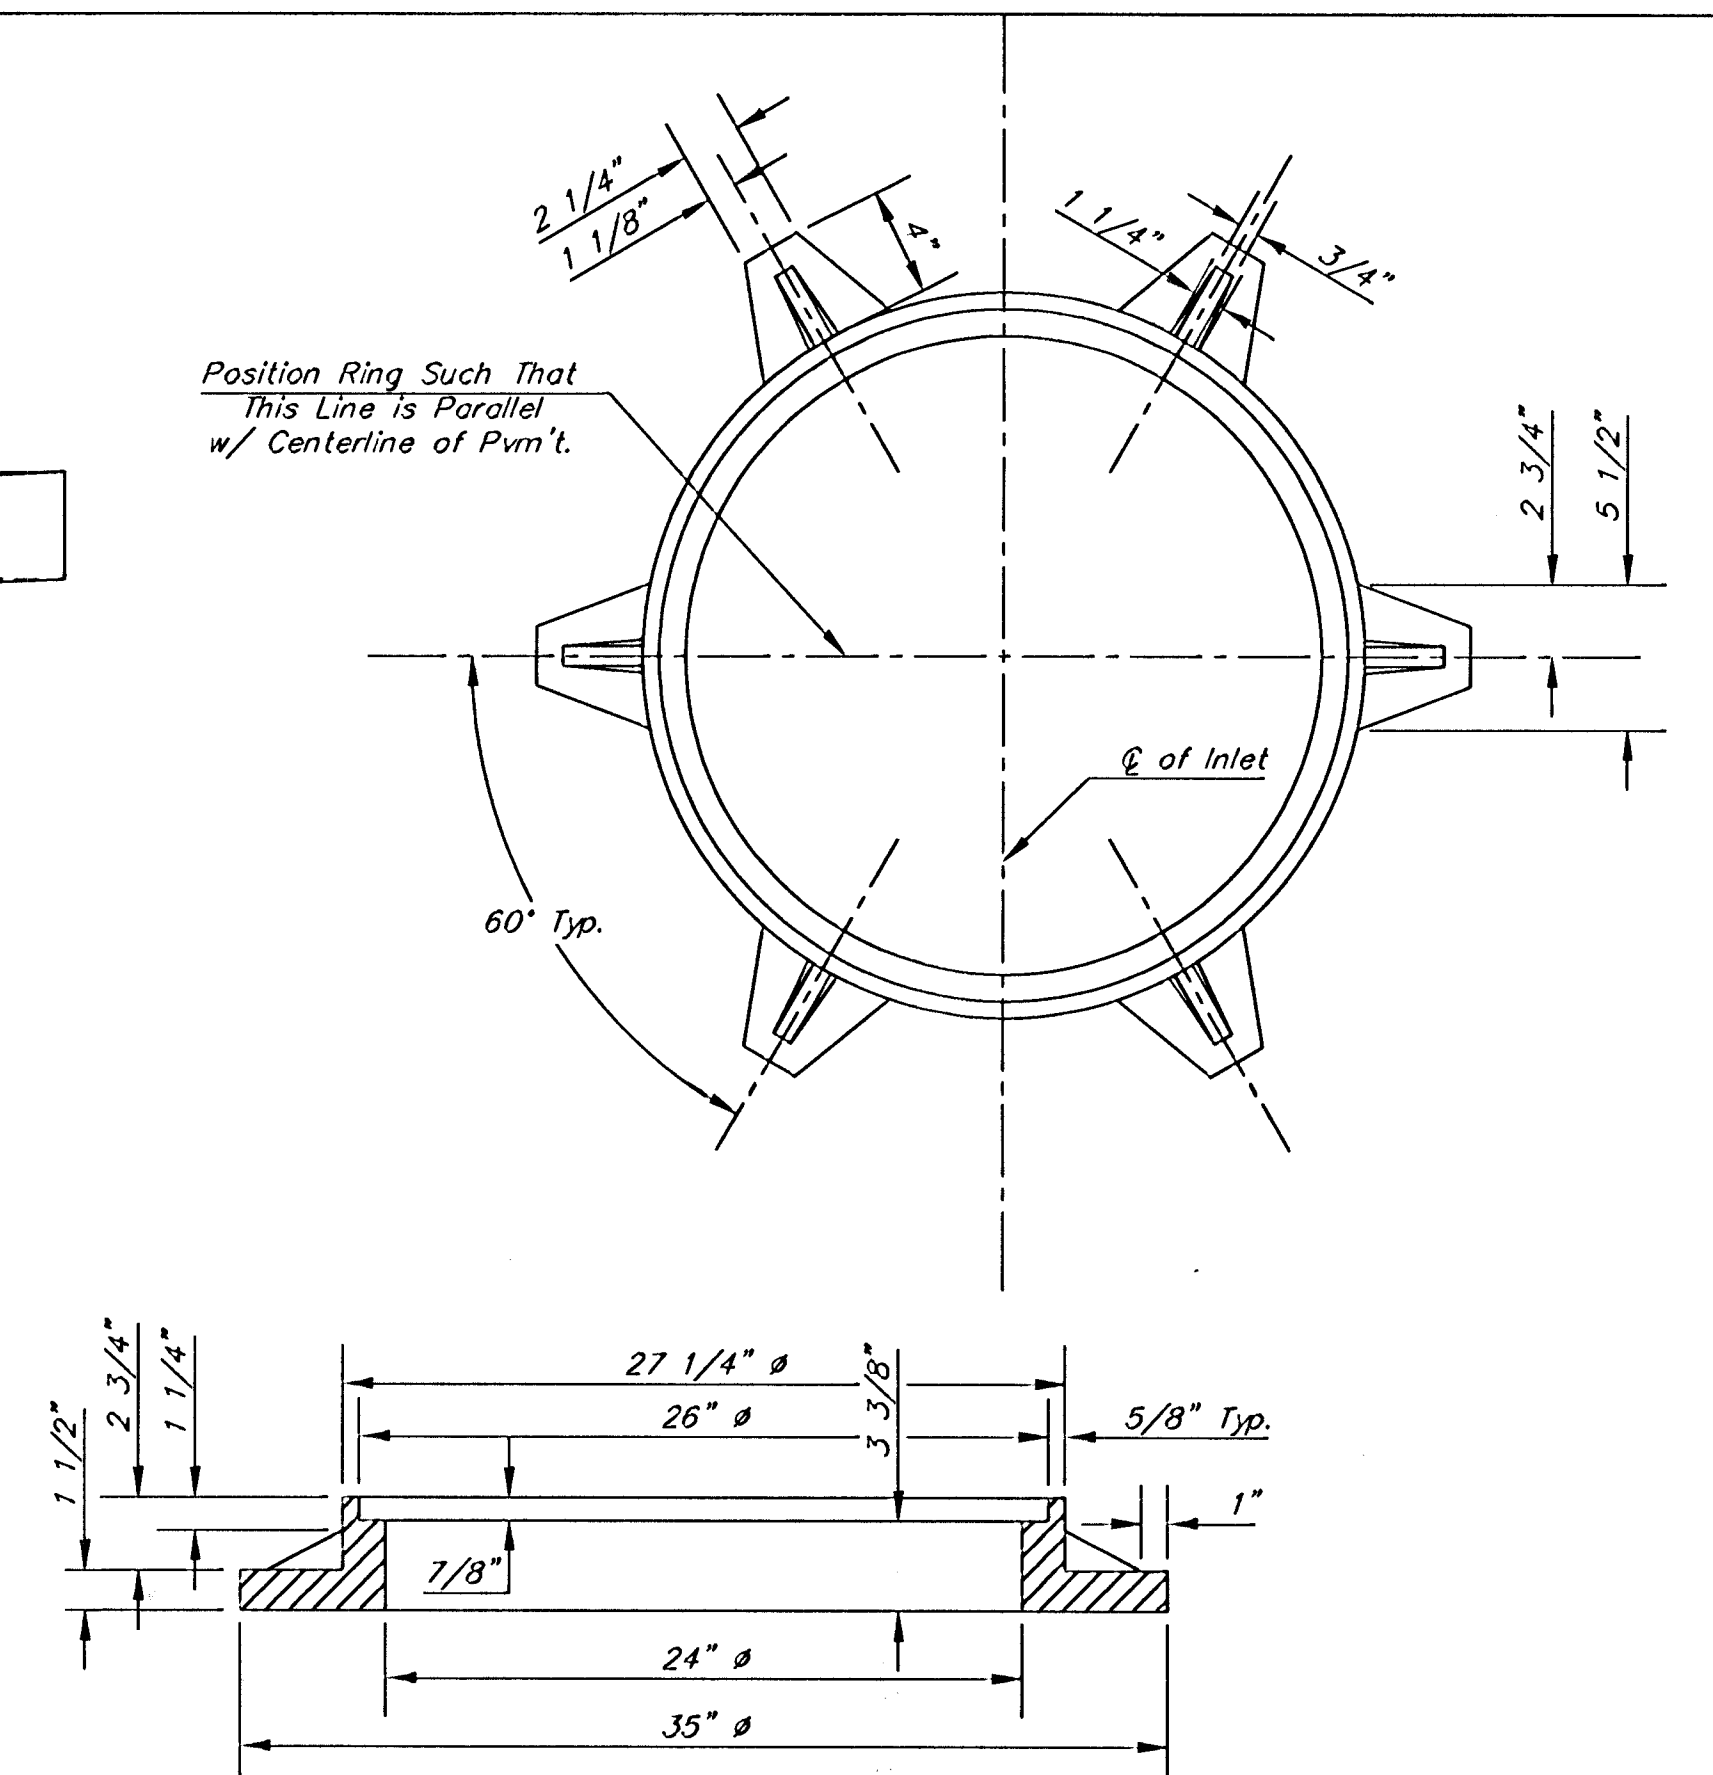


MANHOLE RING AND COVER

Weight = 180 Lbs.

*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

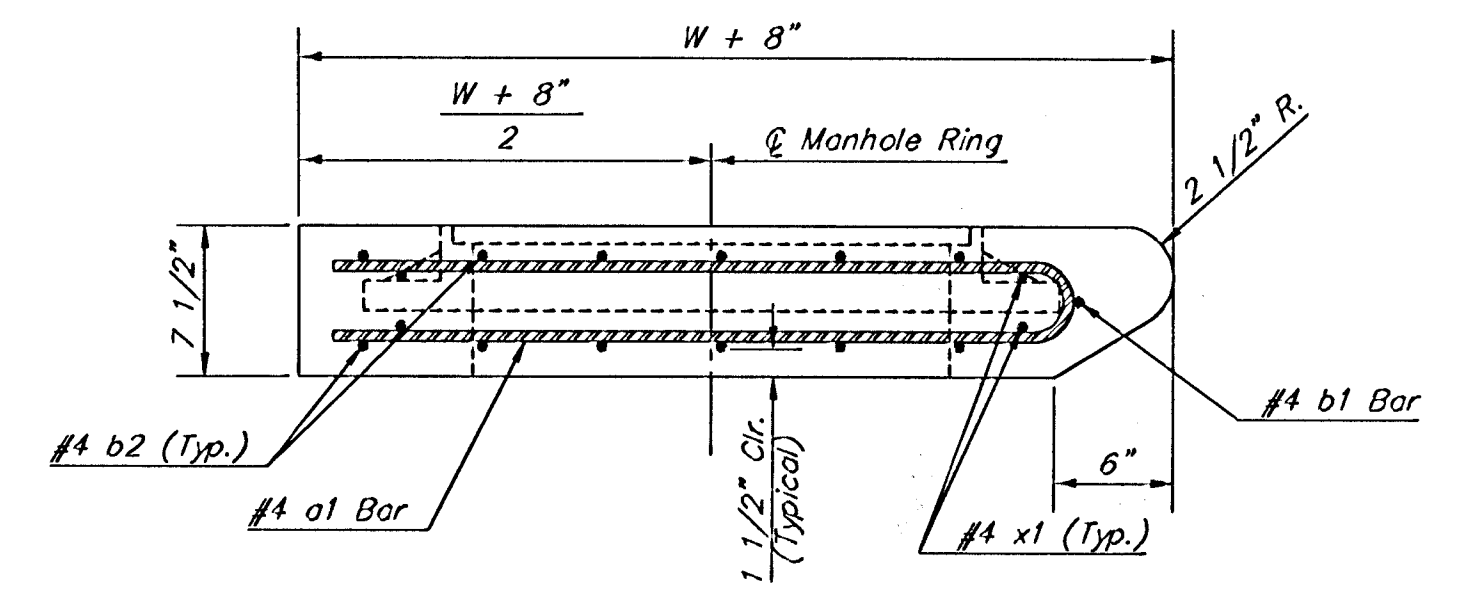

SECTION C-C

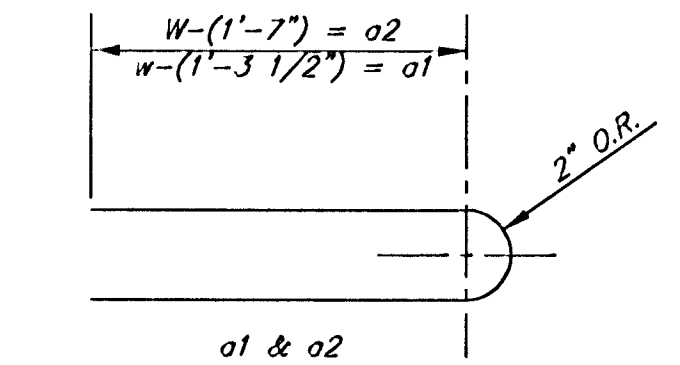

STANDARD CURB INLET PRECAST TOPS			
W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
3'-0"	3'-8" x 6'-4" x 1 1/2"	21" & SMALLER	0.38±
4'-0"	4'-8" x 6'-4" x 1 1/2"	24" & 30"	0.51±
5'-0"	5'-8" x 6'-4" x 1 1/2"	36" & 42"	0.64±
6'-0"	6'-8" x 6'-4" x 1 1/2"	48" & 54"	0.77±
7'-0"	7'-8" x 6'-4" x 1 1/2"	60" & 66"	0.90±

THE CITY OF WICHITA

W

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
425 NORTH MAIN STREET
WICHITA, KANSAS 67202
(316) 268-6501
(316) 268-4114 FAX

STANDARD TYPE 1-A
CURB INLET
OPENING = 6" x 5'-0"

M. E. LINDEBAK P.E. - CITY ENGINEER

PROJECT NUMBER 472-83329 OCA NO. XXXXXX

DATE MAR 96 SHEET 11 OF 23