


Brick barrels less than 16' deep shall have 8" walls except when located within public street or alley pavement; then the wall shall be 12". Brick barrels more than 16' deep shall have 12" walls. The "L" and "W" dimensions shall be a minimum of 5'6" for brick barrels with 8" walls and 6'2" for brick barrels with 12" walls when the brick barrels are over 4' in height. Completed manhole shall be without leaks and watertight.

TOP VIEW

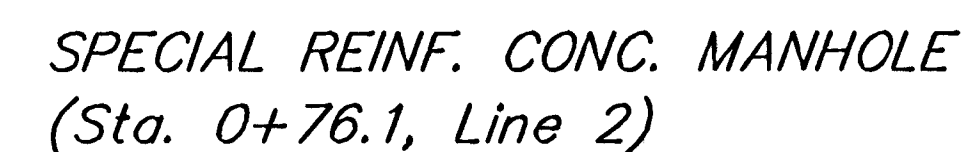

NOTE:
Bend Bars Not More Than 8"
to Clear Pipes, or Cut Bars
2" Clear of Pipe, as Necessary.

 Baughman ENGINEERING	City of Wichita Standard Reinforced Concrete Manhole Stom Water Drain #269																
Baughman Company, P.A. 315 Ellis St., Wichita, KS 67211 F 3162632721 F 3162632719 ENGINEERING SURVEYING PLANNING LANDSCAPE ARCHITECTURE																	
PROJECT NUMBER 46834024	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">DESIGN</td> <td style="width: 50%;">DRAWN</td> </tr> <tr> <td style="text-align: center;">C.O.W.</td> <td style="text-align: center;">Staff</td> </tr> <tr> <td style="text-align: center;">APPROVED</td> <td style="text-align: center;">DATE</td> </tr> <tr> <td></td> <td style="text-align: center;">5/30/06</td> </tr> <tr> <td colspan="2" style="text-align: center;">SCALE</td> </tr> <tr> <td colspan="2" style="text-align: center;">None</td> </tr> <tr> <td colspan="2" style="text-align: center;">SHEET</td> </tr> <tr> <td colspan="2" style="text-align: center; font-size: 2em; font-weight: bold;">17 OF 25</td> </tr> </table>	DESIGN	DRAWN	C.O.W.	Staff	APPROVED	DATE		5/30/06	SCALE		None		SHEET		17 OF 25	
DESIGN	DRAWN																
C.O.W.	Staff																
APPROVED	DATE																
	5/30/06																
SCALE																	
None																	
SHEET																	
17 OF 25																	
REVISIONS																	
Enc: Clifton Crow, Add: Rembise																	