

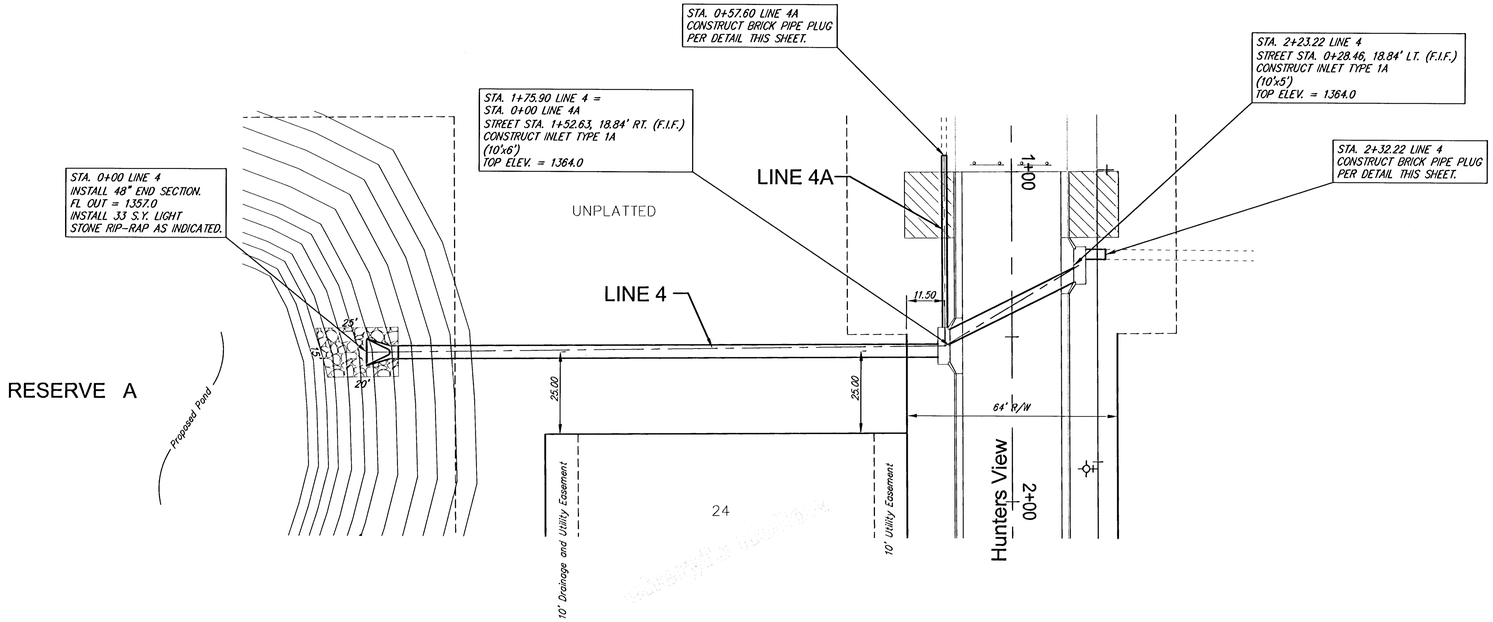


SCALE 1" = 20' (Horiz.)
1" = 5' (Vert.)
IRON = •



PIPE PLUG DETAIL

1. Mortar used in plug construction shall be in accordance with standard specifications.
2. All brick used in stack construction shall meet Grade ASTM C32 for MM and MS.
3. Pipe plugs shall be Subsidiary to the project.

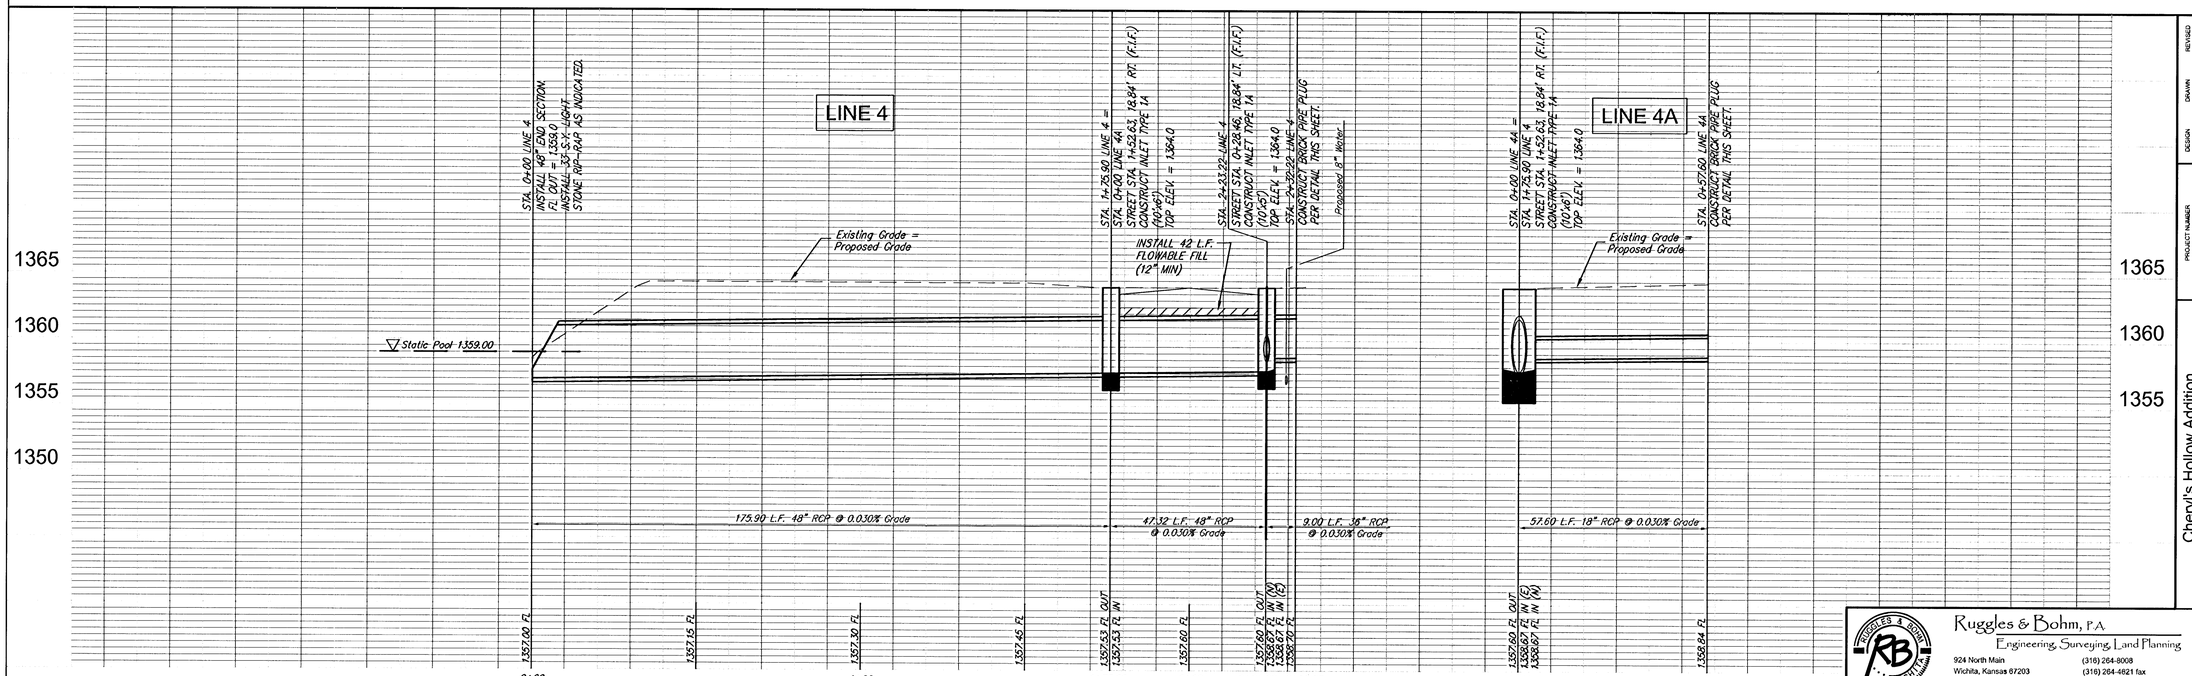

DESIGN KWL
DRAWN RA
DATE Aug. 2, 2005
REVISED
REVIEW

PROJECT NUMBER
DRAWING FILE Storm Sewer (Line 4)

Cheryl's Hollow Addition
Storm Water Sewer Line 4
WICHITA, KANSAS

Ruggles & Bohm, P.A.
Engineering Surveying Land Planning
924 North Main
Wichita, Kansas 67203
www.rbkansas.com
(316) 264-8008
(316) 264-4821 fax
E-mail: info@rbkansas.com

RB JOB 2666E
SHEET 19 OF 43