NOTES

1. ALL RIPRAP FOR THIS PROJECT SHALL BE NATURAL STONE. NEITHER BROKEN CONCRETE, FABRIC ENVELOPE, NOR PREMIXED DRY PACKAGED CONCRETE BAG ALTERNATES WILL BE ALLOWED.
2. TOEWALLS SHALL BE INSTALLED ALONG ALL EDGES OF STONE RIPRAP OR AS SHOWN ON PLANS.
3. GROUTING OF THE SURFACE OF THE RIPRAP SHALL NOT BE PERFORMED. GROUTING OF THE TOEWALLS SHALL BE PERFORMED PER CITY SPECIFICATIONS.
4. DEPTH OF TOEWALL SHALL NOT BE DEEPER THAN THE EXISTING POND FLOOR ELEV.=154.6.

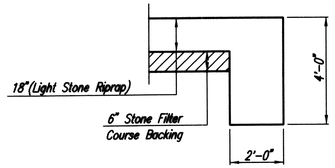

TYPICAL SECTION THRU TOEWALL
NO SCALE

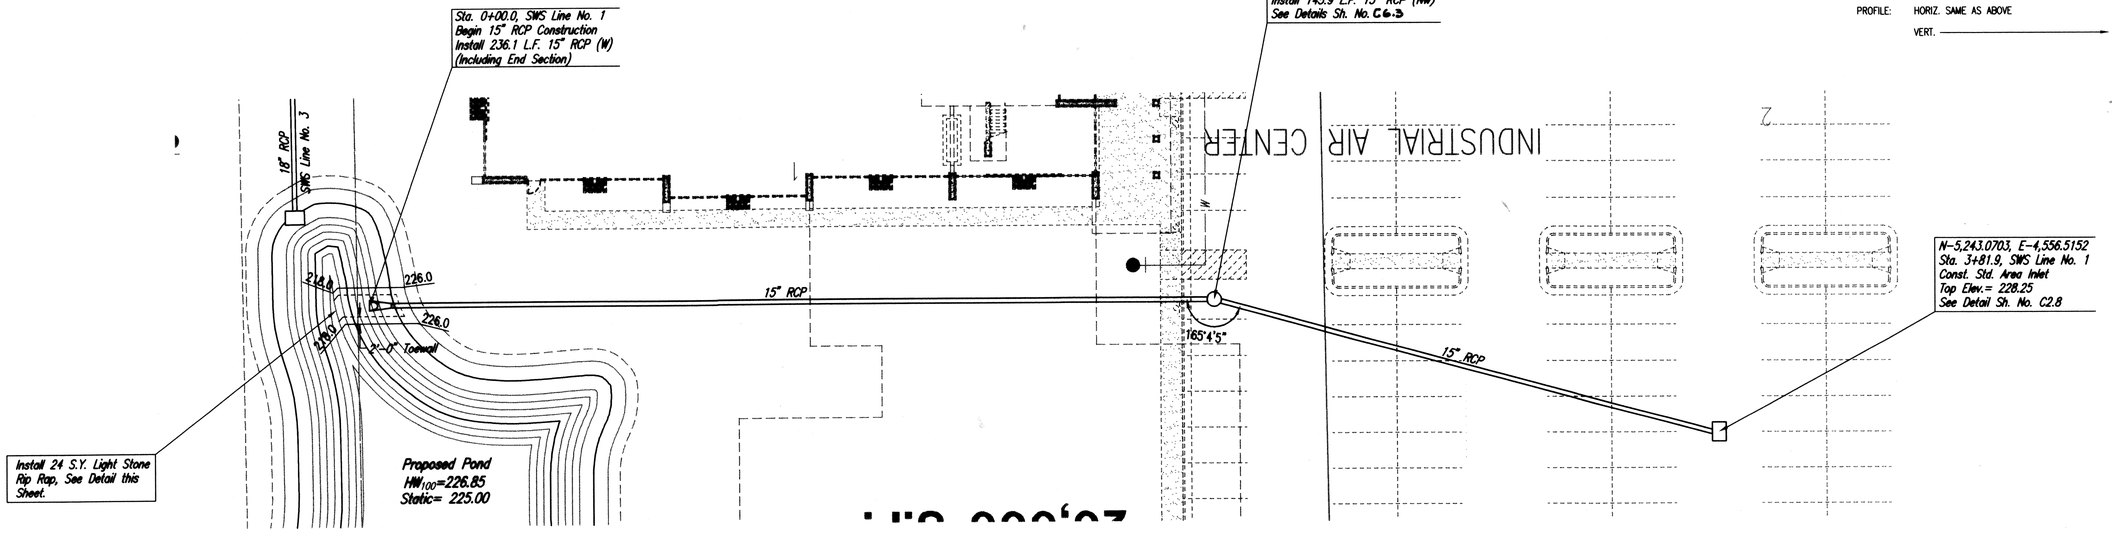

STORM WATER SEWER LINE NO. 1

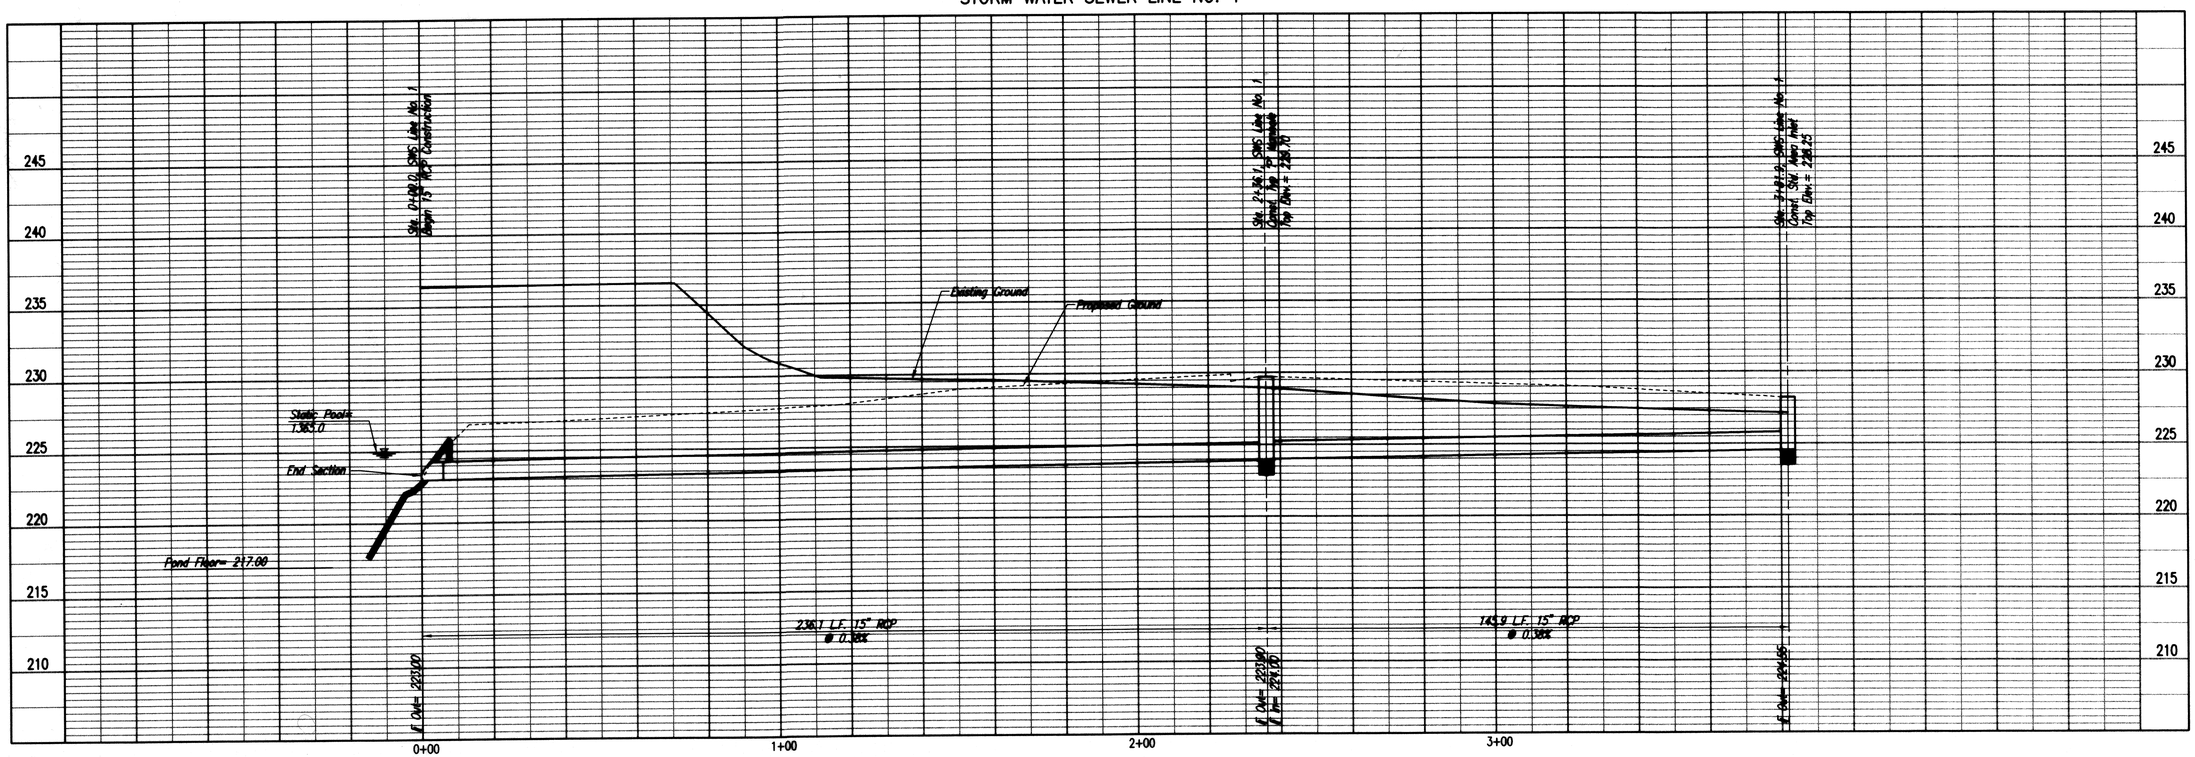

Saved 03-06-2007 1:08:12 PM by SAW
Plot Scale 1:20 03-08-2007 1:14:10 PM by SAW
O:\2006\06567\Site Civil\Private Plans\Storm Water Sewer\06567-C2.3-SWSP1

Architectural Development Services, L.L.C.
P.O. Box 49405
Wichita, Kansas 67201
Phone: 316 986-4343
Fax: 316 686-8064

SHAWN A. WAY
GENERAL
17899
KANSAS
PROFESSIONAL ENGINEER
3/9/07

Ethanol Products Corporate Headquarters

38th and Webb Road
Wichita, Kansas

prints issued
3-9-07
For Construction

project no.
06122

drawn SAW check SRB

STORM WATER SEWER PLAN/PROFILE

C2.3

of

Professional Engineering Consultants, P.A.
303 S. TOPEKA • WICHITA, KANSAS 67202 • 316.262.2691 • FAX 316.262.3003
www.pec1.com