



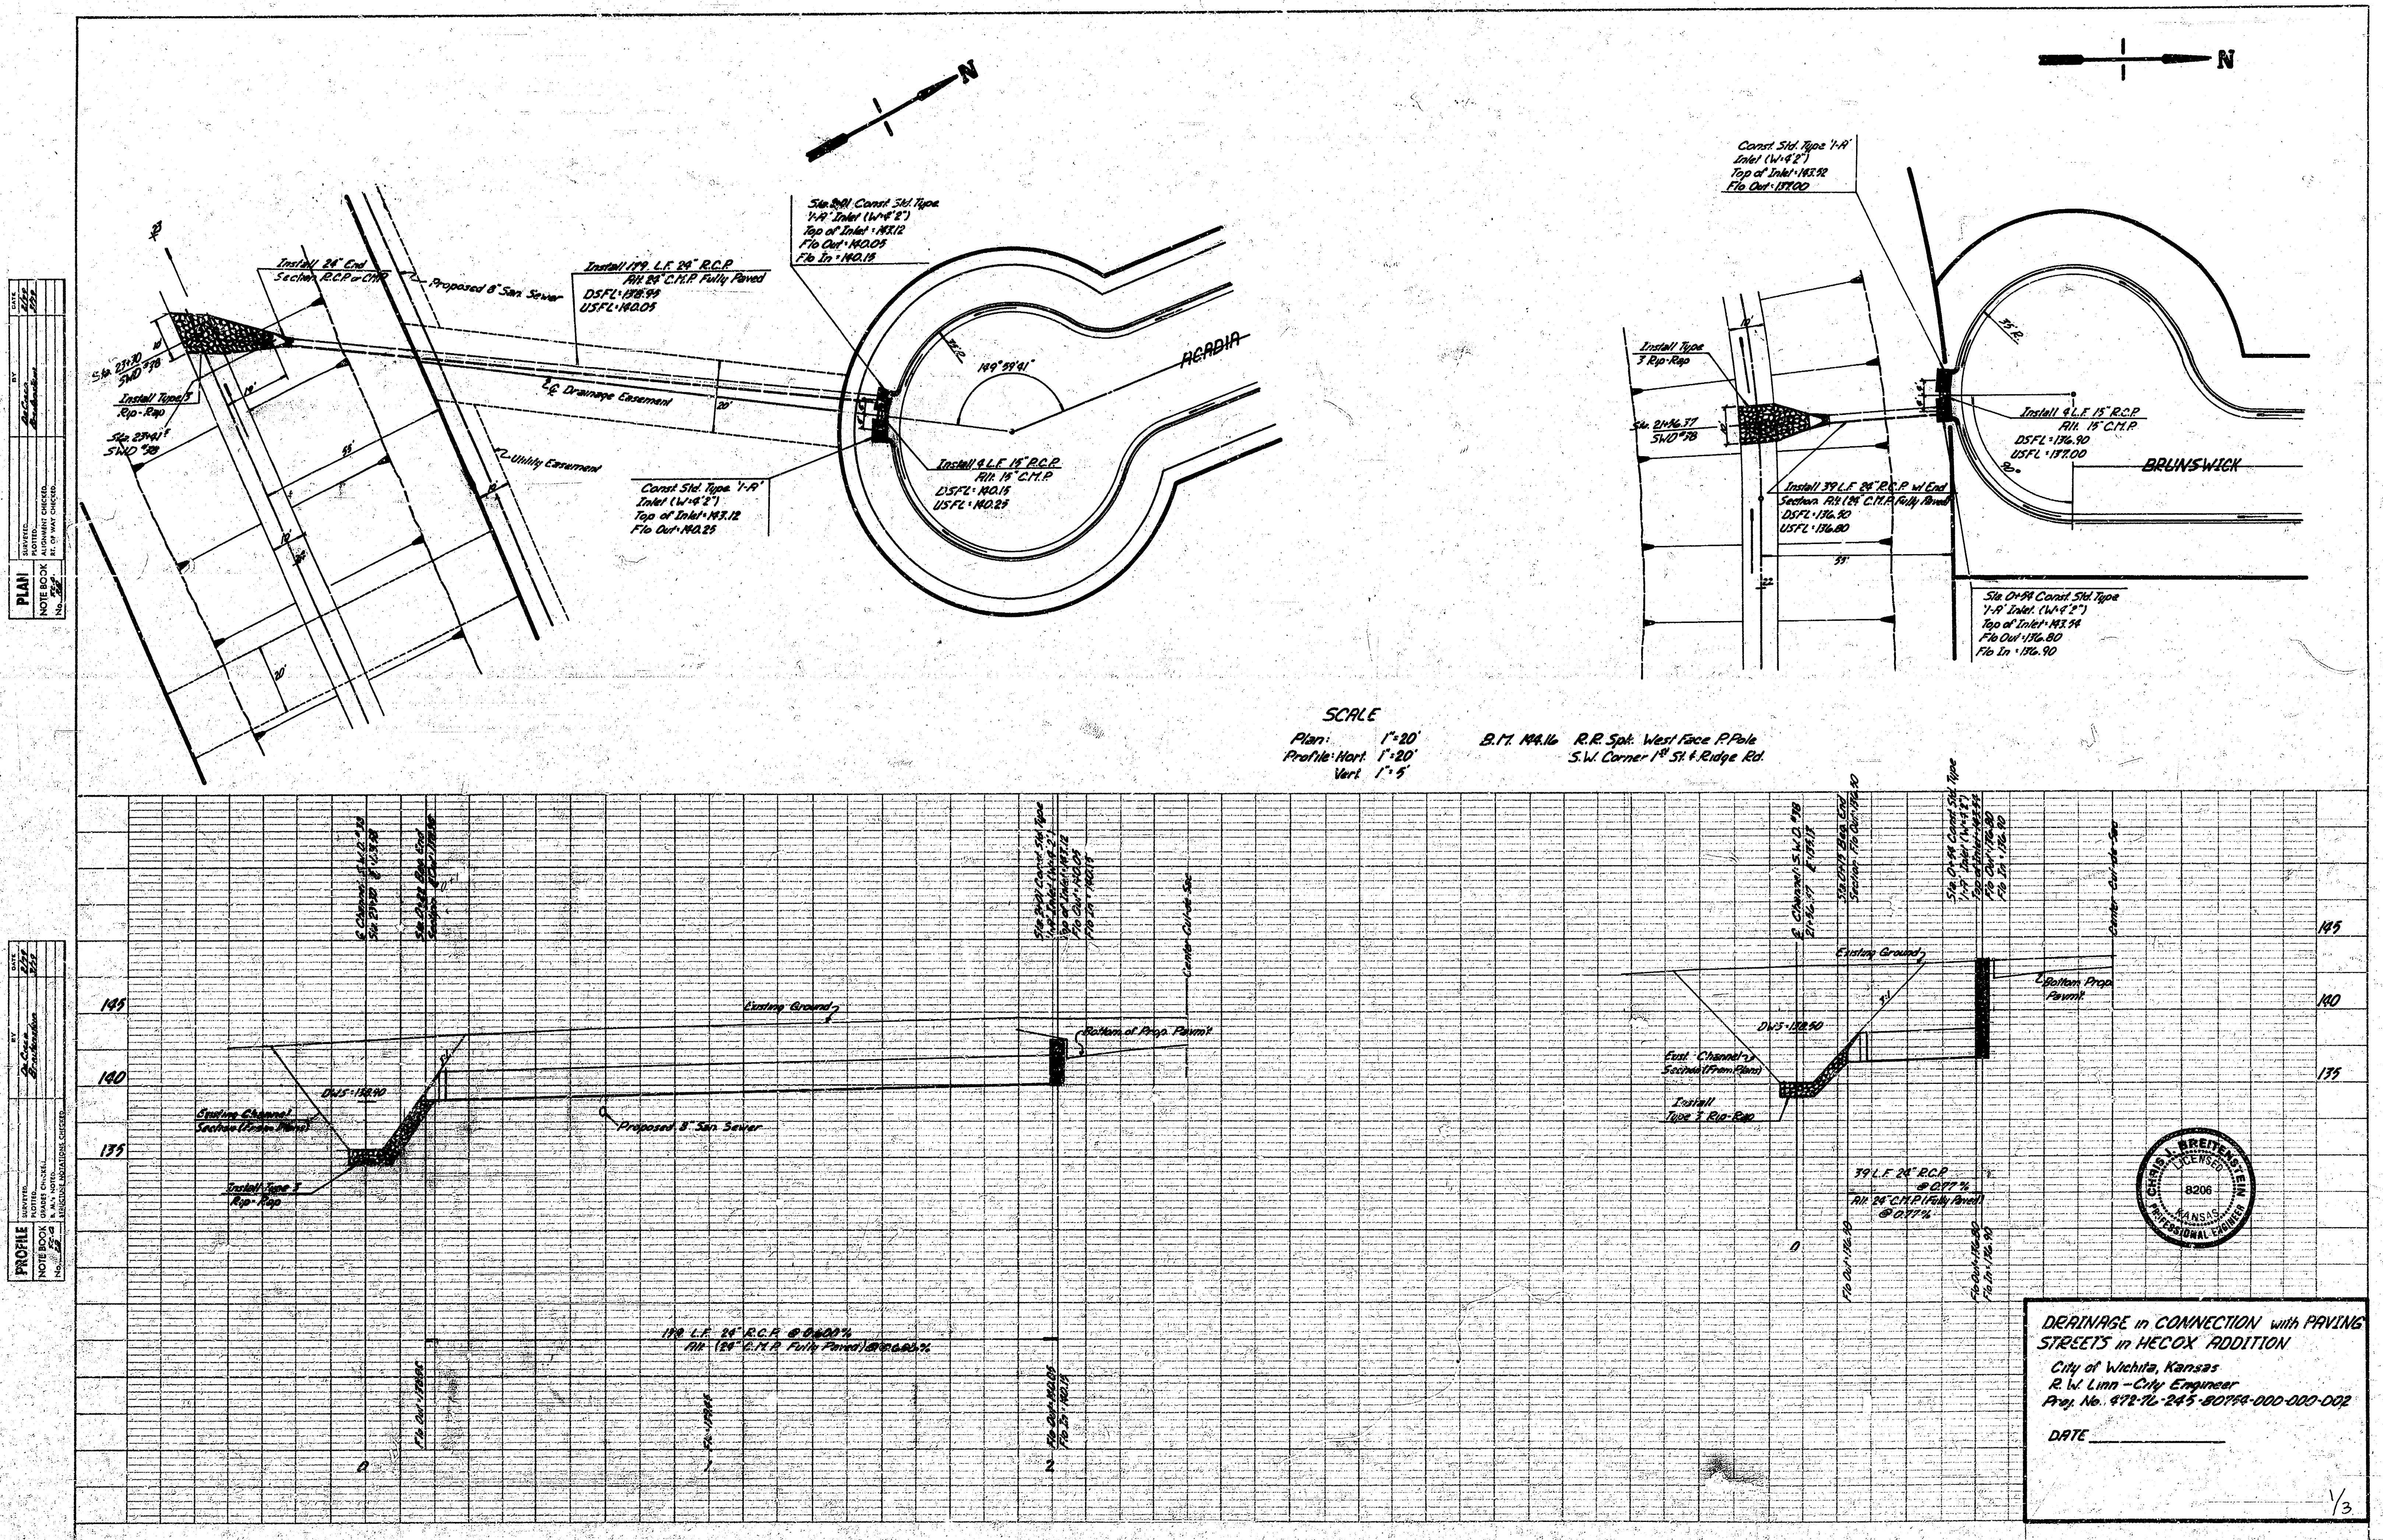


1. Drainage Contractor to Coordinate Construction with  
Paving, Sanitary Sewer, Storm Sewer, Drain #8 at Water  
Contractors.

2. Rip-Rap shall be Type 3 Rip-Rap. The Type 3 Rip-Rap  
shall be 12" thick and 6" Sand/1 Gravel Based. The Rock  
for Rip-Rap shall be Hard, Dense, Durable and shall be Reasonably well Graded. The Size  
Range of Rock used shall have a Maximum Size of (100s)  
Cubic Foot and a minimum size of 1.5". The 6 Inch Sand  
Gravel/ Sanding for Rip-Rap shall be a Continuous Layer of  
Sand/1 Gravel or Sand/1 Crushed Rock Reasonably well  
Graded to a Maximum Size of 1.5".

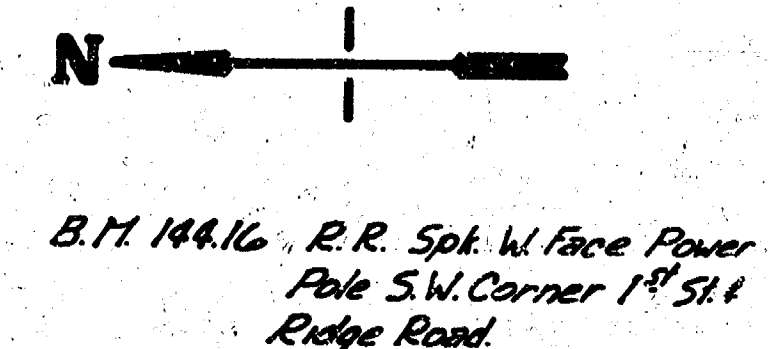

SCALE  
Plan: 1"=20'  
Profile: Horiz: 1"=20'  
Vert: 1"=5'

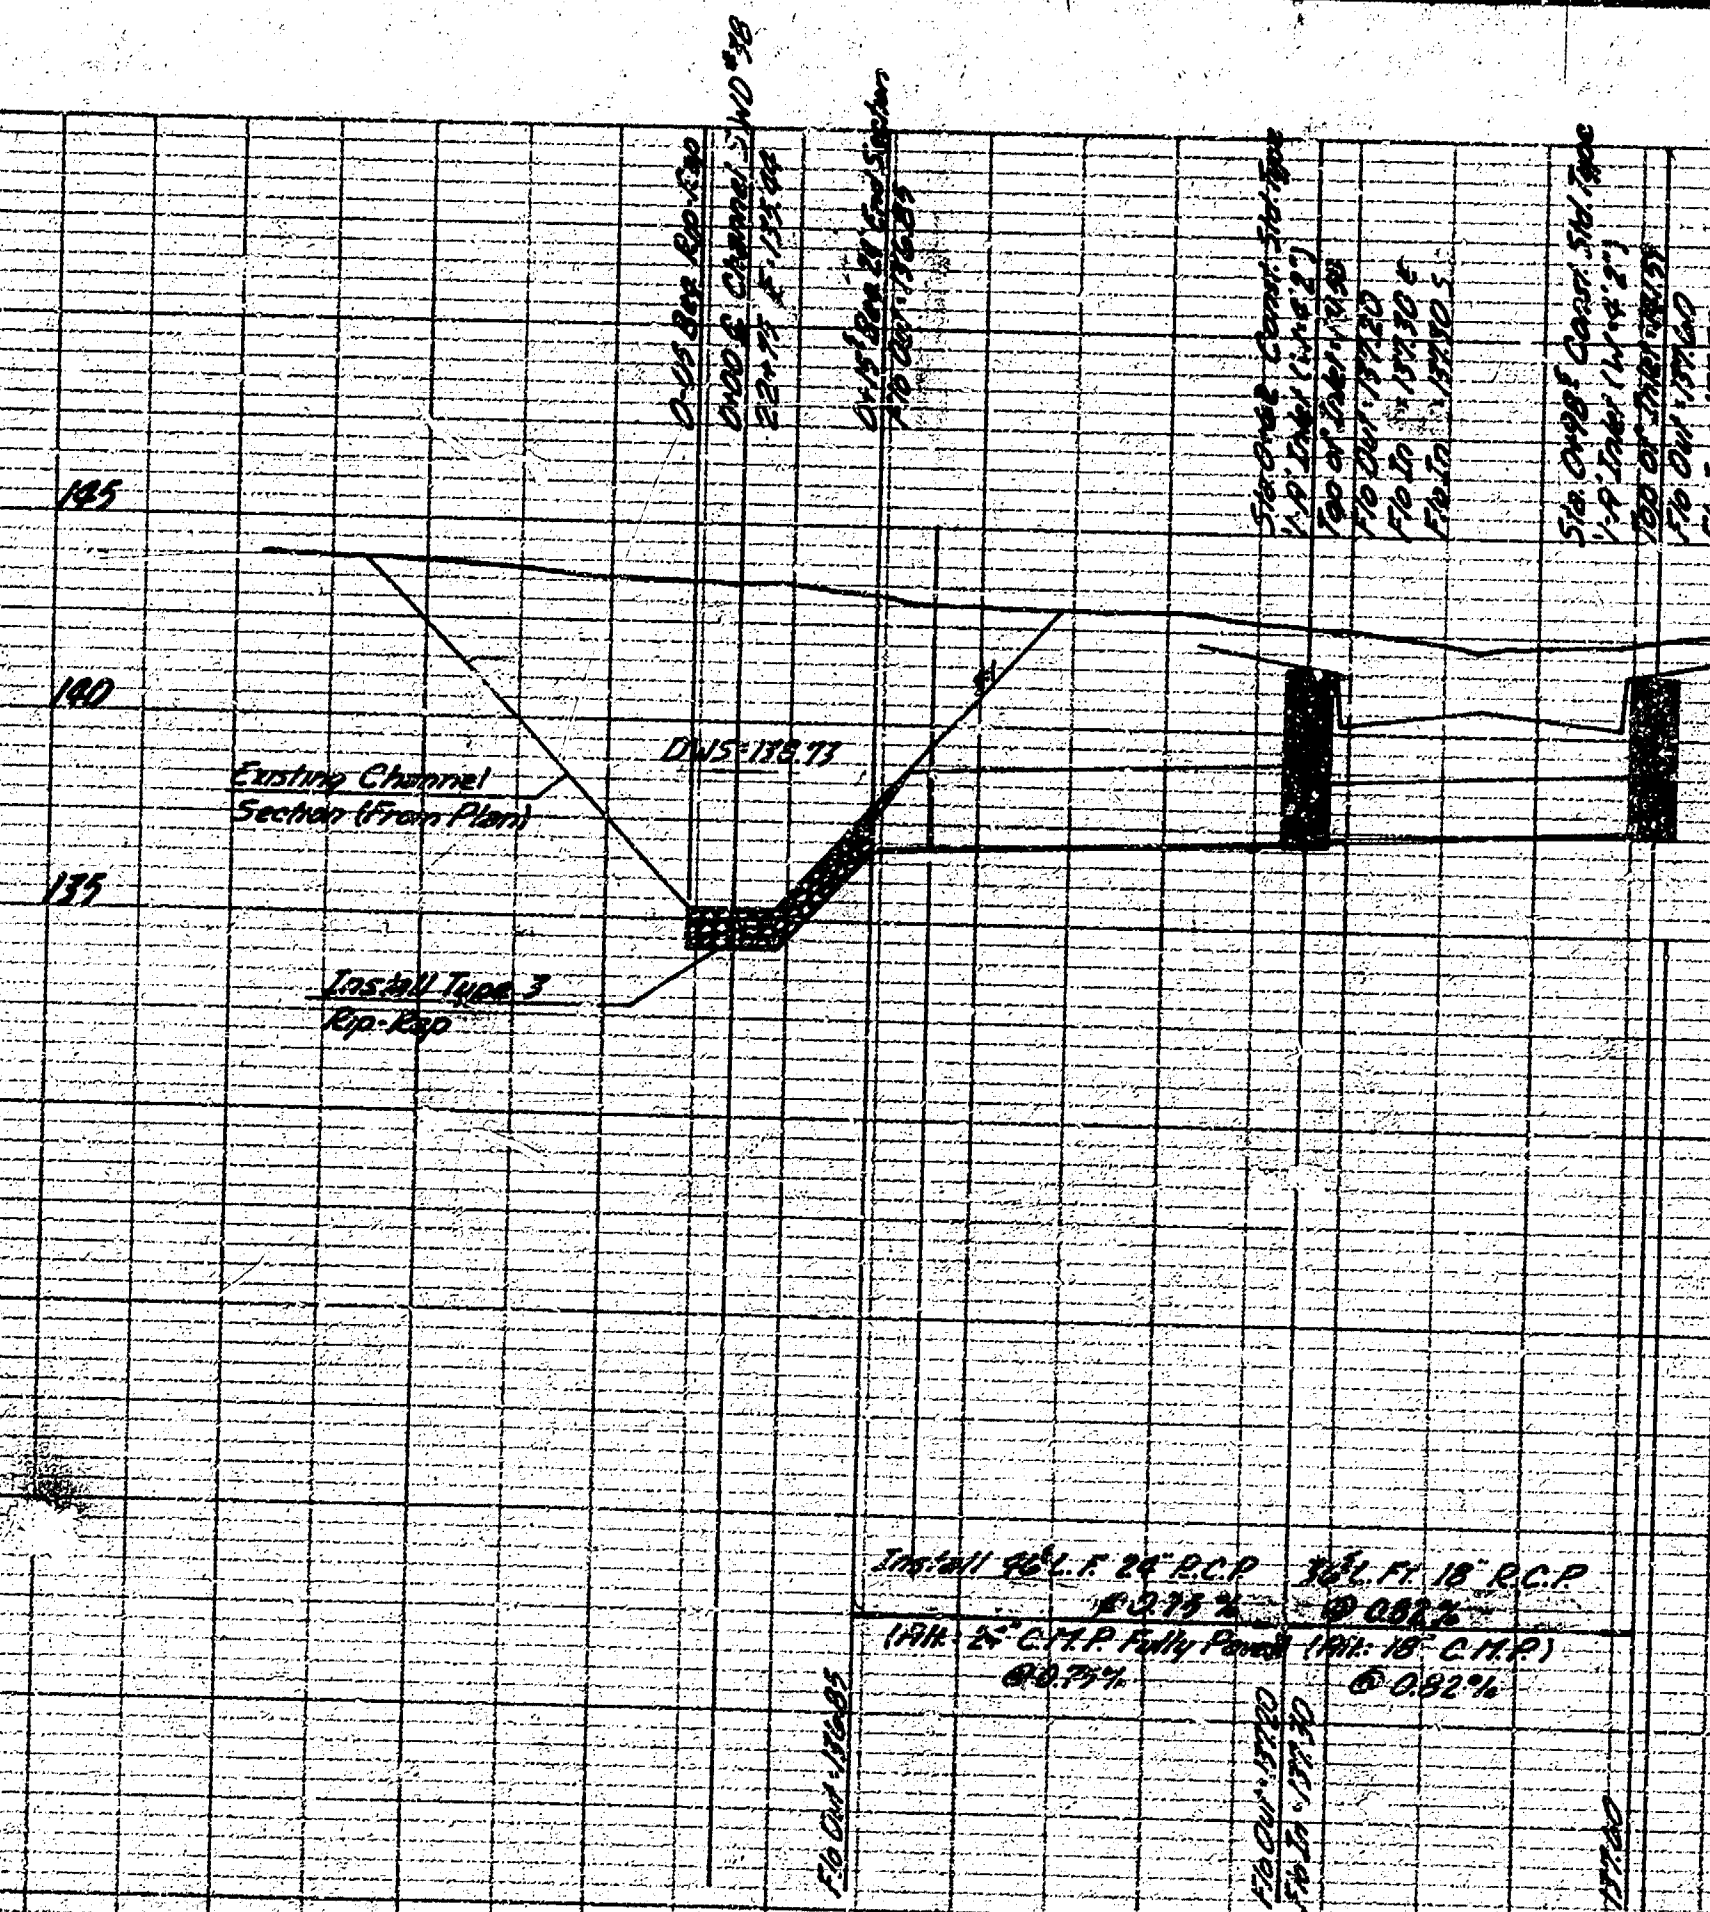

**DRAINAGE in CONNECTION with  
PAYING STREETS in HECOX ALON.**

17-0513

