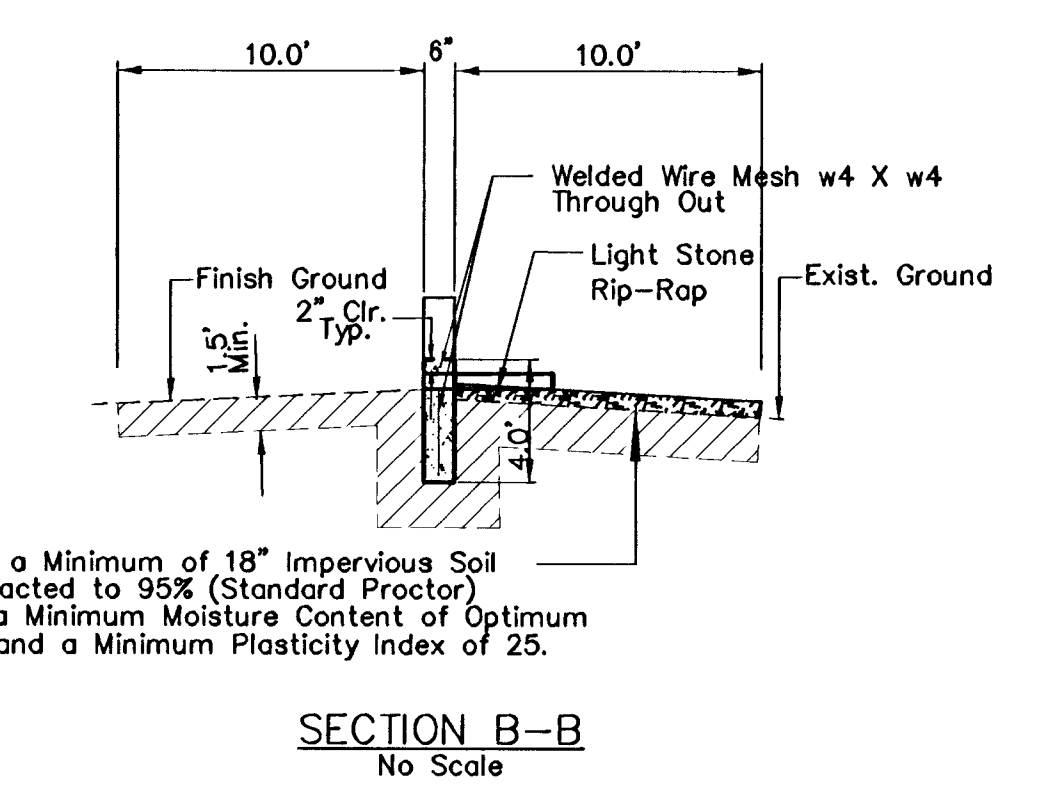
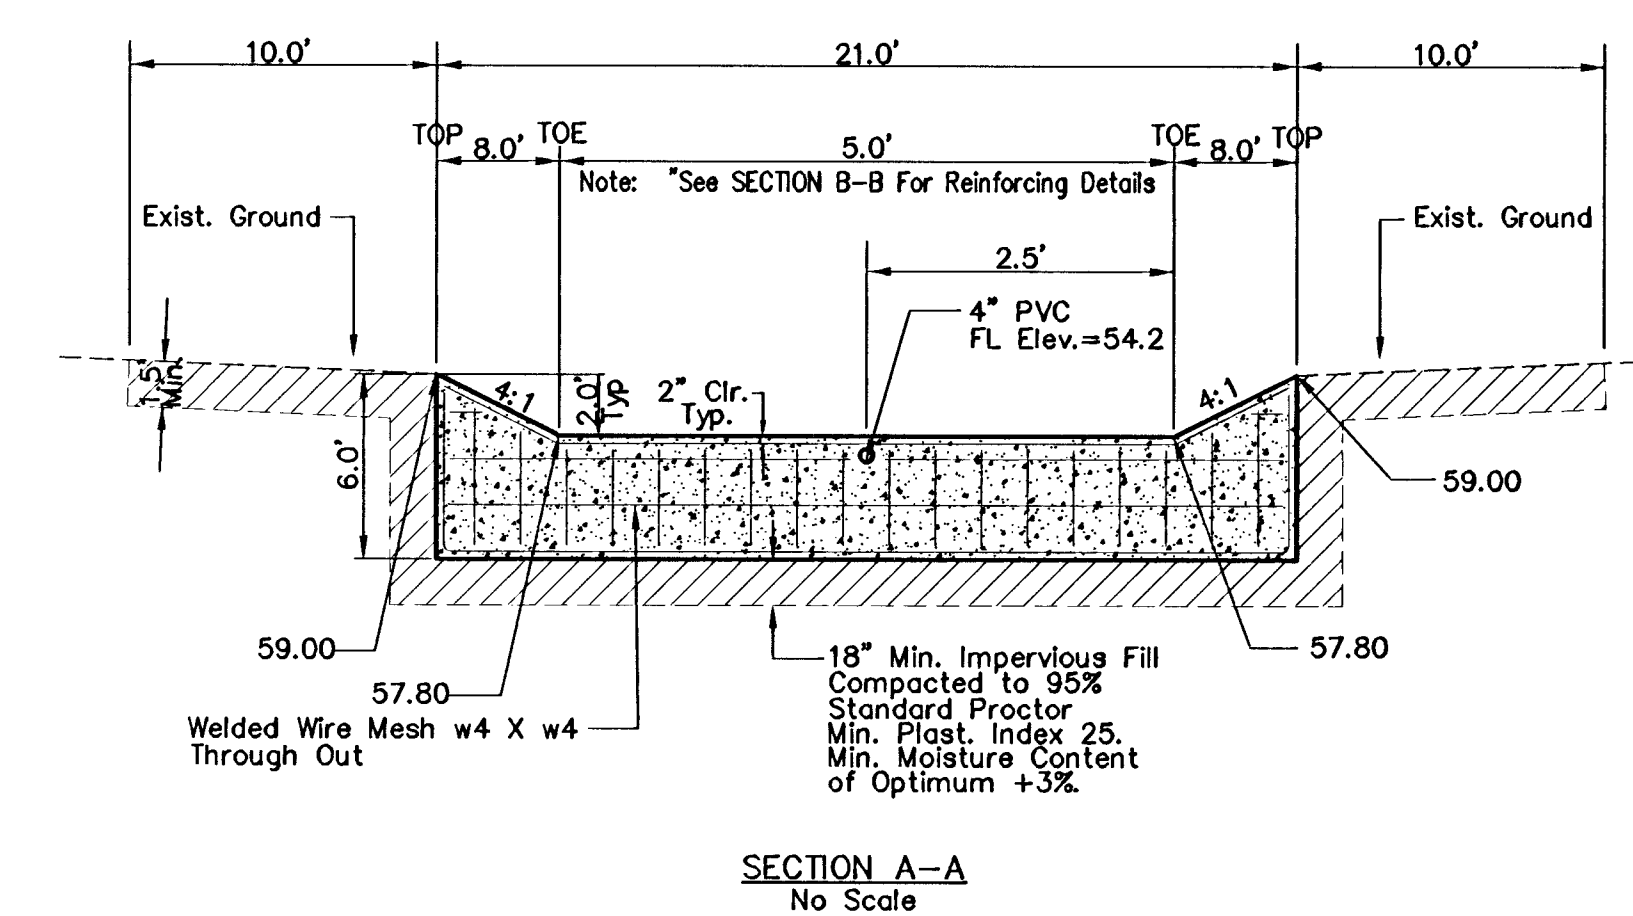
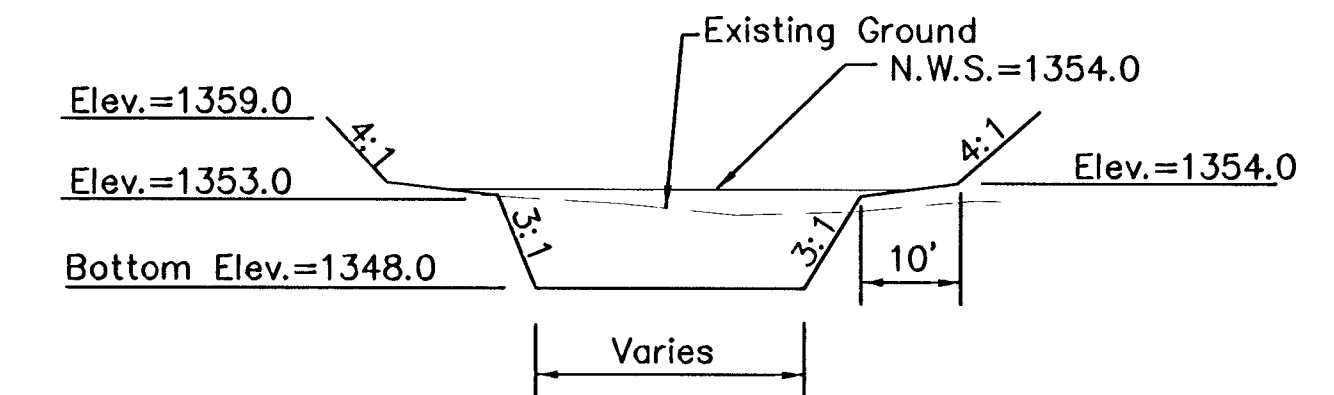
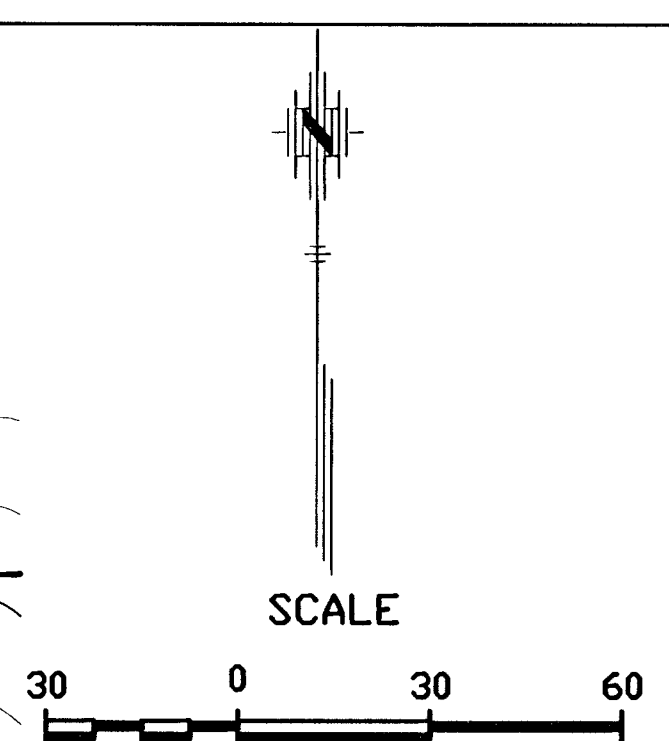
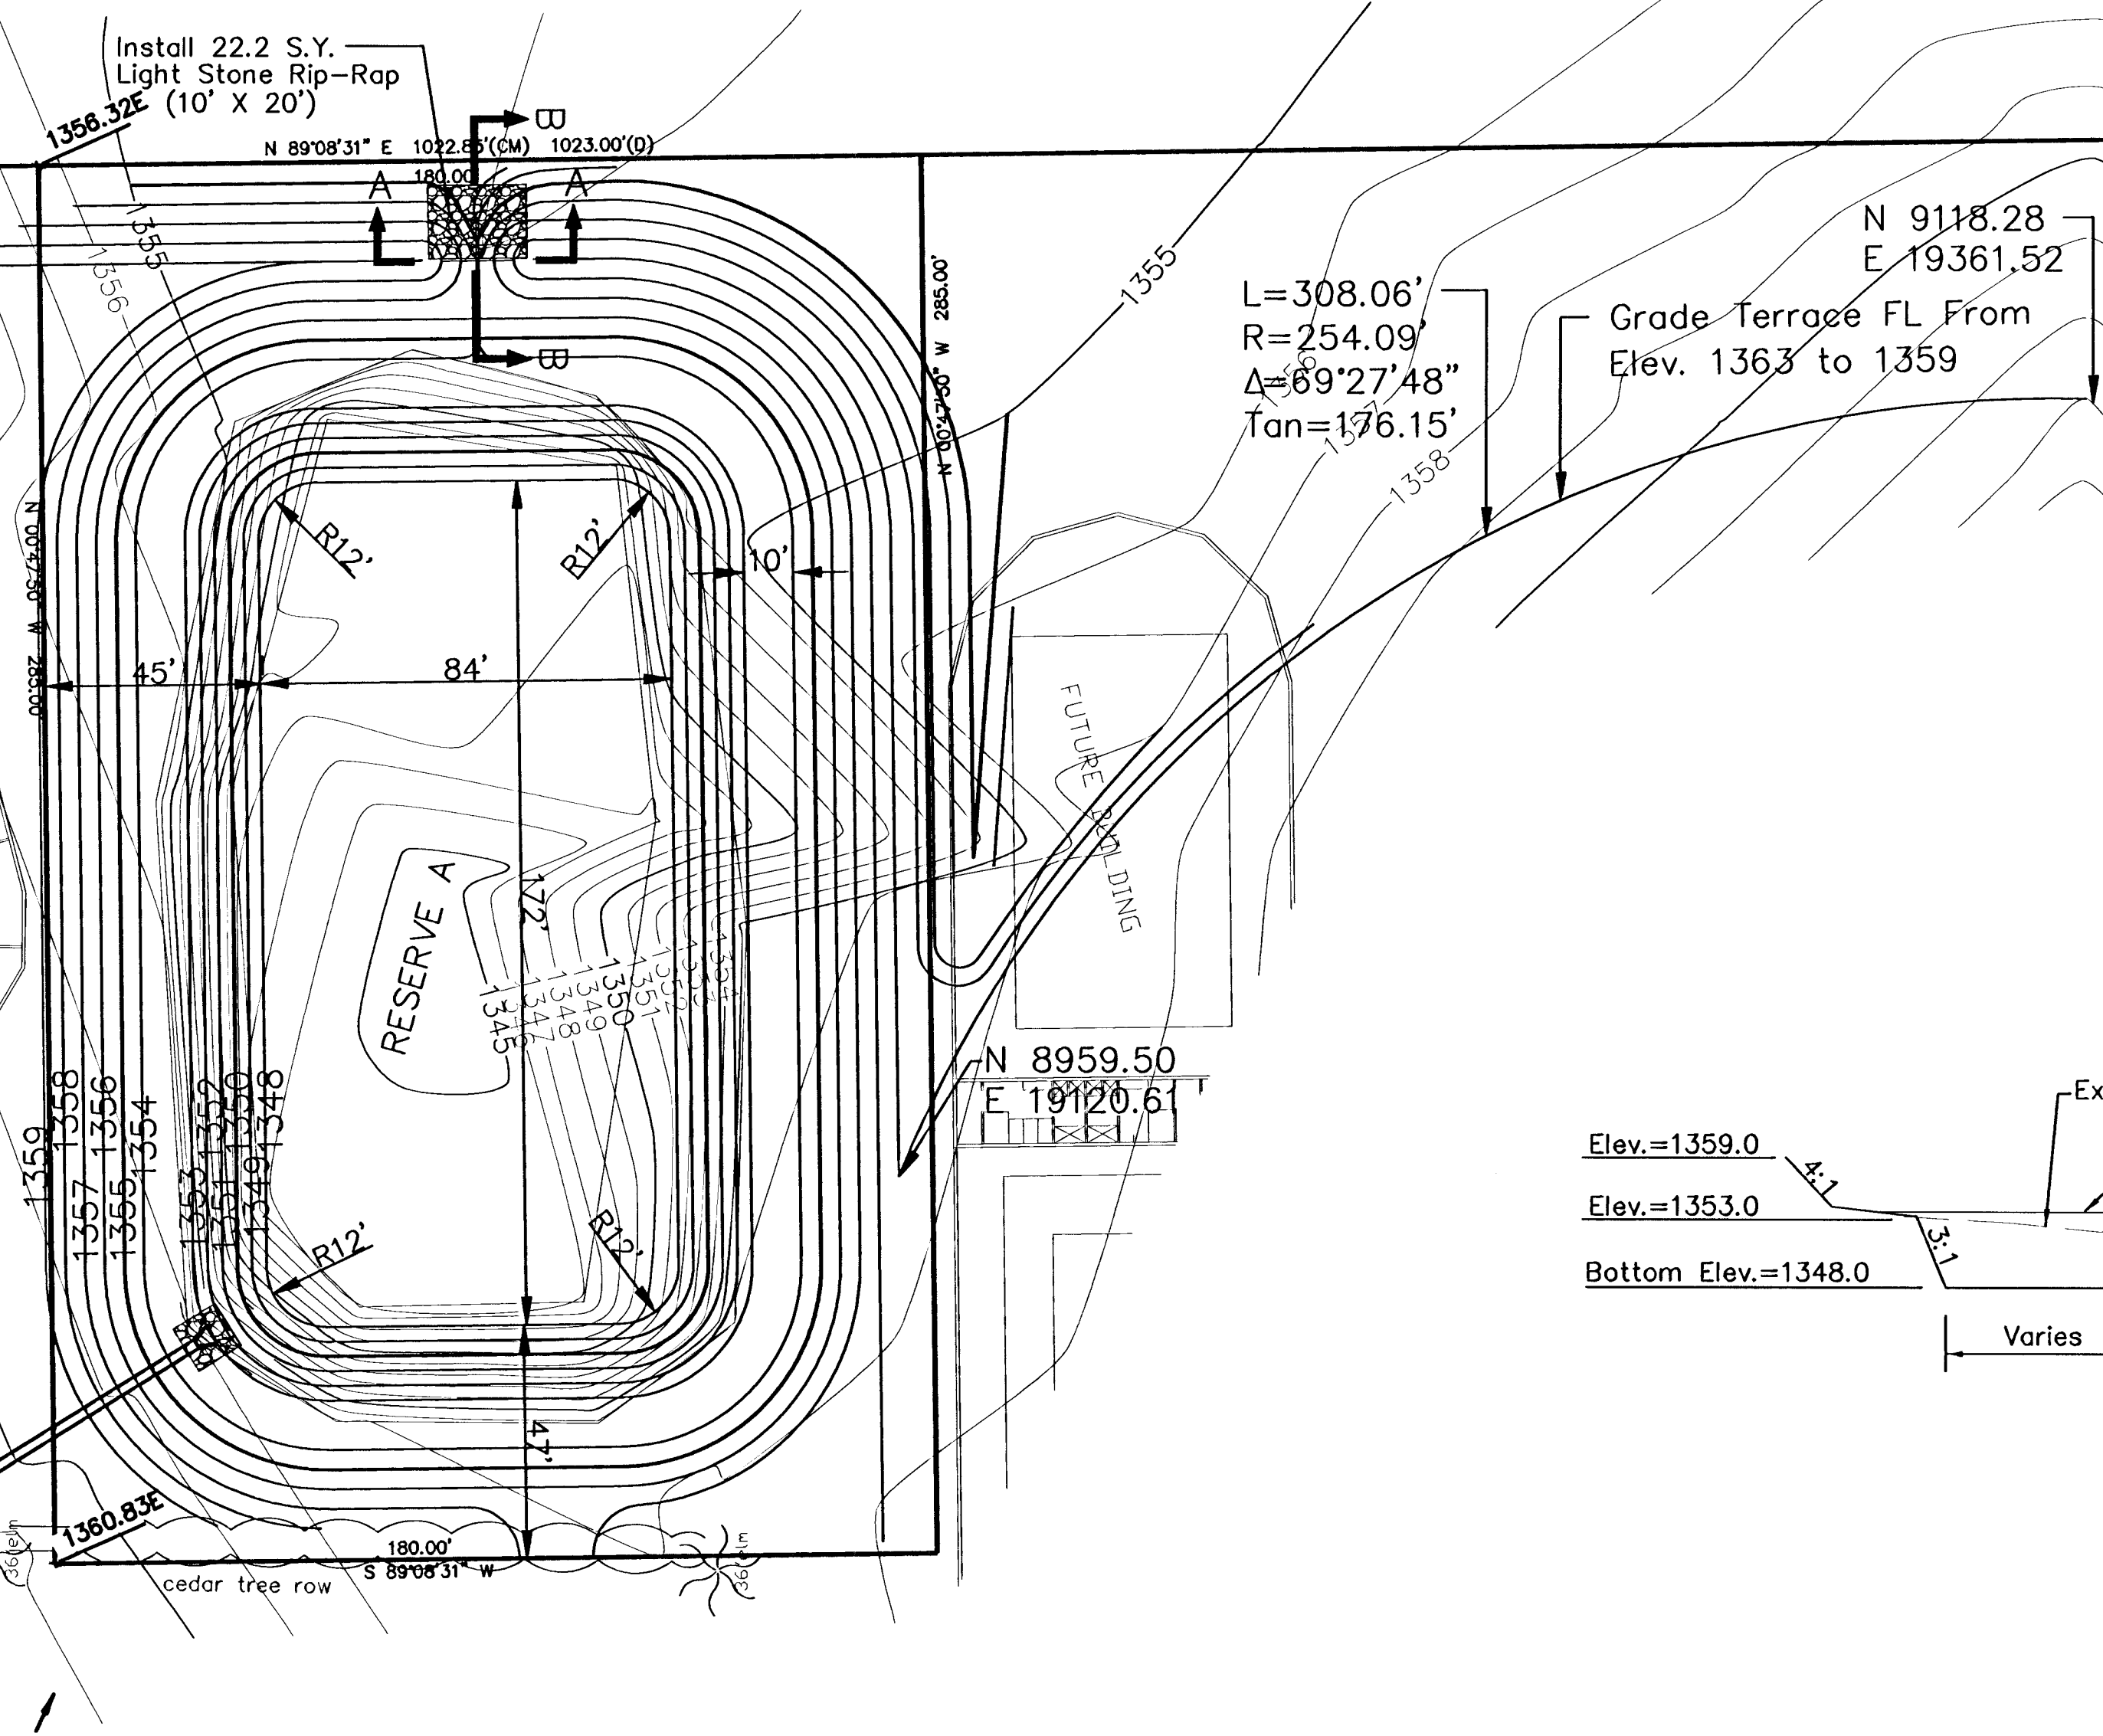


[illegible]

- NOTE:
1. All Concrete to be 4,000 P.S.I. Structural Mix.
 2. All Exposed Concrete Edges to Have 3/4" - 45° Chamfer.
 3. All Exposed Concrete Surfaces to be Broomed.
 4. Use W4 X W4 Welded Wire Fabric for Reinforcement
 5. Minimum Overlap of Reinforcing Steel Shall be 24 Inches.

FINAL		 POE & ASSOCIATES, INC. C O N S U L T A N T S 5940 E. Central, Suite 200 ■ Wichita, KS 67206-4242 Phone 316/685-4114 ■ FAX 316/685-4444	NORTHWEST METHODIST ADDITION STORM SEWER IMPROVEMENTS GRADING PLAN CITY OF WICHITA, KANSAS JIM ARMOUR P.E. - CITY ENGINEER 1748 PPS (607861)		No.	Date	By	Approved	Revision
Designed By: T. Austin/S. Schmidt			△						
Drawn By: A. Moss			△						
Poe Job No.: 874/Ecase.dwg			△						
Date: 2/12/2007			△						

Sheet
 8 of 10