


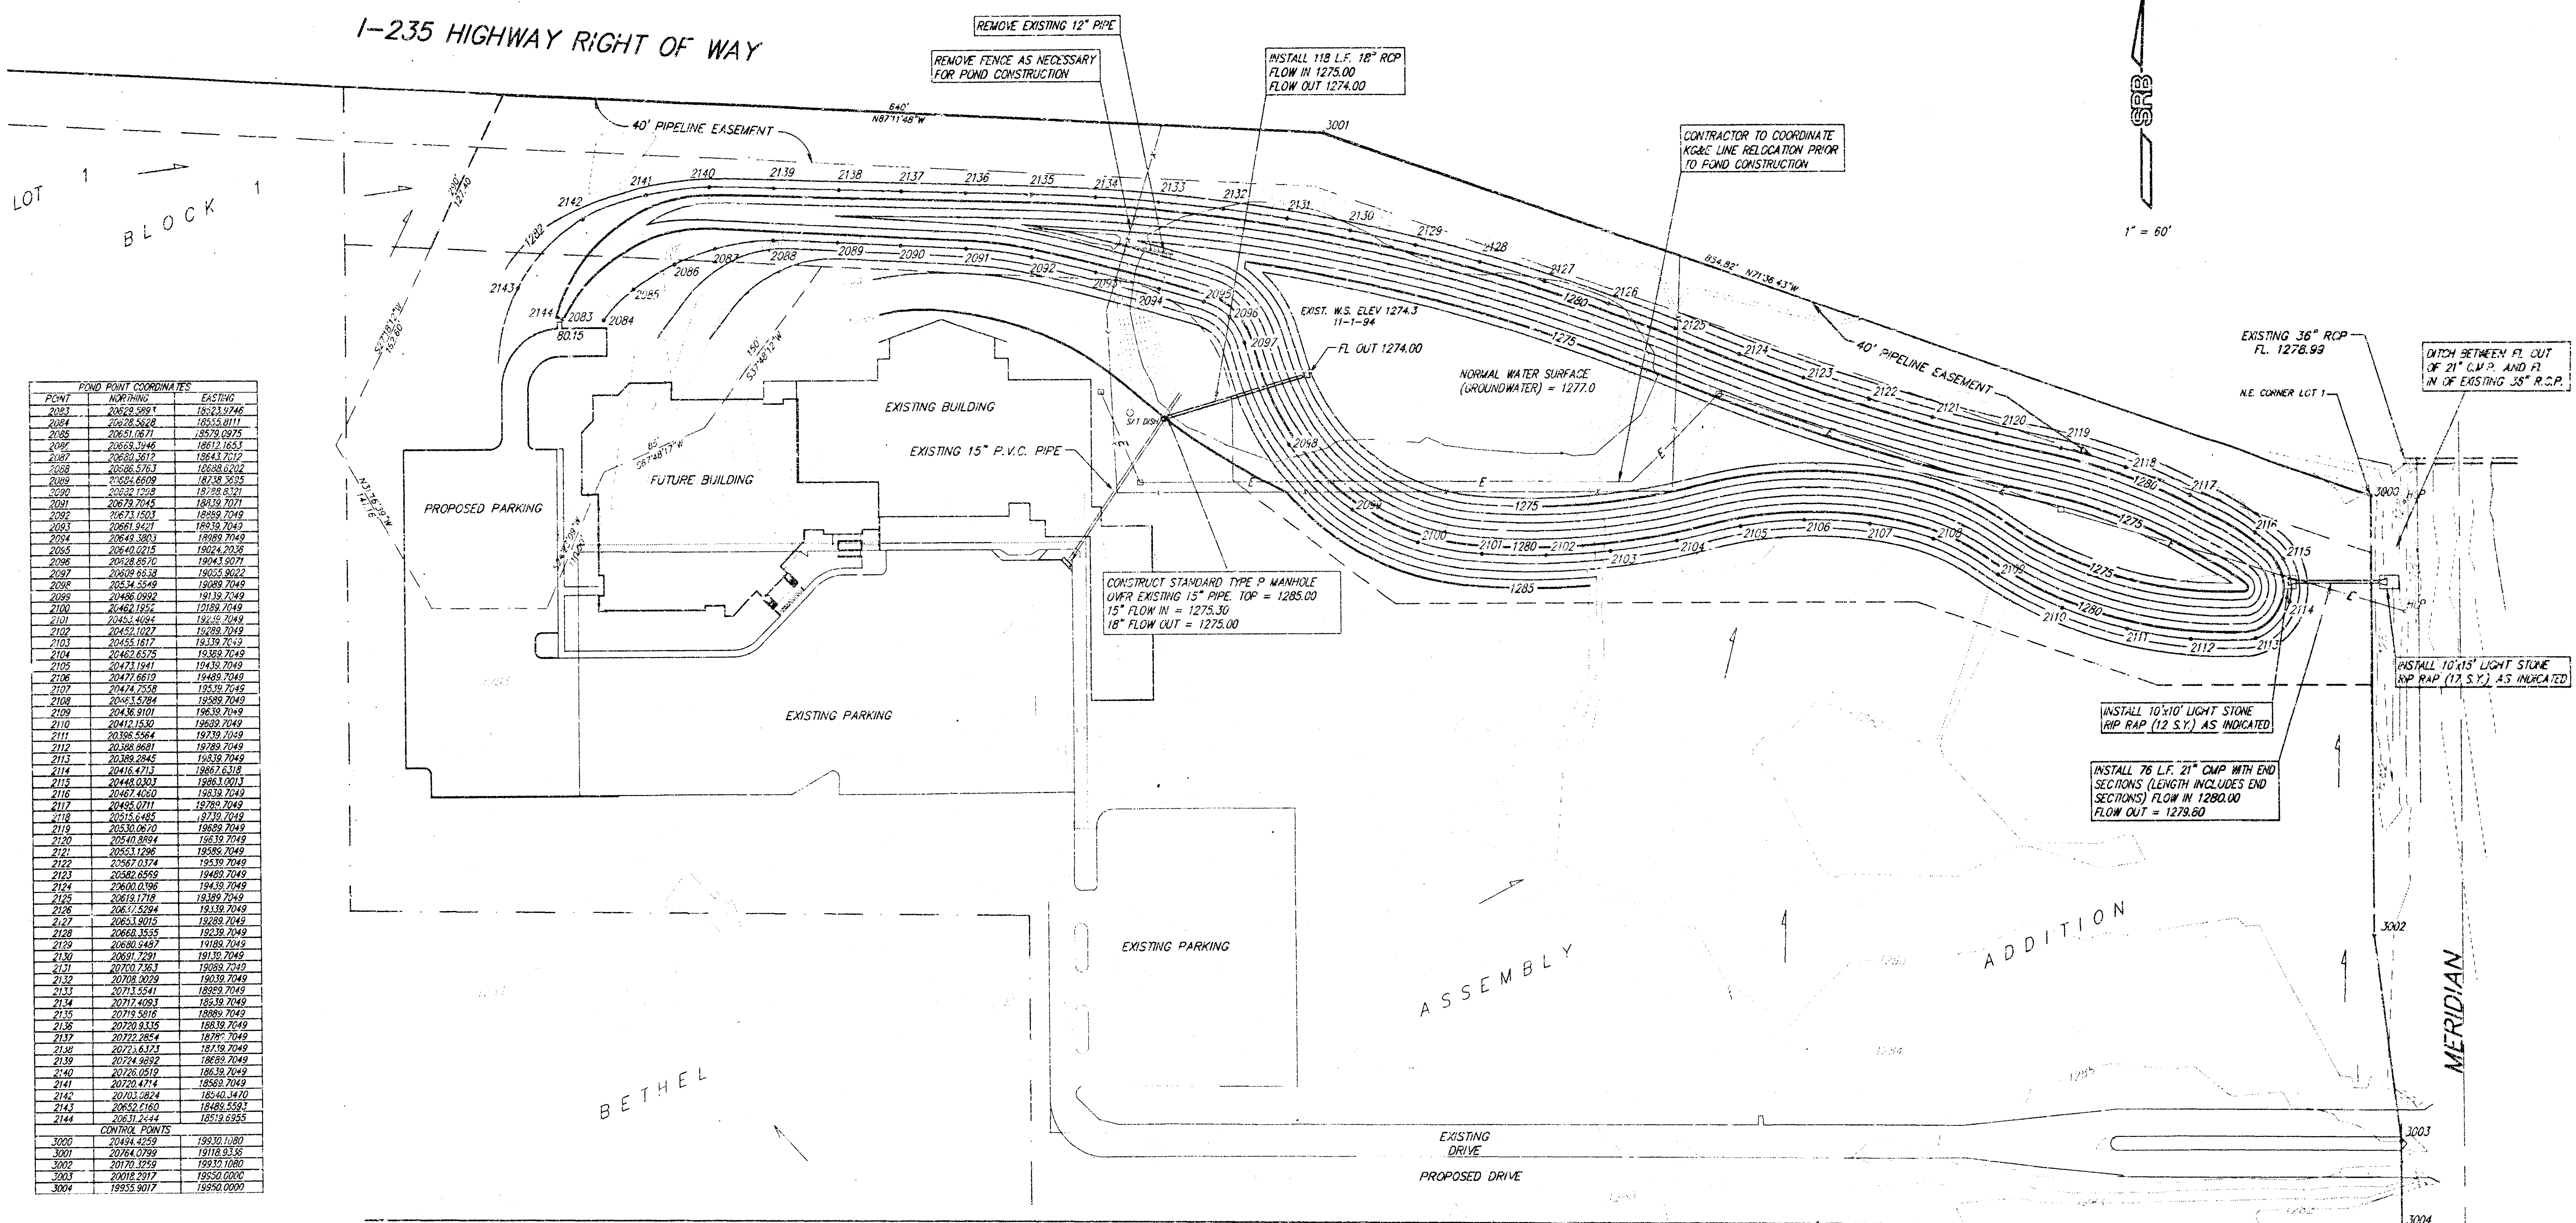

BENCH MARK:

TOPOGRAPHIC SURVEY DATE 11-1-94

THIS PLAN IS BASED ON MAXIMUM OF 322,340 SQ. FT. (7.4 ACRES) TOTAL PAVEMENT AND ROOF AREAS. ANY INCREASE OF IMPERVIOUS SURFACE OVER THIS AREA LIMIT WOULD REQUIRE ADDITIONAL DETENTION. SEE ACCOMPANYING DRAINAGE REPORT.

1. *The technical specifications for this part of the construction shall be the City of Wichita Standard Specifications for Storm Water and Drainage.*
2. *The existing 18" storm sewer line extending northeasterly of the new manhole shall be abandoned in place and both ends shall be plugged as per specifications.*
3. *Contractor shall ditch between flowline out of new 21" c.m.p. to the flowline in of the existing 36" r.c.p.*

1. Clearing and grubbing of pond site shall be in accordance with section 202 of the 1990 edition of STANDARD SPECIFICATIONS FOR STATE ROAD AND BRIDGE CONSTRUCTION FOR THE KANSAS DEPARTMENT OF TRANSPORTATION.
2. Unclassified excavation of pond site shall be in accordance with section 204 of the 1990 edition of STANDARD SPECIFICATIONS FOR STATE ROAD AND BRIDGE CONSTRUCTION FOR THE KANSAS DEPARTMENT OF TRANSPORTATION.
3. Compaction of earthwork for pond site shall be Type B, MR 30 and shall be in accordance with section 210 of the 1990 edition of STANDARD SPECIFICATIONS FOR STATE ROAD AND BRIDGE CONSTRUCTION FOR THE KANSAS DEPARTMENT OF TRANSPORTATION.
4. Interior slopes of pond shall be 6:1.
5. All trees, debris, and excess material shall be removed from the site by the contractor.