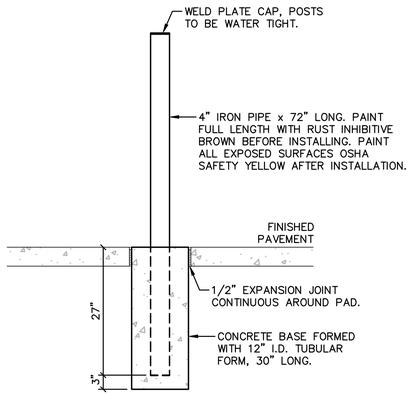

B PROTECTIVE BARRIER POST
N.T.S.

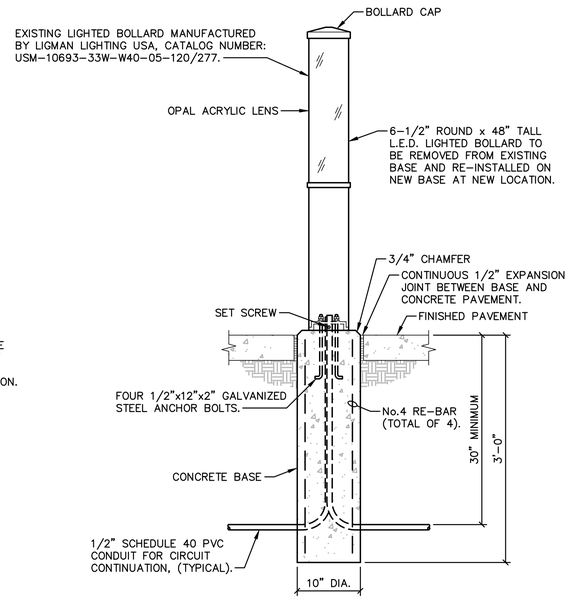

C LIGHTED BOLLARD MOUNTING DETAIL
N.T.S.

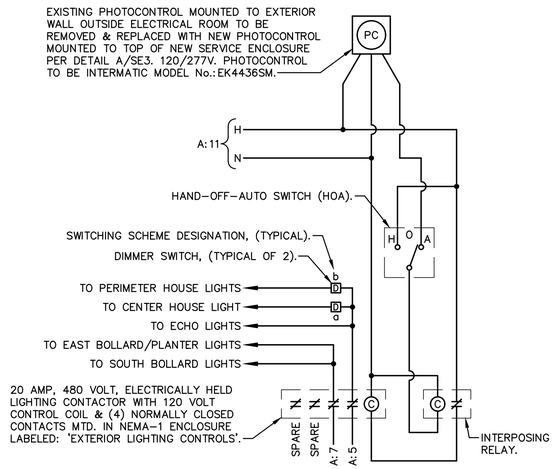

NOTE:
ALL EQUIPMENT SHOWN, (EXCEPT PHOTOCONTROL), IS EXISTING TO BE RELOCATED FROM ELECTRICAL ROOM TO INSIDE NEW SERVICE ENCLOSURE AND RECONNECTED AS SHOWN.

D LIGHTING CONTROL DIAGRAM
N.T.S.

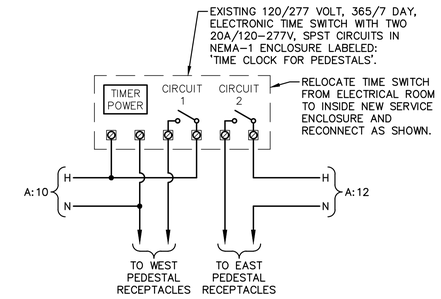

NOTE:
VERIFY EXISTING PROGRAM SCHEDULE PRIOR TO DISCONNECTING AND RE-PROGRAM TIME SWITCH AS REQUIRED TO MAINTAIN SCHEDULE.

E PEDESTAL RECEPTACLE CONTROL DIAGRAM
N.T.S.

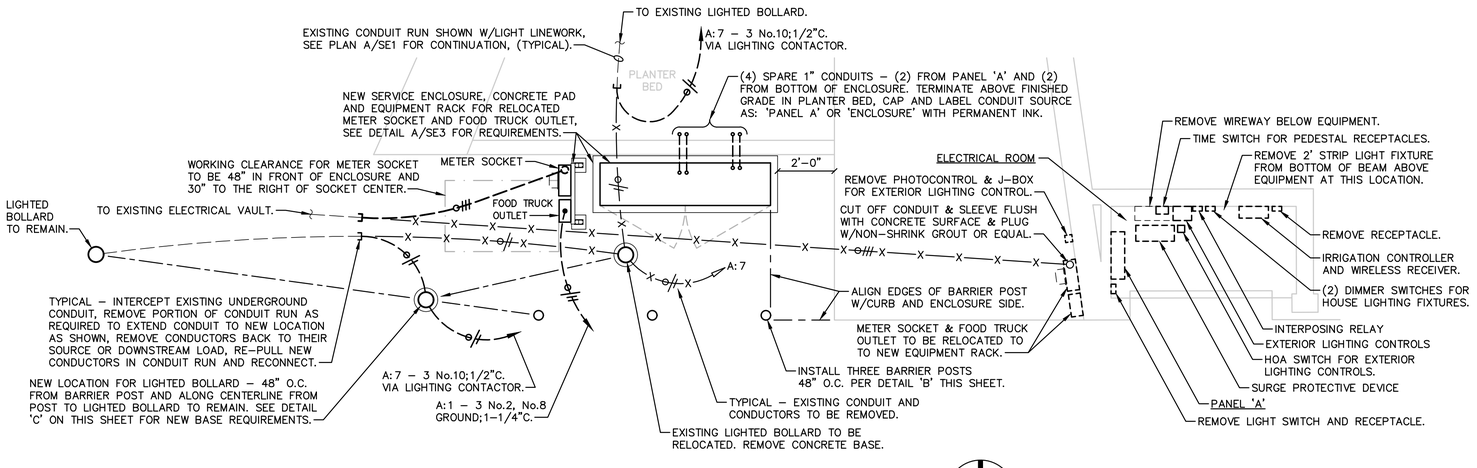

A ENLARGED ELECTRICAL PLAN
3/8" = 1'-0"
2' 0 1' 2' 4'
NORTH

PLAN NOTES:

1. ALL EQUIPMENT SHOWN IN ELECTRICAL ROOM IS EXISTING AND SHALL BE DISCONNECTED, REMOVED, RE-INSTALLED IN NEW SERVICE ENCLOSURE AND RECONNECTED, UNLESS OTHERWISE NOTED ON PLAN.
2. ALL CONDUITS, BOXES & WIRING THAT ARE ABANDONED IN ELECTRICAL ROOM BY REMOVAL OF EQUIPMENT, AND THROUGH EXTERIOR WALL OF BUILDING TO METER SOCKET, FOOD TRUCK OUTLET AND PHOTOCONTROL SHALL BE REMOVED.
3. PATCH ALL OPENINGS LEFT IN INTERIOR AND EXTERIOR WALL SURFACES AFTER REMOVAL OF EQUIP. ENCLOSURES, BOXES AND CONDUIT. REMOVE ALL CAULK RESIDUE AROUND ENCLOSURES AND BOXES REMOVED FROM EXTERIOR WALL. TAPE, SAND AND REFINISH REPAIRED WALL SURFACES TO MATCH SURROUNDING WALL FINISHES.
4. ABANDONED AND SPARE CONDUITS THAT EXIT ELECTRICAL ROOM THRU FLOOR SLAB SHALL BE CUT OFF FLUSH WITH FLOOR SURFACE AND PLUGGED WITH NON-SHRINK GROUT OR EQUAL.

PRINTS ISSUED

DATE	PURPOSE	NO.
5/18/26	FOR BID	

CHESTER I. LEWIS REFLECTION SQUARE PARK
UTILITY MODIFICATIONS
205 E. DOUGLAS AVE.
WICHITA, KS
COW PROJECT No.: 482-11099

LK ARCHITECTURE
100 N. BROADWAY, SUITE 800, WICHITA, KS 67202
T 316.268.0230 F 316.268.0205

JASON LEWIS KEENAN
#29455
05/18/2026
KANSAS
PROFESSIONAL ENGINEER

CONTACT: NICK STAIB, PLA, ASLA
DRAWN: ST
CHECKED: .

PROJECT NUMBER:
25201.05

SHEET TITLE:
ENLARGED ELECTRICAL PLAN AND DETAILS

SHEET NUMBER:
SE2
OF: SE4