




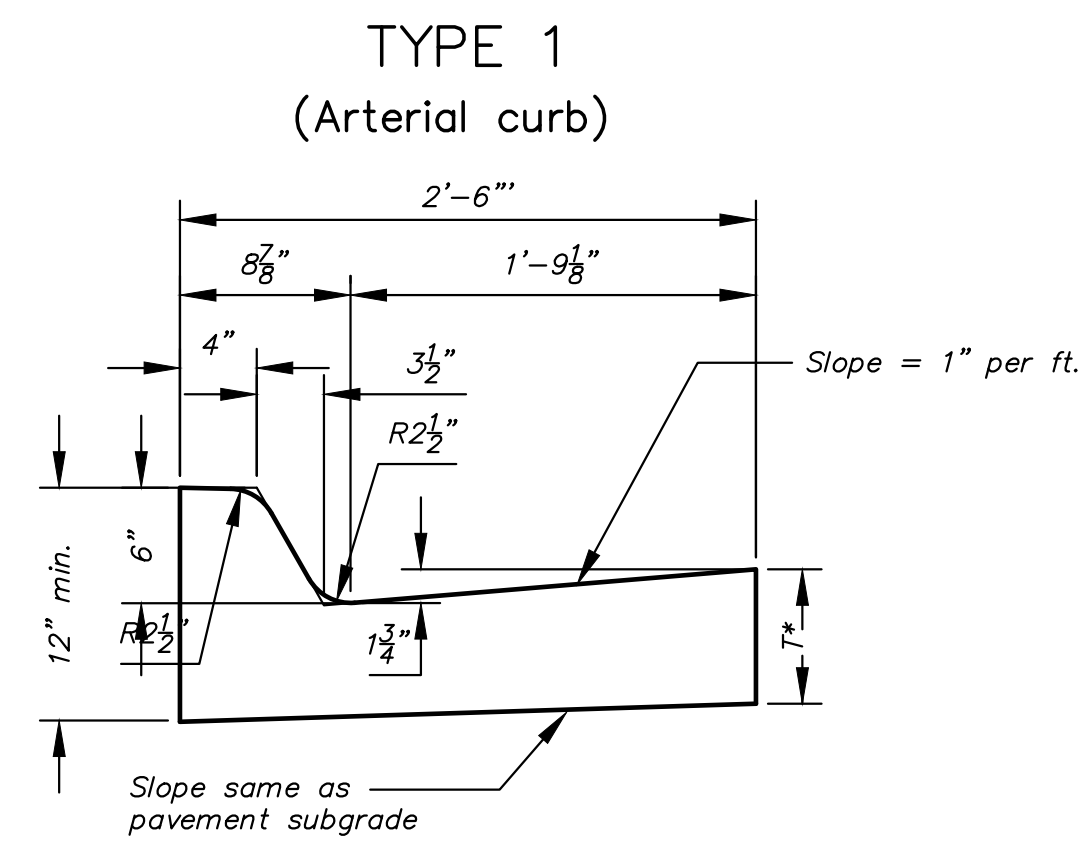


Combined Curb & Gutter (6")

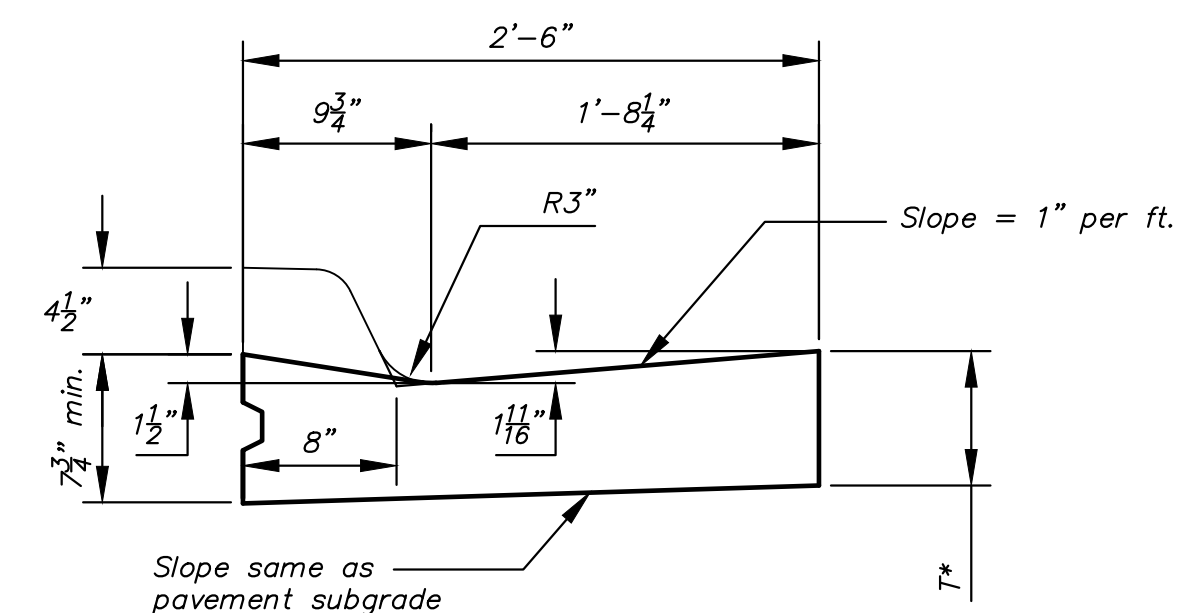


Combined Curb & Gutter (1 1/2")

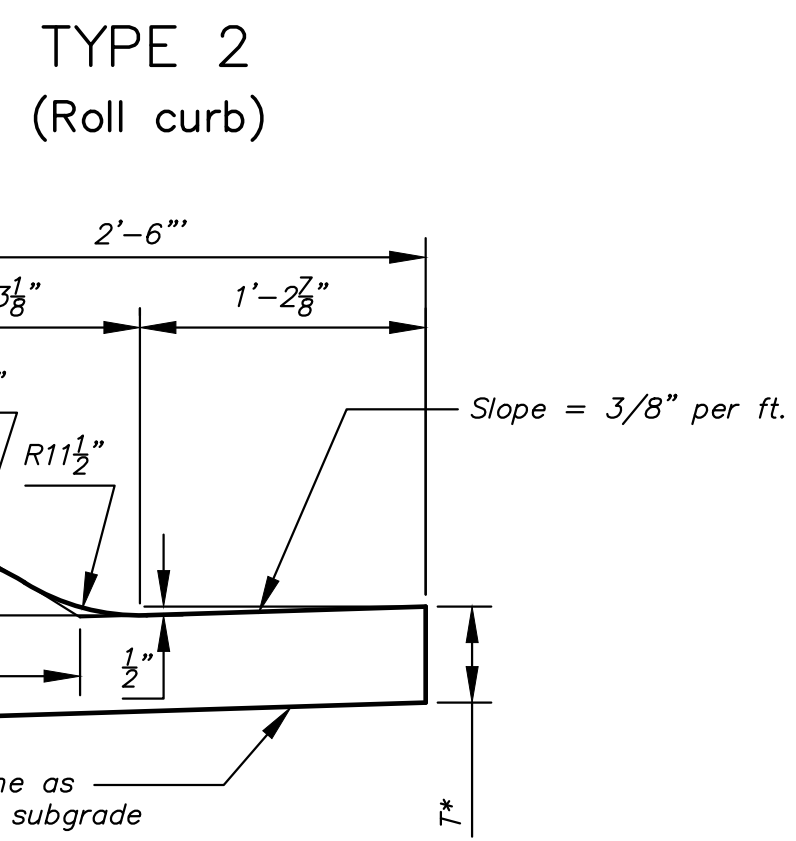


Combined Curb & Gutter (3 5/8")

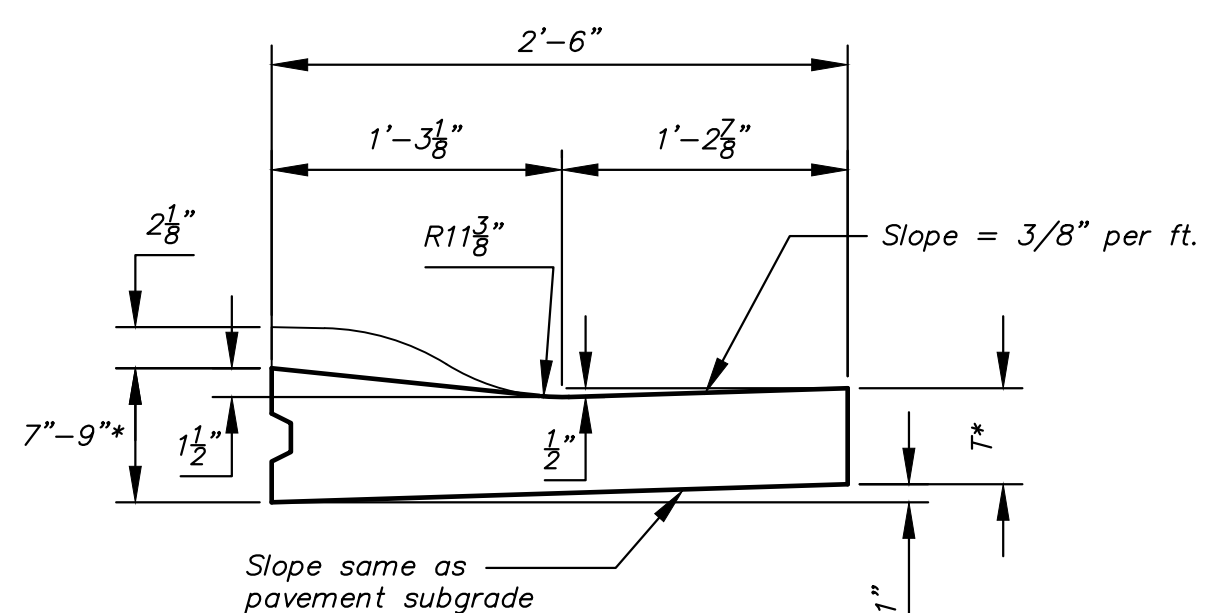


Combined Curb & Gutter (1 1/2")

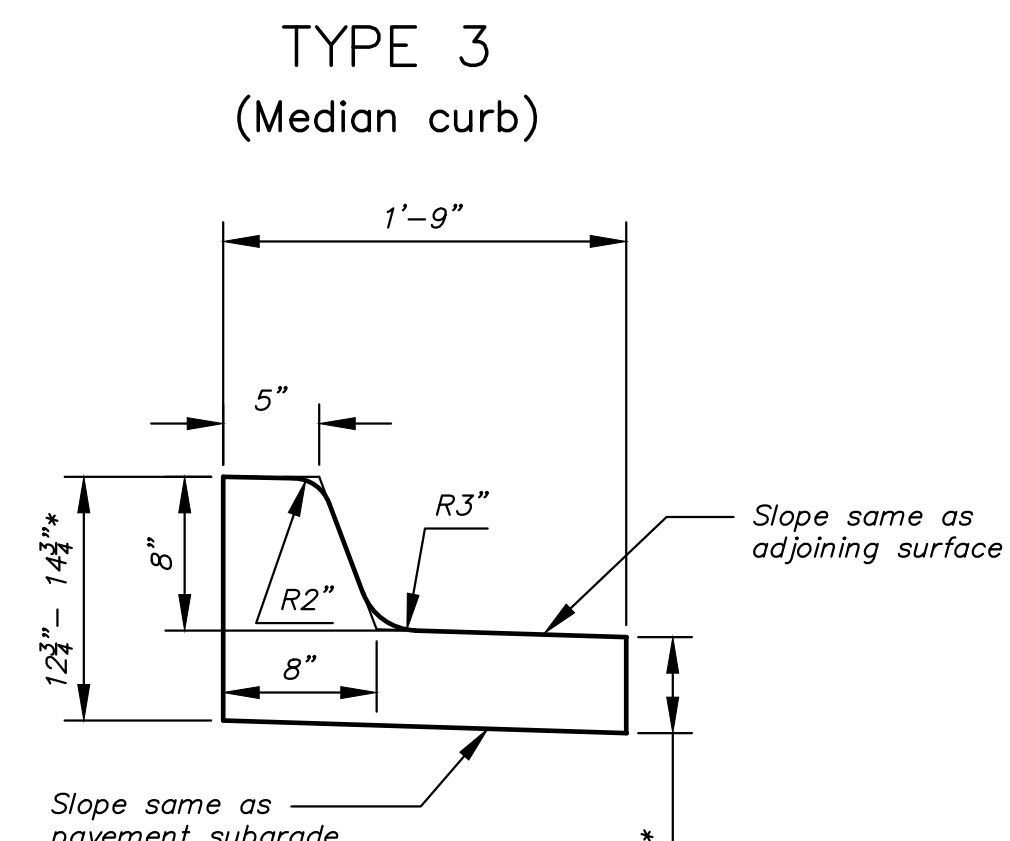


Combined Curb & Gutter (8")

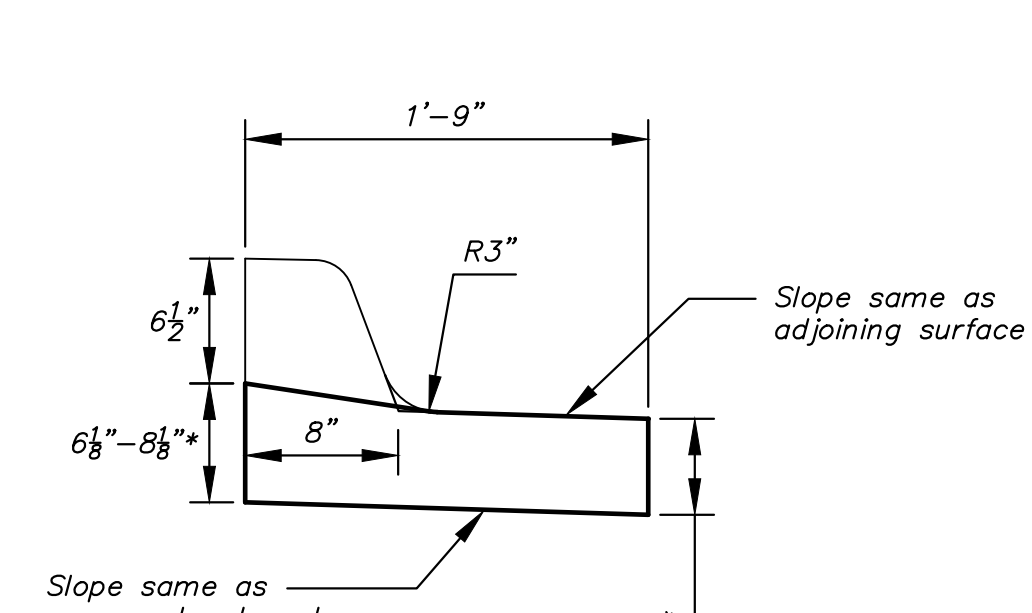

Combined Curb & Gutter (1 1/2")

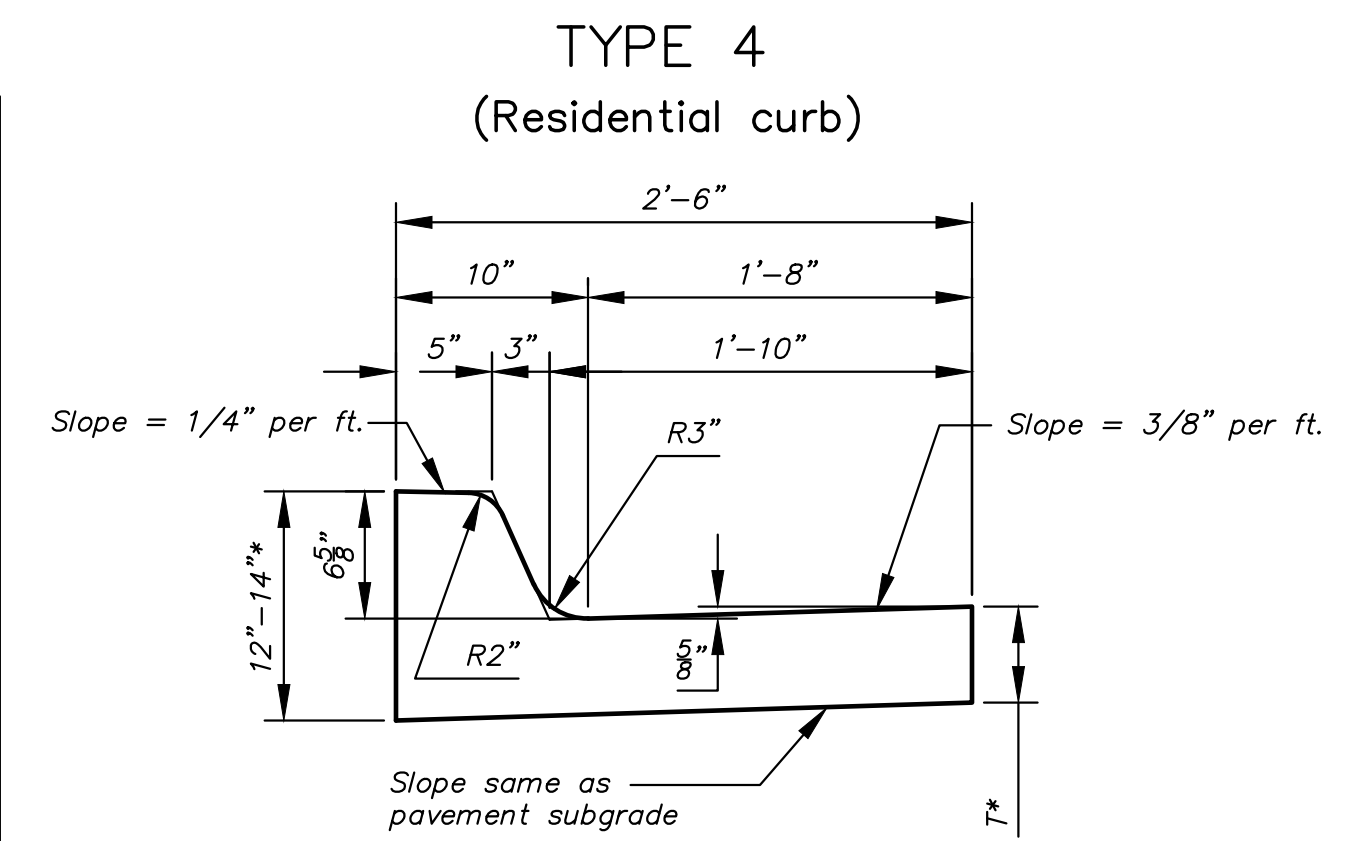

Combined Curb & Gutter (6 5/8")




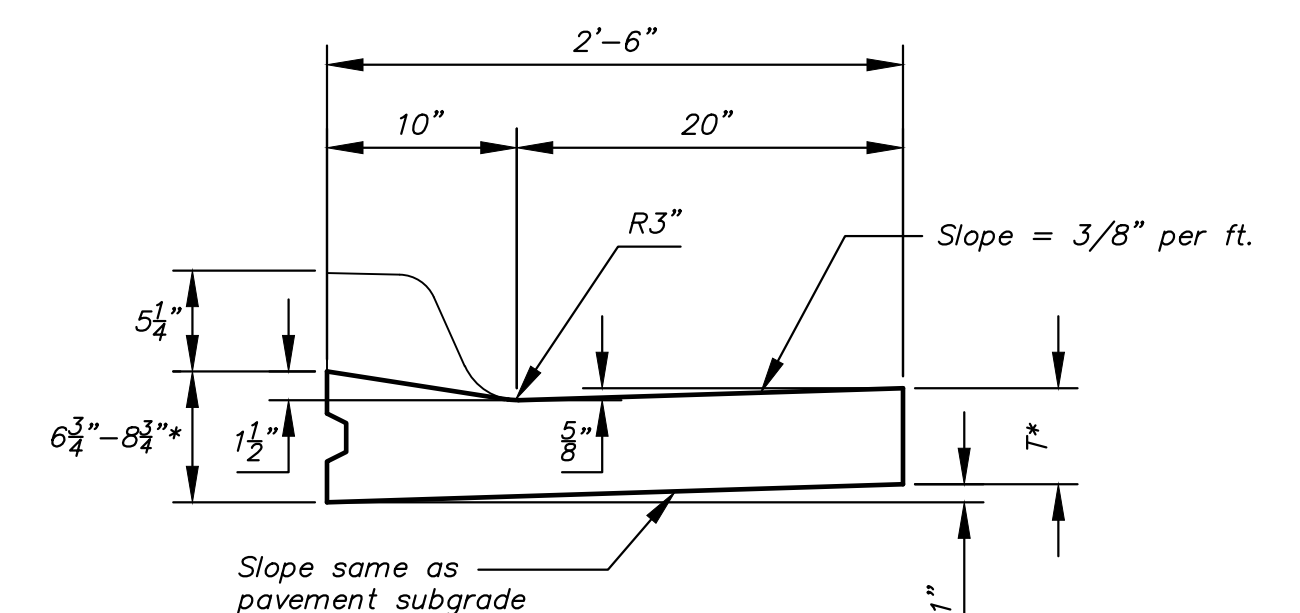


Combined Curb & Gutter (1 1/2")

T^* = Thickness of curb to adjust with pavement thickness

GENERAL NOTES

1. Expansion (isolation) joints shall be constructed a maximum of 300' apart and at all Pls, PCs, cul-de-sac quadrants, and ends of returns.
2. Contraction joints shall be constructed a minimum of 12' apart.
3. Joint sealer shall be required at all joints on arterial and industrial streets and at intersections on residential streets.

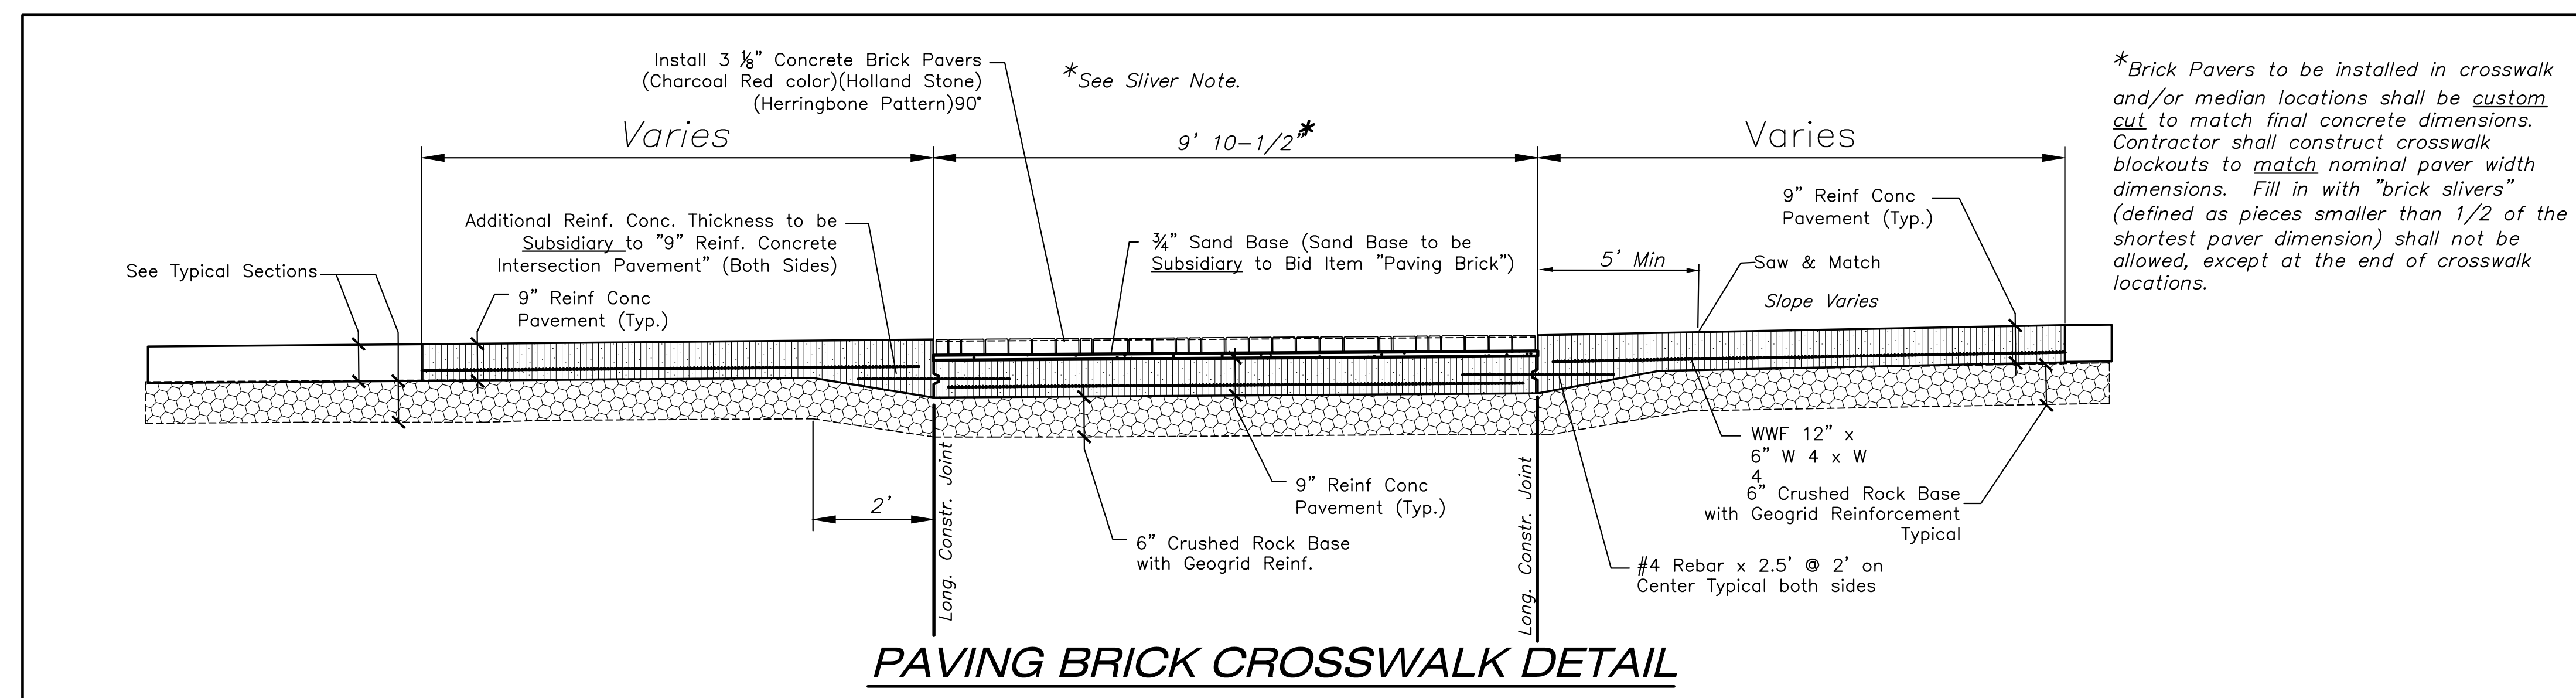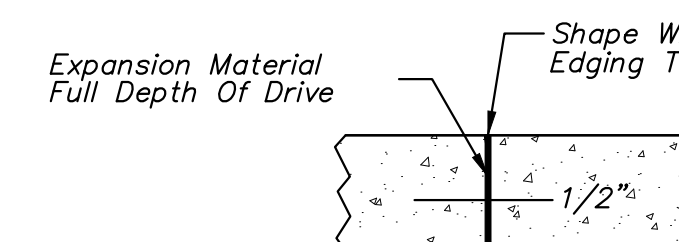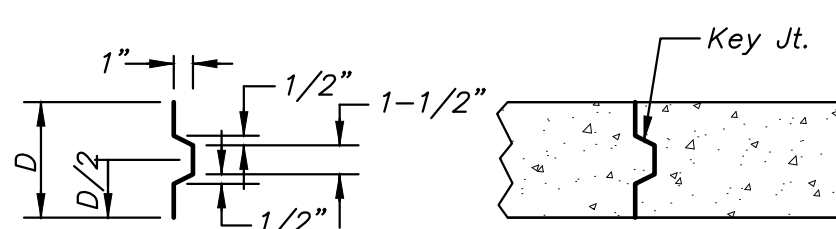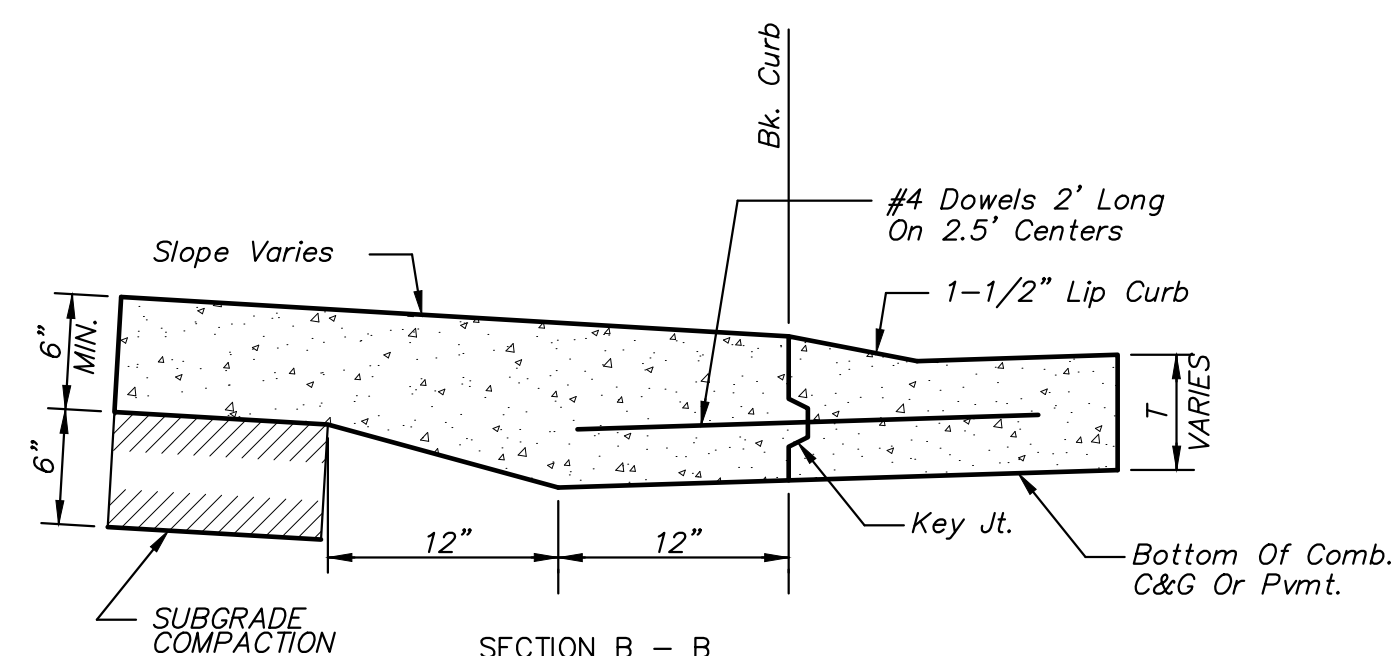

REVISED: OCTOBER 2015

 CITY OF WICHITA PUBLIC WORKS & UTILITIES ENGINEERING DIVISION	REVISION: 0000000000 <i>CURB & GUTTER & PAVING BRICK CROSSWALK DETAILS</i>		
	CITY ENGINEER <i>GARY JANZEN, P.E.</i>		
	PROJECT NUMBER 472-2025-086171	OCA NUMBER ####	DATE JULY 2023
	CITY ENGINEER'S OFFICE CITY HALL - SEVENTH FLOOR 455 NORTH MAIN STREET WICHITA, KANSAS 67202-1620 (316) 268-4501		SHEET C-504-P06 OF 20