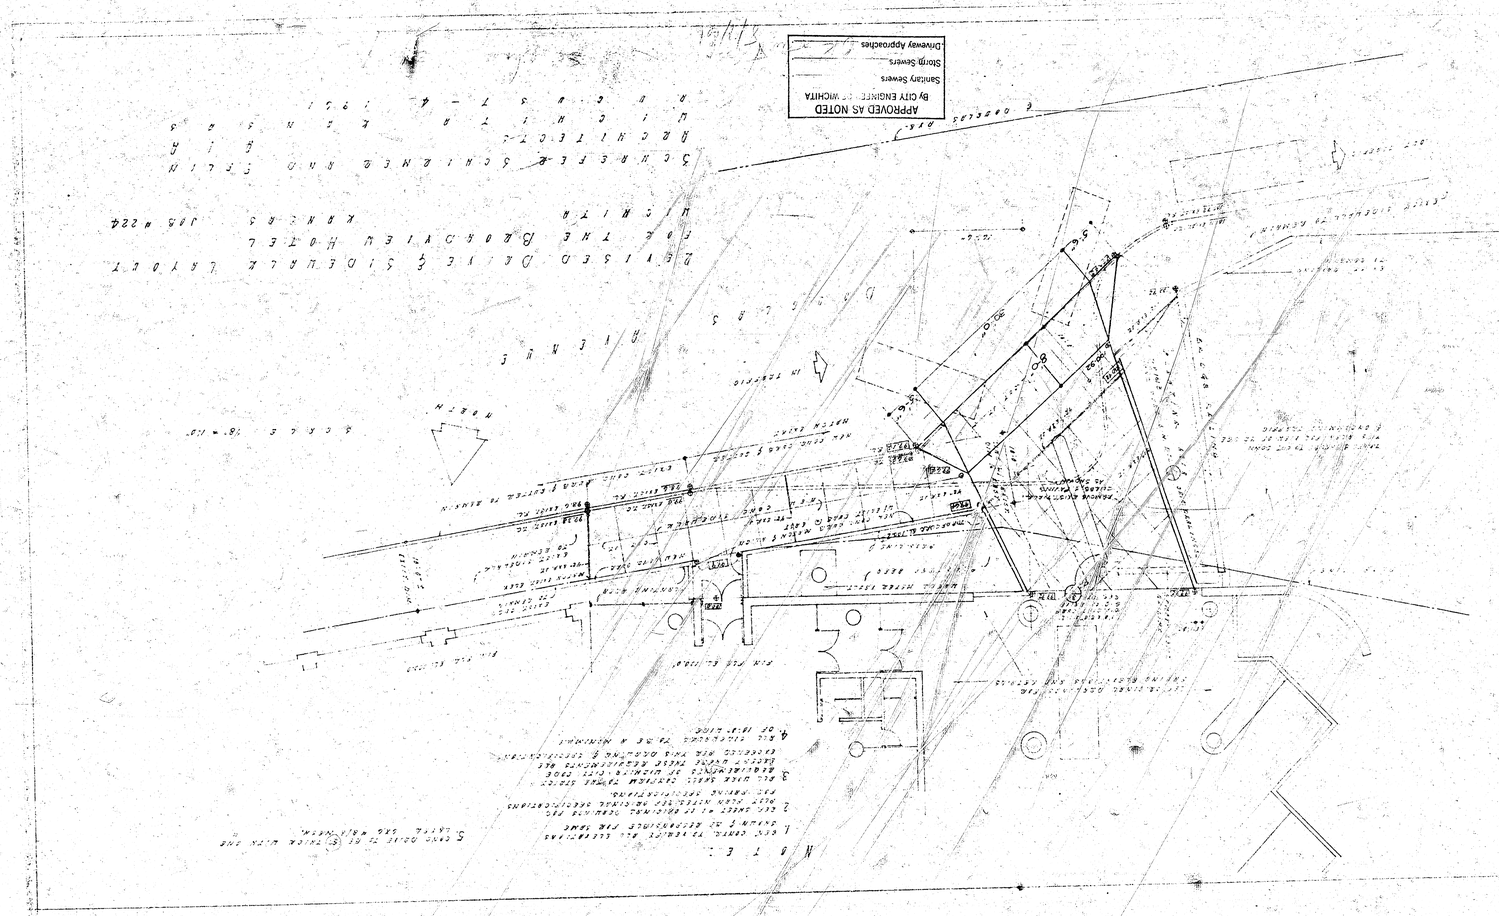
APPROVED AS NOTED
By CITY ENGINEER - WICHITA
Sanitary Sewers
Storm Sewers
Driveway Approaches
NOTE:
1. ELEC. CONTR. TO VERIFY ALL ELECTRICAL LOADS & REQUIREMENTS FOR SIZING OF SERVICE EQUIPMENT.
2. ELEC. SHEET #1 OF ARCHITECTURAL DRAWING FOR ADDITIONAL SPECIFICATIONS.
3. ALL EXTERIOR LIGHTING SHALL BE DIRECTED ON PROPERTY AND SHIELDED AS REQUIRED BY WICHITA CITY CODE.
ELECTRIC SERVICE SHALL BE UNDERGROUND.
4. ALL EXISTING TO REMAIN UNLESS OTHERWISE NOTED.
5. CONTRACTOR TO VERIFY ALL EASEMENTS AND SETBACKS.
SCALE: 1/8" = 1'-0"
NORTH
DEVELOPED DRIVE-IN SIDEWALK LAYOUT
FOR THE DOUBLEVIEW HOTEL
WICHITA, KANSAS
JOB # 224
SCHAFER-SCHNEIDER AND ZIELIN
ARCHITECTS
WICHITA, KANSAS
DATE
DRAWN BY
CHECKED BY
SHEET