

LOCATION MAP


BOEING MILITARY AIRPLANE COMPANY
WICHITA, KANSAS

**INDUSTRIAL WASTEWATER
TREATMENT PLANT IMPROVEMENTS**


**1.0 MILLION GALLON
WASTEWATER STORAGE TANK**

BLACK & VEATCH ENGINEERS-ARCHITECTS
KANSAS CITY, MISSOURI
PROJECT NO. 11903.001
1984

- SHEET LIST:
1. GENERAL LAYOUT
 2. STORAGE TANK - PLAN AND SECTIONAL PLAN
 3. STORAGE TANK - REINFORCING PLANS
 4. STORAGE TANK - CONCRETE SECTIONS AND DETAILS
 5. PUMP STATION AND FLOW CONTROL M.H. - SECTIONS AND DETAILS
 6. STANDARD CONCRETE DETAILS
 7. MISCELLANEOUS DETAILS
 8. ELECTRICAL - PLAN VIEWS
 9. ELECTRICAL - SCHEMATICS AND ONE-LINES

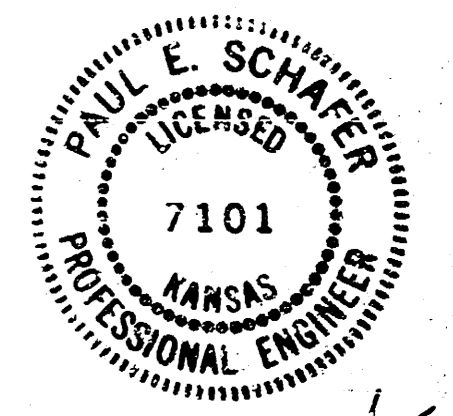

FILMED FROM THE BEST
AVAILABLE COPY

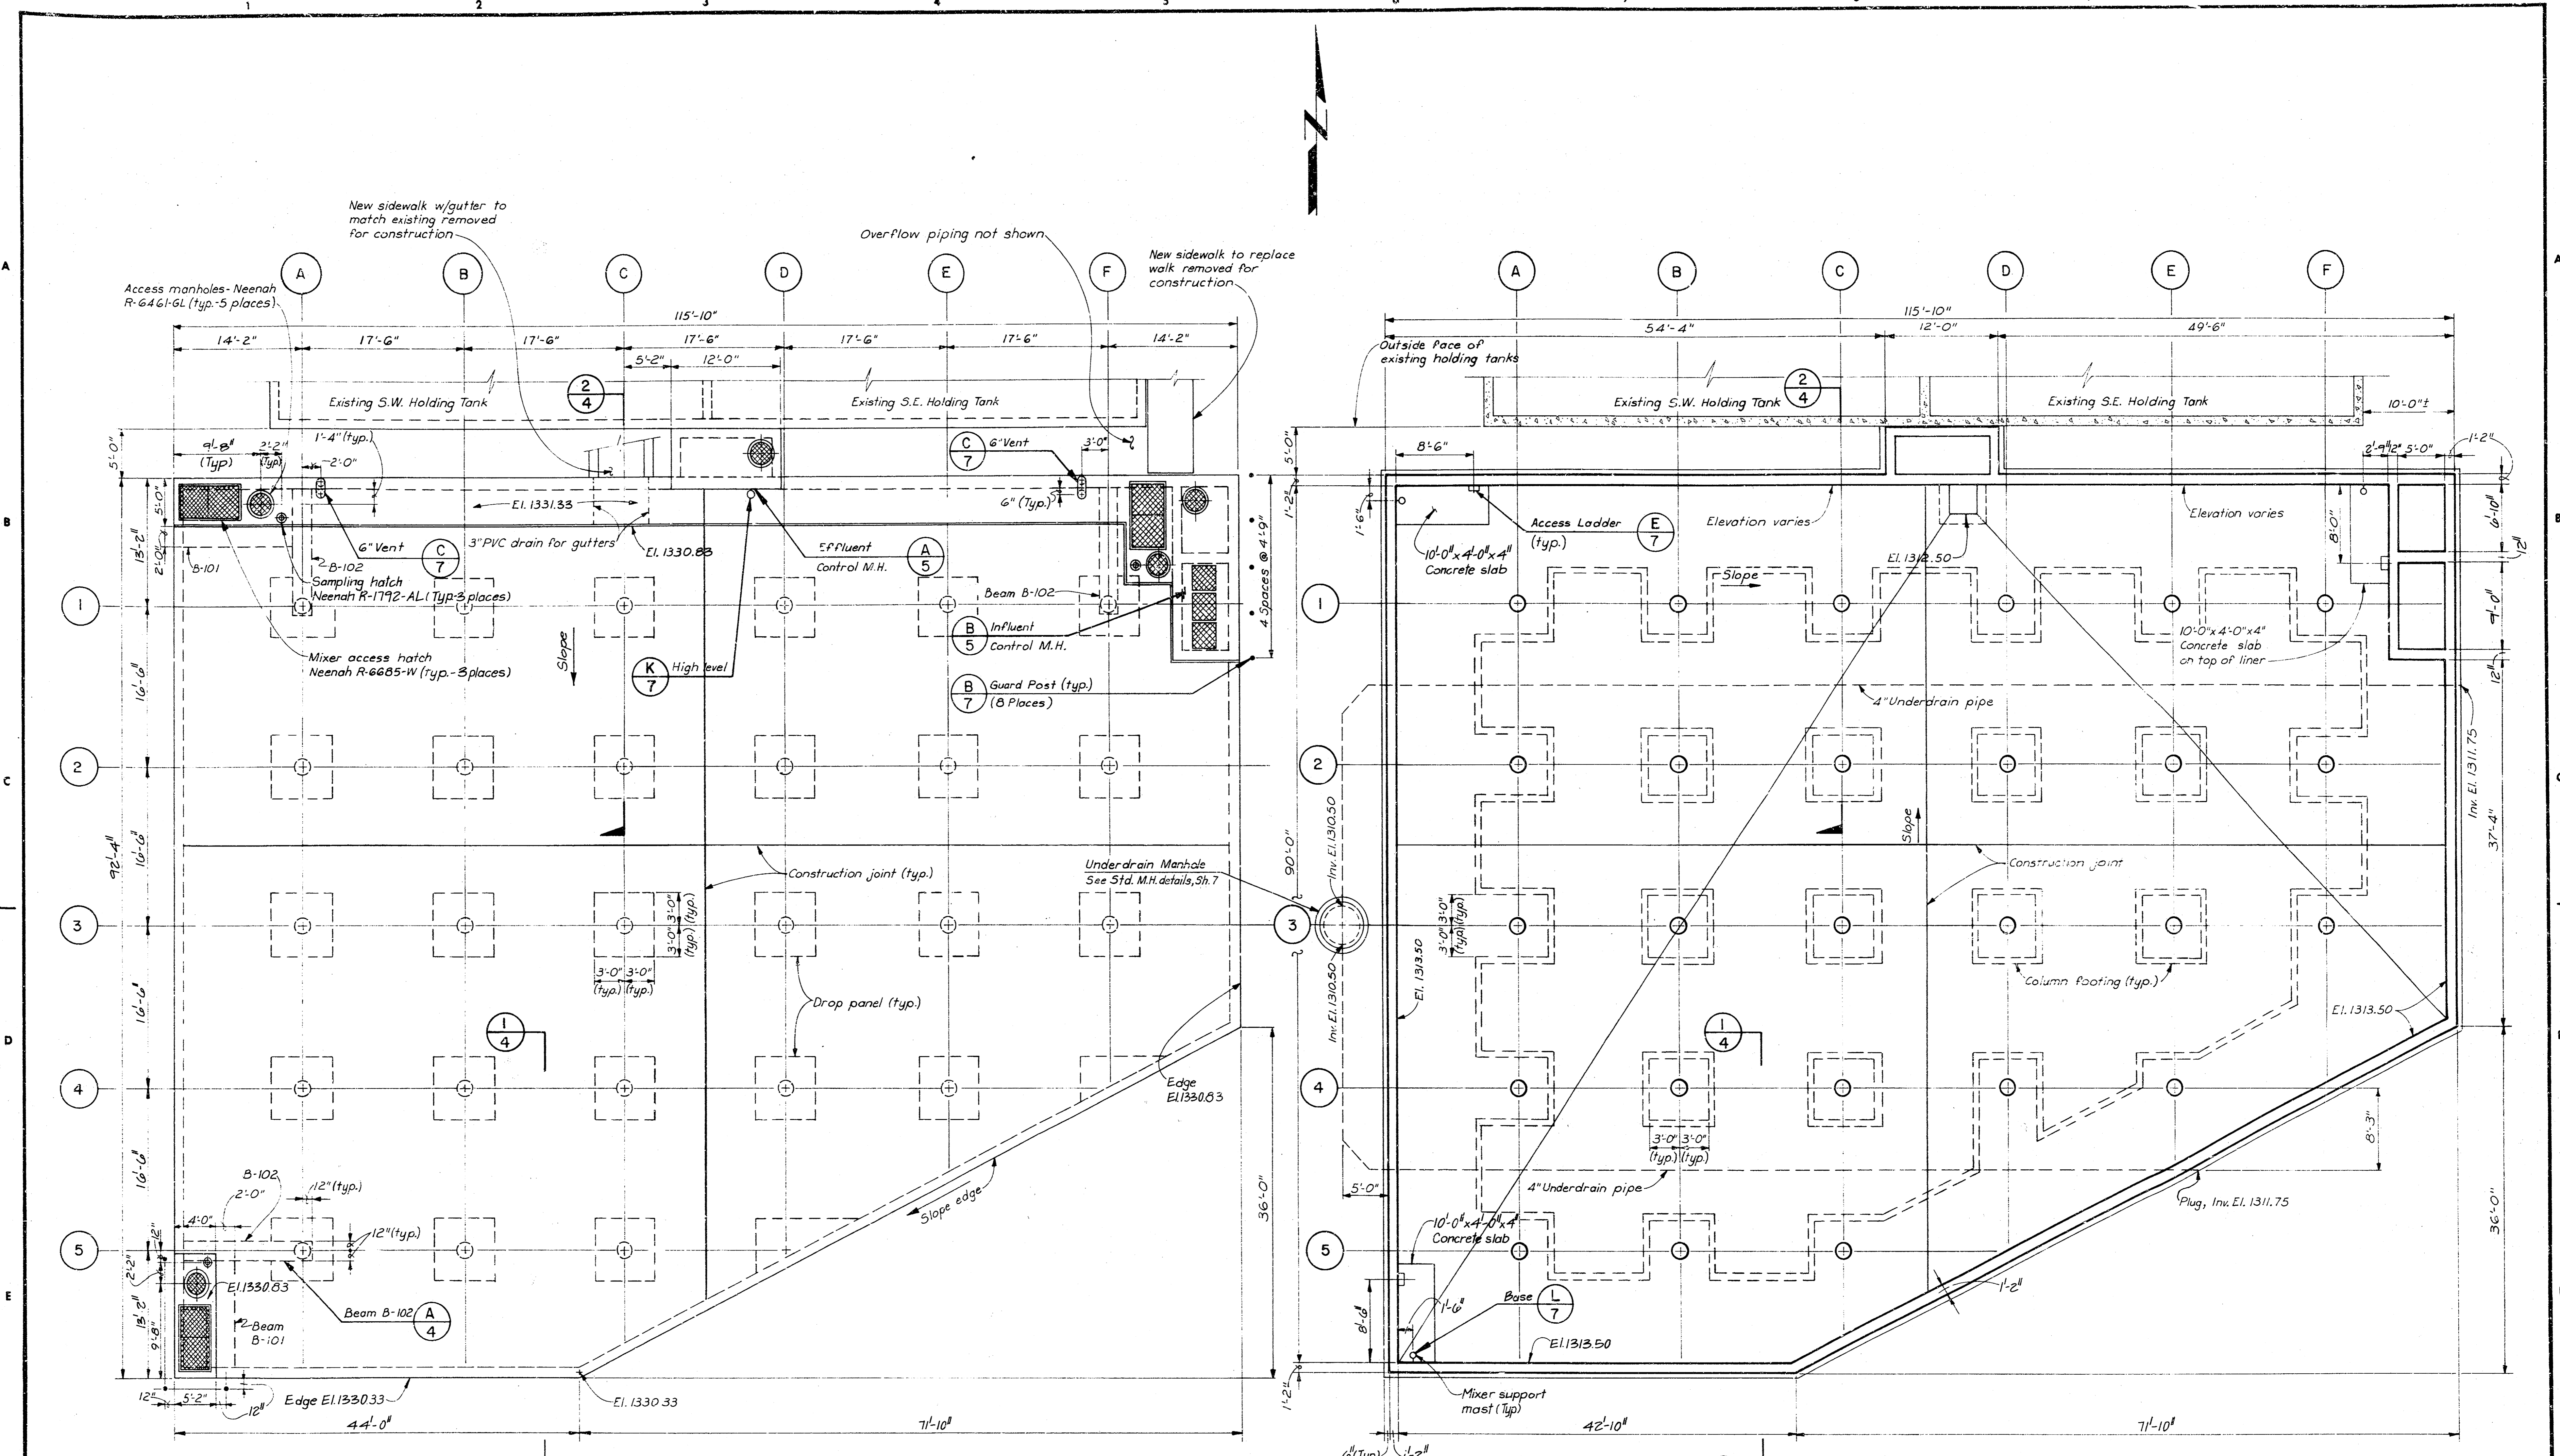

• Denotes guard posts

PLAN
1/8" = 1'-0"

SECTIONAL PLAN
1/8" = 1'-0"

B.S.V.-C-2096-A


NO.	DATE	REVISIONS AND RECORD OF ISSUE	NO.	BY	CHK	APP

DESIGNED MPS
 DETAILED SCH
 CHECKED RAM
 APPROVED [Signature]
 DATE 31 Dec 84




PROJECT NO.
11903.001

BOEING MILITARY AIRPLANE CO.
 INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS
 1.0 MG STORAGE TANK
 PLAN & SECTIONAL PLAN

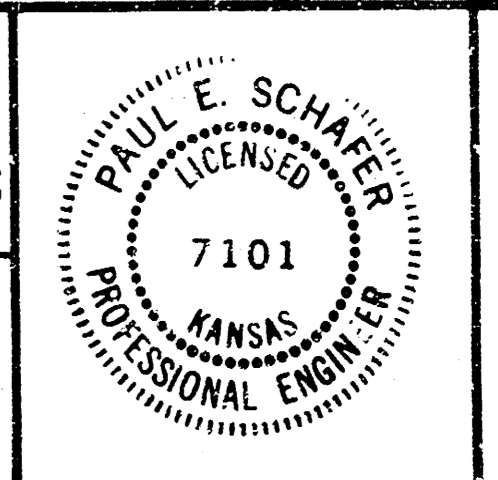

SHEET
2 OF 9

FILMED FROM THE BEST AVAILABLE COPY

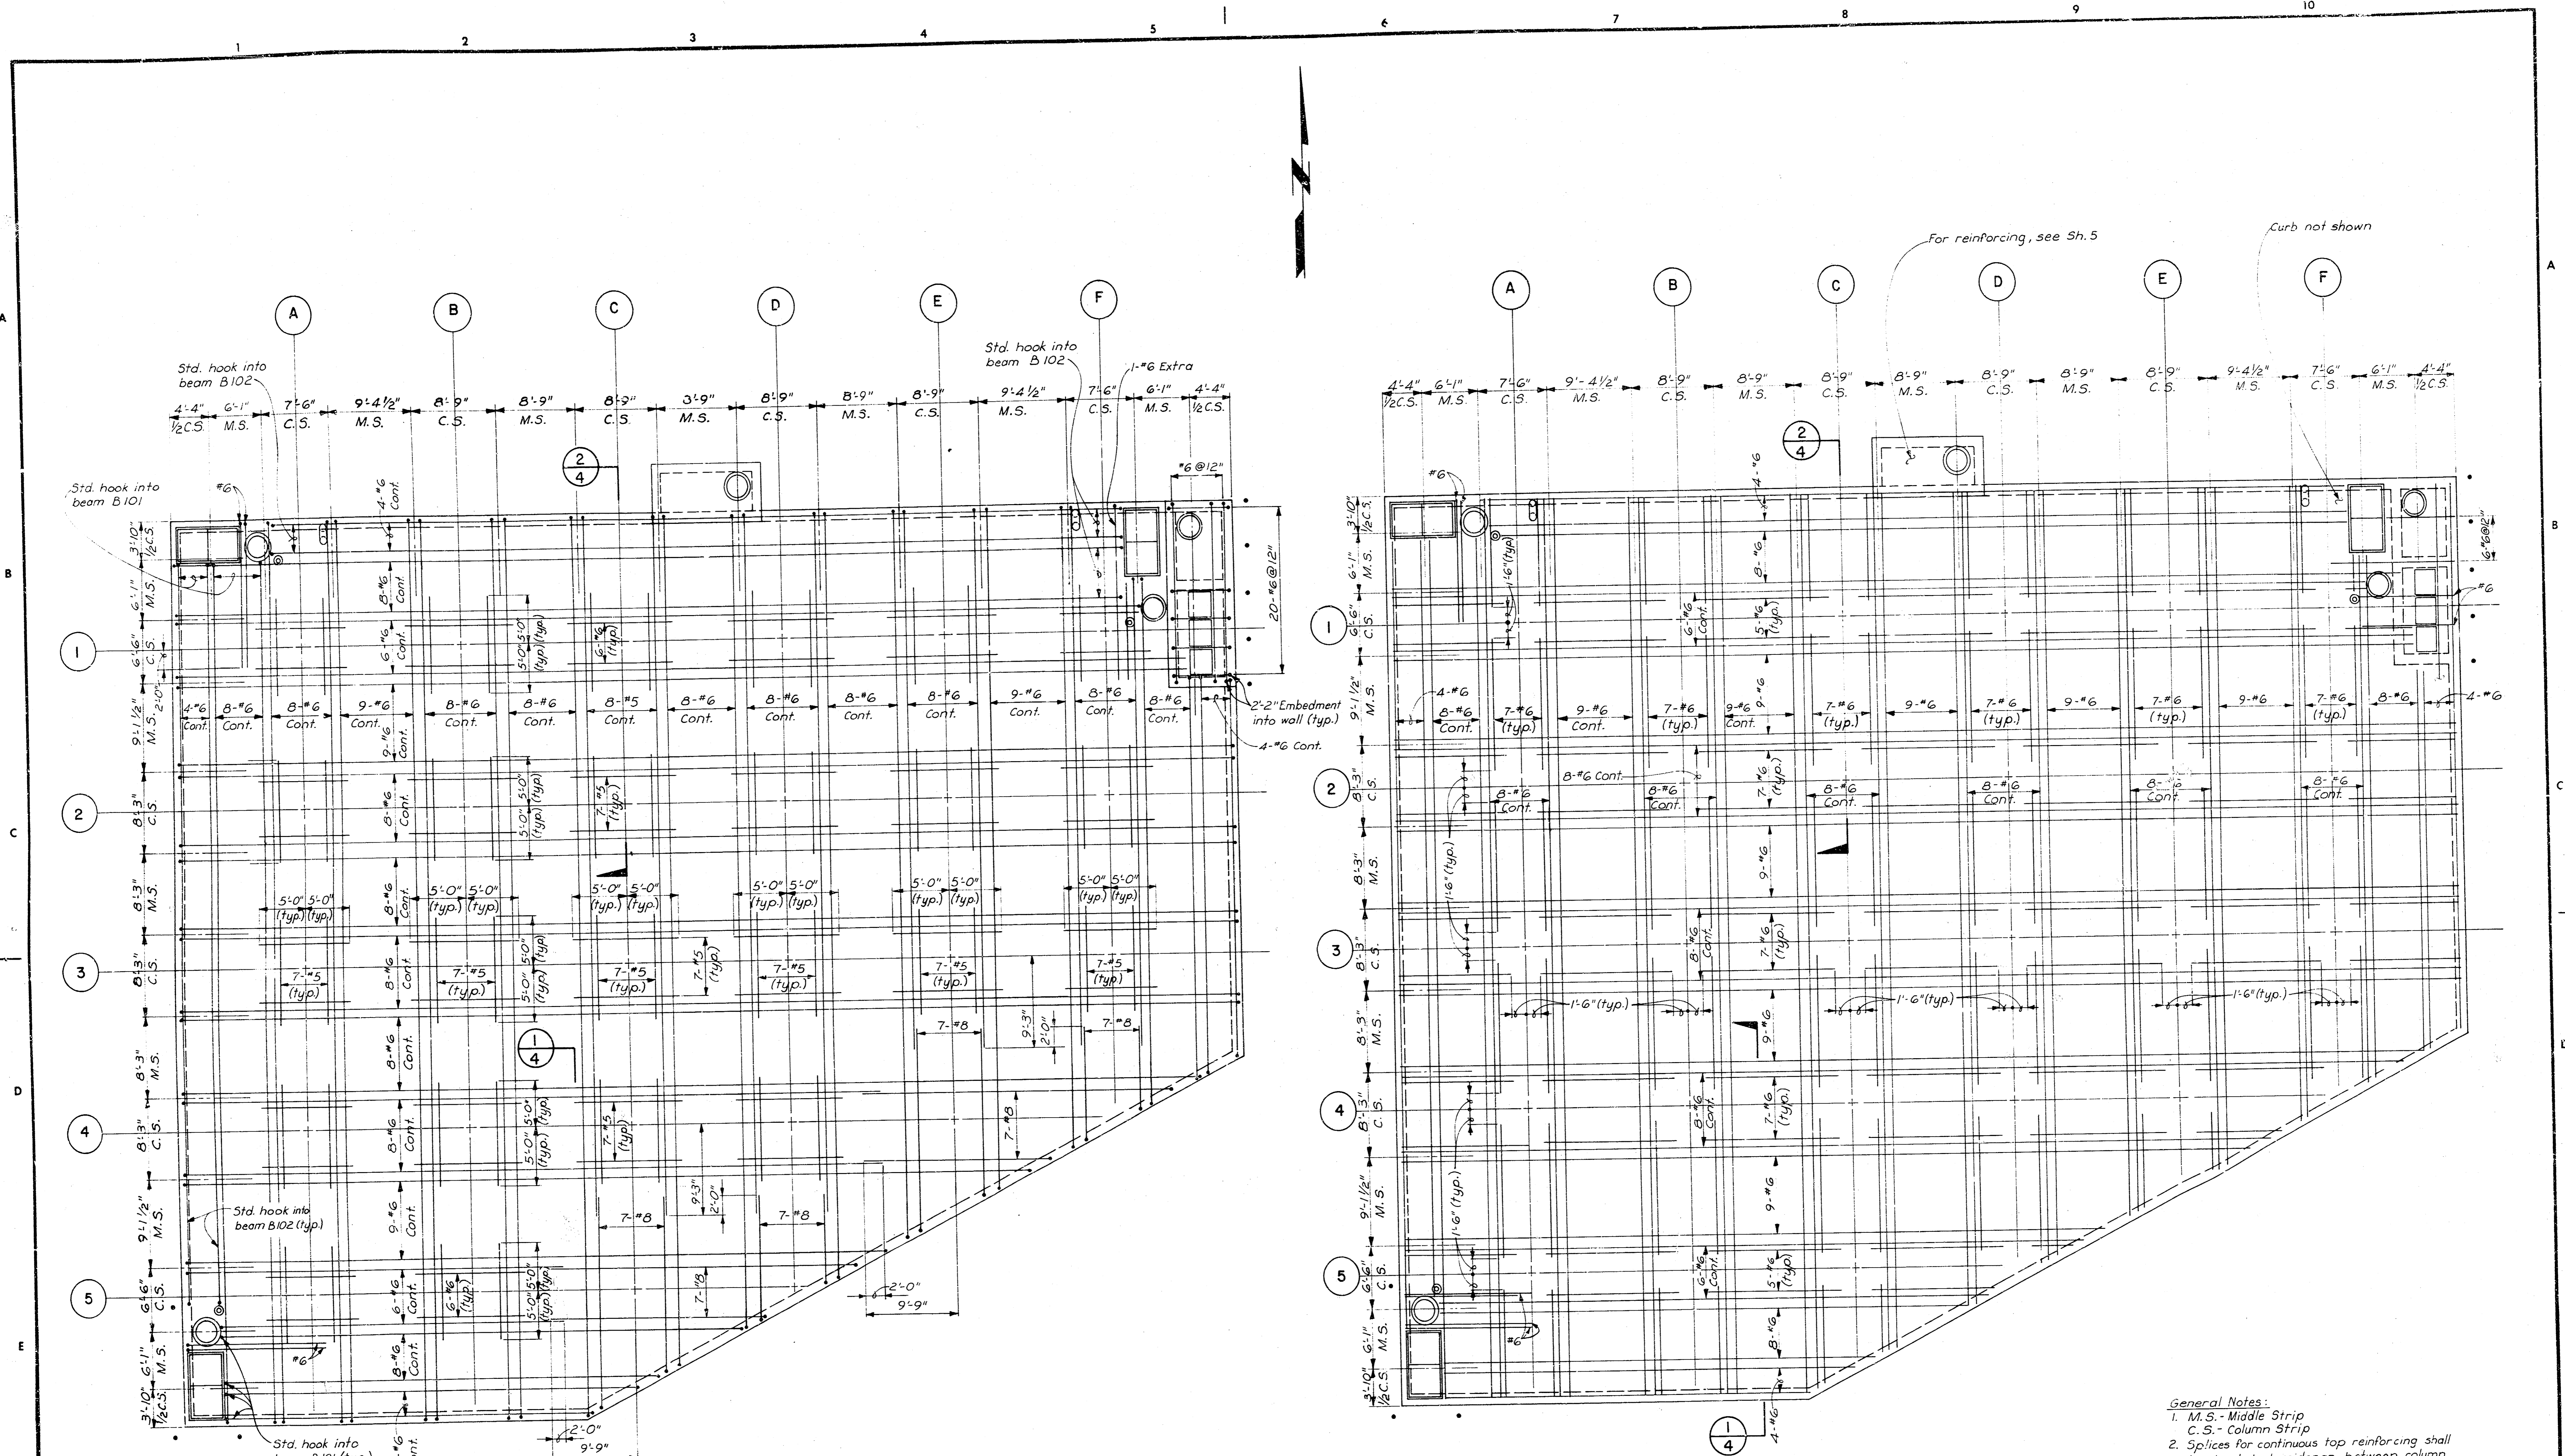

TOP REINFORCING STEEL
 ROOF PLAN
 1/8"=1'-0"


BOTTOM REINFORCING STEEL
 ROOF PLAN
 1/8"=1'-0"

- General Notes:
1. M.S. - Middle Strip
C.S. - Column Strip
 2. Splices for continuous top reinforcing shall be located at midspan between column rows using a 30 bar diameter splice.
 3. Splices for continuous bottom reinforcing shall be located at column rows using a Class B tension splice in accordance with ACI 318-83.

BAV-C-2426-A

NO.	BY	CK	APP	DATE	REVISIONS AND RECORD OF ISSUE


DESIGNED LWC
 DETAILED WJT, SCH
 CHECKED RED
 APPROVED [Signature]
 DATE 3/12/84

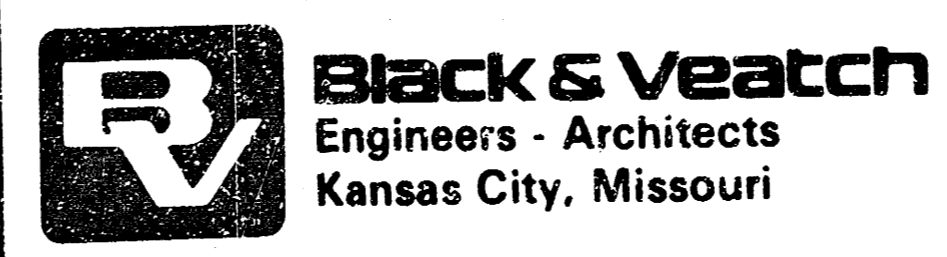

PROJECT NO.
 11903.001


BOEING MILITARY AIRPLANE CO.
 INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS

1.0 MG STORAGE TANK
 REINFORCING PLANS

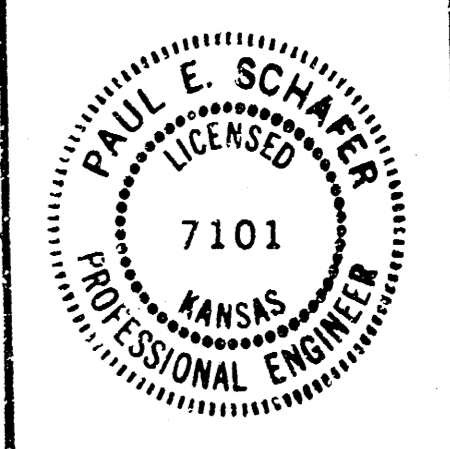

SHEET
 3 OF 9

FILMED FROM THE BEST AVAILABLE COPY

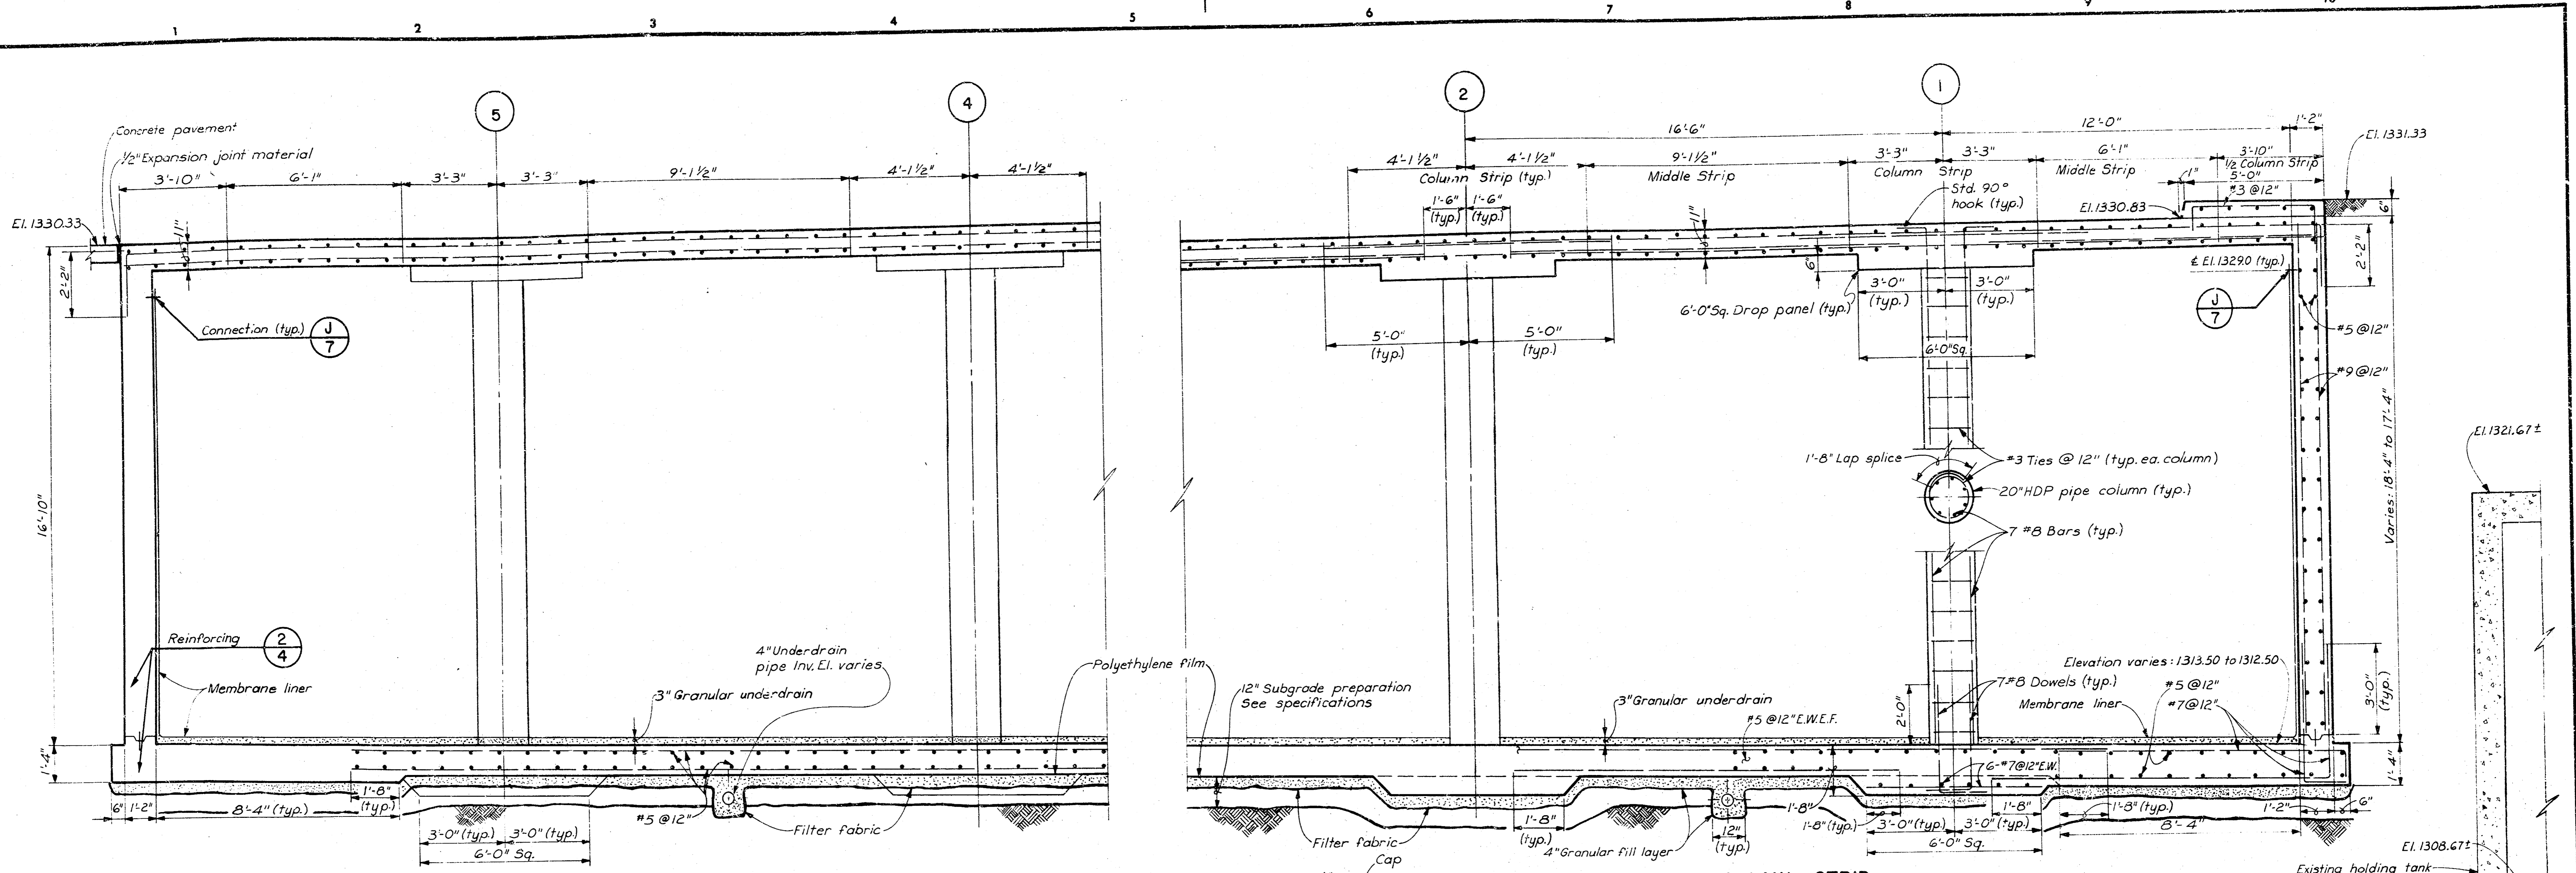


TYPICAL MIDDLE STRIP

SECTION 1
3/8"=1'-0"

TYPICAL COLUMN STRIP


SECTION 2
3/8"=1'-0"

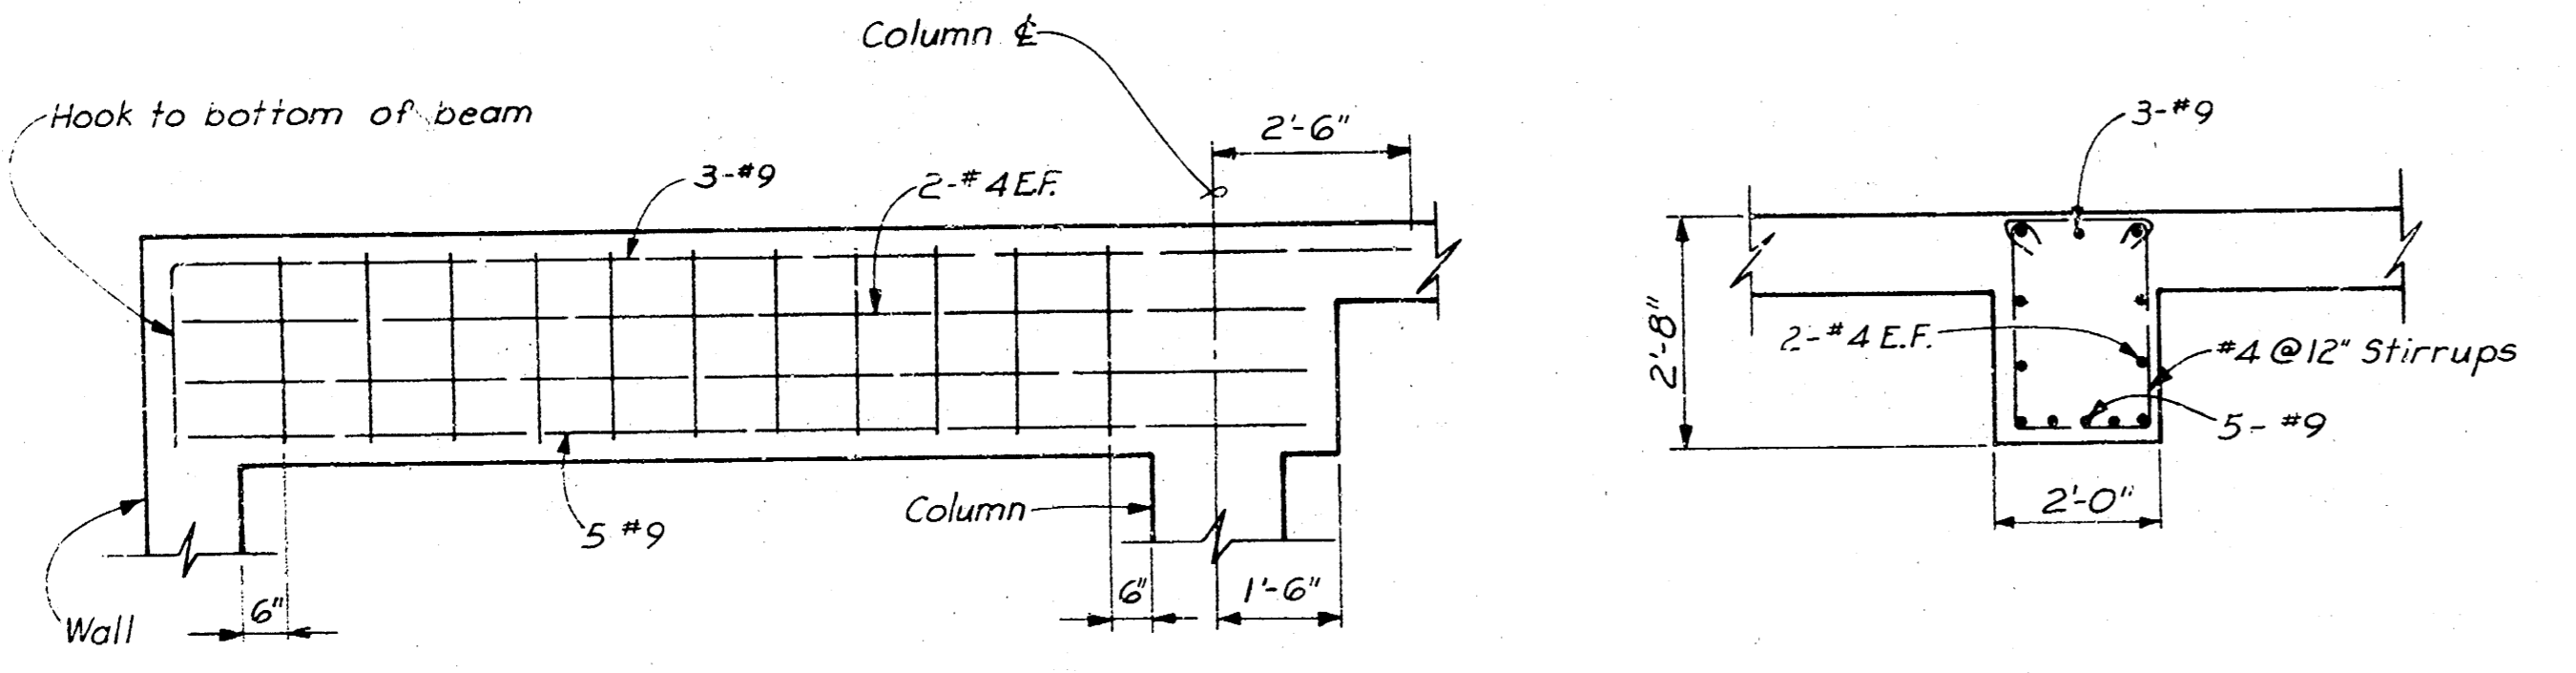

ELEVATION

SECTION


BEAM DETAIL B102
3/8"=1'-0"

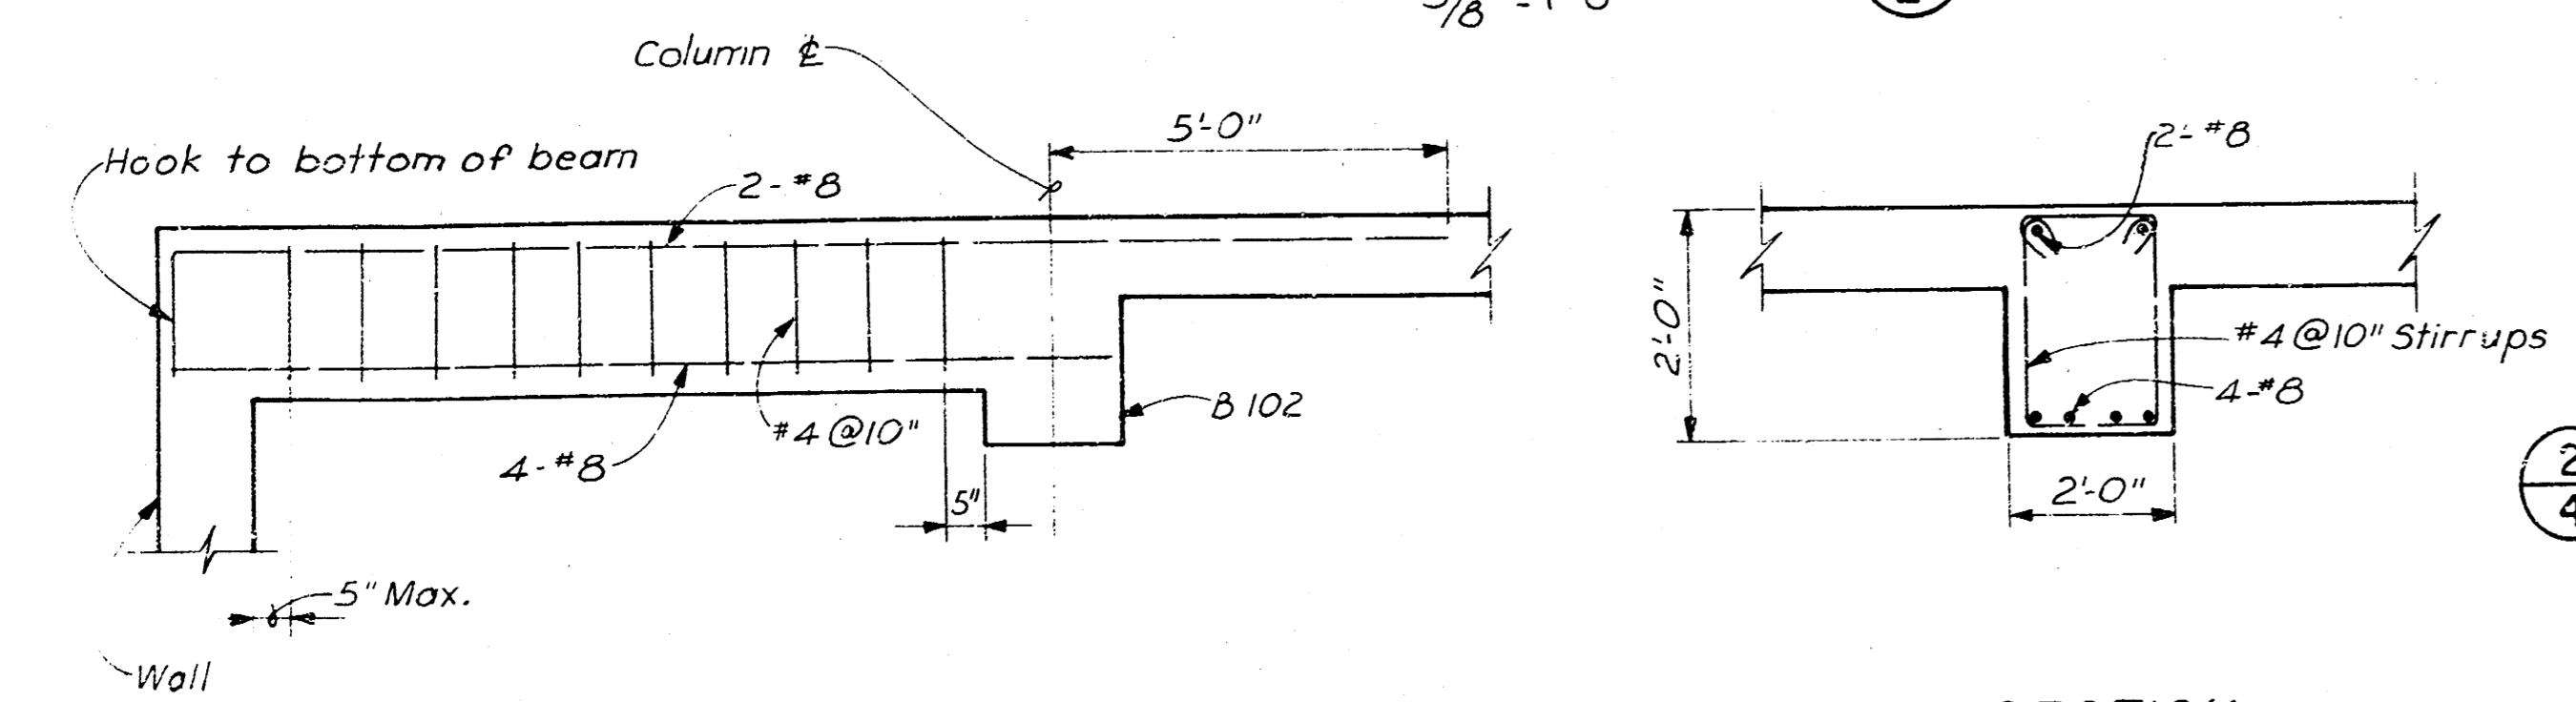


ELEVATION

SECTION


BEAM DETAIL B101
3/8"=1'-0"

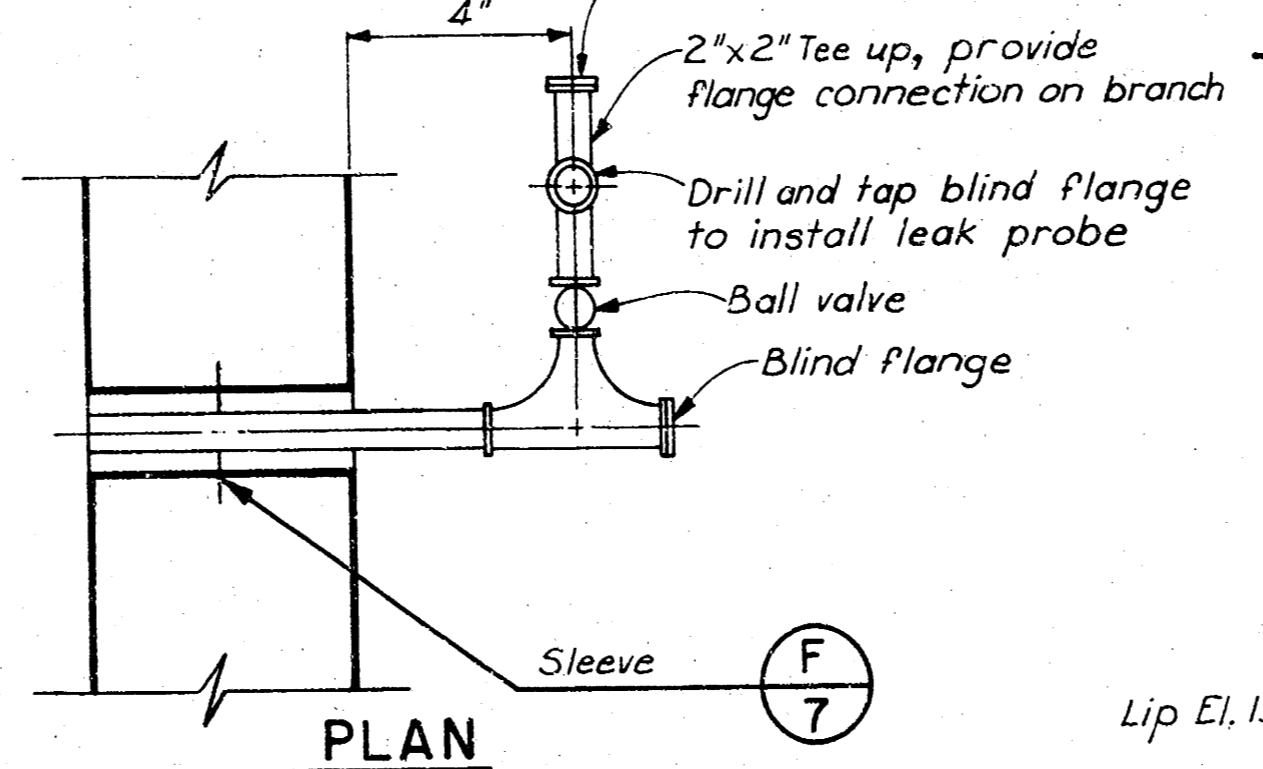

LEAK DETECTION PROBE
No Scale

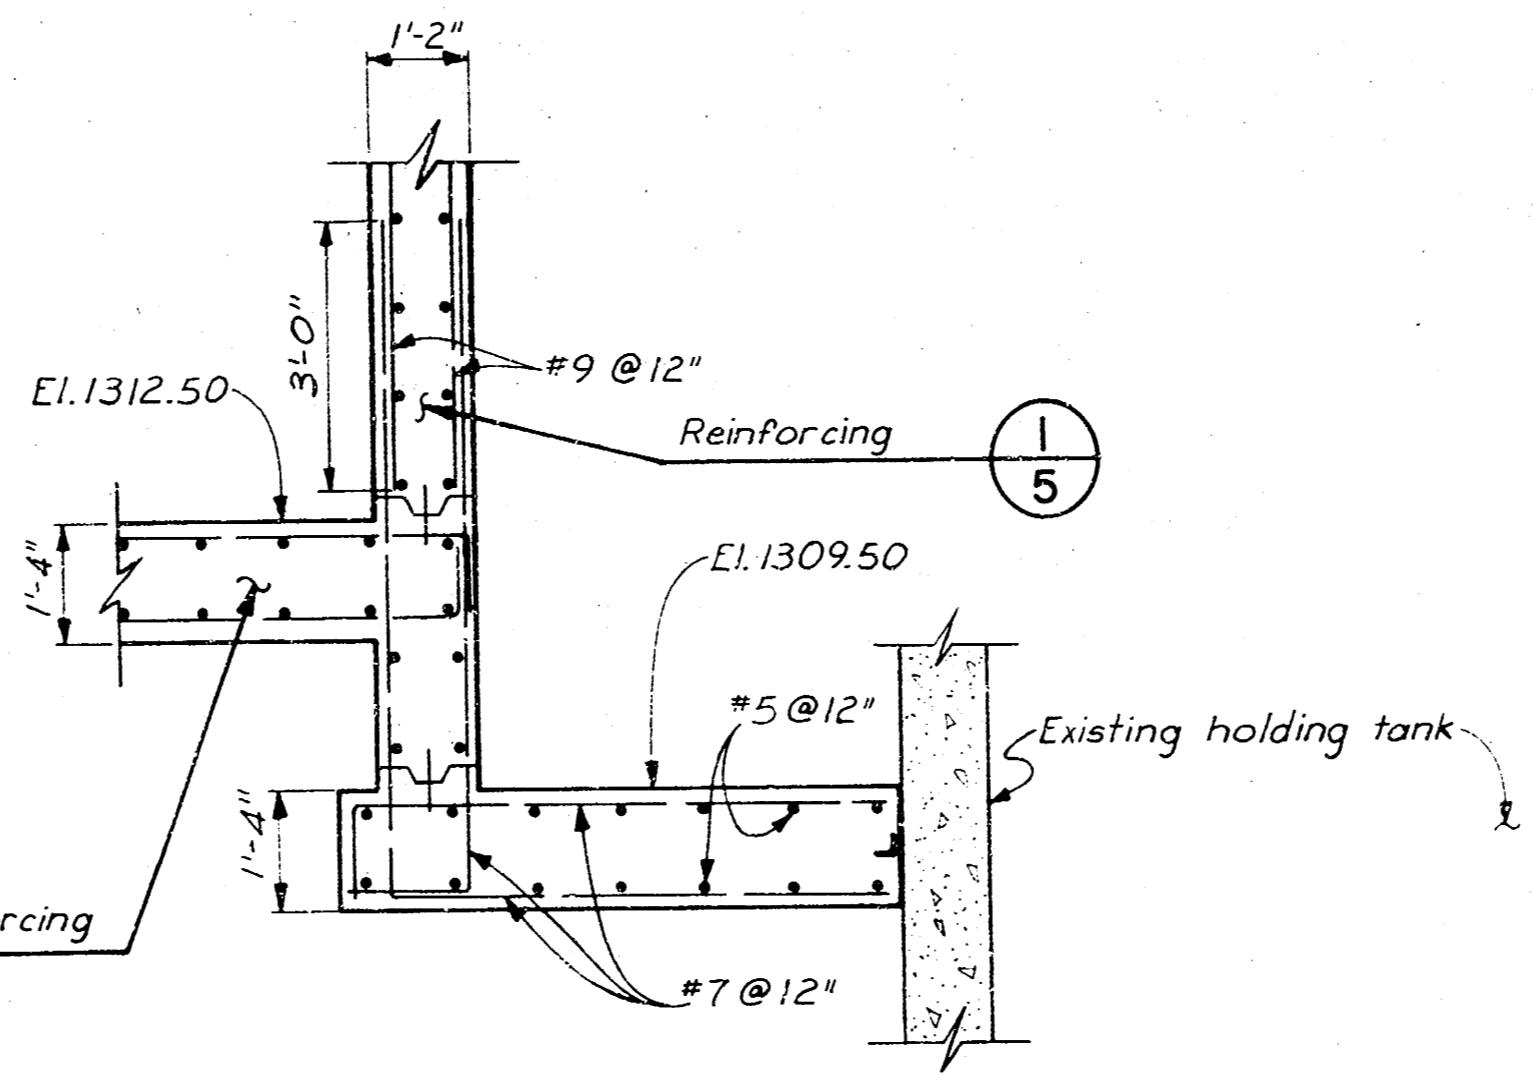


SECTION 3
3/8"=1'-0"

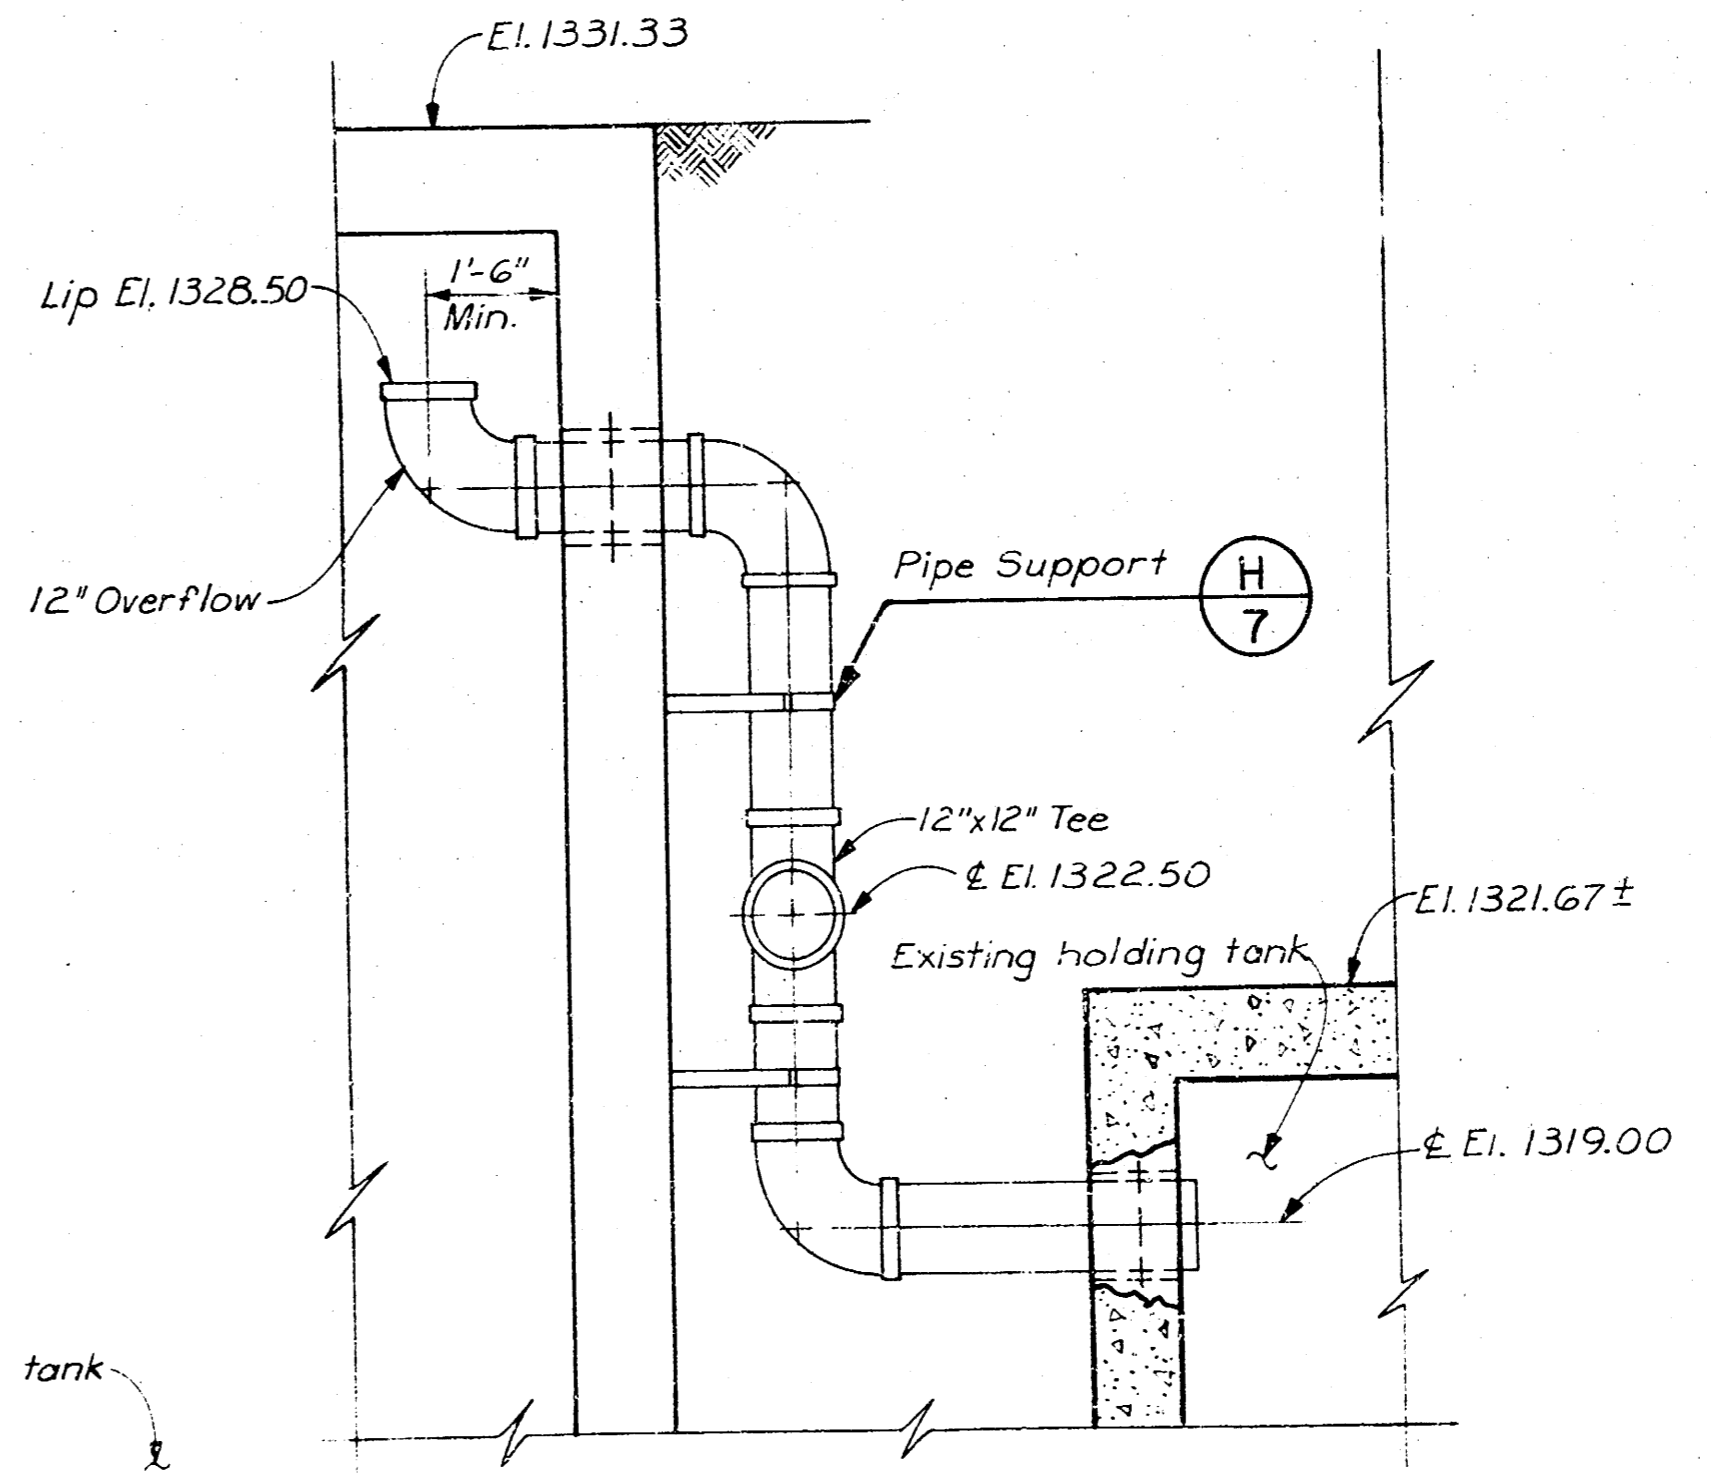

SECTION 4
3/8"=1'-0"


NO.	BY	CHK	APP	DATE	REVISIONS AND RECORD OF ISSUE

DESIGNED MPS, LWC
 DETAILED SCH
 CHECKED RAM, RED
 APPROVED [Signature]
 DATE 31 Dec 82

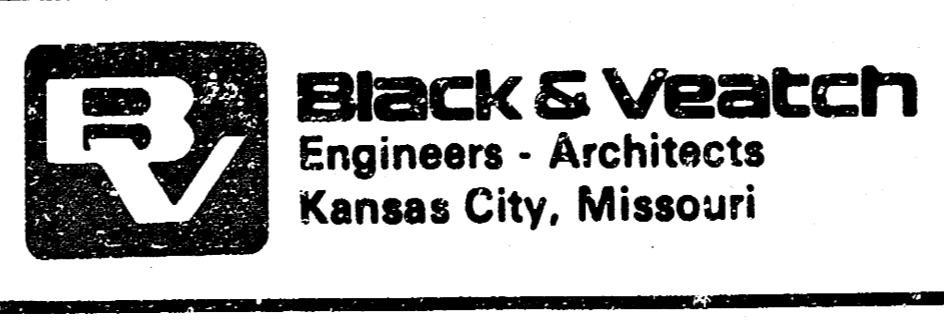


PROJECT NO.
11903.001

BOEING MILITARY AIRPLANE CO.
 INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS
 1.0 MG STORAGE TANK
 CONCRETE SECTIONS AND DETAILS

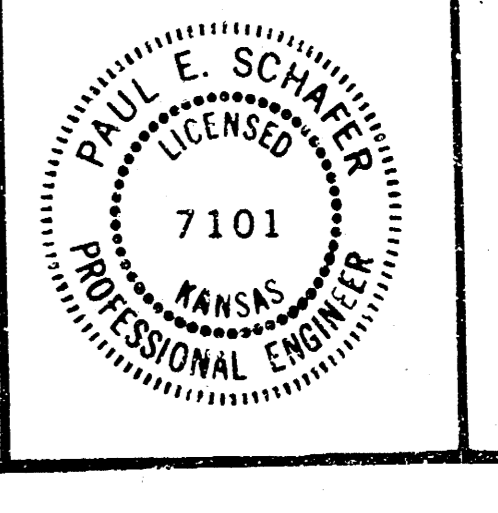


SHEET
4 OF 9
5/10


FILMED FROM THE BEST AVAILABLE COPY

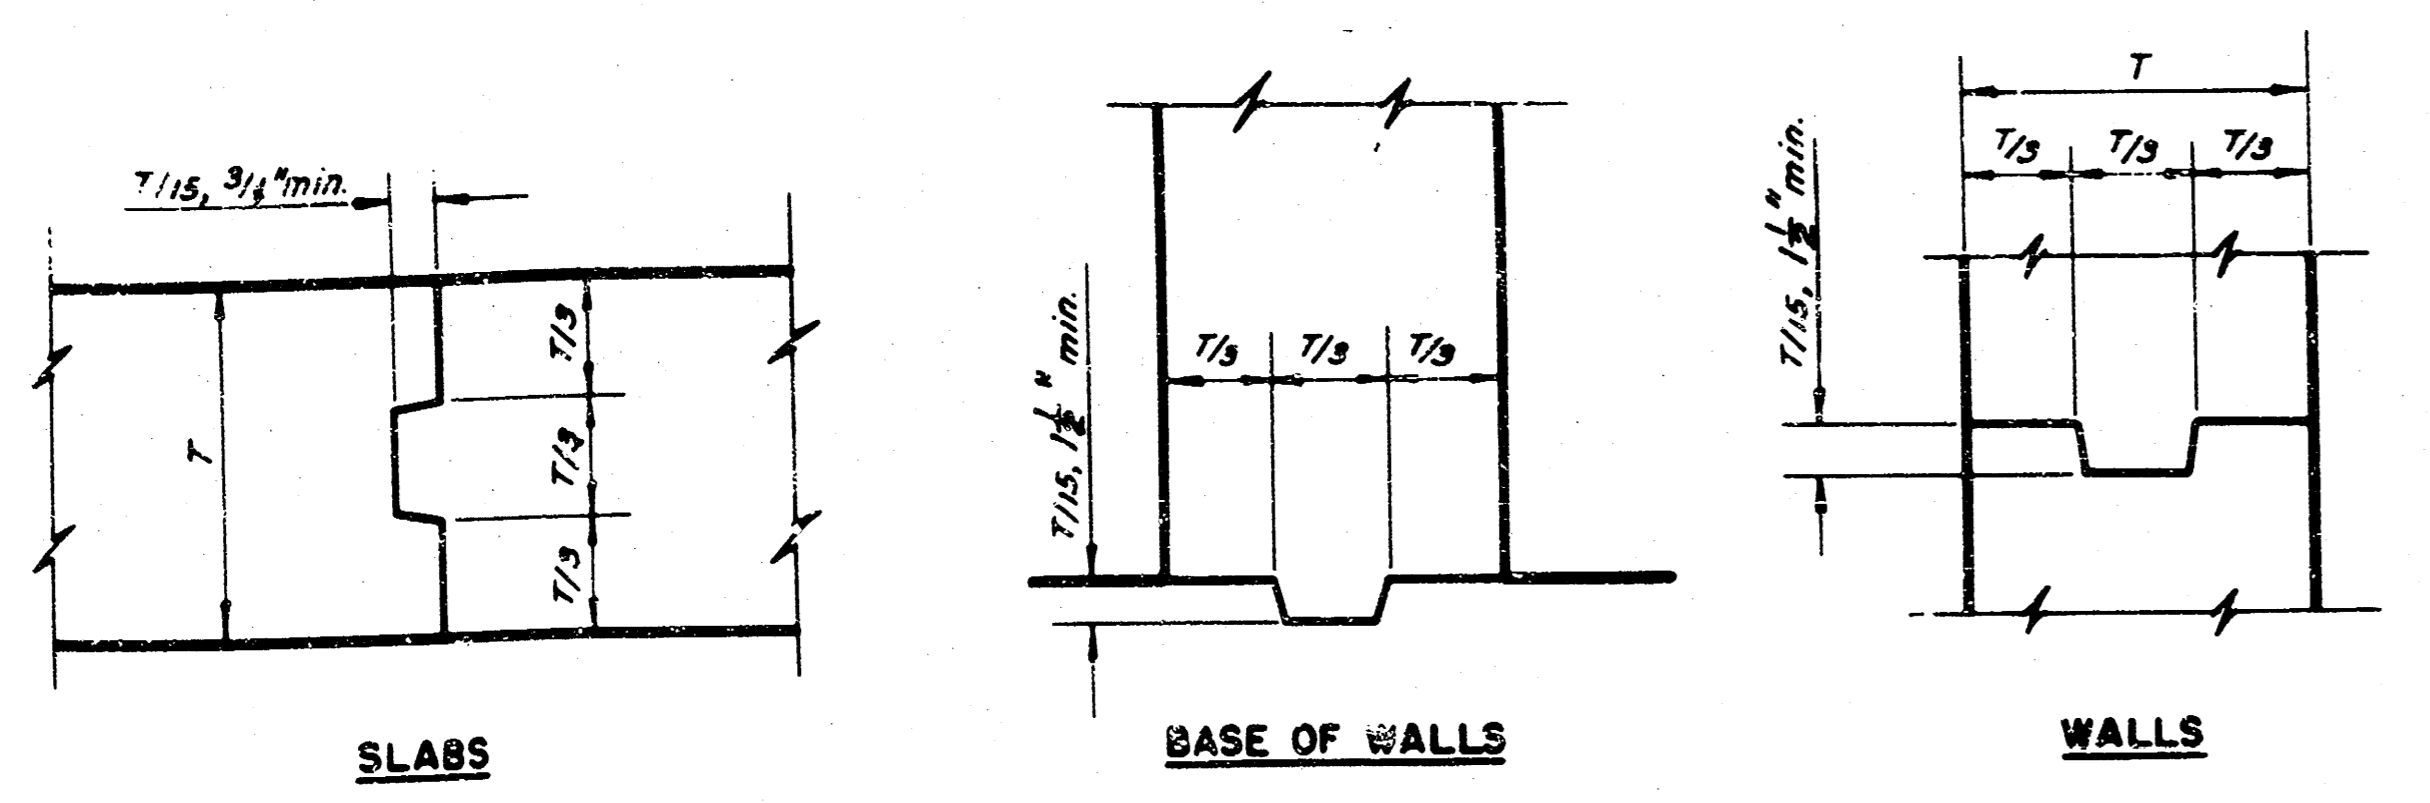

JOINTS WITHOUT WATER STOPS

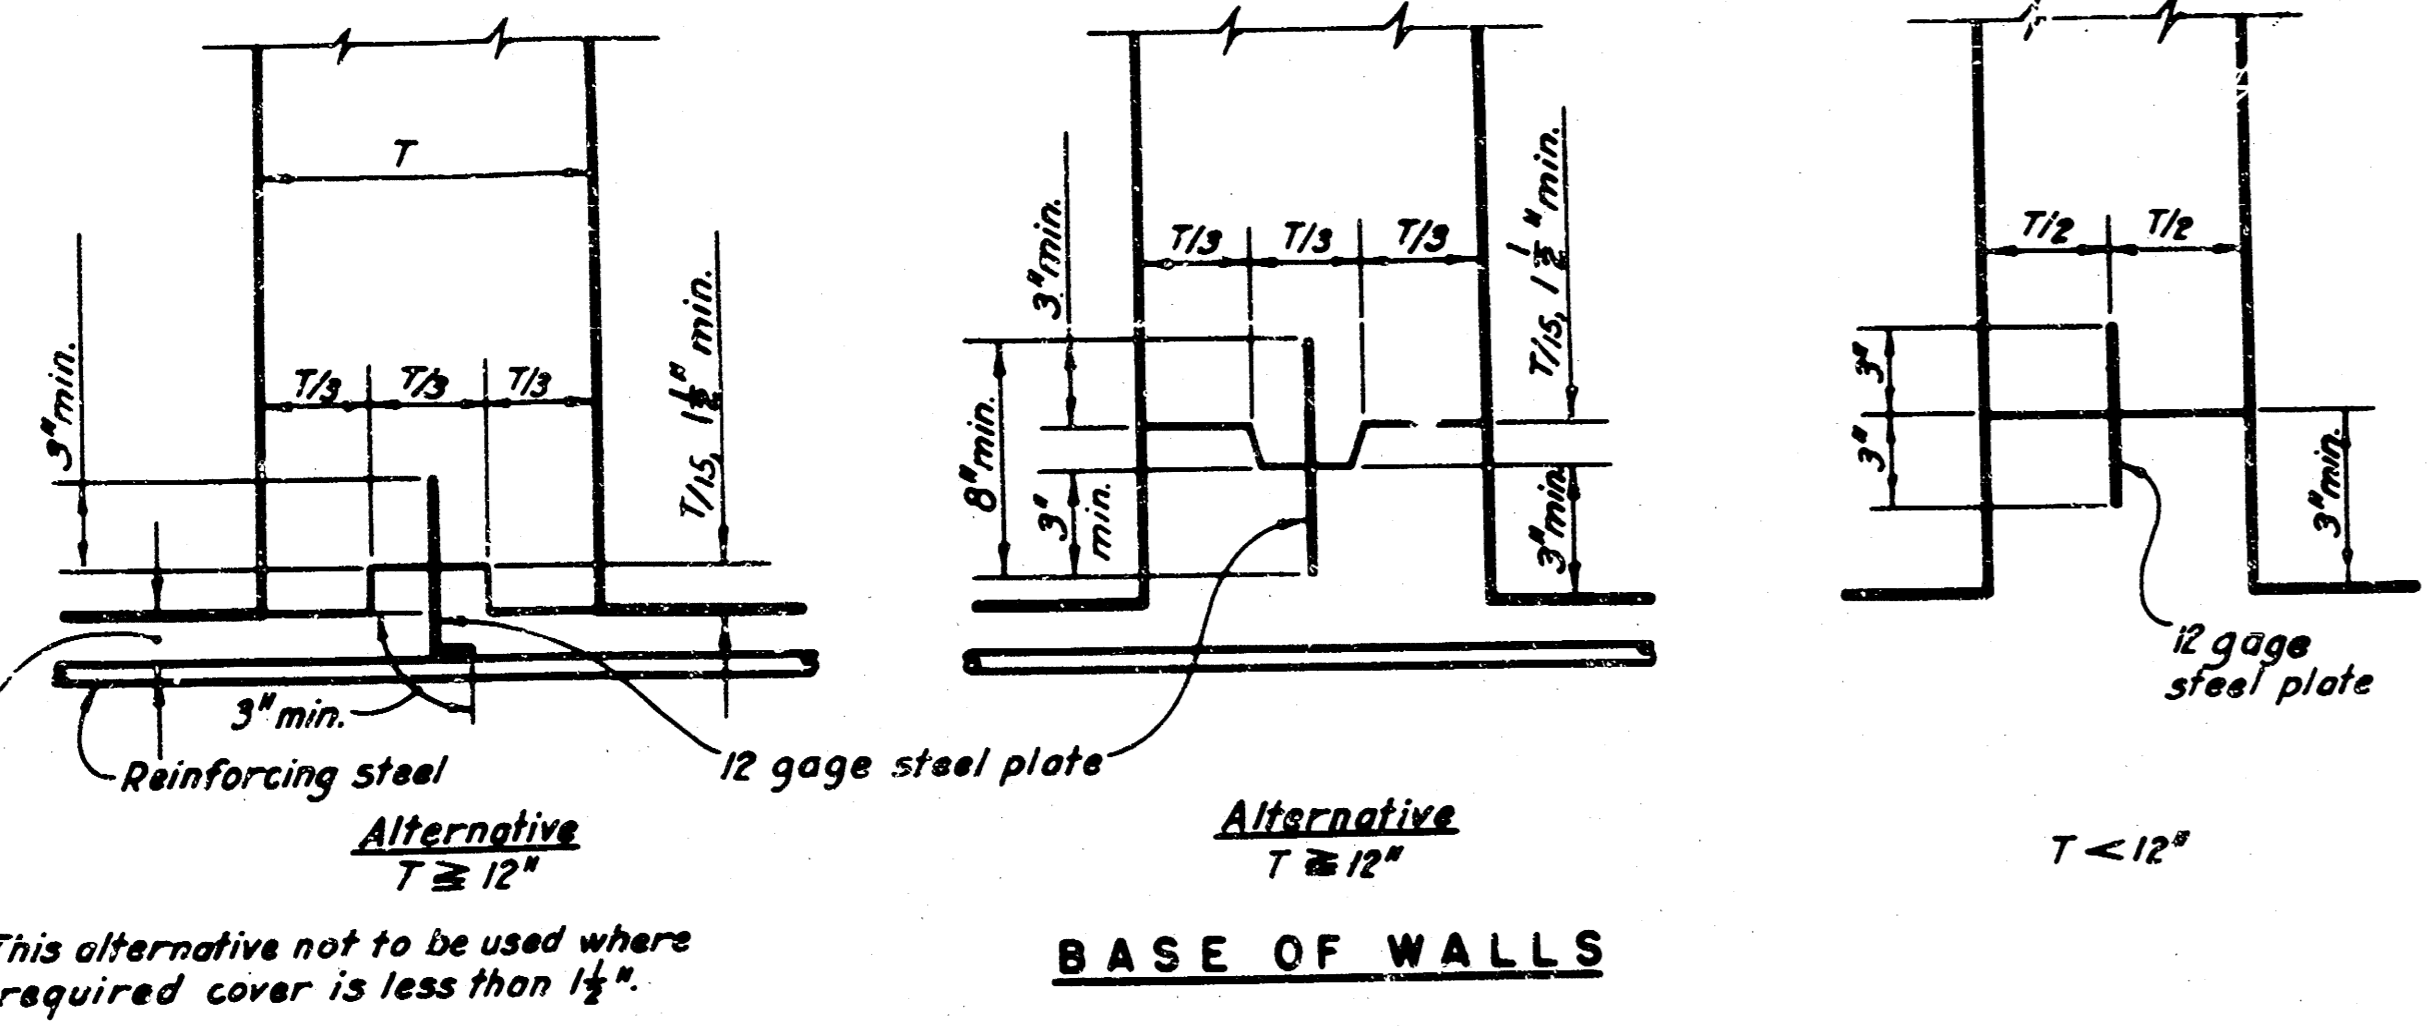


SPACERS FOR WALL REINFORCEMENT

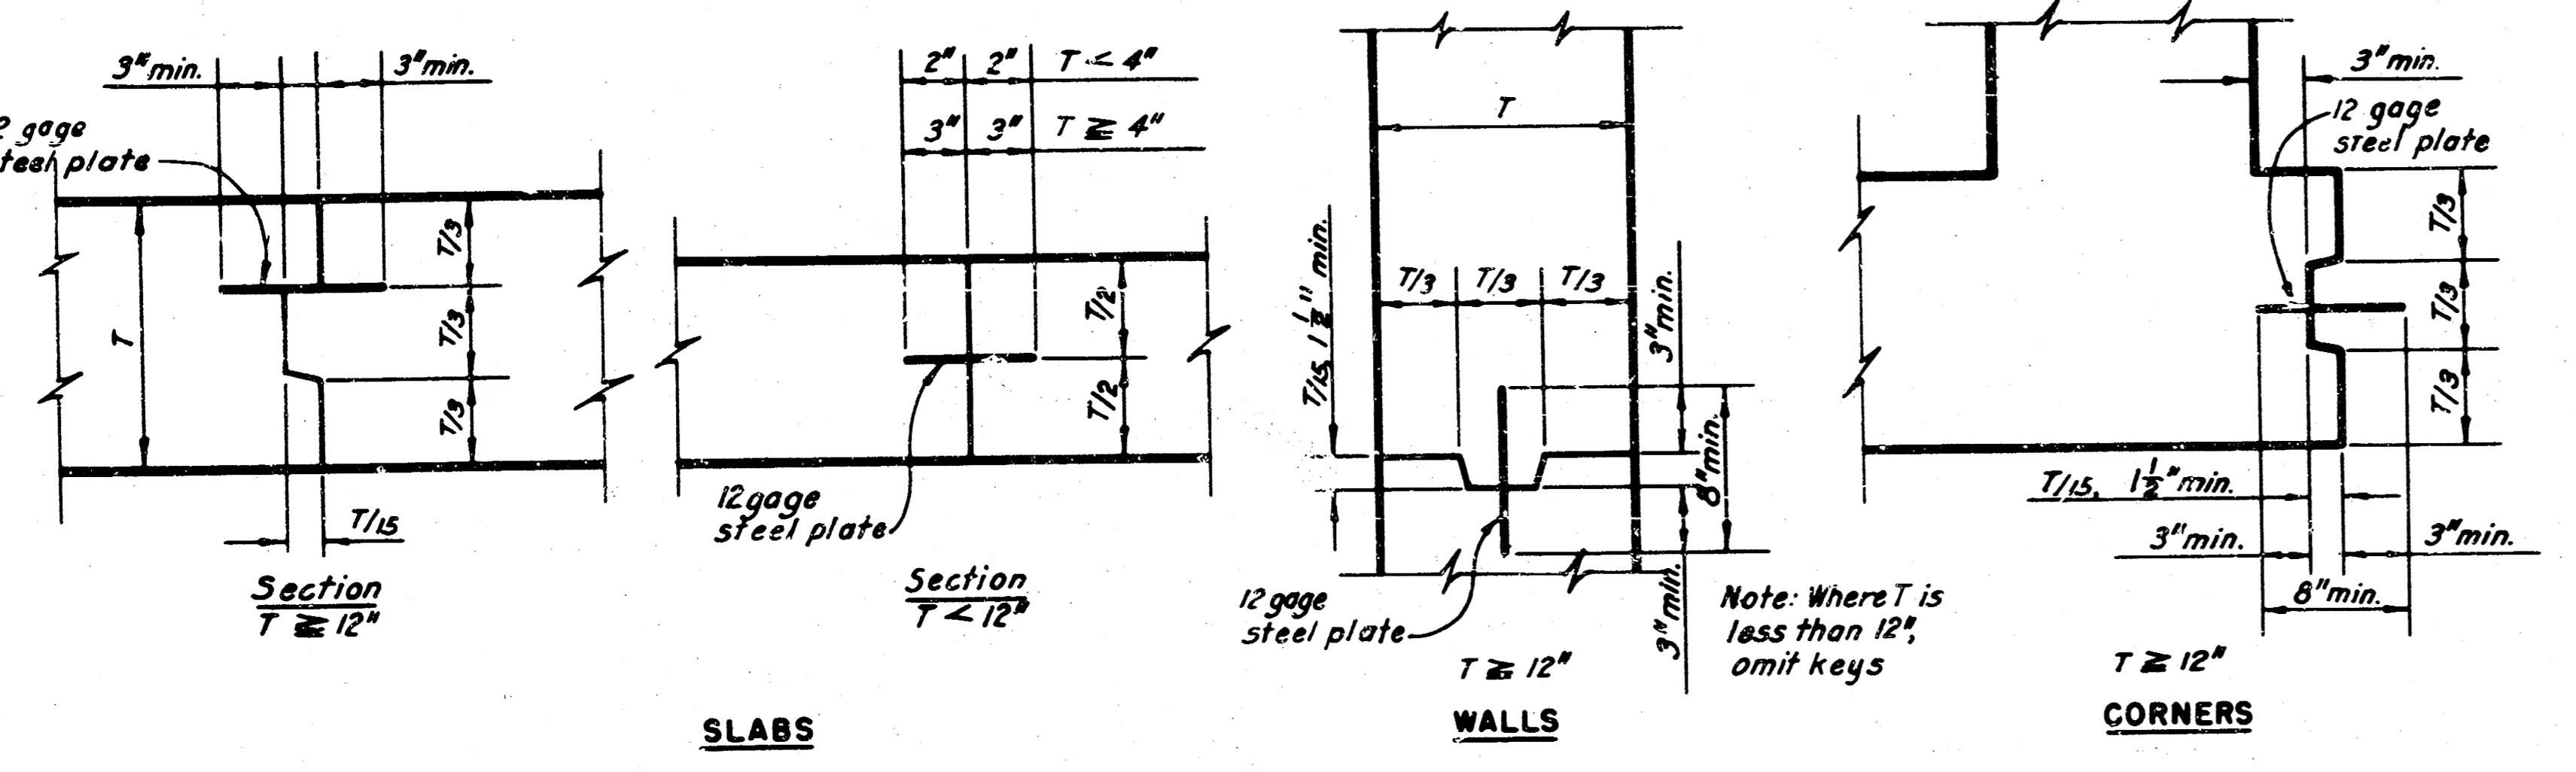

WATERTIGHT JOINTS

TYPICAL CONSTRUCTION JOINTS

Note: Reinforcing steel is to be carried across all construction joints.

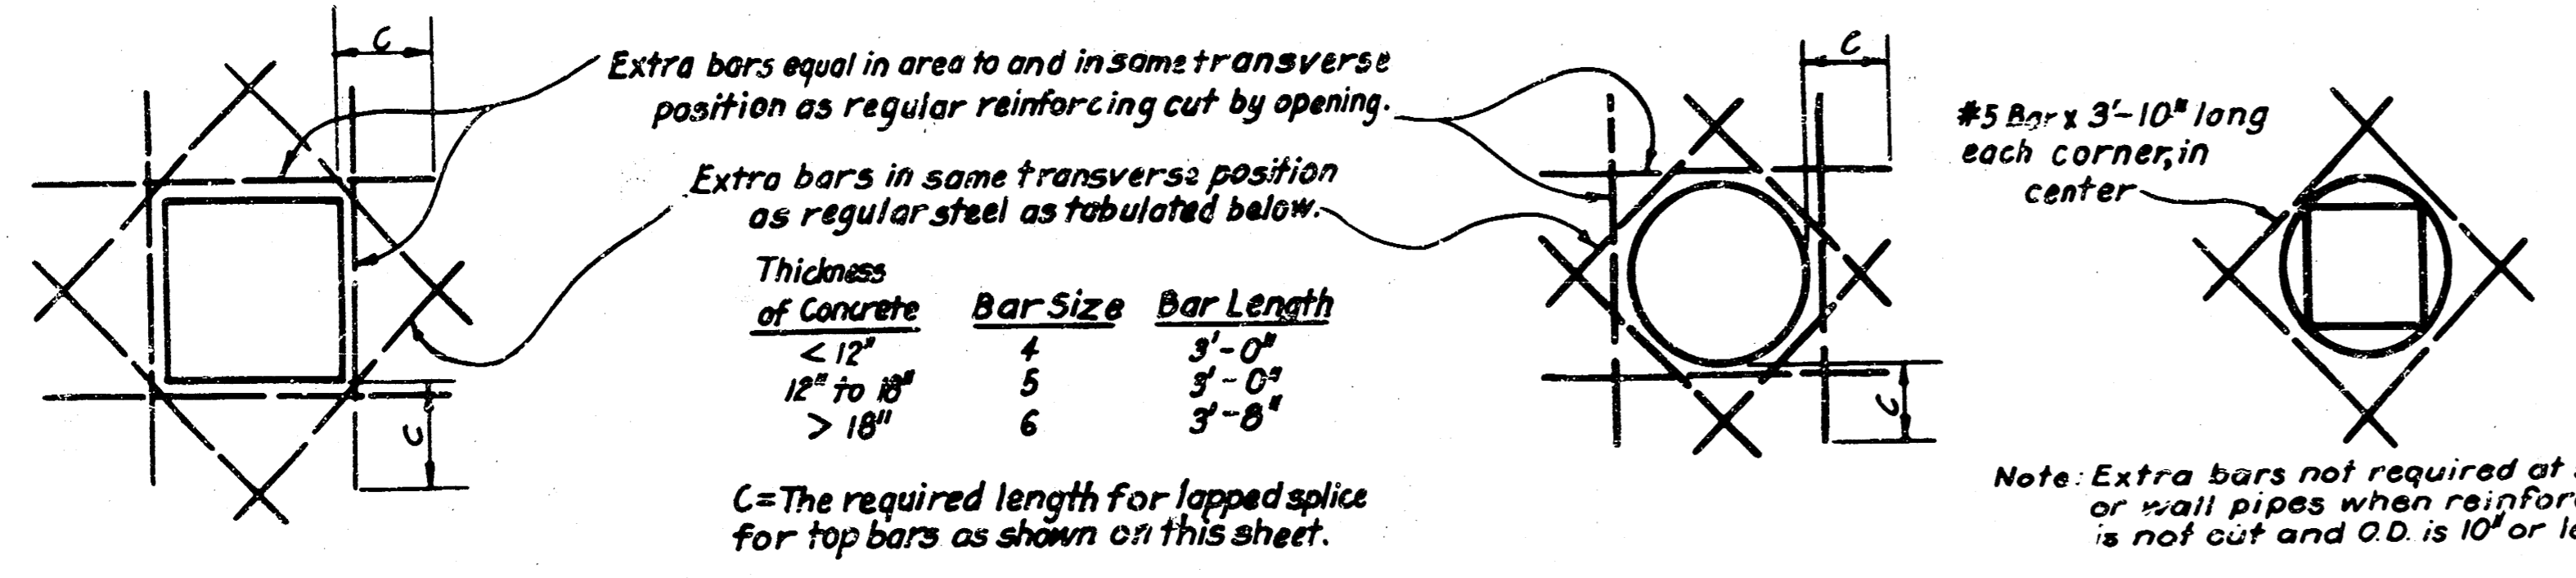

FOR RECTANGULAR OPENINGS LARGER THAN 2' DIAGONAL

FOR CIRCULAR OPENINGS LARGER THAN 2' DIAMETER

FOR OPENINGS 2' AND SMALLER IN DIAMETER OR DIAGONAL

TYPICAL EXTRA REINFORCING AT OPENINGS

BAR SIZE	LENGTH OF LAPPED SPLICES FOR REIN. ORCING IN INCHES		LENGTH OF EMBEDMENT FOR END ANCHORAGE OF REINFORCING WITH STANDARD HOOKS, IN INCHES	
	* TOP BARS	OTHERS	* TOP BARS	OTHERS
3	20	20	14	14
4	23	20	16	16
5	29	20	20	18
6	37	26	26	20
7	50	36	36	22
8	66	47	44	26
9	83	60	55	32
10	106	76	66	41
11	130	93	78	52
14	Not Permitted		108	79
18	Not Permitted		158	119


* Top bars are horizontal bars so placed that more than 12" of concrete is cast in the member below the bar. Horizontal bars in walls are to be provided with laps as required for top bars.

Except as otherwise indicated on the plans, embedment lengths for end anchorage and lapped splices shall be not less than (no minus tolerance) shown above. Lapped splices shall not be made at points of maximum stress as determined by the Engineer, and shall not be spaced closer than 6 inches on center. If splices are staggered so that no more than 1/2 are spliced in a lap splice length, the splice length can be reduced to 75% of the lengths tabulated above.


CONCRETE COVER FOR REINFORCEMENT

LOCATION	MINIMUM COVER
Unformed surfaces adjacent to excavation	3"
Formed or top surfaces exposed to weather or saturated air, submerged or in contact with earth	2"
#6 or larger bars	1 1/2"
#5 or smaller bars	1 1/4"
Other locations	
Bars in beams or girders, including stirrups and column spirals or ties	1 1/2"
Slabs, walls and joist	1 1/4"
#14 and #18	1 1/2"
#11 and smaller	1 1/4"

Cover for reinforcing steel shall not be less than the minimum given above (no minus tolerance), and shall not exceed the minimum by more than 1/4 inch where the concrete thickness is 24 inches or less, or more than 1/2 inch where the concrete thickness is more than 24 inches.

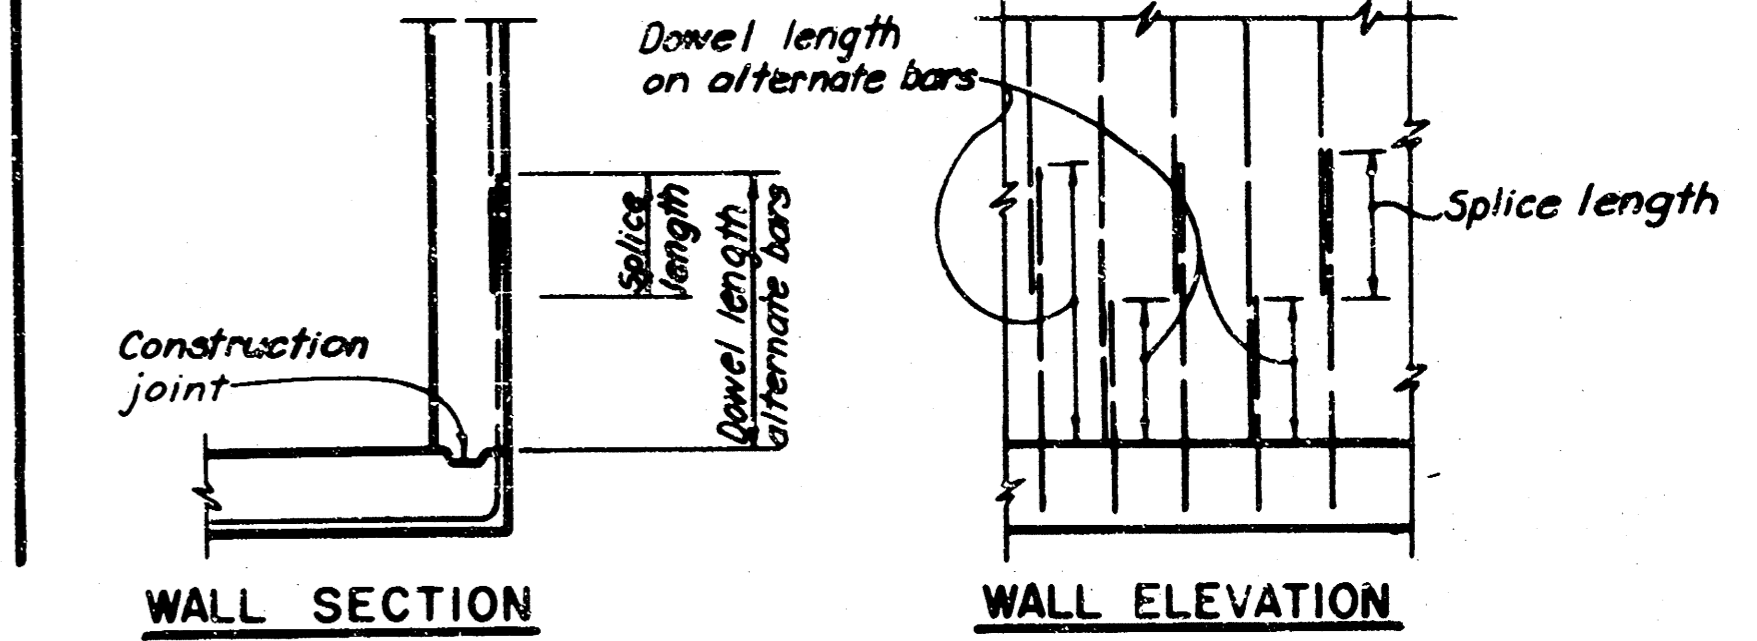

TYPICAL WALL JOINT REINFORCING DETAILS FOR ALTERNATING DOWEL LENGTHS

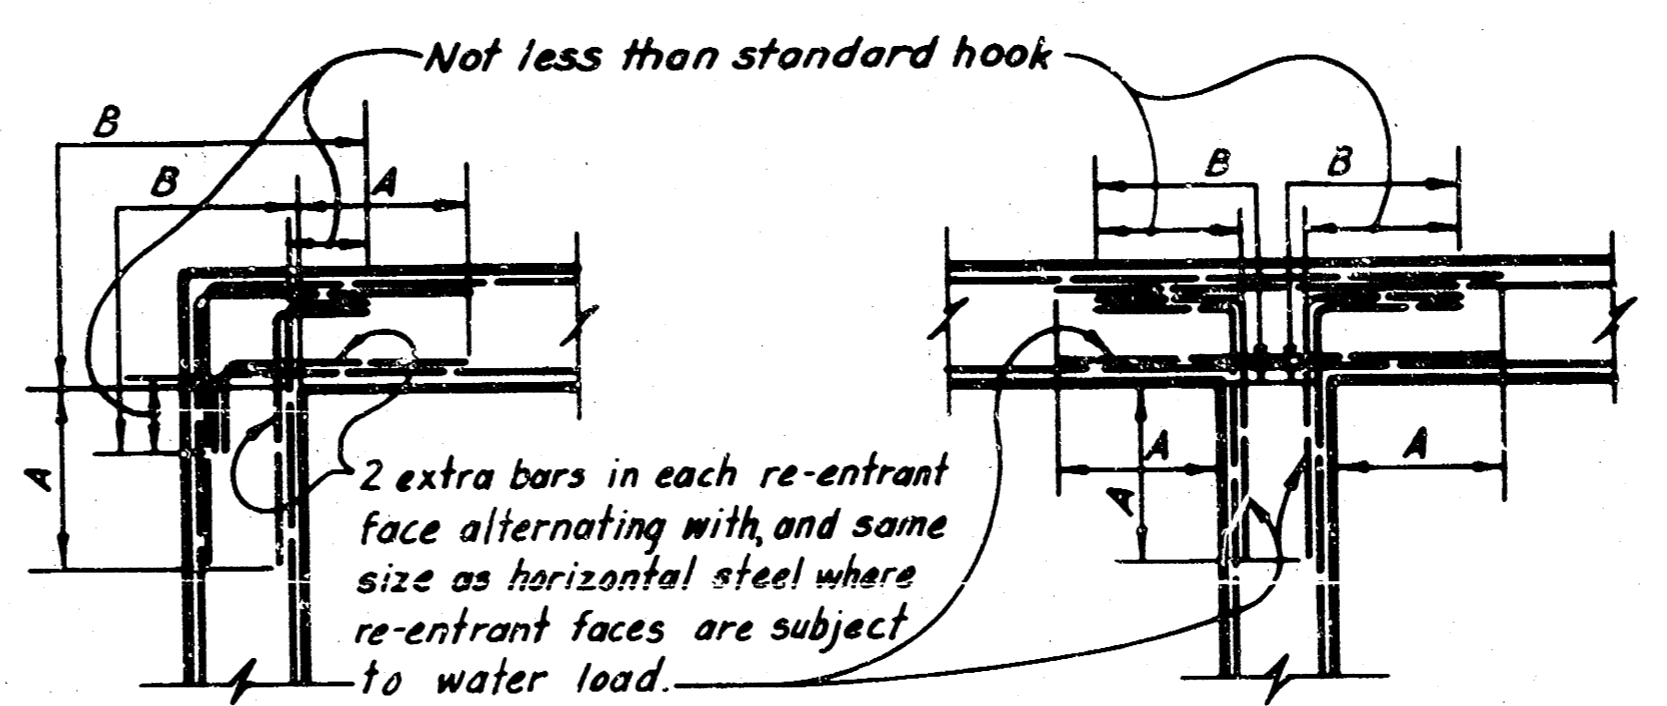


A = 1/2 the clear span distance measured horizontally or 0.4 the clear span or cantilever measured vertically, whichever is the smaller; but in no case less than the required length of lapped splices for top bars, as shown on this sheet. The 'A' dimension for one-half of the extra bars can be reduced by 30%.


Note: Vertical reinforcing not shown. B = Sufficient length to permit bars to extend through the wall to the opposite face and terminate in a standard hook but shall not be less than the length required for embedment of top bars, as shown on this sheet.

D = not less than the length required for lapped splices for top bars, as shown on this sheet.

TYPICAL CORNER REINFORCING DETAILS

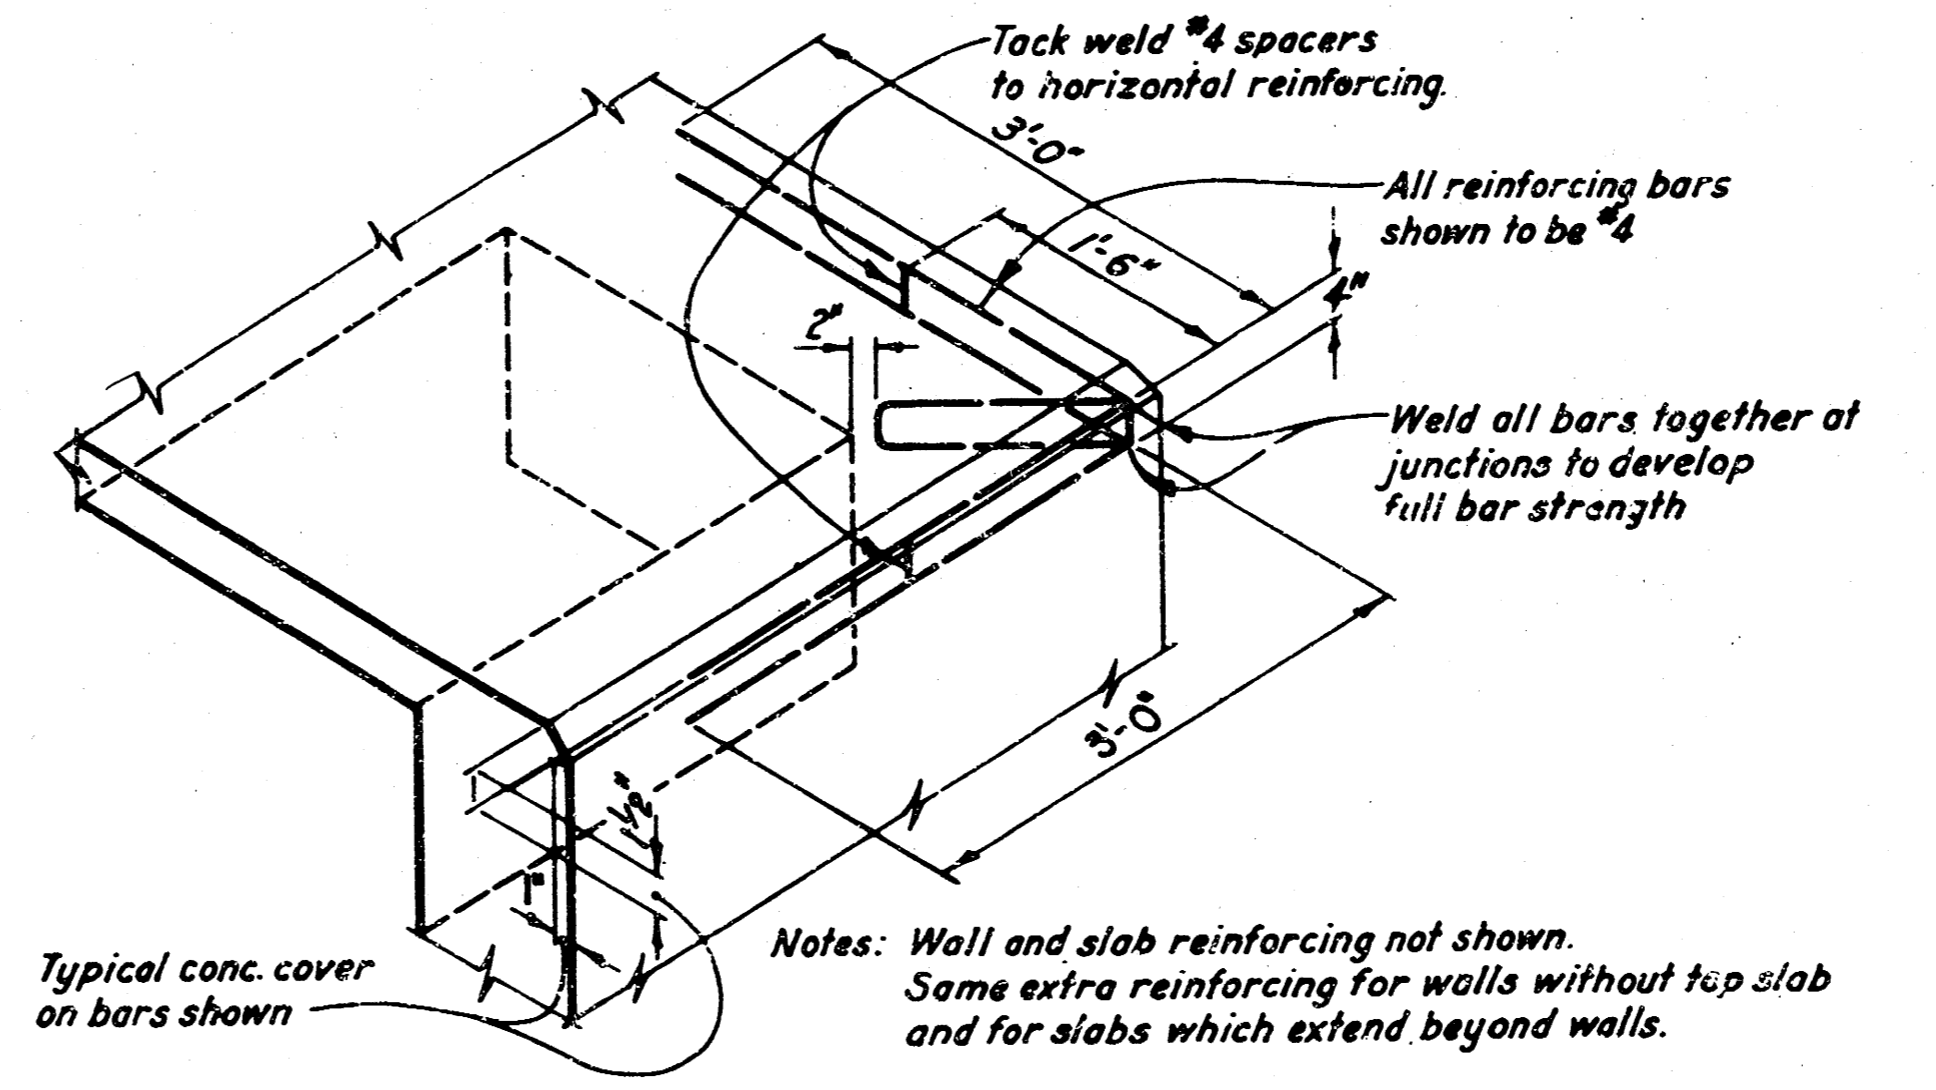

EXTRA CORNER REINFORCING AT TOP OF WALLS AND/OR SLABS WHICH ARE TO SUPPORT MASONRY

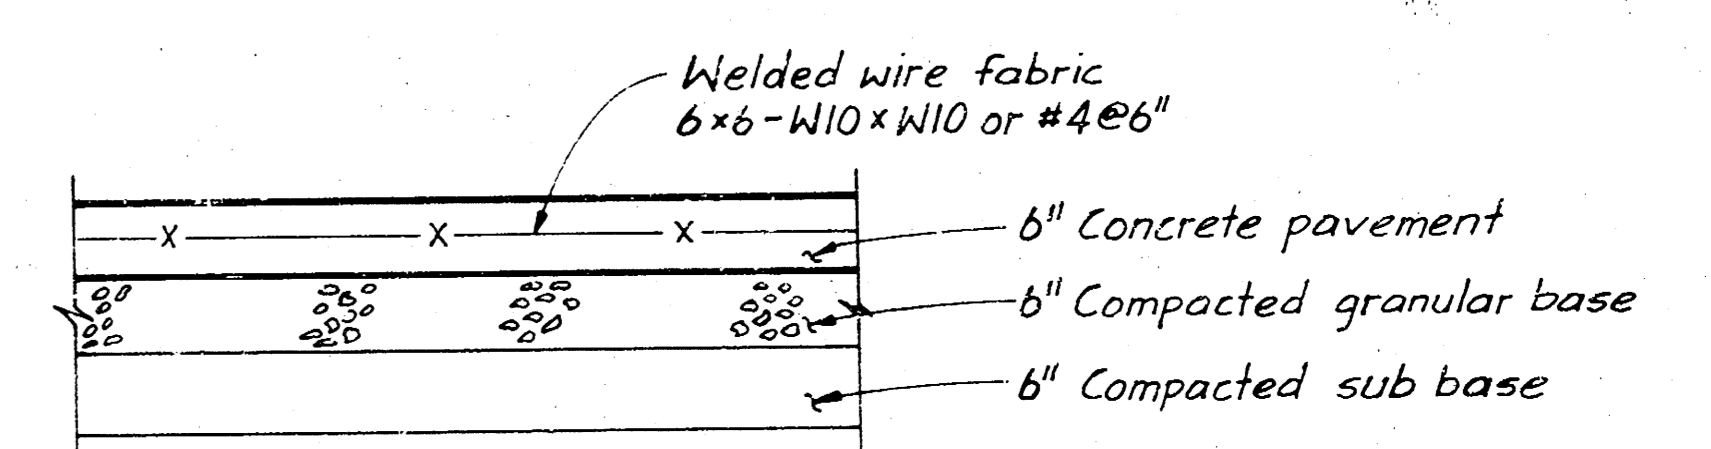


Notes:
1. Provide sawed joint at 10'-0" on centers
2. Provide 1/2" Exp. joint material between pavement & new structure.

CONCRETE PAVEMENT SECTION

No Scale

GENERAL NOTE:
Details on this sheet apply to the entire set of plans except where specifically shown otherwise.

BOEING MILITARY AIRPLANE CO.
INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS

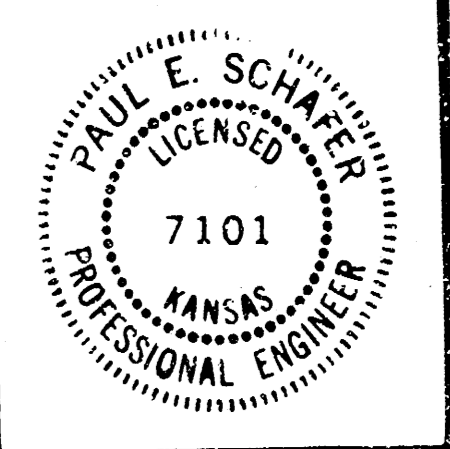

SHEET 6 OF 9


PROJECT NO.
11903.001

DESIGNED: MPS
CHECKED: JLR
APPROVED: RAM
DATE: 3/12/84




STANDARD CONCRETE DETAILS


FILMED FROM THE BEST AVAILABLE COPY

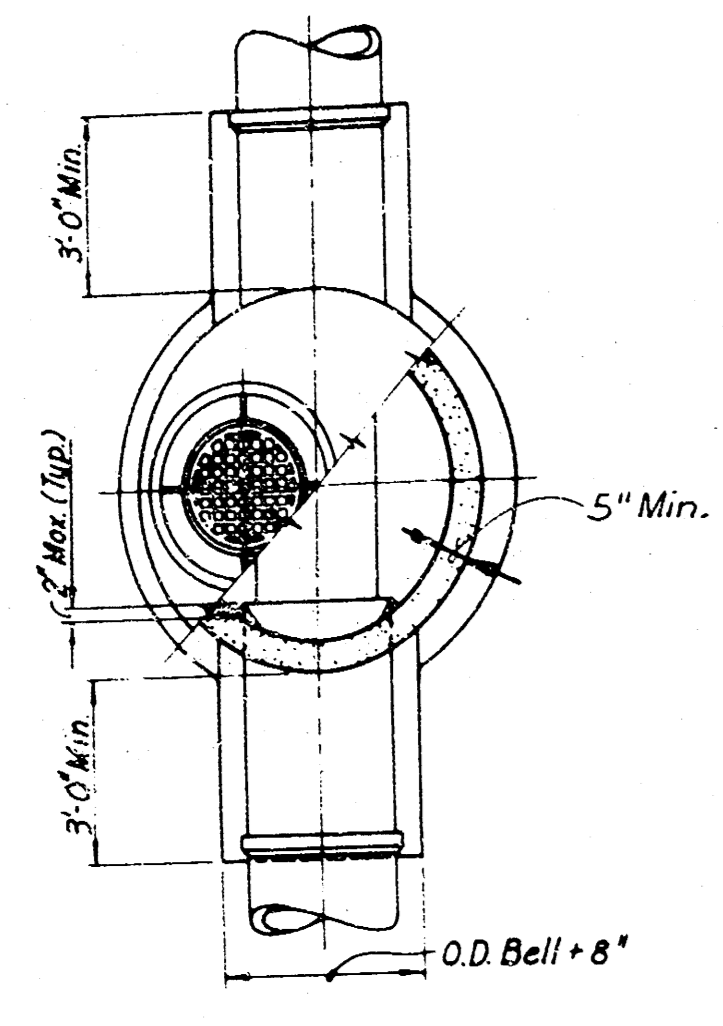


PLAN AND SECTIONAL PLAN

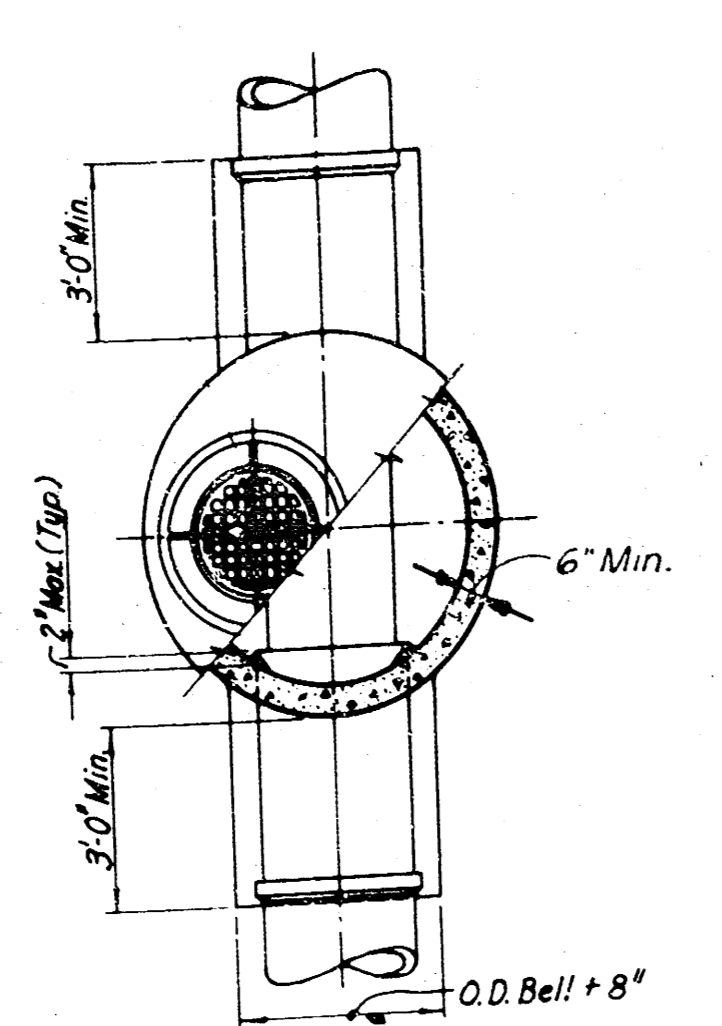

PLAN AND SECTIONAL PLAN

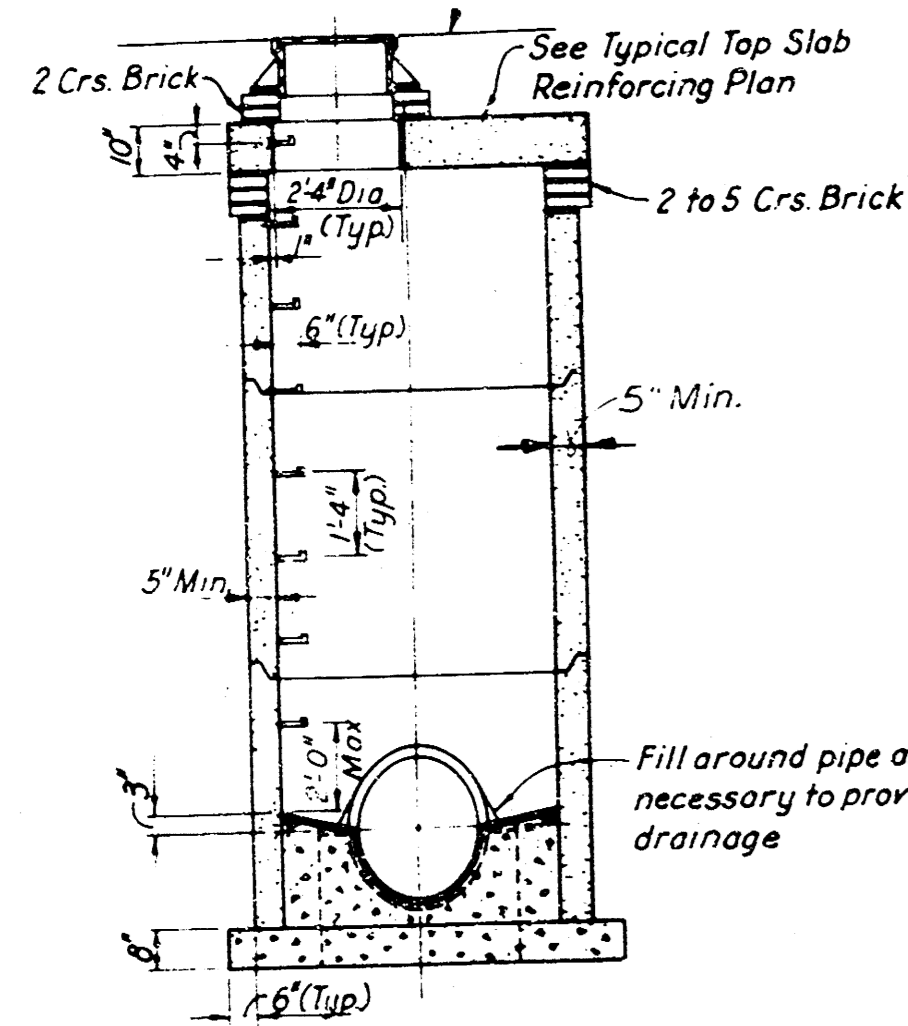


STANDARD SECTION

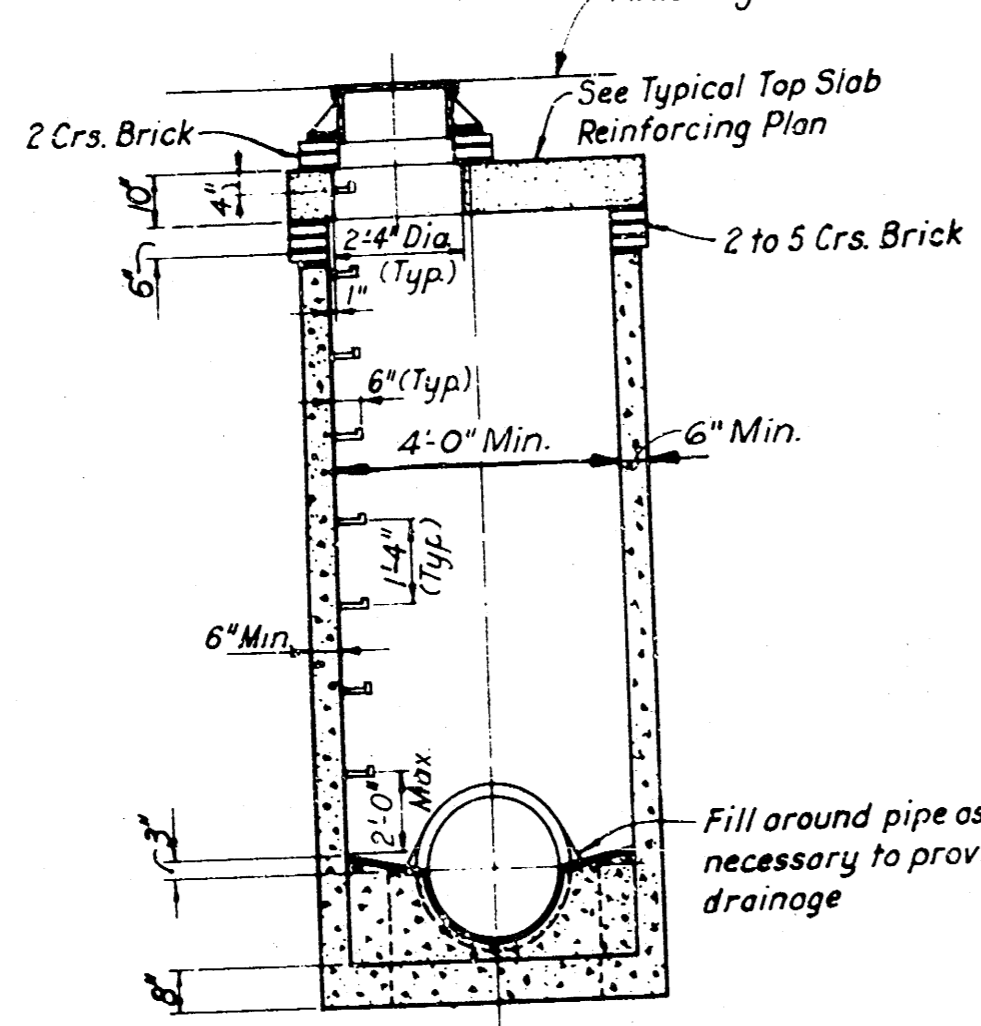


STANDARD SECTION


CONCRETE POURED IN PLACE MANHOLE

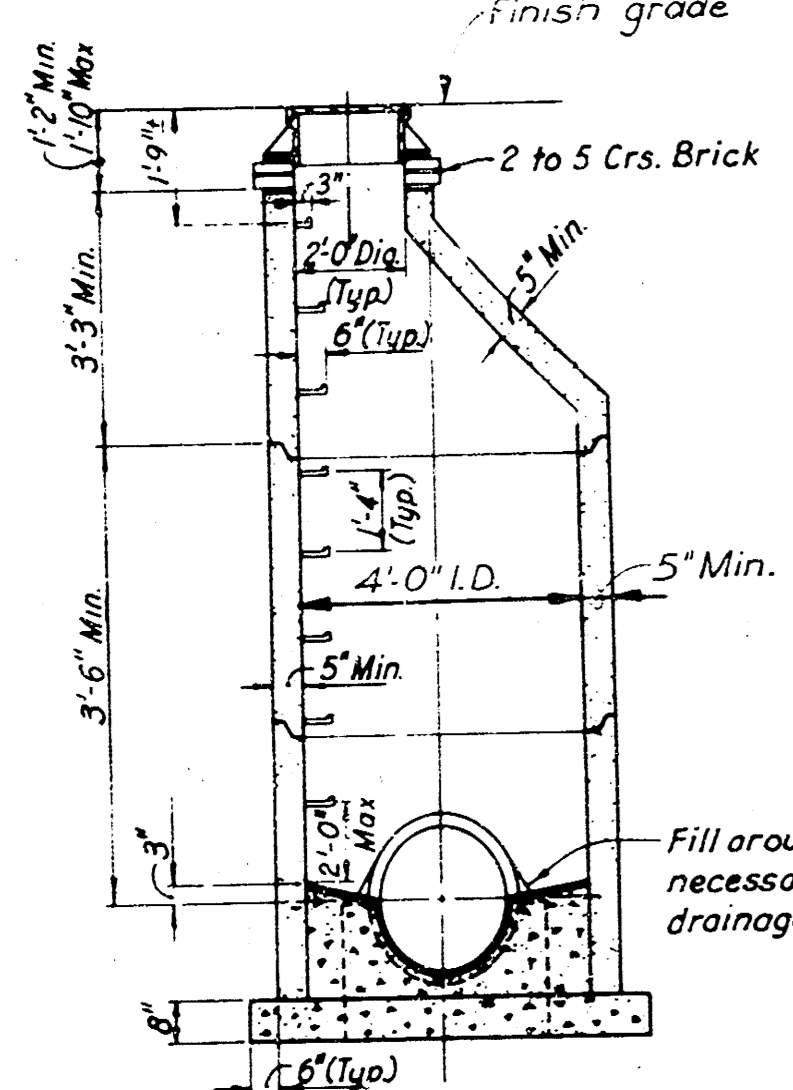

ALTERNATIVE STANDARD SECTION

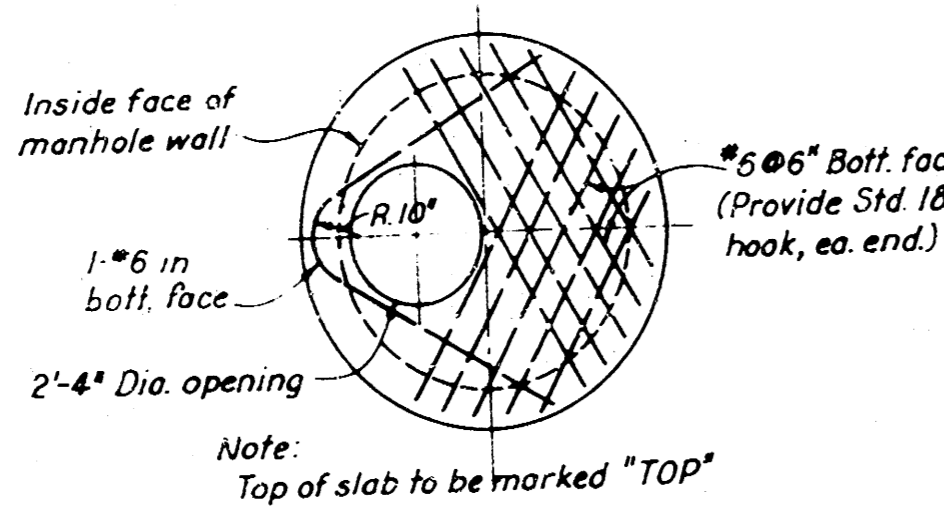

TYPICAL TOP SLAB REINFORCING PLAN

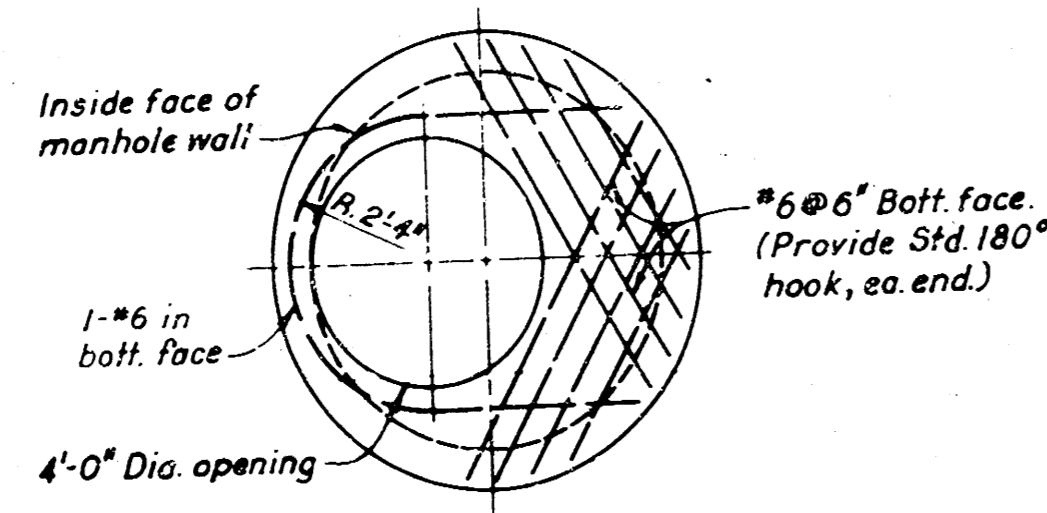


TYPICAL REDUCER SLAB REINFORCING PLAN

GENERAL MANHOLE NOTES

- All manhole rings to be set in mortar.
- Any material excavated beneath pipe entering or leaving manholes shall be replaced with concrete; such concrete fill shall extend to the center of the pipe for a distance of at least 3'-0" from face of manhole and shall terminate at a bell.
- Wall reinforcing in precast manhole circular sections to be ASTM C-76 Class III.
- Manhole inverts in precast manholes to be grouted in with expanding grout.
- Manhole steps shown as poured concrete. At contractor's option, inverts may be built up using brick and mortar. Provide 1" minimum cement mortar finish, all inverts.

LEGEND

- Concrete poured in place
- Precast concrete
- Brick masonry

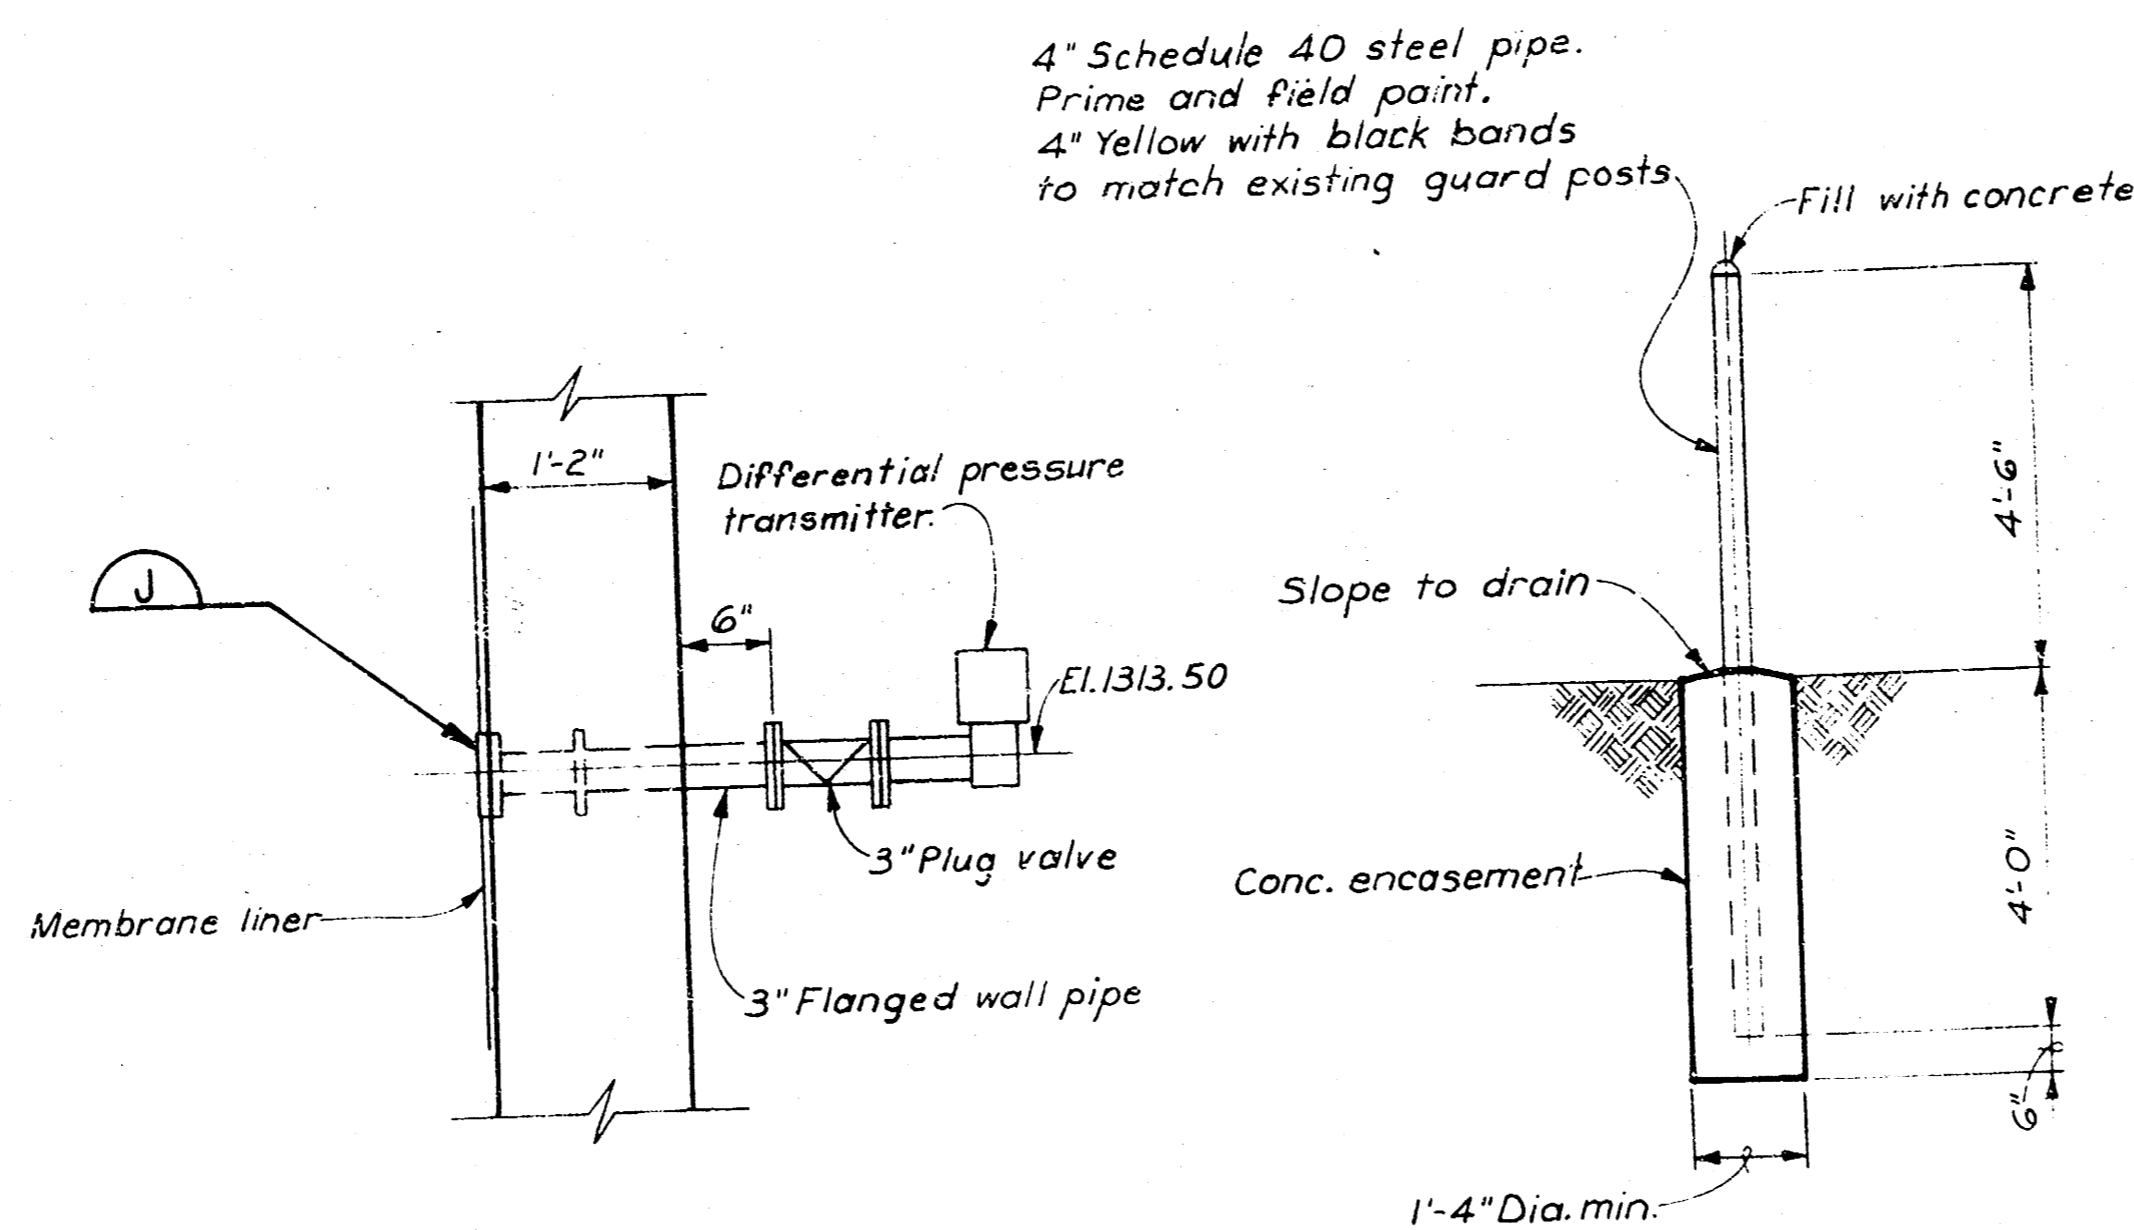

DIFFERENTIAL PRESSURE TRANSMITTER DETAIL

No Scale

GUARD POST DETAIL


No Scale

VENT DETAIL

No Scale

PIPE SUPPORT DETAIL

No Scale

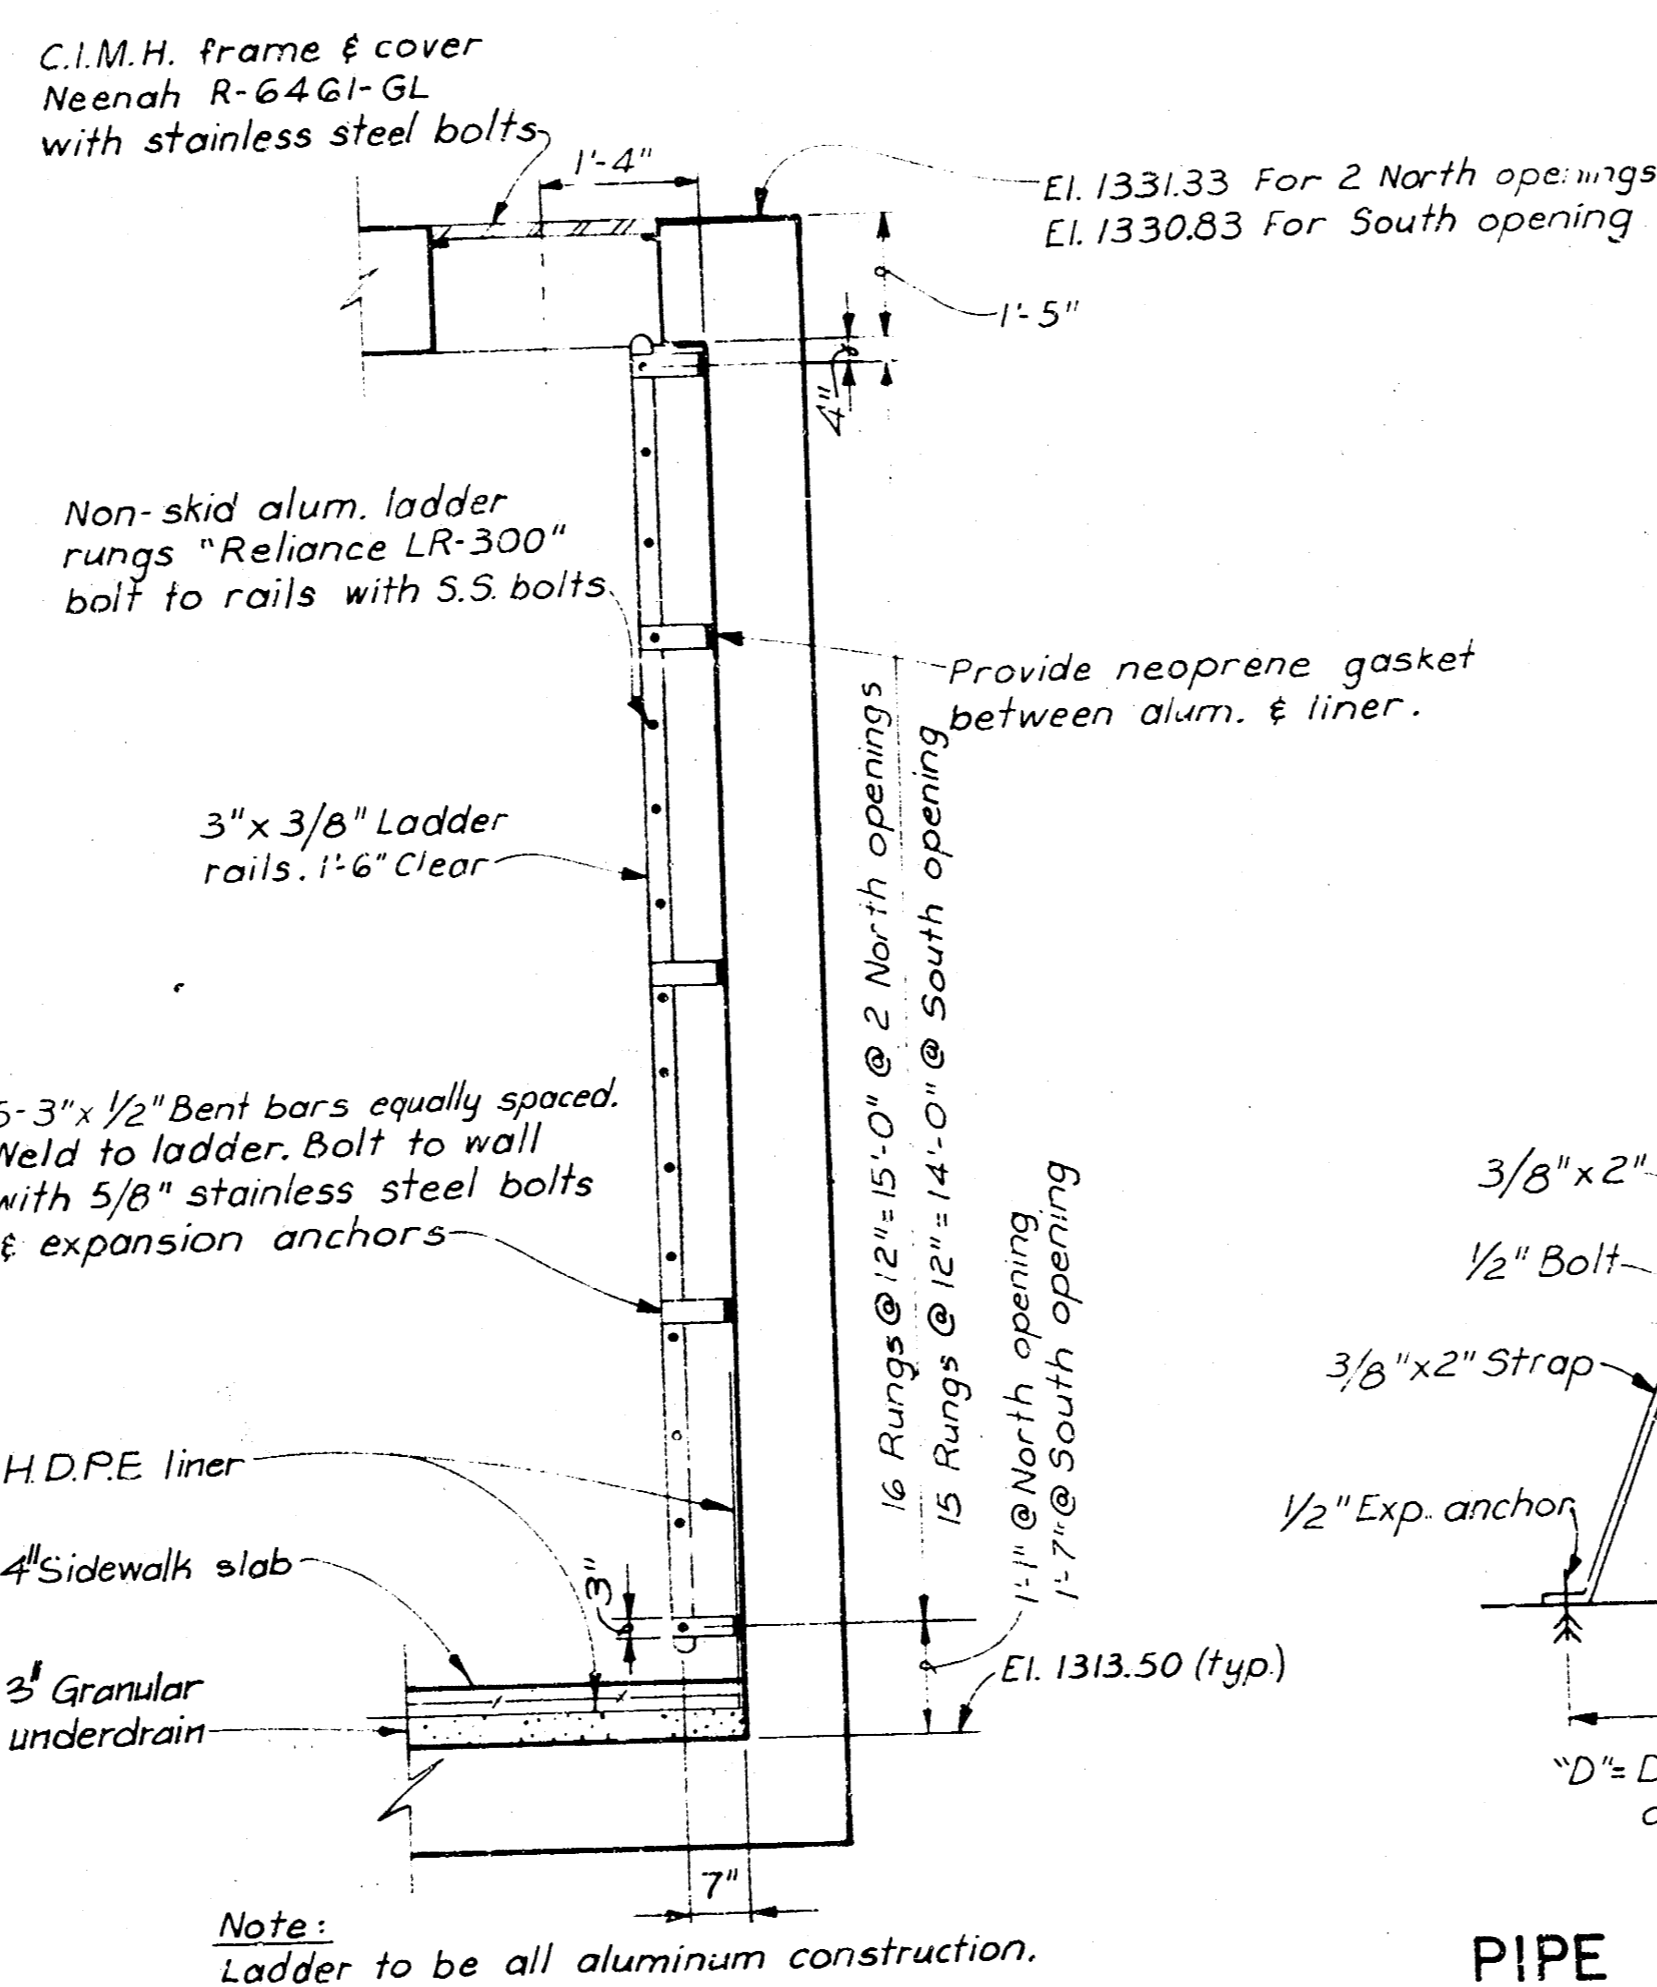

LADDER DETAIL


No Scale

PIPE SIZE	SLEEVE SIZE
1/2"	* 2"
3/4" & 1"	* 3"
1 1/4" & 1 1/2"	* 3 1/2"
2" & 2 1/2"	* 4"
3" & 3 1/2"	* 5"
4"	* 6"

Larger than 4" Pipe O.D. + 2" (1)
 * Schedule 40 std steel pipe
 (1) Fabricate with 1/4" Plate


SLEEVE DETAIL

No Scale

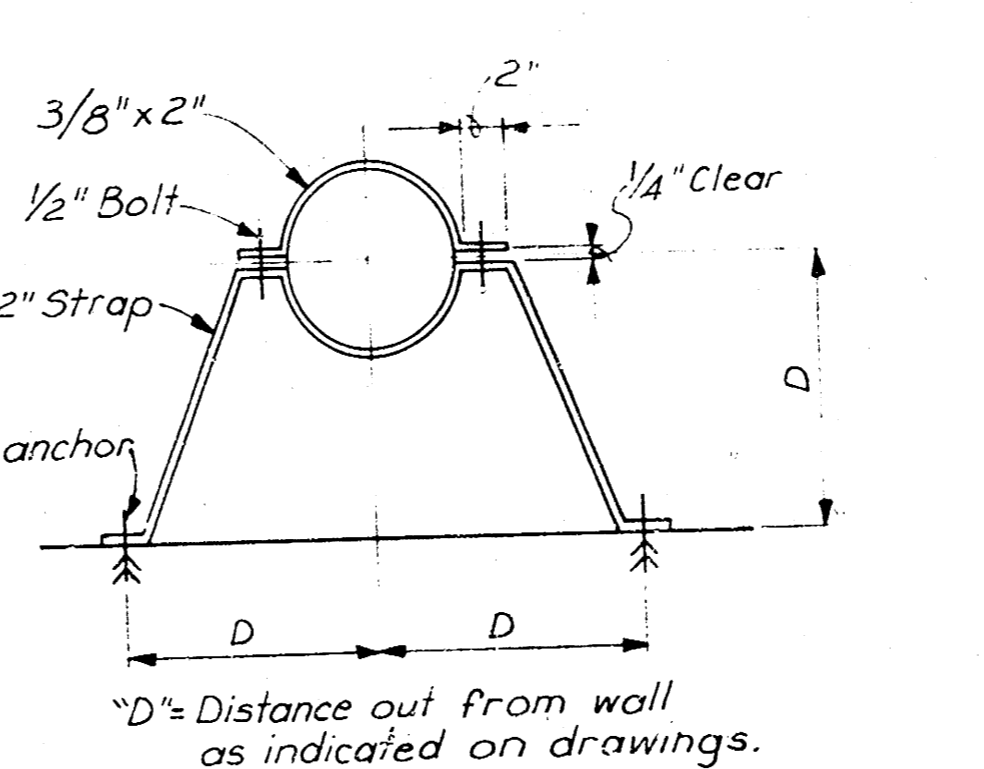


PIPE SUPPORT DETAIL

No Scale

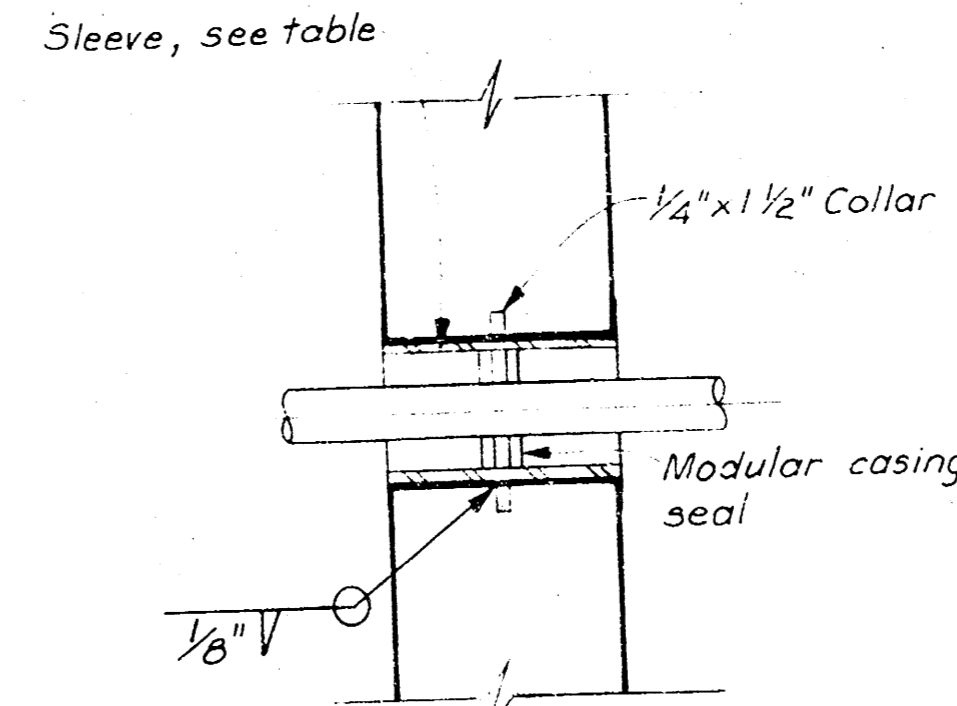


SLEEVE DETAIL

No Scale

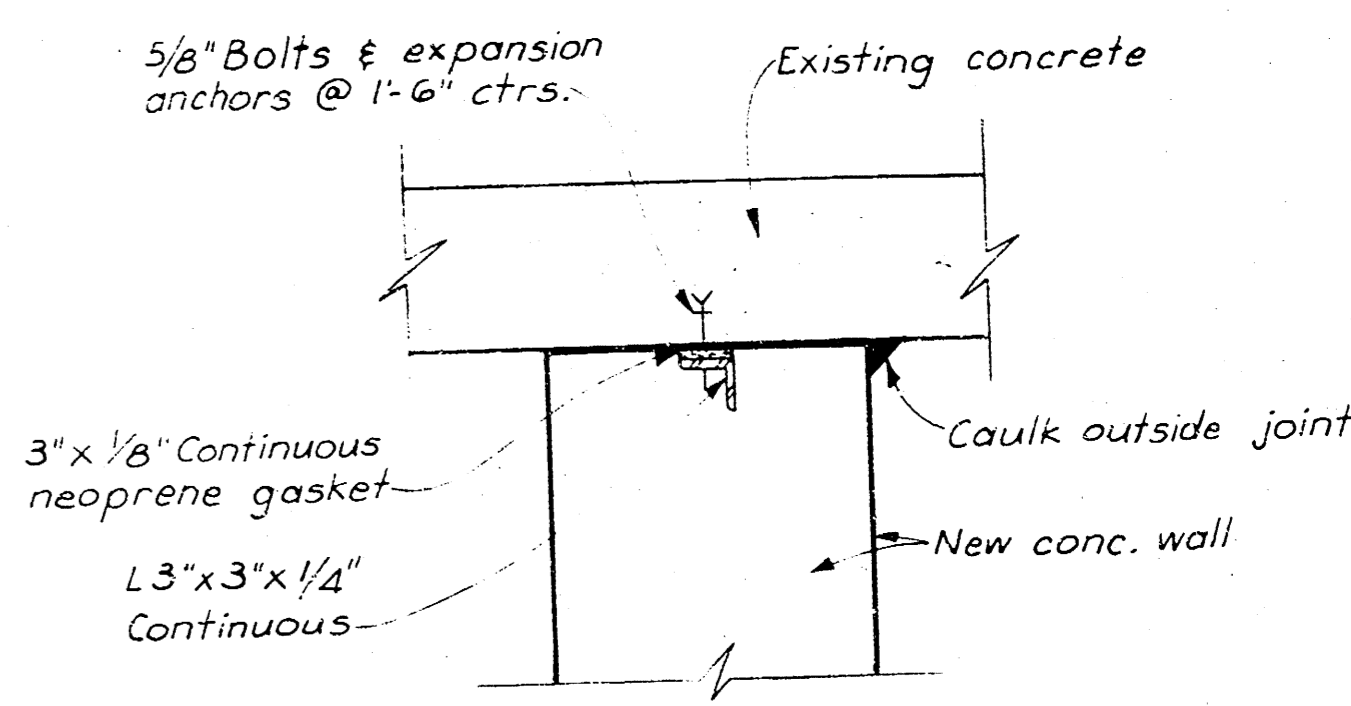


CONNECTION DETAIL

No Scale

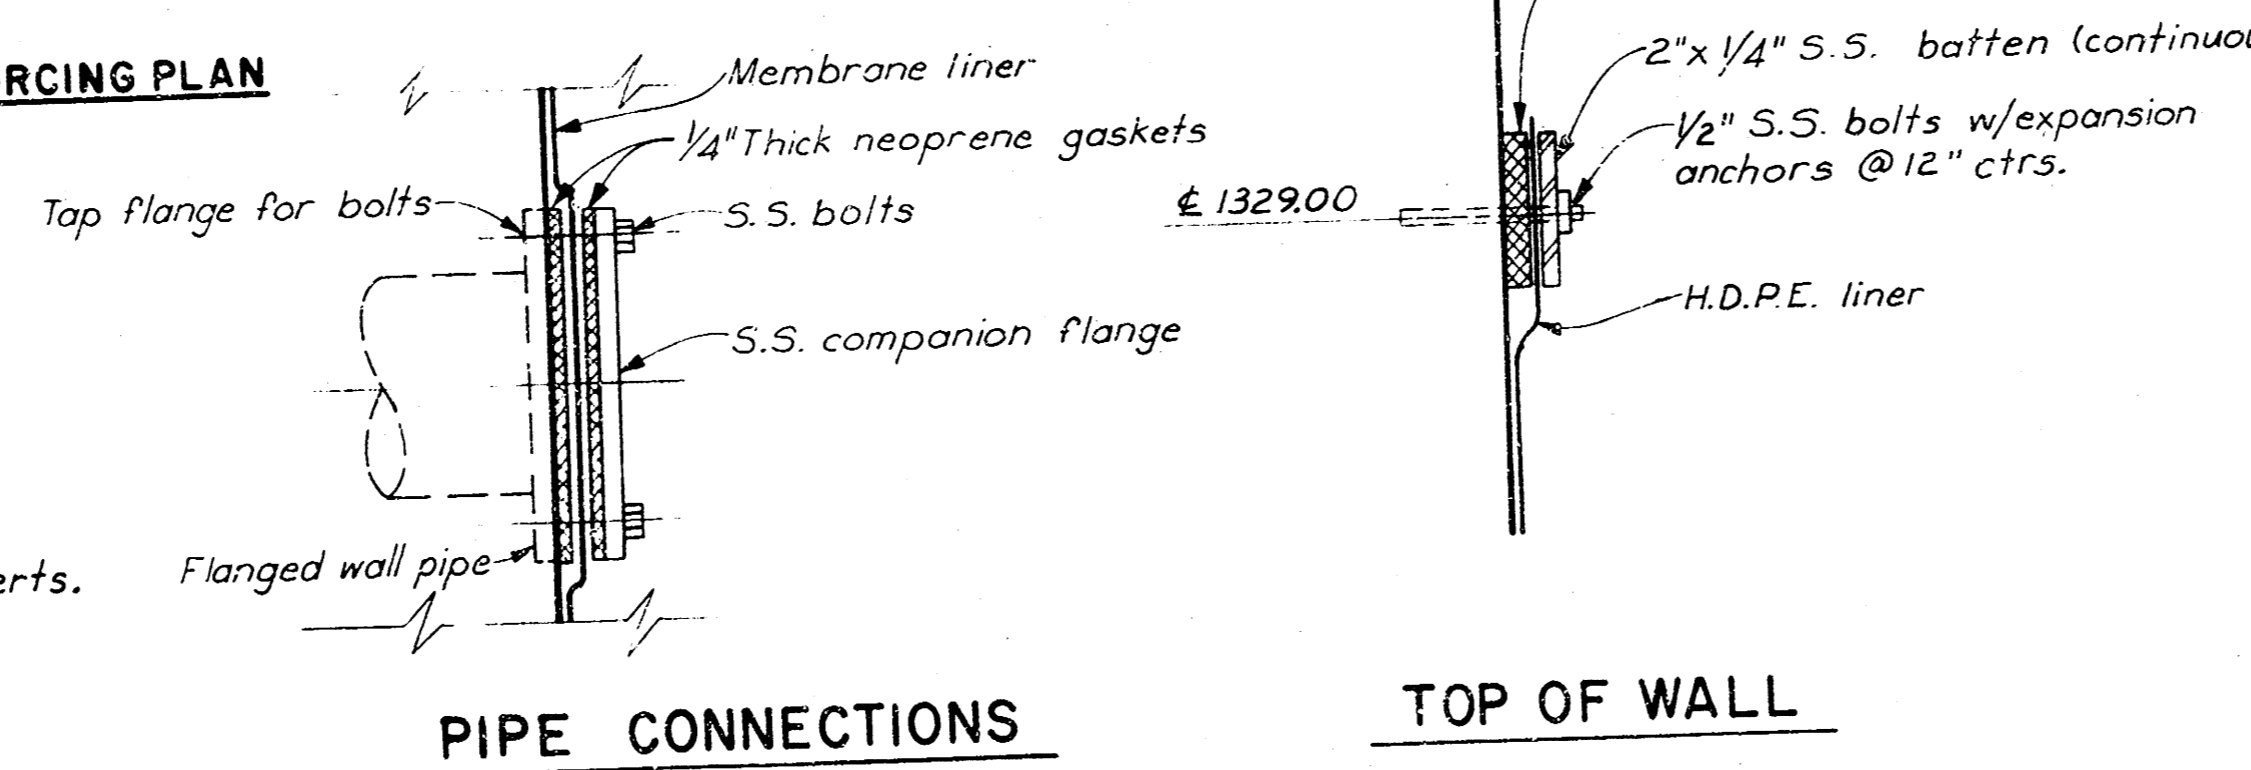

MEMBRANE LINER CONNECTION DETAILS

No Scale

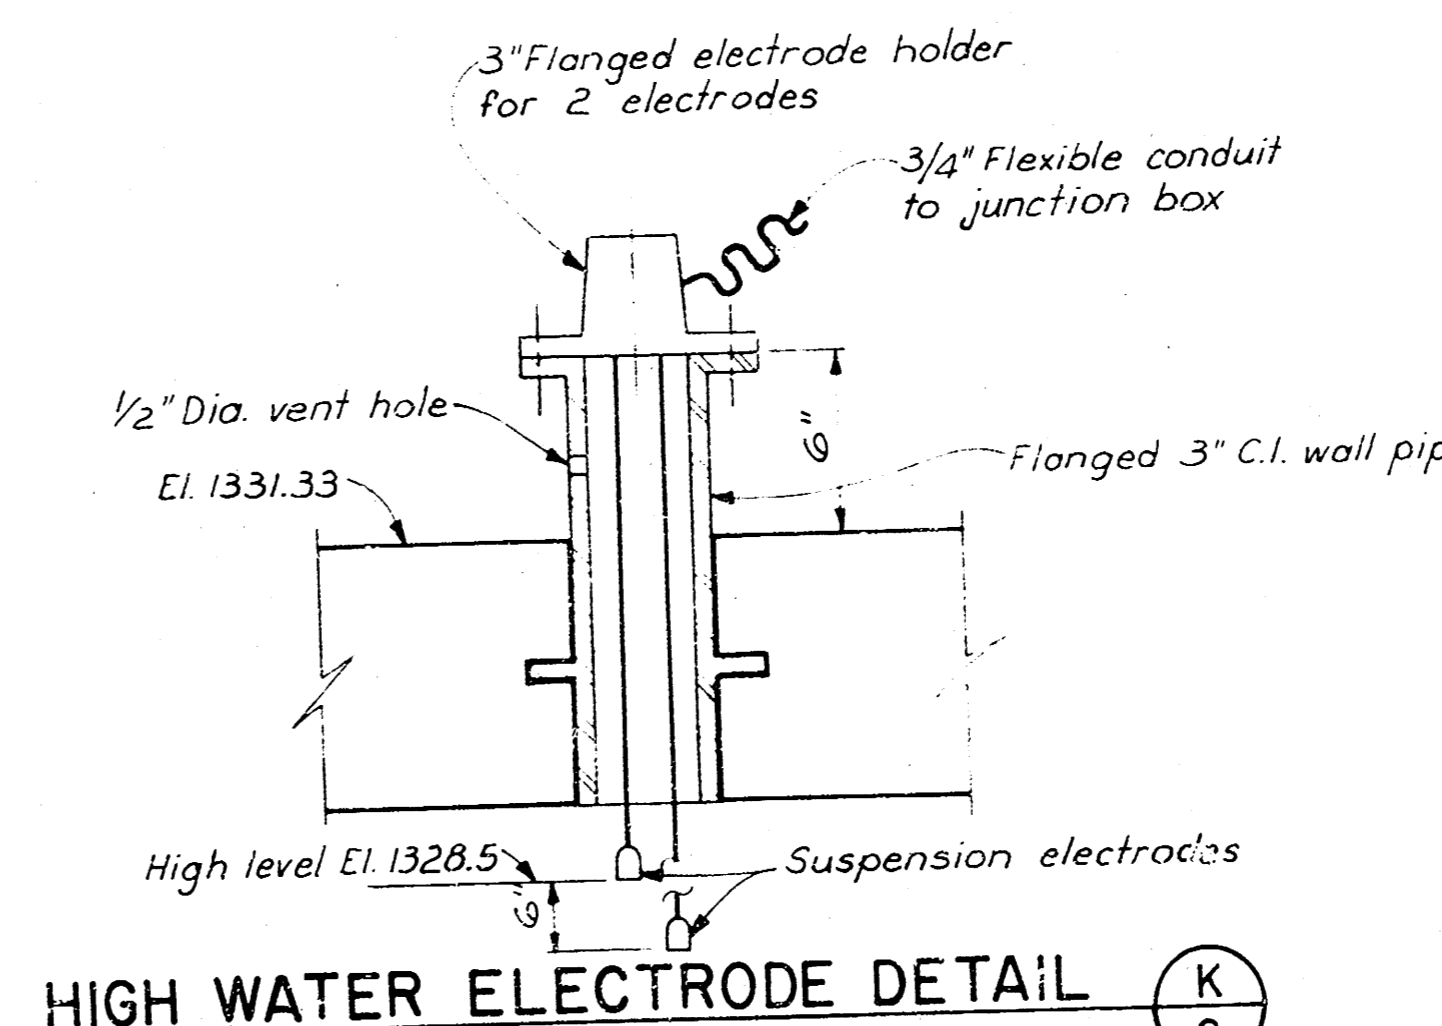

HIGH WATER ELECTRODE DETAIL

No Scale

BASE DETAIL

No Scale

NO.	BY	CHK	APP	DATE	REVISIONS AND RECORD OF ISSUE


DESIGNED	MP S
DETAILED	SCH
CHECKED	RAM
APPROVED	
DATE	3/Dec 01



PROJECT NO. 11903.001


BOEING MILITARY AIRPLANE CO. INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS

MISCELLANEOUS DETAILS

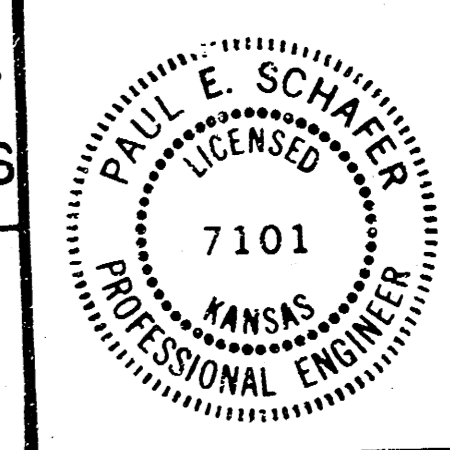


SHEET 7 OF 9


FILMED FROM THE BEST AVAILABLE COPY

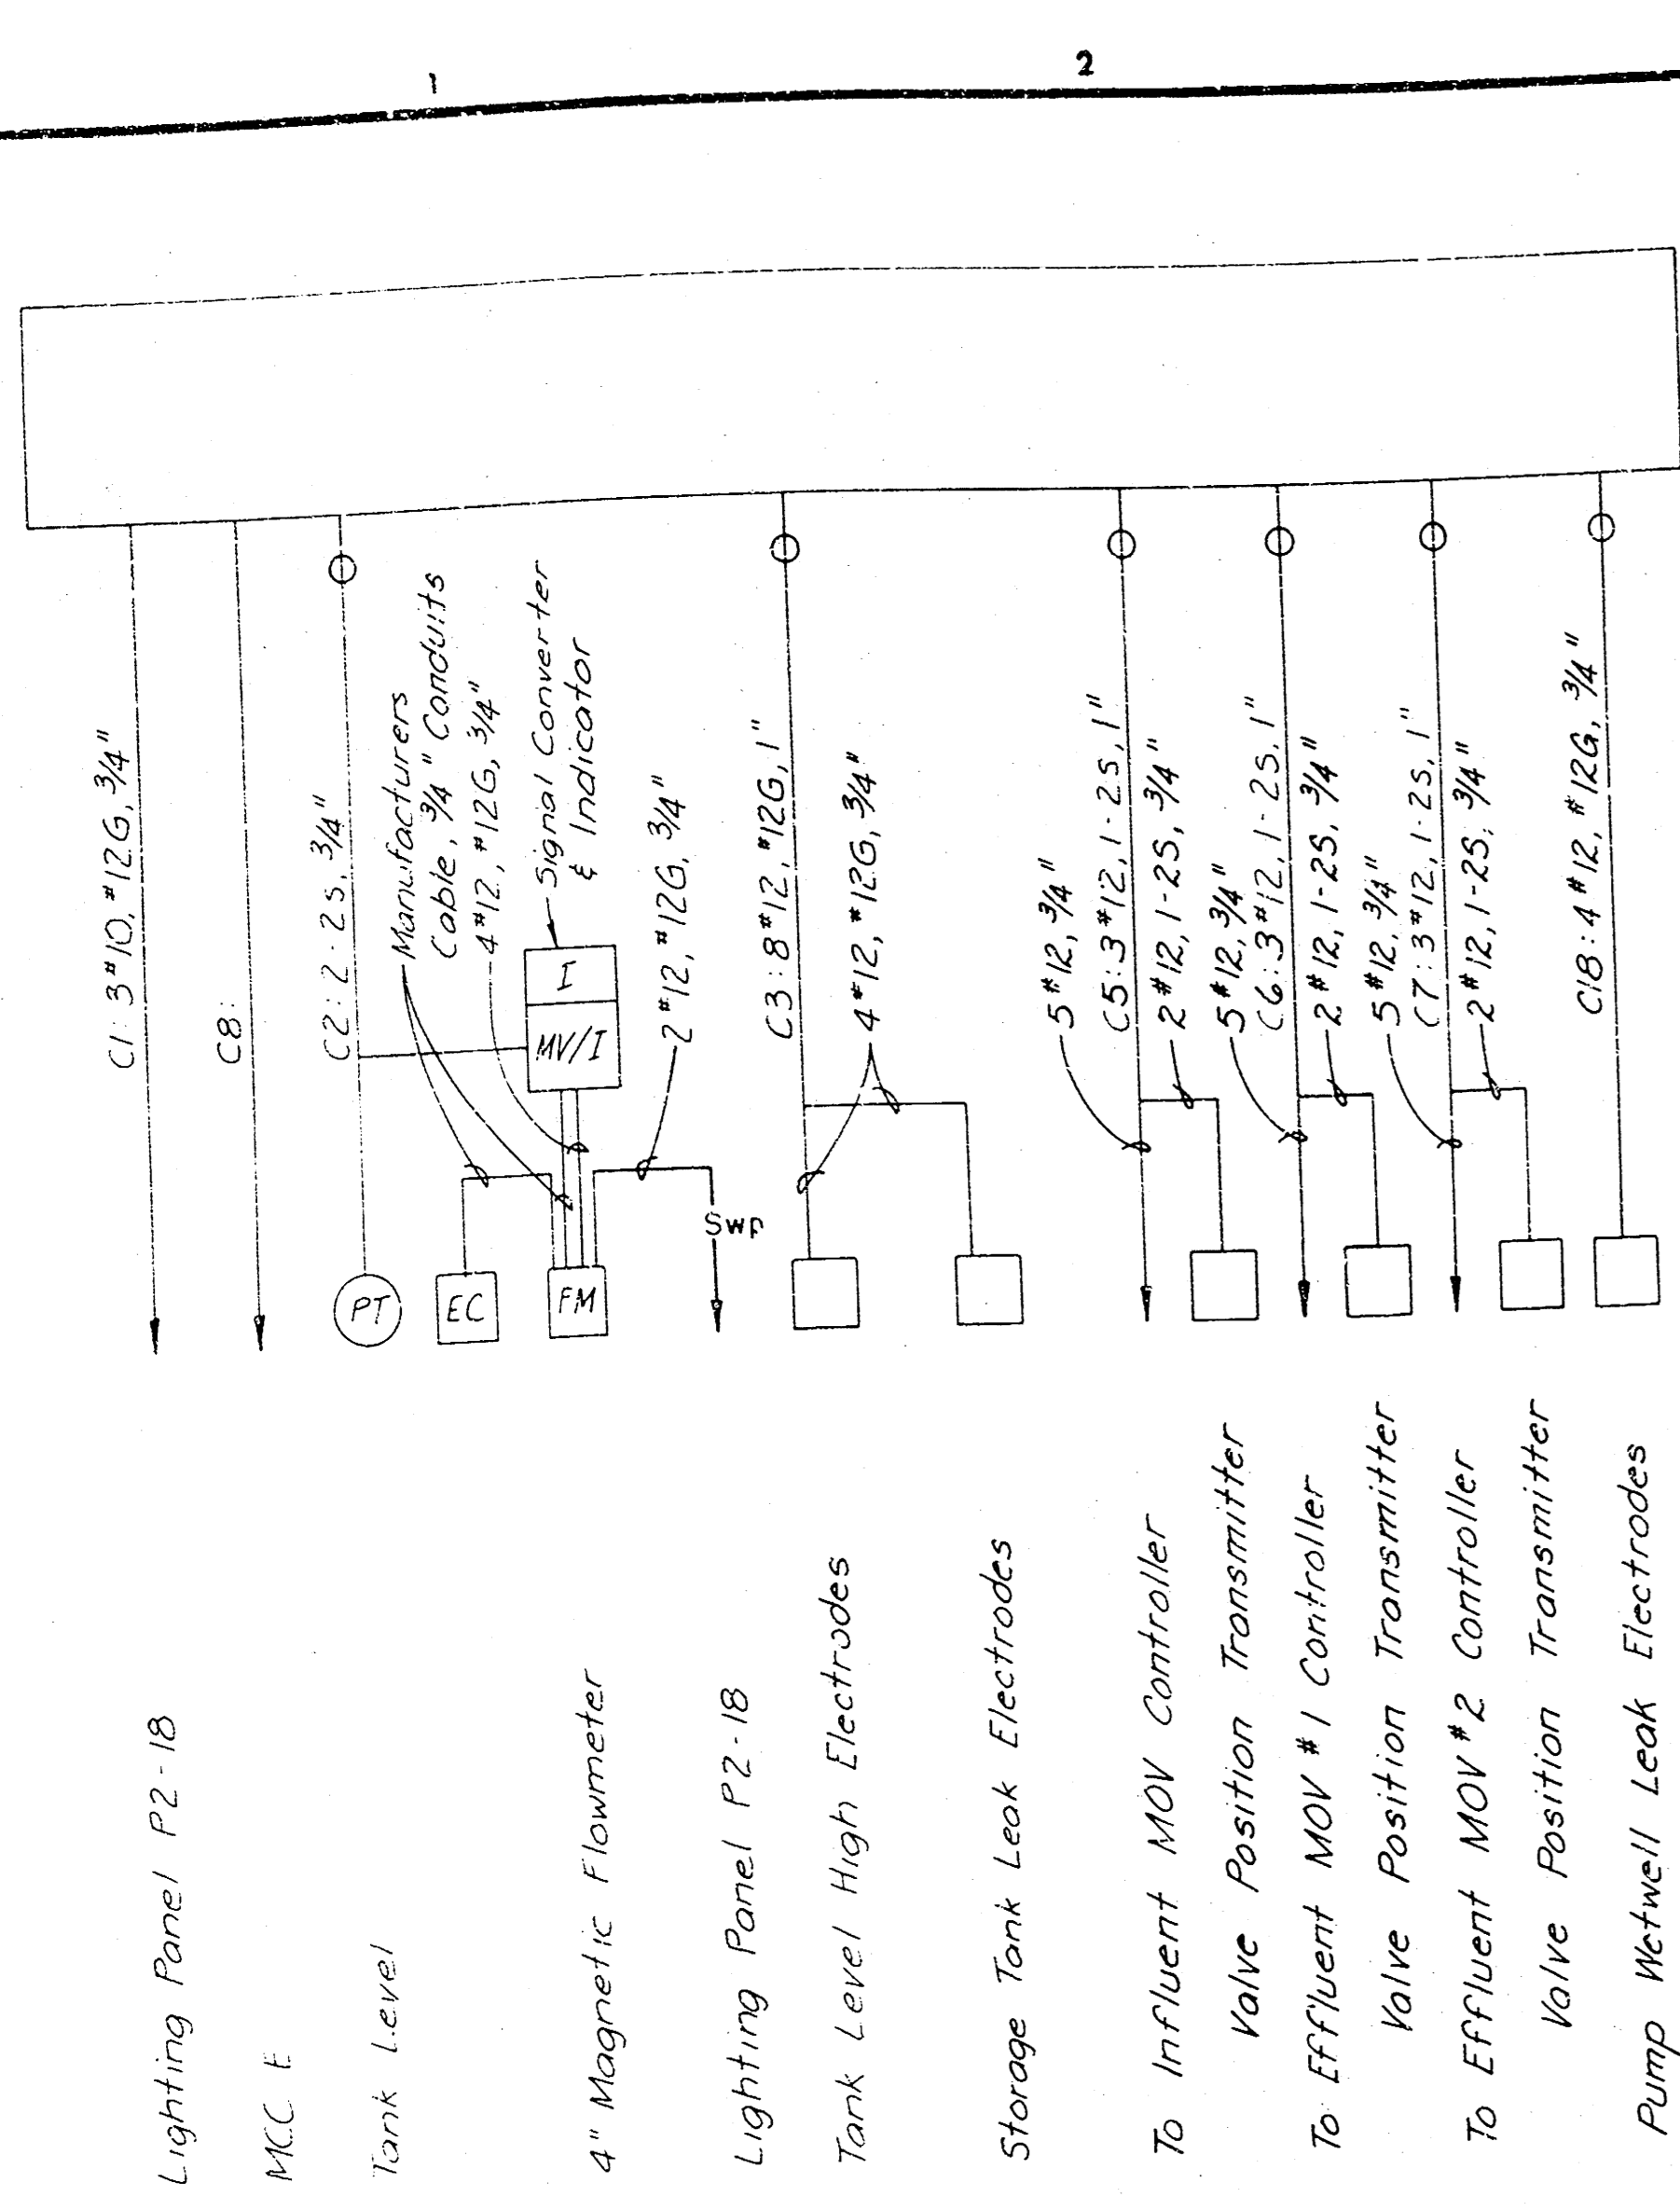


CONTROL PANEL ONE-LINE DIAGRAM

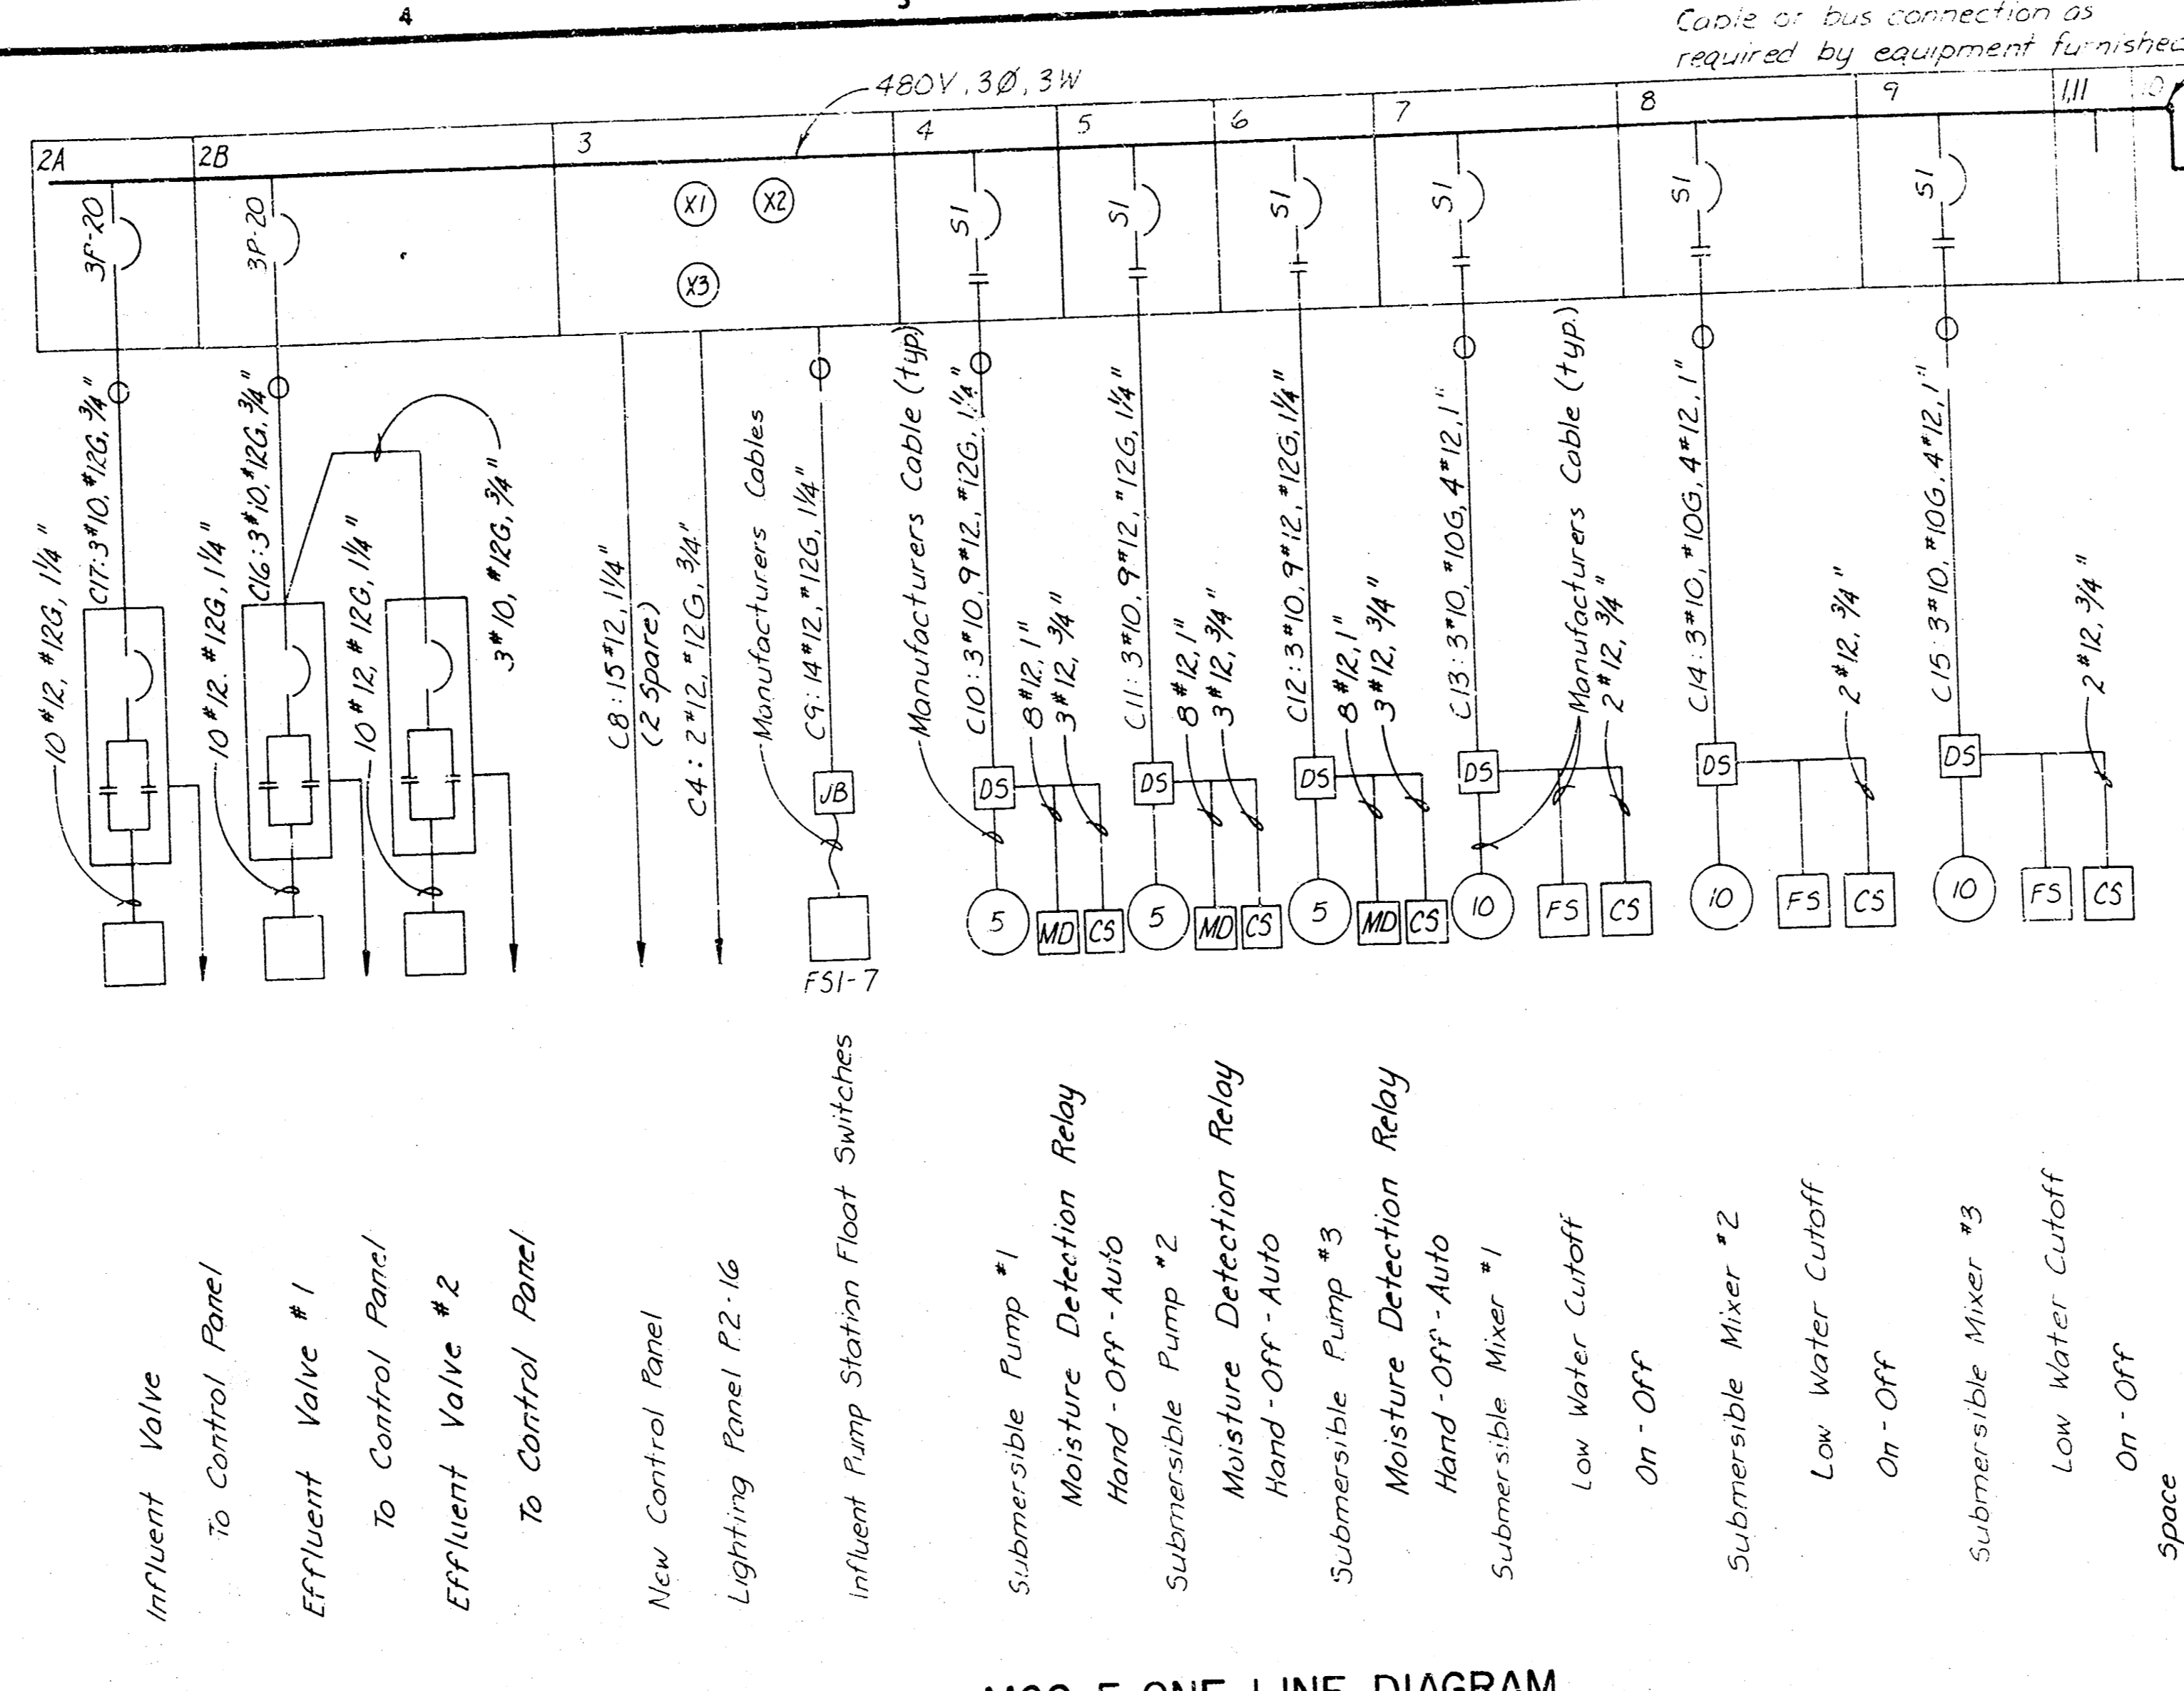


MCC E ONE-LINE DIAGRAM

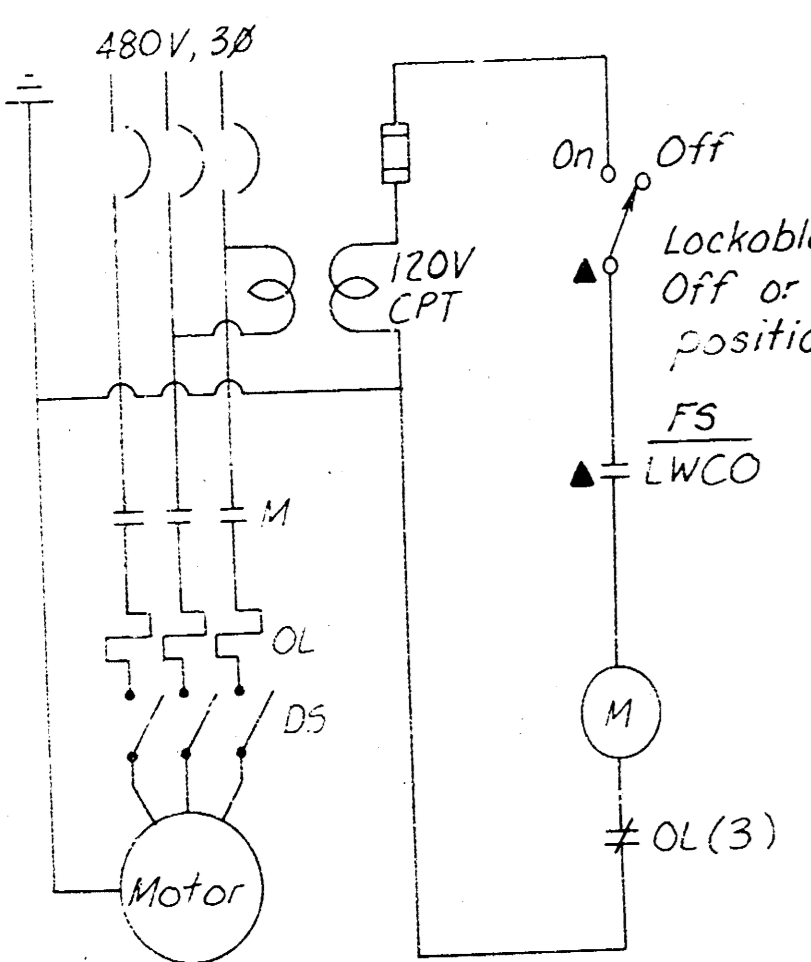

SUBMERSIBLE MIXERS (3)

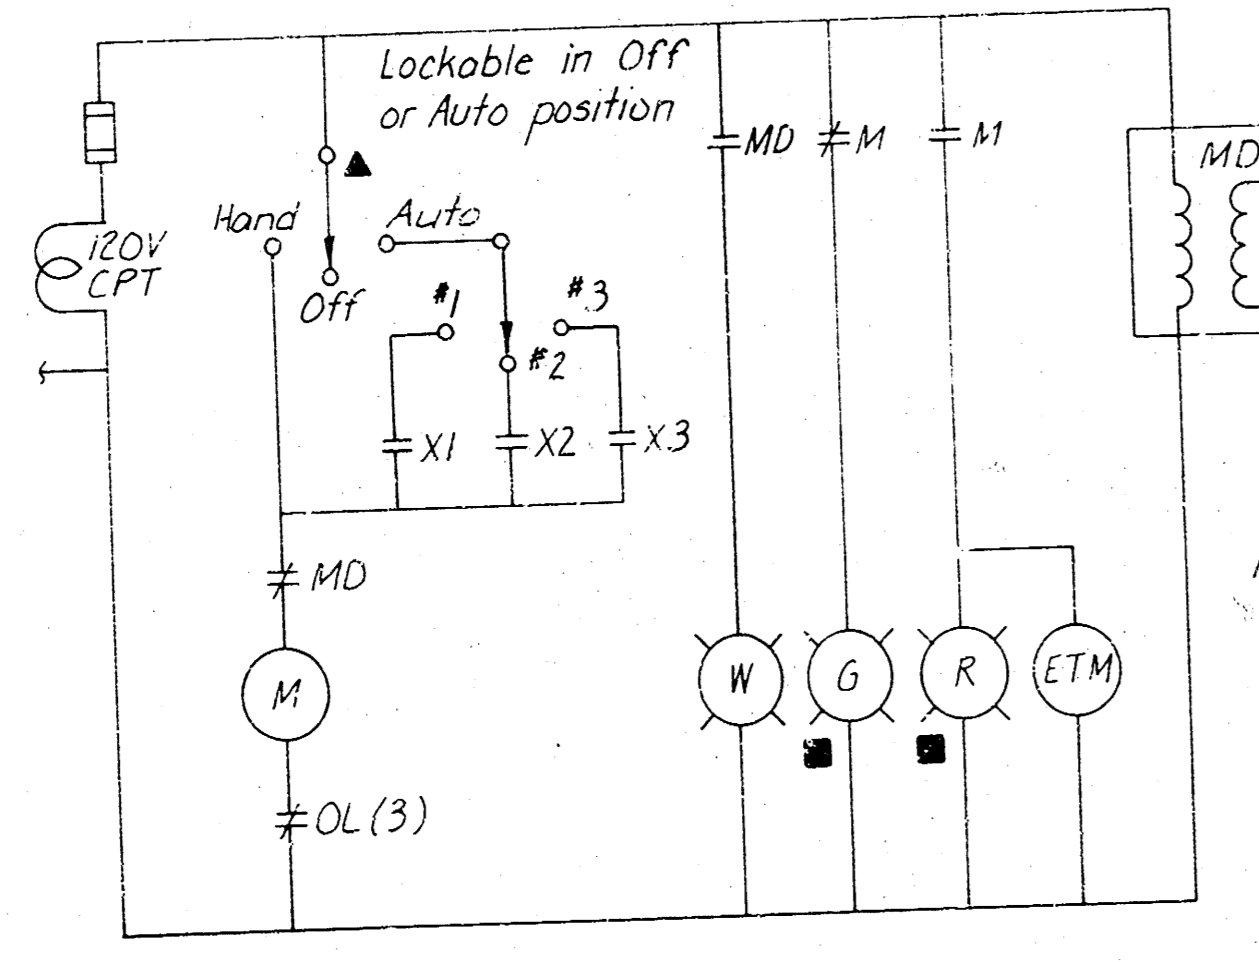


SUBMERSIBLE PUMPS (3)

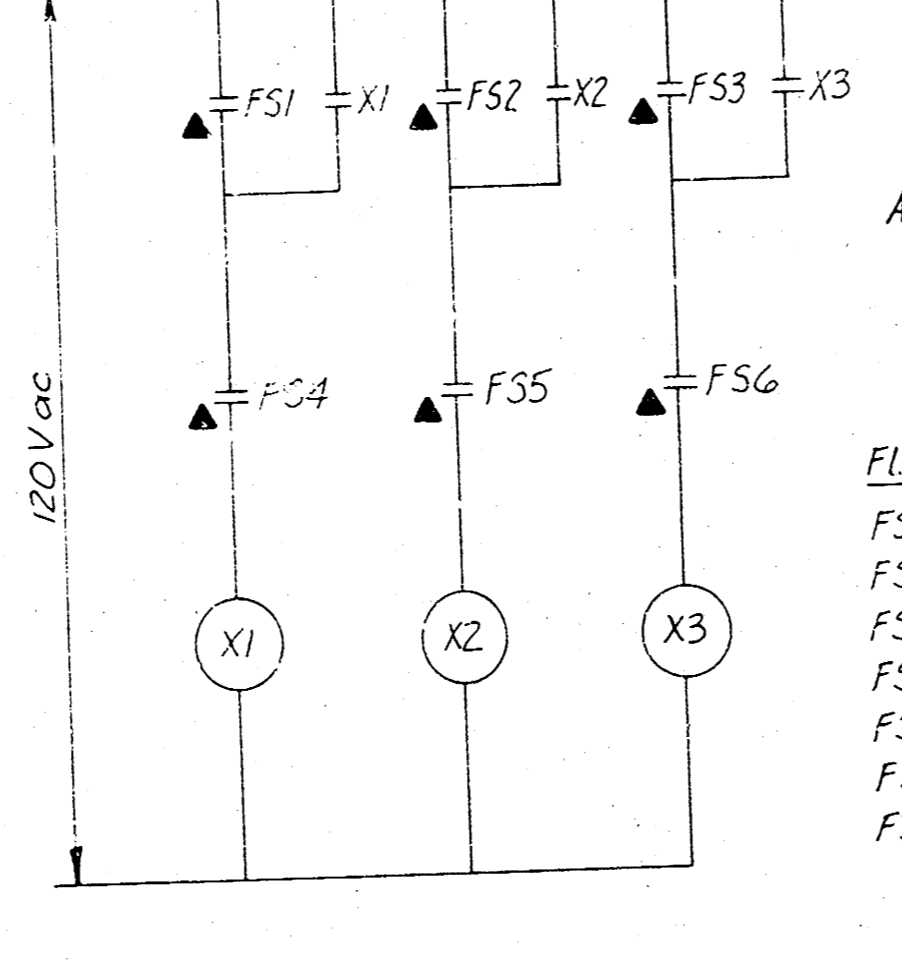


SUBMERSIBLE PUMP LEVEL CONTROLS

- FLOAT SW ELEVATIONS
- FS1 1320.5 Start Pump #1
 - FS2 1321.0 Start Pump #2
 - FS3 1321.5 Start Pump #3
 - FS4 1315.0 Stop Pump #1
 - FS5 1315.5 Stop Pump #2
 - FS6 1316.0 Stop Pump #3
 - FS7 1322.0 High Level Alarm

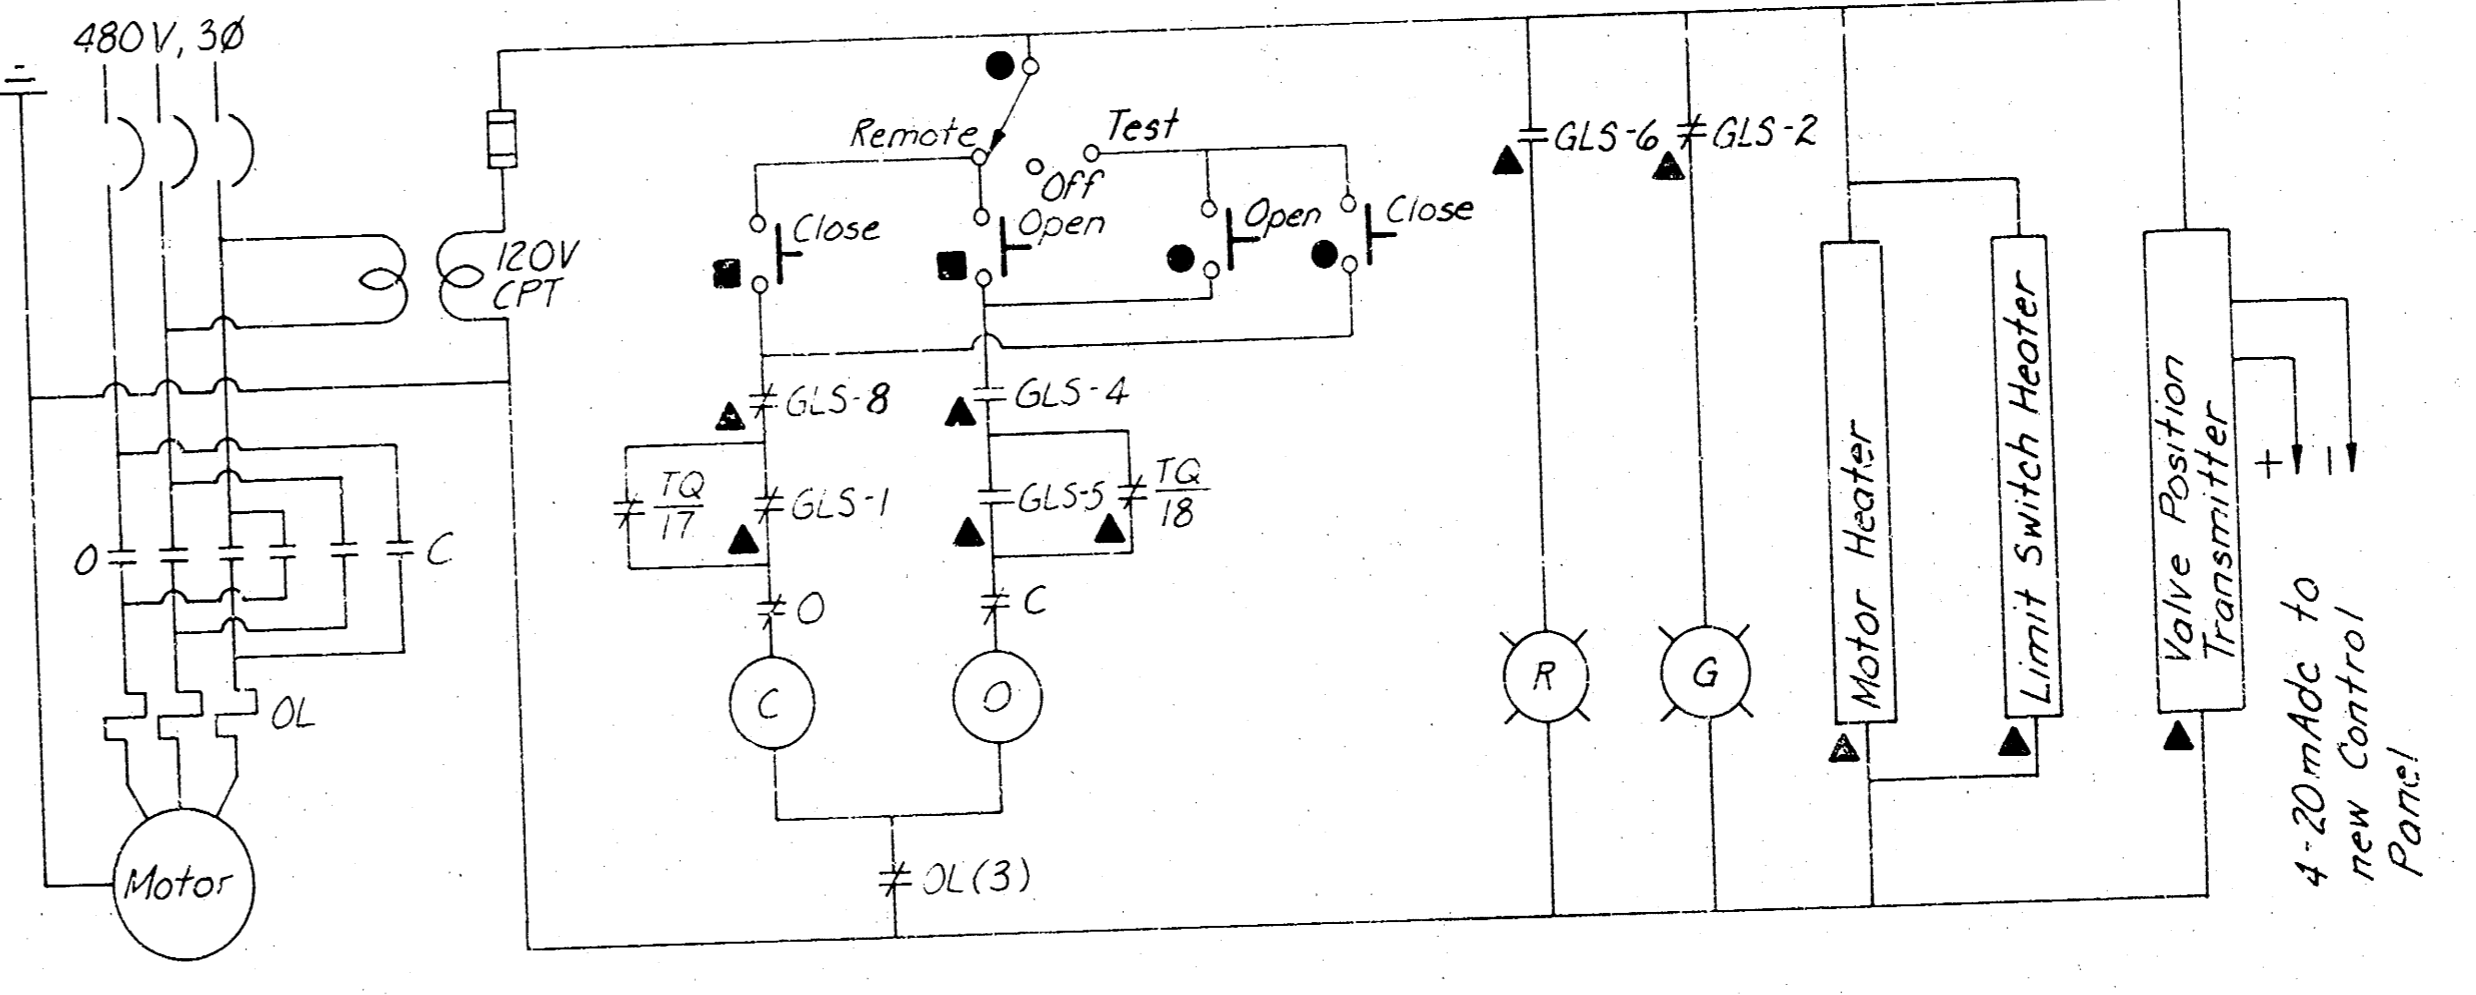

MOTOR OPERATED VALVES (3)

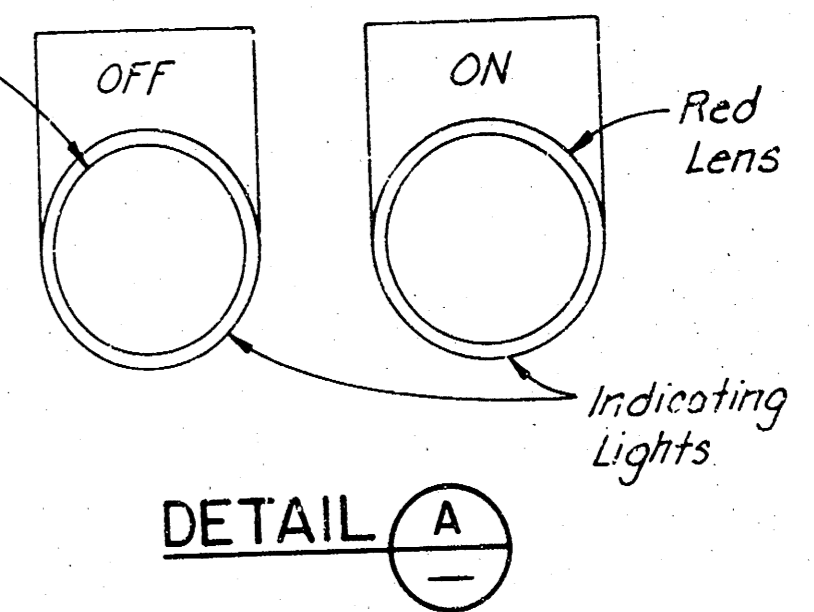


DETAIL A


1	10	
2A	2B	7
3	8	
4	4	
5	11	
6		

MCC E FRONT VIEW

MOTOR CONTROL CENTER NO. MCC E
 MCC LOCATION INDUSTRIAL WASTEWATER PLANT
 ENCLOSURE:
 NEMA TYPE 1 WITH GASKETED DOORS
 ARRANGEMENT:
 SINGLE FACE, FRONT ONLY, MOUNTING UNITS STRAIGHT
 NOT ACCESSIBLE FROM REAR
 REAR REMOVABLE PLATES
 MAIN BUS AT TOP
 INCOMING FEEDER ENTERS TOP
 OUTGOING FEEDERS ENTER TOP
 CONTROL WIRING ENTERS TOP
 GROUND BUS
 CHARACTERISTICS:
 MAIN BUS RATING 600 AMP
 BUS BRACING AT 22,000 AMPERE SYMMETRICAL
 WIRING NEMA CLASS 2, TYPE B

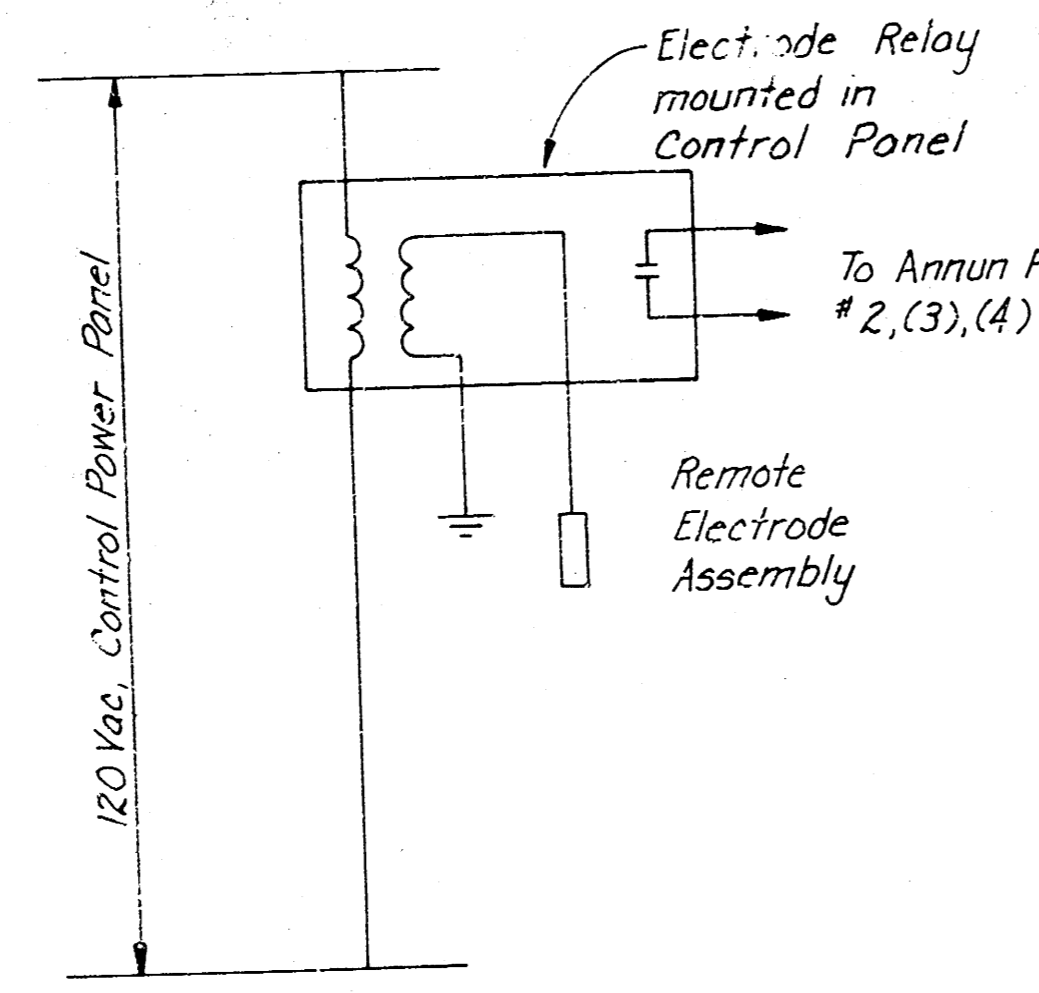

ELECTRODE RELAY (Typ of 3)

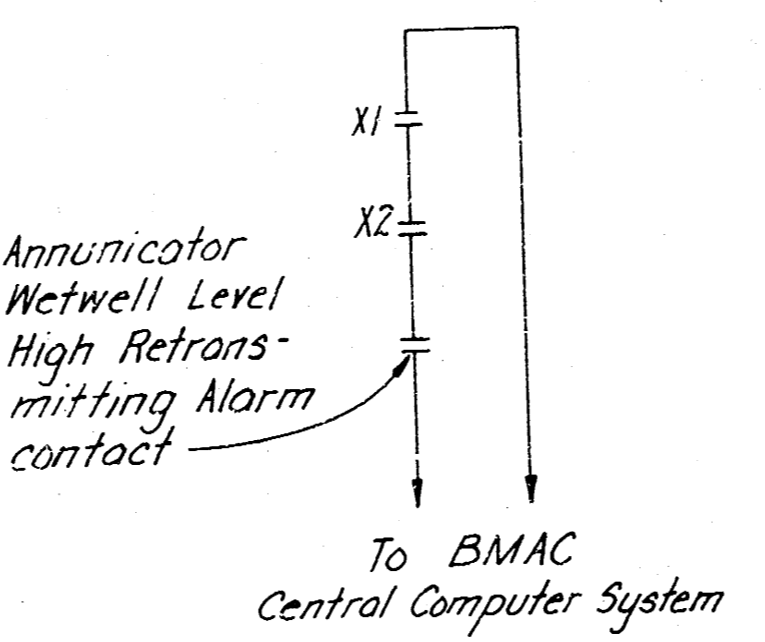


PUMP FAILURE ALARM

PUMP NO	GLS CONTACT	VALVE POSITION		
		FULL OPEN 0%	INTERMEDIATE POSITION 95%	FULL CLOSED 100%
1				
2				
3				
4				
5				
6				
7				
8				

T1, T2 OPENS ON HIGH CLOSING TORQUE
 T1, T2 OPENS ON HIGH OPENING TORQUE
 --- CONTACT CLOSED

MOTOR OPERATED VALVE SWITCH DEVELOPMENT

- DEVICE LEGEND
- ▲ REMOTE MOUNTED FROM STARTER AT EQUIPMENT
 - LOCATED ON NEW CONTROL PANEL
 - LOCATED AT MOTOR OPERATED VALVE CONTROLLER

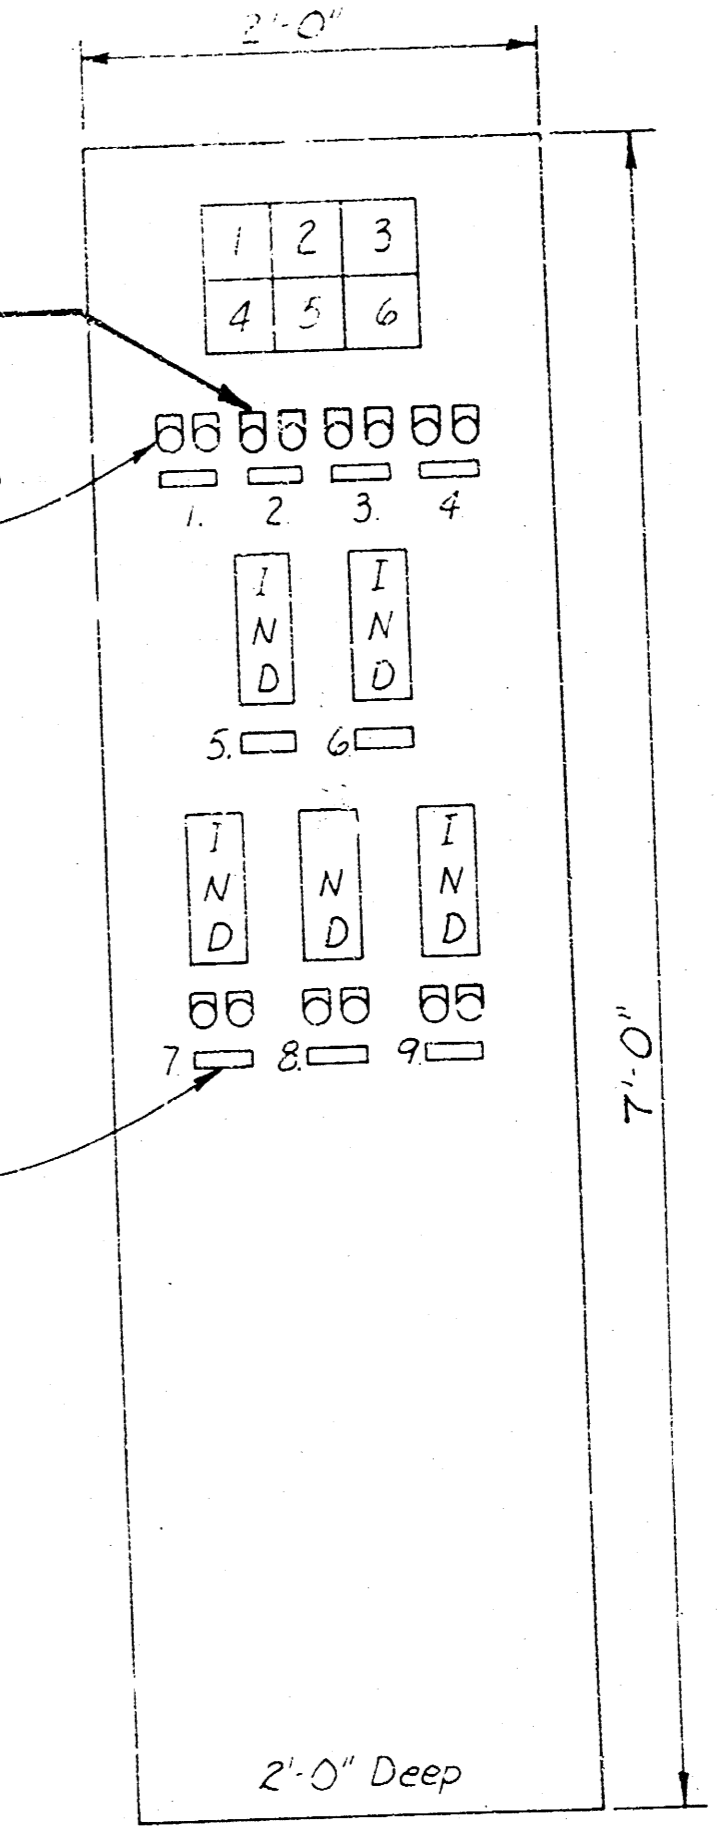

NEW CONTROL PANEL

- NAMEPLATE LEGEND
- ANNUNCIATOR
 - SUBMERSIBLE PUMP 1
 - SUBMERSIBLE PUMP 2
 - SUBMERSIBLE PUMP 3
 - TANK LEVEL
 - TANK EFFLUENT FLOW
 - INFLUENT VALVE
 - EFFLUENT VALVE 1
 - EFFLUENT VALVE 2

- ANNUNCIATOR LEGEND
- TANK LEVEL HIGH
 - WETWELL LEVEL HIGH
 - STORAGE TANK LEAK
 - PUMP WETWELL LEAK
 - SPARE
 - SPARE

Annunciator Alarm Points and Tank Effluent Flow signal shall be capable of retransmitting to BMAC central computer system. Wiring for these points by others.

NO.	DATE	REVISIONS AND RECORD OF ISSUE	NO.	BY	CK	APP


DESIGNED JDC
 DETAILED JKE
 CHECKED JAW
 APPROVED D.E. Clark
 DATE 12-27-87



PROJECT NO.
11903.001

BOEING MILITARY AIRPLANE CO.
INDUSTRIAL WASTEWATER PLANT IMPROVEMENTS

ELECTRICAL
SCHEMATICS AND ONE-LINES

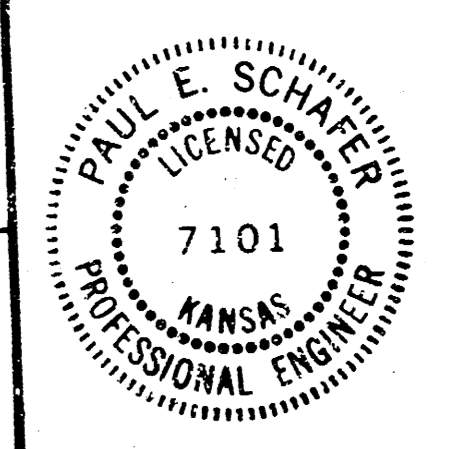

SHEET
9 OF 9
10/10

FILMED FROM THE BEST AVAILABLE COPY